
GENERAL NOTES:

- 4ft cases consist of 2 (24") doors.
- 6ft cases consists of 3 (24") doors.
- 8ft cases Bi-swing consist of 4 (24") doors.
- 12ft cases Bi-swing consist of 6 (24") doors.
- · Door frames are heated. Doors are not heated.
- · Lighting controls occupancy sensors are required.
- OPTION 1: OEM Provided: Lighting controls (on/off) are standard unless otherwise specified.
- OPTION 2: END User Provided: Lighting controls should be based on occupancy sensors.



SHIPPING W	/EIGHT
Case	Weight
ONRM	



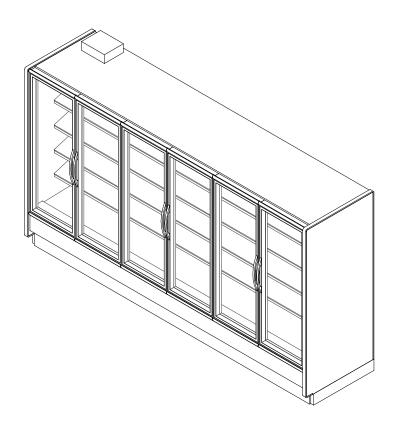



■ COMPONENT

ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

ONRM

Rev. Date	Rev.#	Rev. Title
12-10-19	5	DATA UPDATE
6-5-19	4	NOTES UPDATE



ELECTRICAL DATA				
		High Effic	iency Fans	
Case	Fans Per	120	Volt	
Length	Case	Amps	Watts	
4'	2	0.43	52	
6'	2	0.43	52	
8'	3	0.66	79	
12'	4	0.88	106	

LIGHTING DATA					
		Clear	voyant v4 (Per Ligh	LED Ligh nt Row)	ting
		Standard Power (Cornice or Shelf)			Power ce Only)
Case	Lights	120 Volts		120 Volts	
Length	per row	Amps	Watts	Amps	Watts
4'	1	0.05	5.9	0.12	14.9
6'	2	0.08	9.4	0.20	23.8
8'	2	0.10	11.8	0.25	29.9
12'	3	0.15	17.6	0.37	44.8

ANTI CONDENSATE DATA					
			Ant	hony	
		19	90	Vista-	C/I60
	Door	120	Volts	120 \	Volts
Case Length	Size	Amps	Watts	Amps	Watts
4'	24"	0.24	28.2	0.44	52.2
6'	24"	0.41	49.2	0.58	69.6
8'	24"	0.47	56.4	0.68	81.6
12'	24"	0.71	84.6	0.93	111.6

GUIDELINES AND CONTROL SETTINGS								
			BTUH/	door	Superheat Set			
	Case	Door			Point @ Bulb	Evaporator	Discharge	Discharge Air
Application	Length	Size	Conventional	Parallel	(°F)	(°F)	Air (°F)	Velocity (FPM)
Meat/Seafood	4', 6', 8', 12'	24"	510	480	6 - 8	28	32	380

DEFROST CONTROLS				
	Timed-Off Defrost			
Defrosts Per	Fail-Safe	Termination		
Day	(Min)	Temp (°F)		
2	30	42		

NOTES:

- \bullet "---" indicates that the feature is not an option with this case model.
- Listed discharge air velocity represents the average velocity at the peak of defrost.
- Temperature and defrost settings listed above are recommended start-up settings. Final operational settings may need to be adjusted for the store conditions in which the case operates.
- The recommended evaporator temperatures may need to be adjusted based on system setup, store conditions, etc. The minimum recommended evaporator temperature is 4°F below the listed evaporator temperature.
- Light wattages above reflect 100% run time. To acquire DOE representation, reduce the light wattage by 42% at 75°F/55%RH.








ONRM

Rev. Date	Rev.#	Rev. Title
12-10-19	5	DATA UPDATE
6-5-19	4	NOTES UPDATE



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

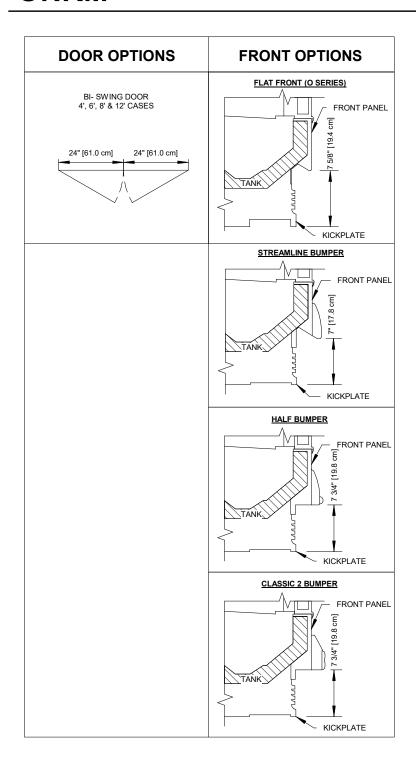








COMPONENT
ALL MEASUREMENTS ARE TAKEN PER
ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX
REFRIGERATED DISPLAY CASES FOR SALE IN THE
UNITED STATES MEET OR EXCEED DEPARTMENT
OF ENERGY 2017 REQUIREMENTS.

ONRM

Rev. Date	Rev.#	Rev. Title
12-10-19	5	DATA UPDATE
6-5-19	4	NOTES UPDATE



A DOVER COMPANY

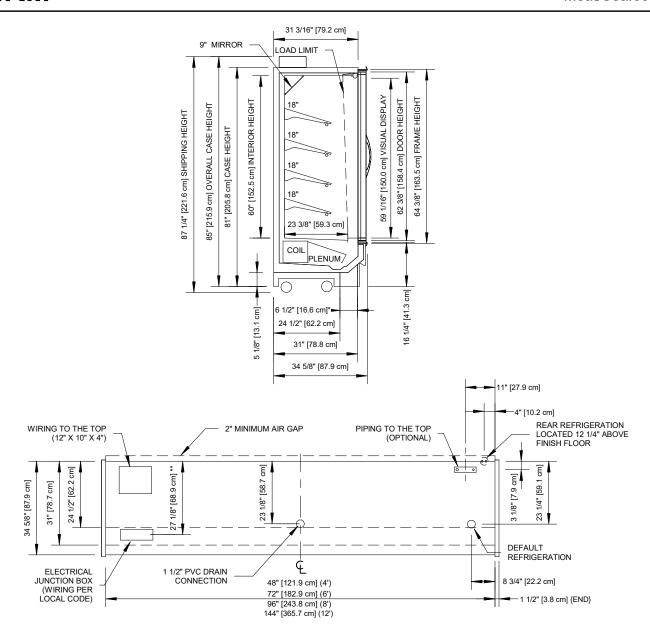

NOTES:

- *: STUB-UP AREA.
- **: RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS.
- Ends add approximately 1" to the case height, 1/2" to the back & 1" to the front.
- · Back panels add approximately 1" to the rear of the case.
- · Top canopy LED lights.
- Unvented kickplate adds 1/4".



ONRM

Rev. Date	Rev.#	Rev. Title
12-10-19	5	DATA UPDATE
6-5-19	4	NOTES UPDATE



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.