Hill PHOENIX
EXCELLENCE™

Display Case Engineering Reference Manual

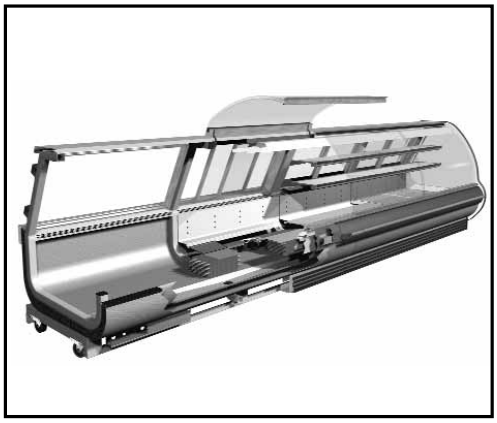

1999

A DOVER DIVERSIFIED COMPANY

2/99

Hill PHOENIX
EXCELLENCE™

Statement of Purpose

We will lead the markets we serve with innovative products, solutions and technological advances in a relentless pursuit to exceed customer expectations.

We will create a culture that promotes teamwork, integrity and respect for our customers, our suppliers and ourselves.

We are intolerant of mediocrity and dedicated to continuous improvement as a way of life.

As a result, ***Hill PHOENIX*** will enhance the success of our customers, the return to our shareholders, and the satisfaction of our employees.

Table of Contents

Merchandisers by Design Application

Single Deck Merchandisers 1

Single Deck Cheese Merchandisers (OC) 2
Single Deck Meat Merchandisers (OM) 4
Single Deck Frozen Meat Merchandisers (OMZ) 6
Single Deck Frozen Food/Ice Cream Merchandisers (OMZD) 8
Single Deck Produce Merchandisers (OP) 10
International Style Self-Service Deli/Seafood Merchandisers (OSIO) 12
Wide International Style Self-Service Deli/Seafood Merchandisers (OWSIO) 16

Multi-Deck Merchandisers 19

Multi-Deck Dairy/Deli/Meat Merchandisers (O2UM) 20
Multi-Deck Dairy/Deli/Meat Merchandisers (O2.5UM) 24
Multi-Deck Dairy/Deli/Meat Merchandisers (O3UM) 28
Multi-Deck Dairy/Deli/Meat Merchandisers (O3.5UM) 32
Multi-Deck Dairy/Deli/Meat Merchandisers (O4UM) 36
Multi-Deck Dairy/Deli/Meat Merchandisers (O5UM) 38
Multi-Deck Rear Load Dairy Merchandisers (O5DR) 40
Multi-Deck Dairy/Deli/Produce Merchandisers (O5DM) 44
Narrow Multi-Deck Dairy Merchandisers (ON5DM) 50
Multi-Deck Frozen Food Merchandisers (O5Z) 52
Multi-Deck Meat Merchandisers (OHM) 54
Narrow Multi-Deck Meat Merchandisers (ONHM) 56
High Multi-Deck Meat Merchandisers (OHMH) 58
Multi-Deck Produce Merchandisers (OHP) 60
High Multi-Deck Produce Merchandisers (OHPH) 62

Reach-In Door Merchandisers 65

Glass Door Reach-In Beverage Merchandisers (ORB) 66
Narrow Glass Door Reach-In Beverage Merchandisers (ONRB) 68
Glass Door Reach-In Frozen Food/Ice Cream Merchandisers (ORZ) 70
Narrow Glass Door Reach-In Frozen Food/Ice Cream Merchandisers (ONRZ) 72
High Glass Door Reach-In Frozen Food/Ice Cream Merchandisers (ORZH) 74

Single Deck Island Merchandisers 77

Wide Island Meat/Deli Merchandisers (OIM) 78
Narrow Island Meat/Deli Merchandisers (ONIM) 82
Wide Island Produce Merchandisers (OIP) 86
Wide Island Frozen Food/Ice Cream Merchandisers (OWIZ / OWIZ(G)) 90
Wide Island Frozen Food/Ice Cream Merchandisers (OWEZ / OWEZ(G)) 92
Island Frozen Food Merchandisers (OIZ) 94
Narrow Island Frozen Food/Ice Cream Merchandisers (ONIZ / ONIZ(G)) 96

Table of Contents

Merchandisers by Design Application (Continued)

Multi-Deck Island Merchandisers 99

Wide Island Multi-Deck Cheese Merchandisers (O3IC) 100

Wide Island Multi-Deck Produce Merchandisers (O3IP) 106

Service Merchandisers 109

American Style Deli Merchandisers (OSA) 110

American Style Flat Glass Deli Merchandisers (OSM) 114

American Style Meat/Deli/Seafood Gravity Coil Merchandisers (OSAG) 118

American Style Flat Glass Meat/Deli/Seafood Gravity Coil Merchandisers (OGM) 122

International Style Meat/Deli/Seafood Merchandisers (OSI) 126

Wide International Style Meat/Deli/Seafood Merchandisers (OWSI) 130

International Style Hot Foods Merchandiser (OSIH) 132

Self-Contained Merchandisers 135

International Style Self-Service Deli/Seafood Self-Contained Mobile Merchandisers (OSIOA-4') 136

International Style Self-Service Frozen Food Self-Contained Mobile Merchandisers (OSIOZA-4') 138

Multi-Deck Dairy/Deli/Meat Self-Contained Mobile Merchandisers (O2.5UMA-4') 140

Multi-Deck Dairy/Deli/Meat Self-Contained Mobile Merchandisers (O3UMA-4') 142

Multi-Deck Self-Contained Dairy/Deli/Produce Merchandisers (O5DMA) 144

Narrow Multi-Deck Self-Contained Dairy/Deli/Meat Merchandisers (ONUA) 148

Wide Island Self-Contained Meat/Deli Merchandisers (OIMA) 152

Wide Island Self-Contained Meat/Deli Merchandisers (OIM(B)A) 154

Narrow Island Self-Contained Meat/Deli Merchandisers (ONIMA) 156

Narrow Island Self-Contained Meat/Deli Merchandisers (ONIM(B)A) 158

Wide Island Self-Contained Produce Merchandisers (OIPA) 160

Wide Island Self-Contained Multi-Deck Cheese Merchandisers (O3ICA) 162

Wide Island Self-Contained Multi-Deck Cheese Merchandisers (O3IC(B)A) 164

International Style Deli/Seafood Self-Contained Mobile Merchandisers (OSIA-4') 166

Index 168

Table of Contents

Merchandisers by Departmental Application

Produce

Single Deck Merchandisers 1
OP 10-11

Multi-Deck Merchandisers 19
O5DM 44-49
OHP 60-61
OHPH 62-63

Single Deck Island Merchandisers 77
OIP / OIP(B) / OIP(BB) 86-89

Multi-Deck Island Merchandisers 99
O3IP / O3IP(B) 106-108

Self-Contained Merchandisers. 133
O5DMA 144-147
OIPA 160-161

Beverage

Multi-Deck Merchandisers 19
O5DM 44-49
ON5DM 50-51

Reach-In Door Merchandisers 65
ORB 66-67
ONRB 68-69

Self-Contained Merchandisers. 133
O5DMA 144-147

Dairy

Multi-Deck Merchandisers 19
O2UM 20-23
O2.5UM 24-27
O3UM 28-31
O3.5UM 32-35
O4UM 36-37
O5UM 38-39
O5DR 40-42
O5DM 44-49
ON5DM 50-51

Self-Contained Merchandisers. 135
O2.5UMA-4' 140-141
O3UMA-4' 142-143
O5DMA 144-147
ONUA 148-150

Deli

Single Deck Merchandisers 1
OC 2-3
OM 4-5
OSIO 12-14
OWSIO 16-17

Multi-Deck Merchandisers 19
O2UM 20-23
O2.5UM 24-27
O3UM 28-31

Deli (Continued)

O3.5UM 32-35
O4UM 36-37
O5UM 38-39
O5DM 44-49
OHM 54-55
ONHM 56-57
OHMH 58-59

Single Deck Island Merchandisers 77
OIM / OIM(B) / OIM(BB) 78-81
ONIM / ONIM(B) 82-84

Multi-Deck Island Merchandisers 99
O3IC / O3IC(B) 100-104

Service Merchandisers 109
OSA 110-112
OSM 114-116
OSAG 118-120
OGM 122-124
OSI 126-128
OWSI 130-131
OSIH (Hot Foods) 132-133

Self-Contained Merchandisers. 135
OSIOA-4' 136-137
O2.5UMA-4' 140-141
O3UMA-4' 142-143
O5DMA 144-147
ONUA 148-150
OIMA 152-153
OIM(B)A 154-155
ONIMA 156-157
ONIM(B)A 158-159
O3ICA 162-163
O3IC(B)A 164-165
OSIA-4' 166-167

Meat

Single Deck Merchandisers 1
OM 4-5

Multi-Deck Merchandisers 19
O2UM 20-23
O2.5UM 24-27
O3UM 28-31
O3.5UM 32-35
OHM 54-55
ONHM 56-57
OHMH 58-59

Single Deck Island Merchandisers 77
OIM / OIM(B) / OIM(BB) 78-81
ONIM / ONIM(B) 82-84

Service Merchandisers 109
OSAG 118-120
OGM 122-124
OSI 126-128
OWSI 130-131

Table of Contents

Merchandisers by Departmental Application (Continued)

Meat (Continued)

Self-Contained Merchandisers 135
O2.5UMA-4' 140-141
O3UMA-4' 142-143
ONUA 148-150
OIMA 152-153
OIM(B)A 154-155
ONIMA 156-157
ONIM(B)A 158-159

Seafood

Single Deck Merchandisers 1
OSIO 12-14
OWSIO 16-17

Service Merchandisers 109
OSAG 118-120
OGM 122-124
OSI 126-128
OWSI 130-131

Self-Contained Merchandisers 135
OSIOA-4' 136-137
OSIA-4' 166-167

Frozen Food

Single Deck Merchandisers 1
OMZ (Frozen Meat) 6-7
OMZD 8-9

Multi-Deck Merchandisers 19
O5Z (Frozen Meat) 52-53

Reach-In Door Merchandisers 65
ORZ 70-71
ONRZ 72-73
ORZH 74-75

Single Deck Island Merchandisers 77
OWIZ / OWIZ(G) 90-91
OWEZ / OWEZ(G) 92-93
OIZ 94-95
ONIZ / ONIZ(G) 96-98

Self-Contained Merchandisers 135
OSIOZA-4' 138-139

Ice Cream

Single Deck Merchandisers 1
OMZD 8-9

Reach-In Door Merchandisers 65
ORZ 70-71
ONRZ 72-73
ORZH 74-75

Single Deck Island Merchandisers 77
OWIZ / OWIZ(G) 90-91
OWEZ / OWEZ(G) 92-93
ONIZ / ONIZ(G) 96-98

Ice Cream (Continued)

Self-Contained Merchandisers 135
OSIOZA-4' 138-139

Single Deck Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** *Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

Single Deck Deli/Cheese Merchandisers

OC - 6', 8', & 12' deli/cheese

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OC	6'	2	1.00	50	0.60	40	0.20	24	2.88	600	3.33	798
	8'	2	1.00	50	0.60	40	0.25	30	3.85	800	4.44	1065
	12'	3	1.50	75	0.90	60	0.38	46	5.78	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watts	Amps	Watts
OC	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OC	27"	560	12	22	36	37	305
	31" & 33"	415	17	26	35	35	305

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OC	2	40	49	70	63	26	63	- - - [3]	- - -

[3] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

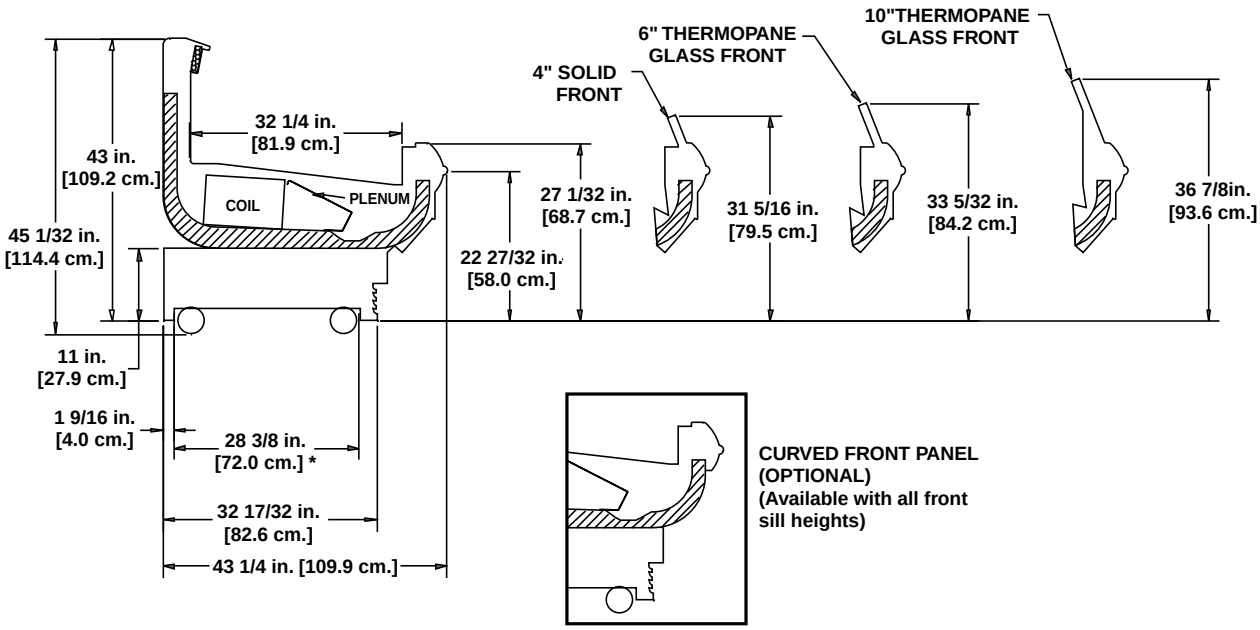

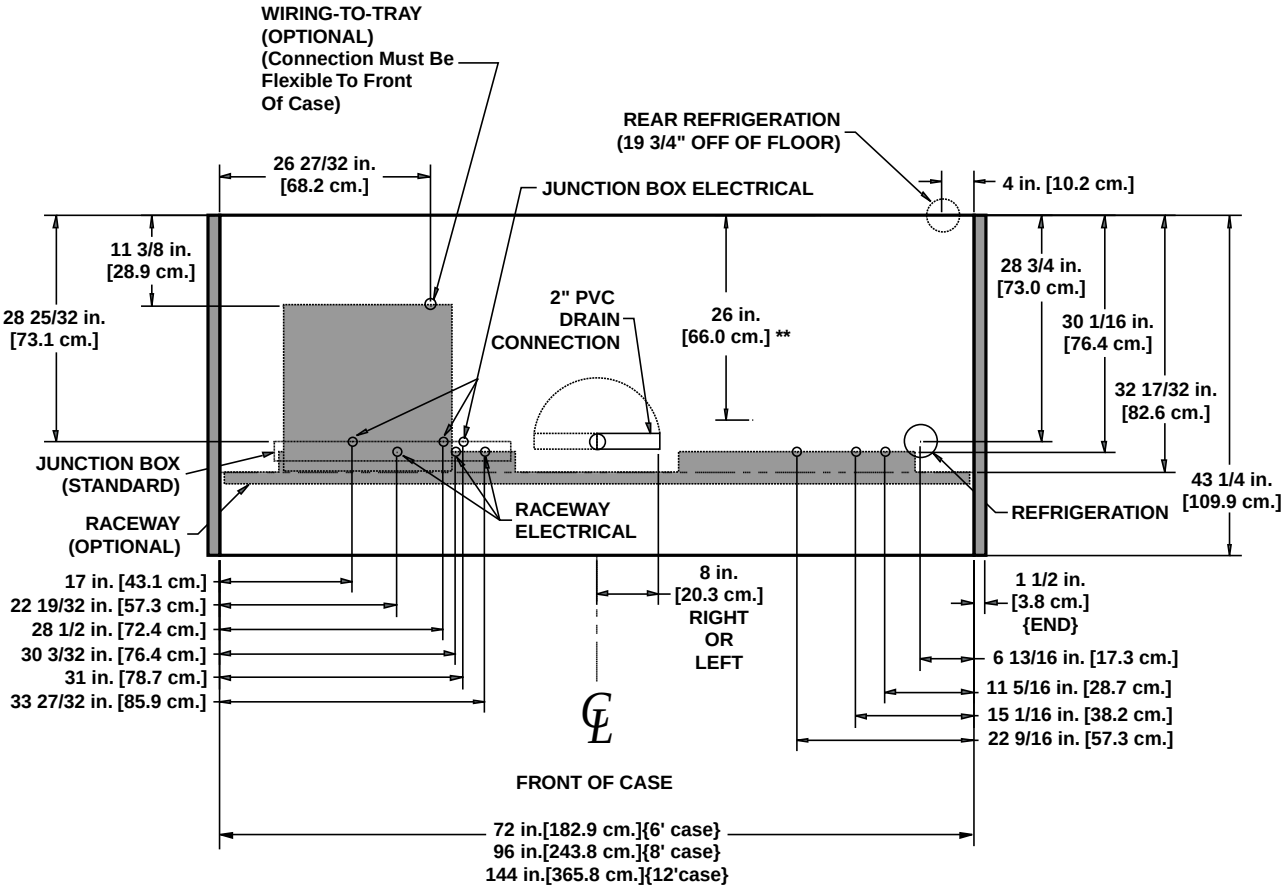

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Single Deck Meat Merchandisers

OM - 6', 8', & 12' meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OM	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	2	1.00	60	0.60	40	0.25	30	3.85	800	4.44	1065
	12'	3	1.50	90	0.90	60	0.38	46	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OM	6'	0.57	68	2.06	247
	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OM Deli	27"	480	17	26	36	39	305
OM Fresh Meat	27"	560	12	22	35	37	305
	31" & 33"	415	17	26	35	35	305

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OM	2	40	49	70	63	26	63	- - -[3]	- - -

[3] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

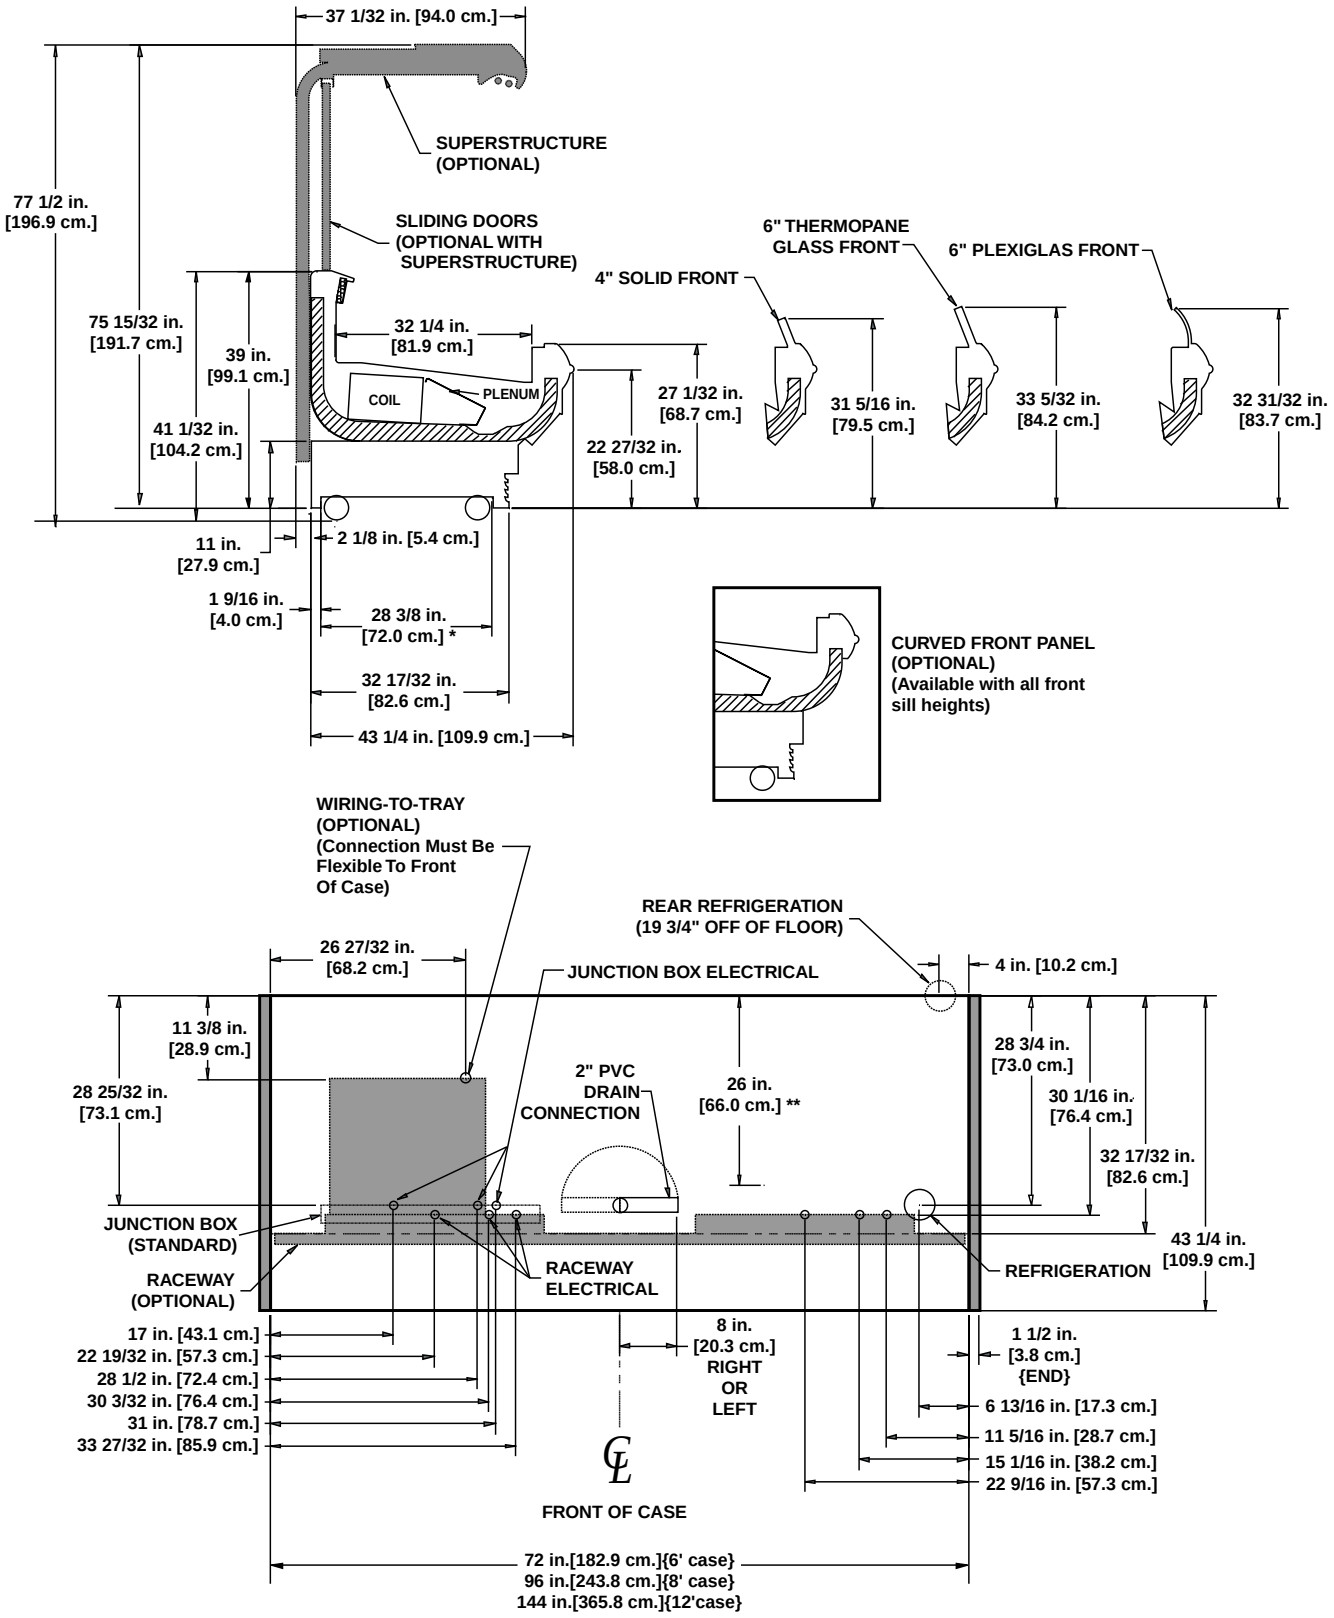

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

Single Deck Frozen Meat Merchandisers

OMZ - 6', 8', & 12' frozen meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps[1]	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps[1]	Defrost Heaters 240 Volts Watts
OMZ	6'	2	1.00	60	0.64	34	0.90	108	5.00	1800	5.76	2394
	8'	3	1.50	90	0.96	51	0.96	115	6.66	2400	7.69	3195
	12'	4	2.00	120	1.28	69	1.83	220	7.99	2880	9.24	3840

1 NOTE: 3 phase load. Figures given in maximum amps per phase.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OMZ	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
OMZ	33"	550	-23	-10	4	0	120

2 BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

3 Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OMZ	4	45	47	- - -[4]	- - -	20	59	- - -	- - -

4 NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

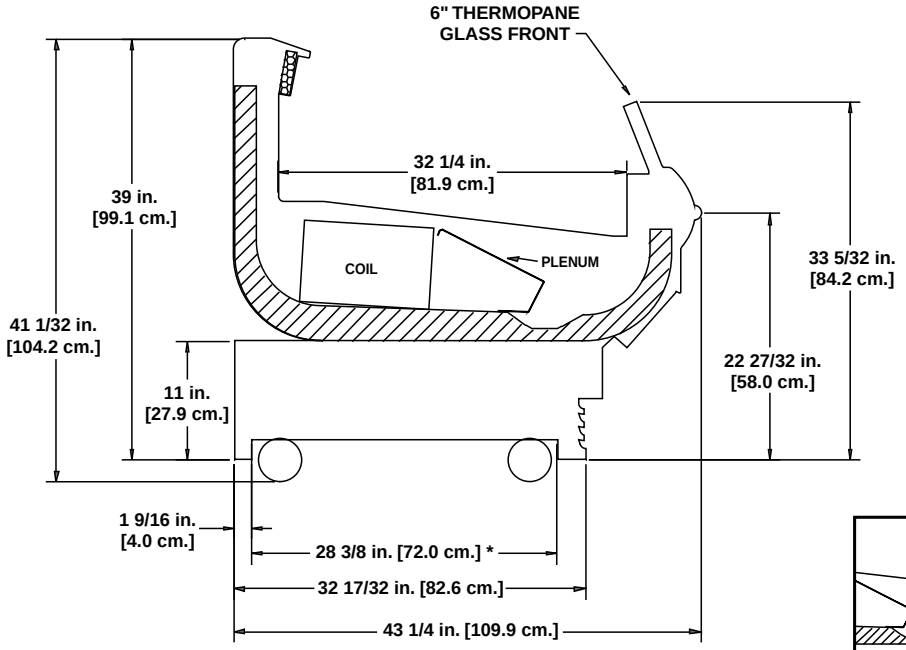



CURVED FRONT PANEL
(OPTIONAL)
(Available with all front
sill heights)

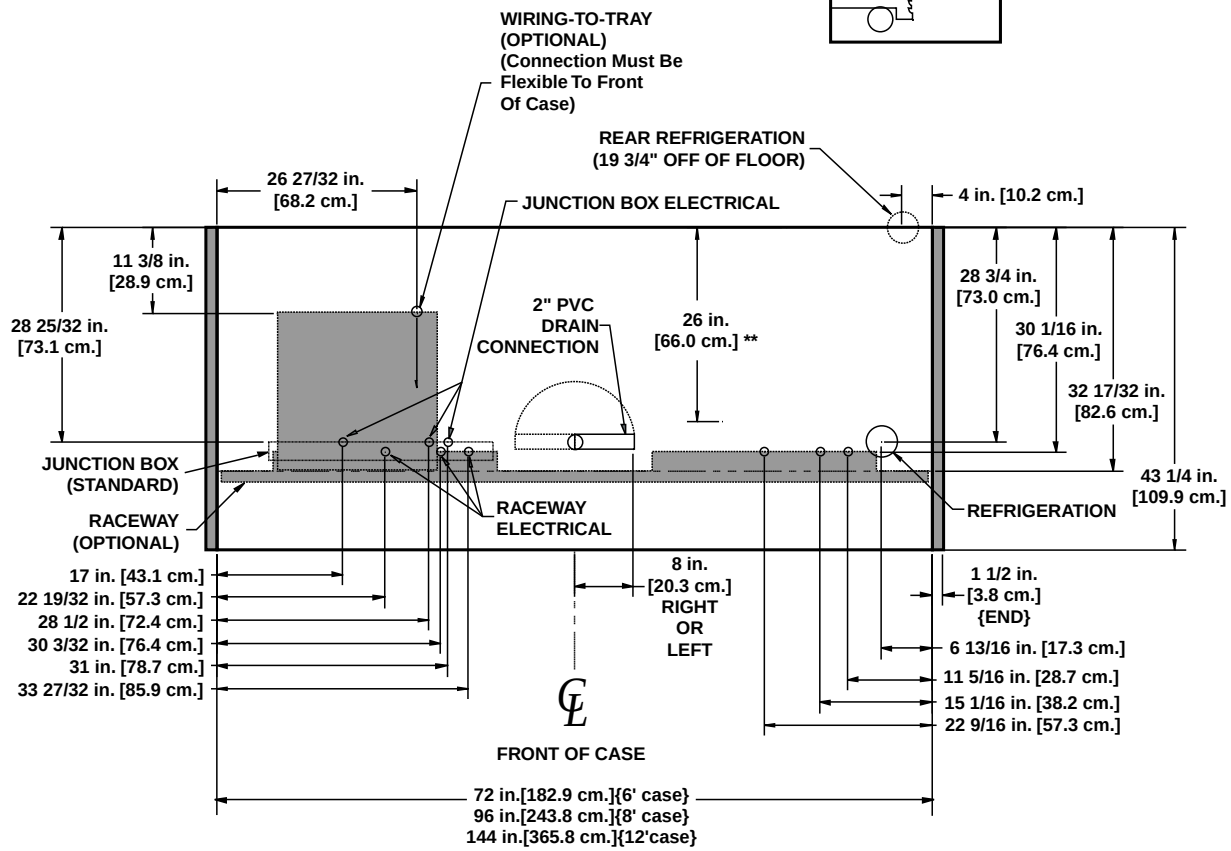

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Single Deck Frozen Food/Ice Cream Merchandisers

OMZD - 6', 8', & 12' frozen food/ice cream

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps[1]	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps[1]	Defrost Heaters 240 Volts Watts
OMZD	6'	2	0.68	34	0.30	22	1.39	167	5.00	1800	5.76	2394
	8'	3	1.02	51	0.45	33	1.90	228	6.66	2400	7.69	3195
	12'	4	1.36	68	0.60	44	2.81	337	7.99	2880	9.24	3840

1 NOTE: 3 phase load. Figures given in maximum amps per phase.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OMZD	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
OMZD-F[2]	456	-18	-8	1	2	240
OMZD-C[2]	476	-28	-18	-8	-8	240

[2] F=frozen food, C=ice cream

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OMZD	1	45	48	- - -[5]	- - -	20	59	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

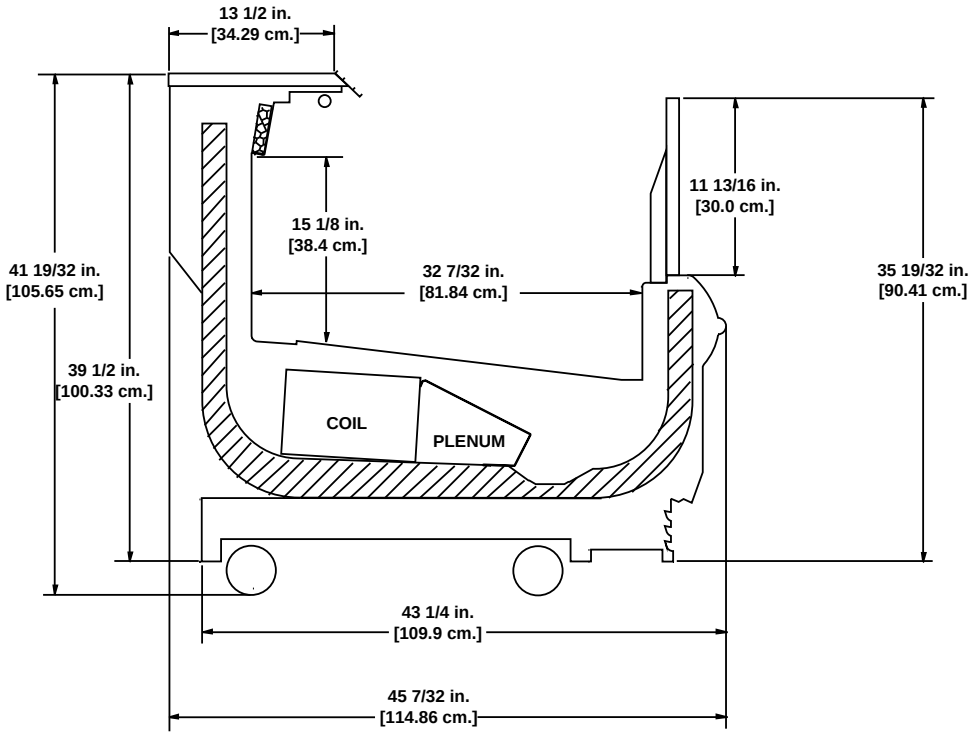

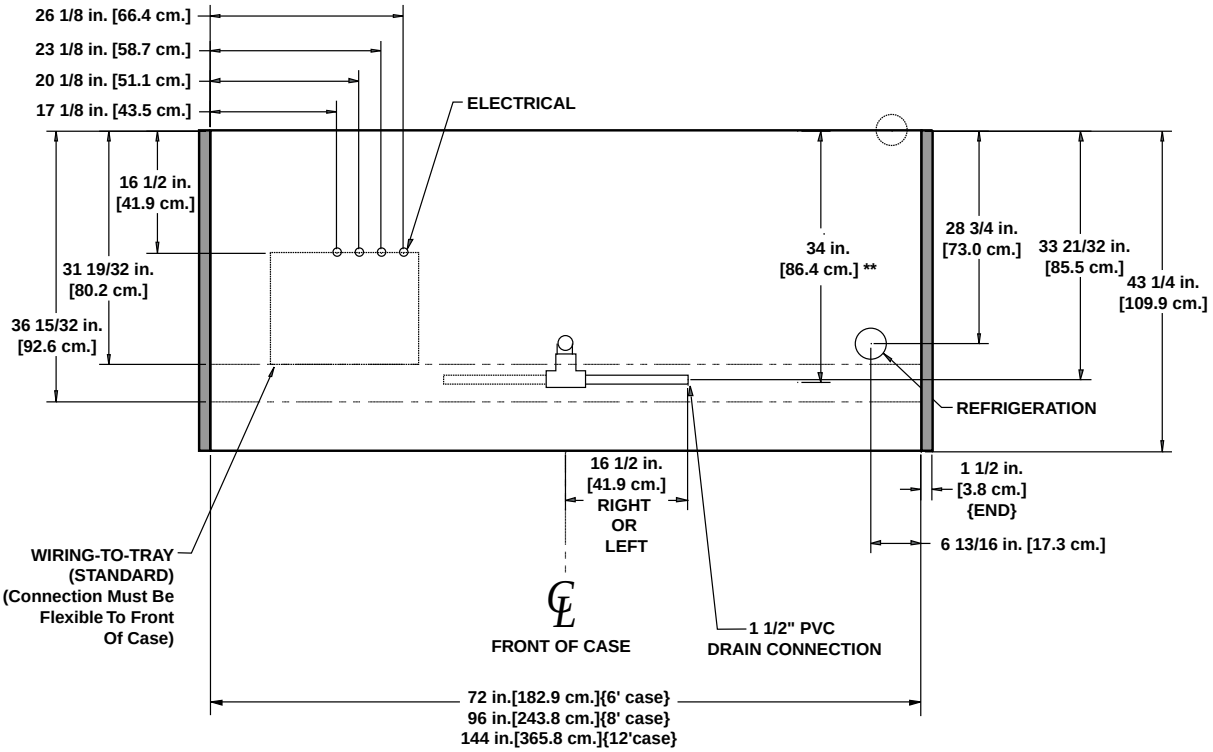

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

Single Deck Produce Merchandisers

OP - 6', 8', & 12' produce

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OP	6'	2	1.00	60	0.60	40	- - -[1]	- - -	2.88	600	3.33	798
	8'	2	1.00	60	0.60	40	- - -	- - -	3.85	800	4.44	1065
	12'	3	1.50	90	0.90	60	- - -	- - -	5.77	1200	6.67	1600

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OP	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Rear Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
OP Standard Temp.	39"	230	27	30	41	50	210
	43"	290	27	30	40	50	210
OP Reduced Temp.	39"	375	22	27	37	45	210
	43"	401	22	27	36	45	210

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OP	2	40	52	60	44	26	65	40	44

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

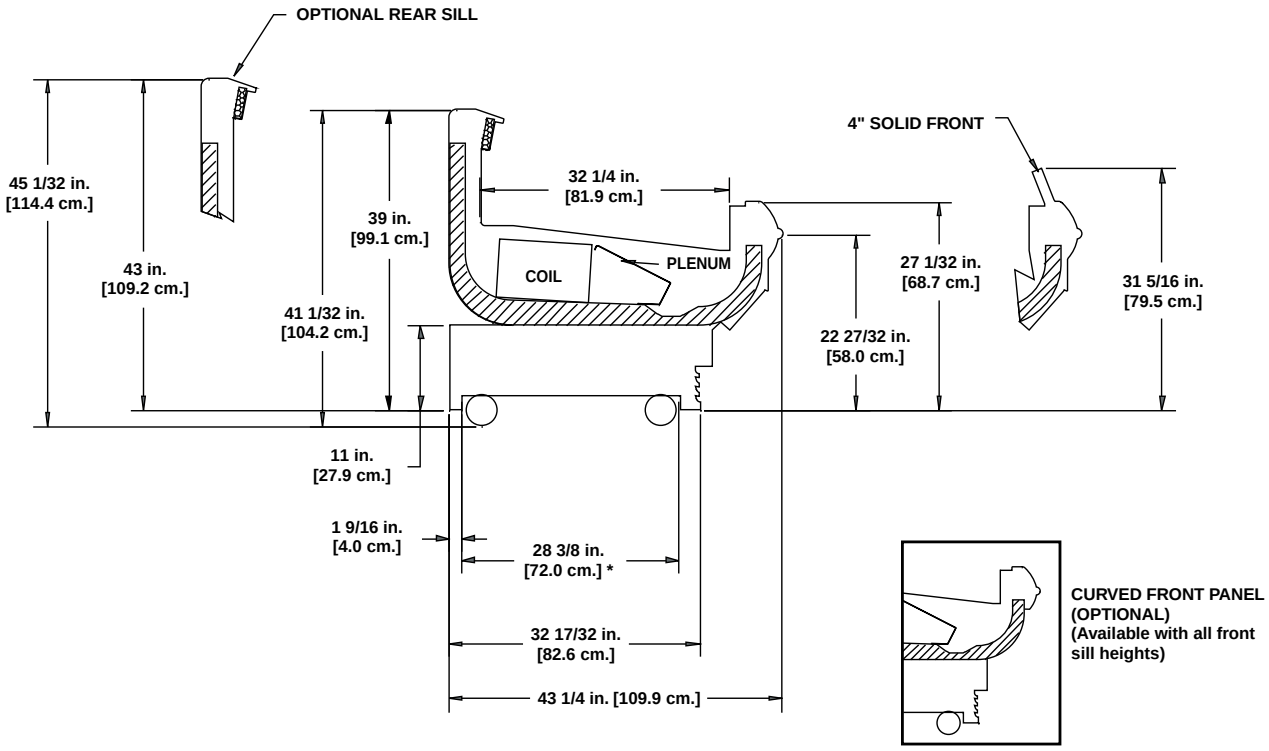

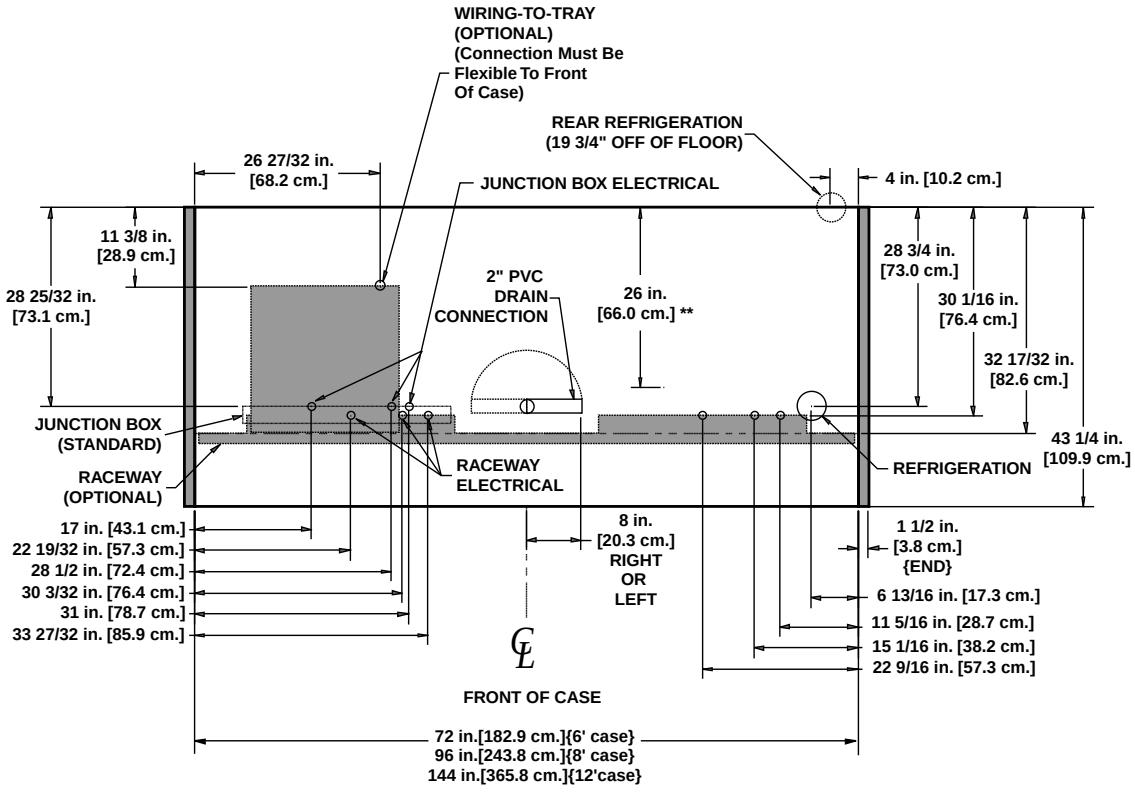

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

International Style Self-Service Deli/Seafood Merchandisers

OSIO - 4', 6', 8', & 12' international style self-service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OSIO	4'	2	0.68	34	0.30	22	0.55	66	1.92	400	2.22	532
	6'	2	0.68	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.02	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OSIO	4'	0.57	68	0.57	68
	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OSIO	695[2]	12	24	33	33	180

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Calculated from OSIOA data compressor tables

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OSIO	3	35	50	55	50	- - -[4]	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

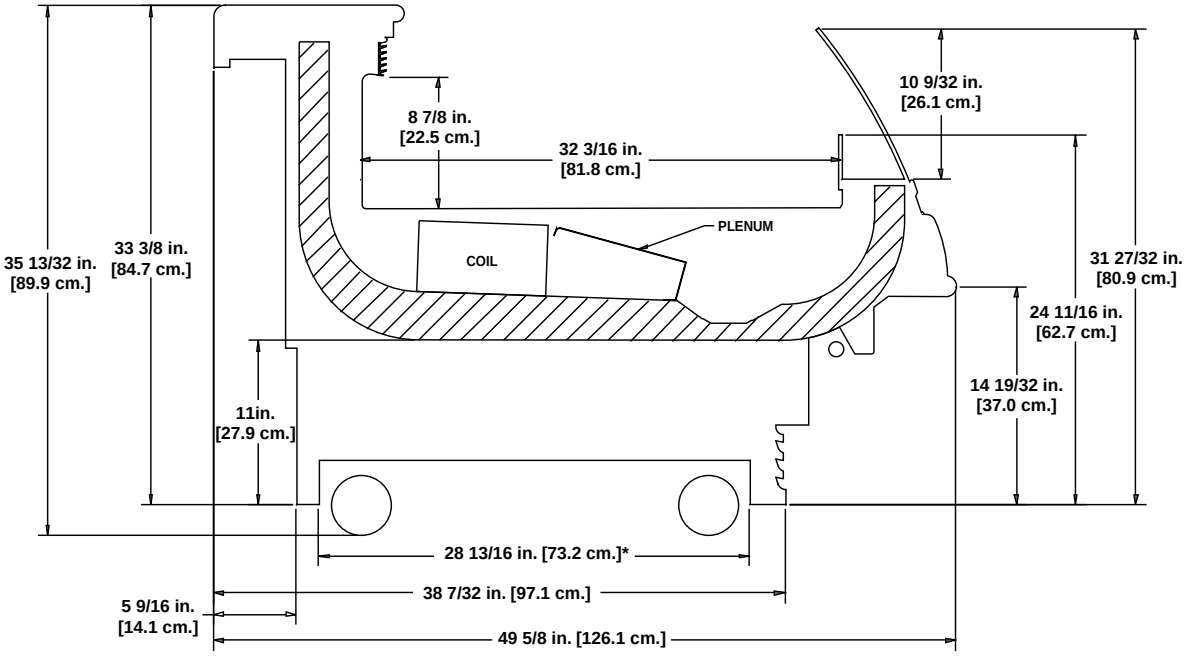

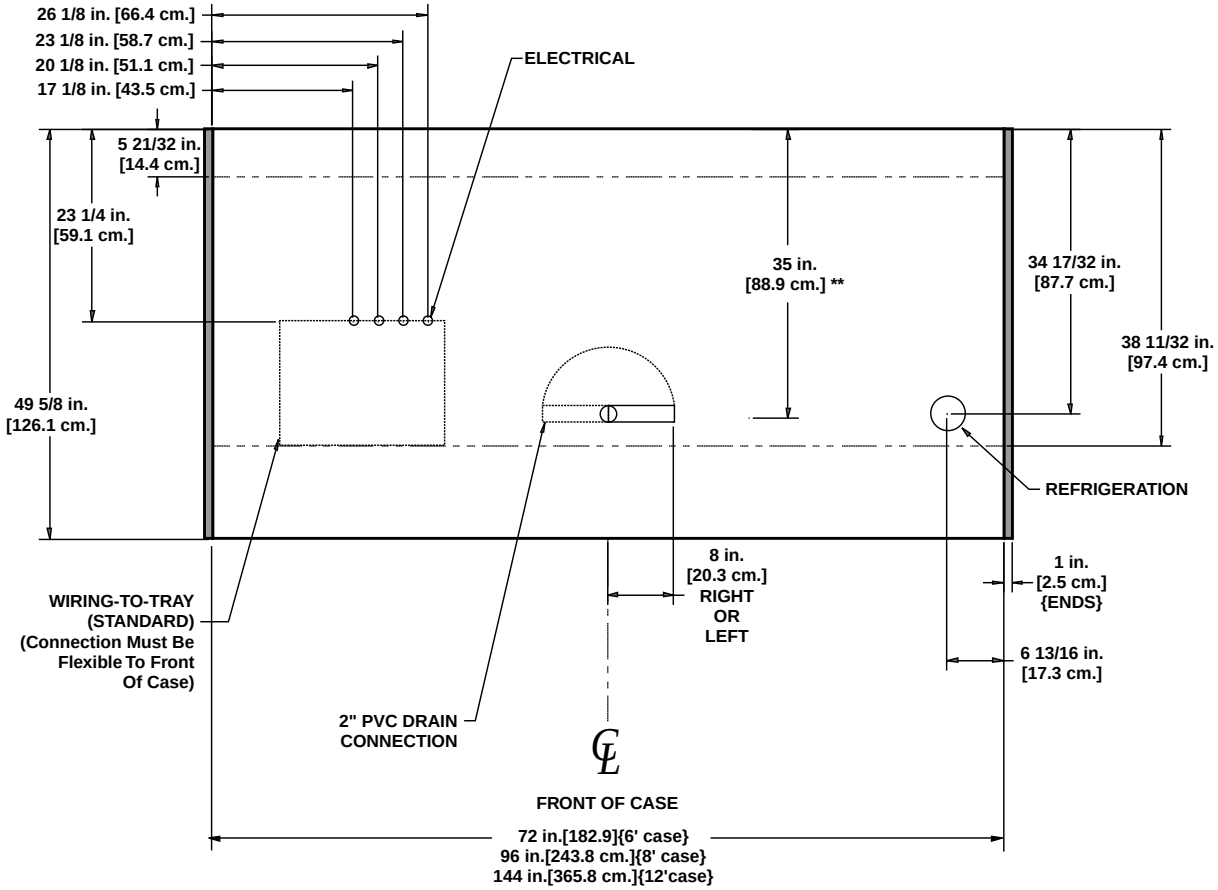

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**

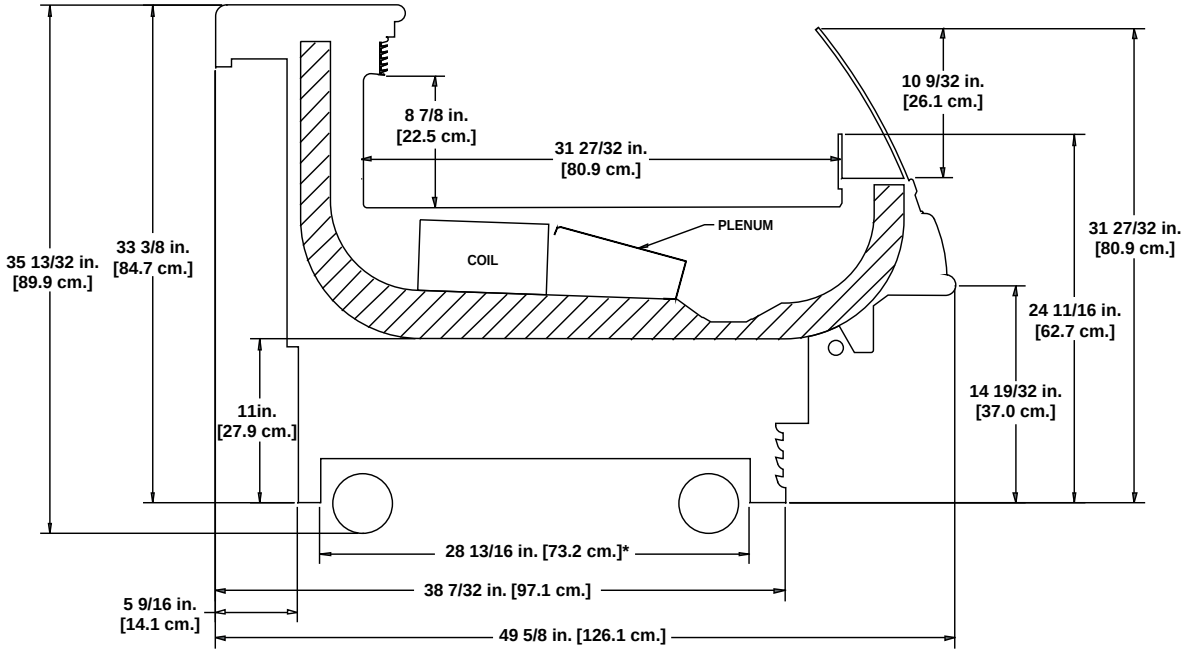

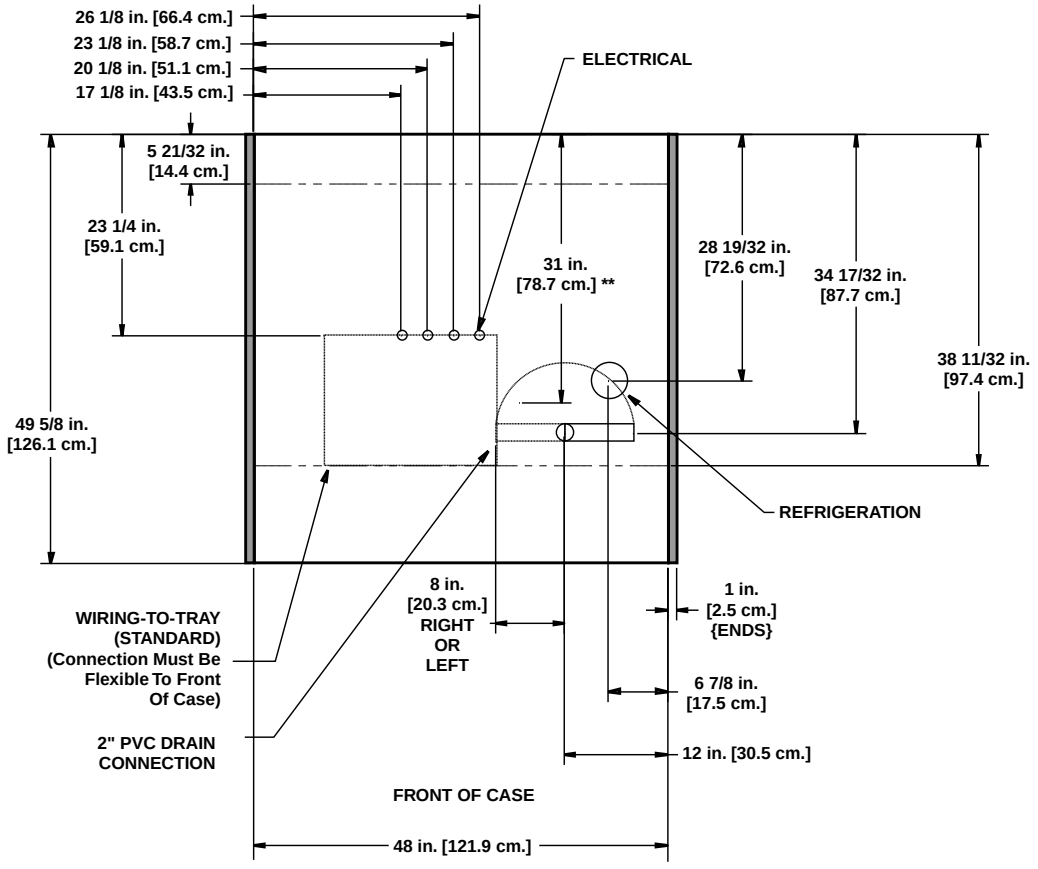

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Wide International Style Self-Service Deli/Seafood Merchandisers

OWSIO - 6', 8', & 12' international style self-service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OWSIO	6'	2	0.68	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.02	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OWSIO	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OWSIO	795[2]	12	24	34	33	180

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Calculated from OSIOA data compressor tables

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OWSIO	3	35	50	55	50	- - -[4]	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

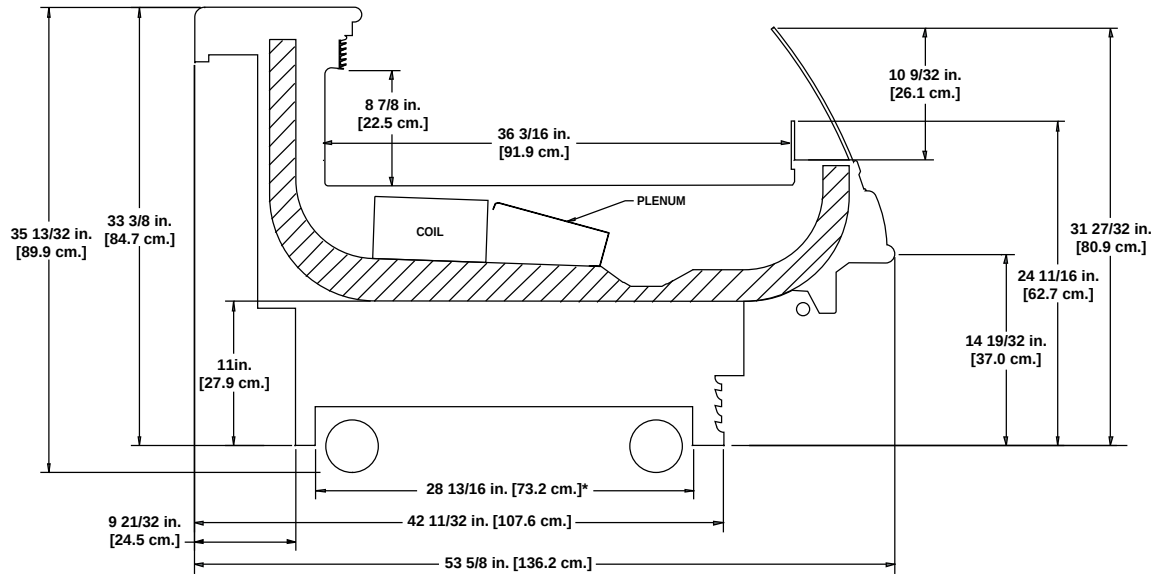

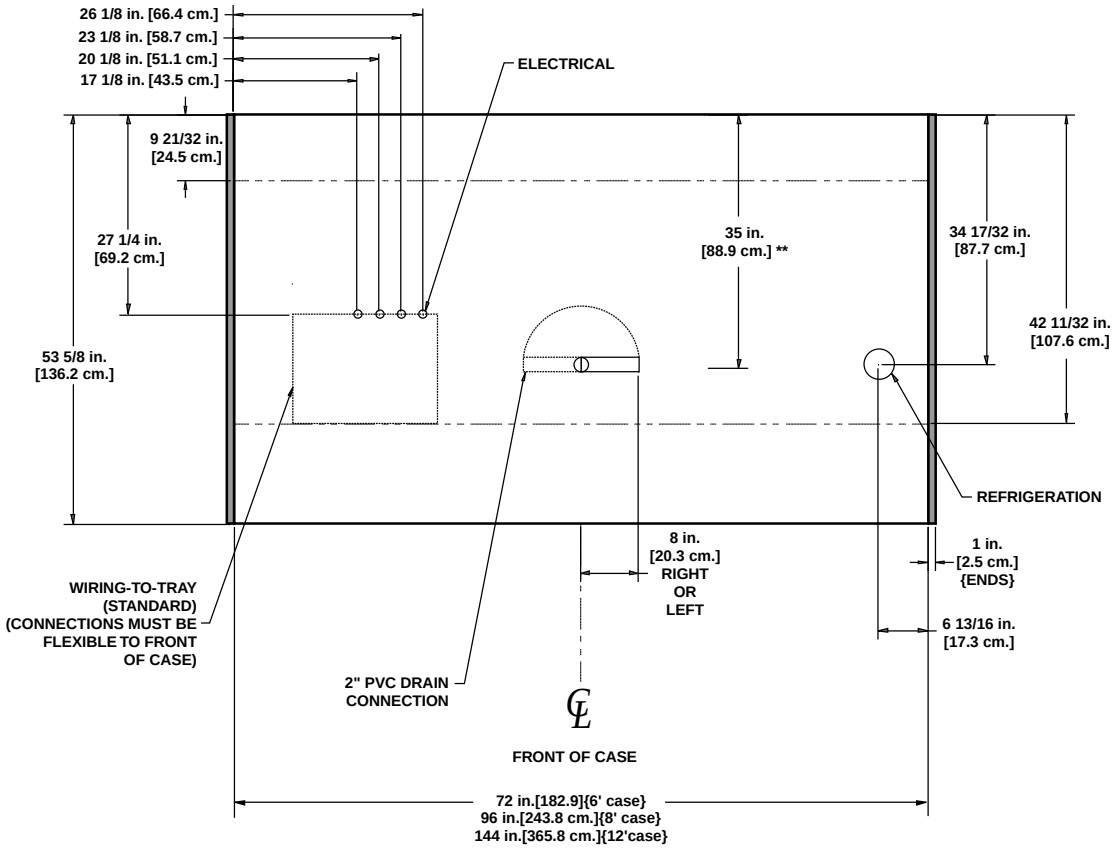

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Multi-Deck Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

Multi-Deck Dairy/Deli/Meat Merchandisers

O2UM - 4', 6', 8', & 12' low profile dairy/deli/meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters[1] 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O2UM	4'	2	1.00	60	0.60	40	0.14	17	1.90	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watts	Amps	Watts
O2UM	4'	0.57	68	1.14	137
	6'	0.57	68	2.06	247
	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model[2]	Front Sill Heights	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
O2UM	27", 31", 33"	1000	17	27	31	40	340

[2] Model O2UM only available for meat application with 33" front

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O2UM	3	40	47	45	45	26	39	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

(For additional rear sill options refer to the *Merchandisers Accessories Guide)

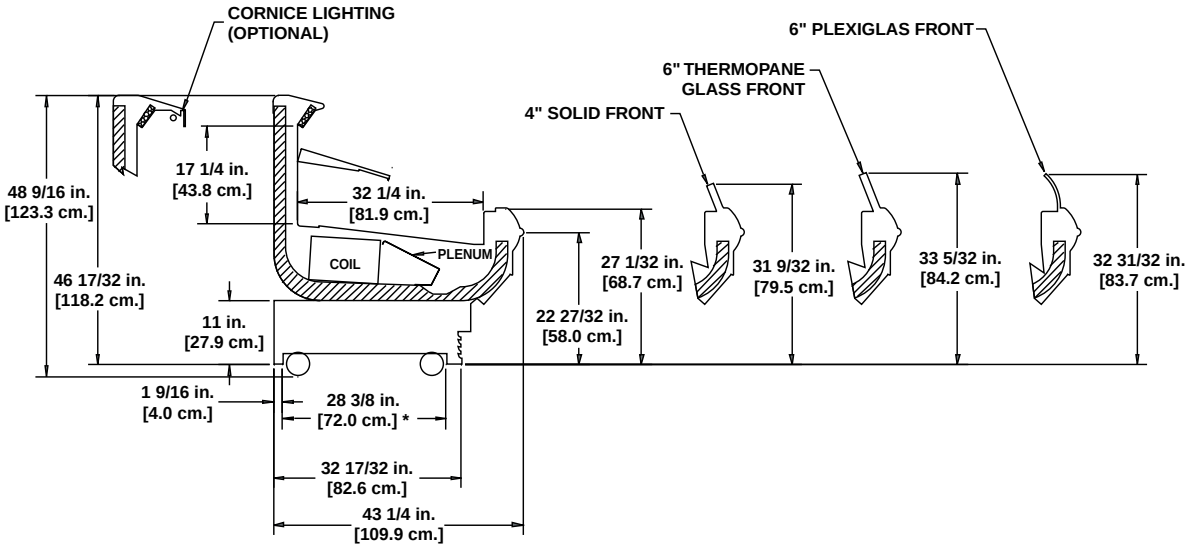

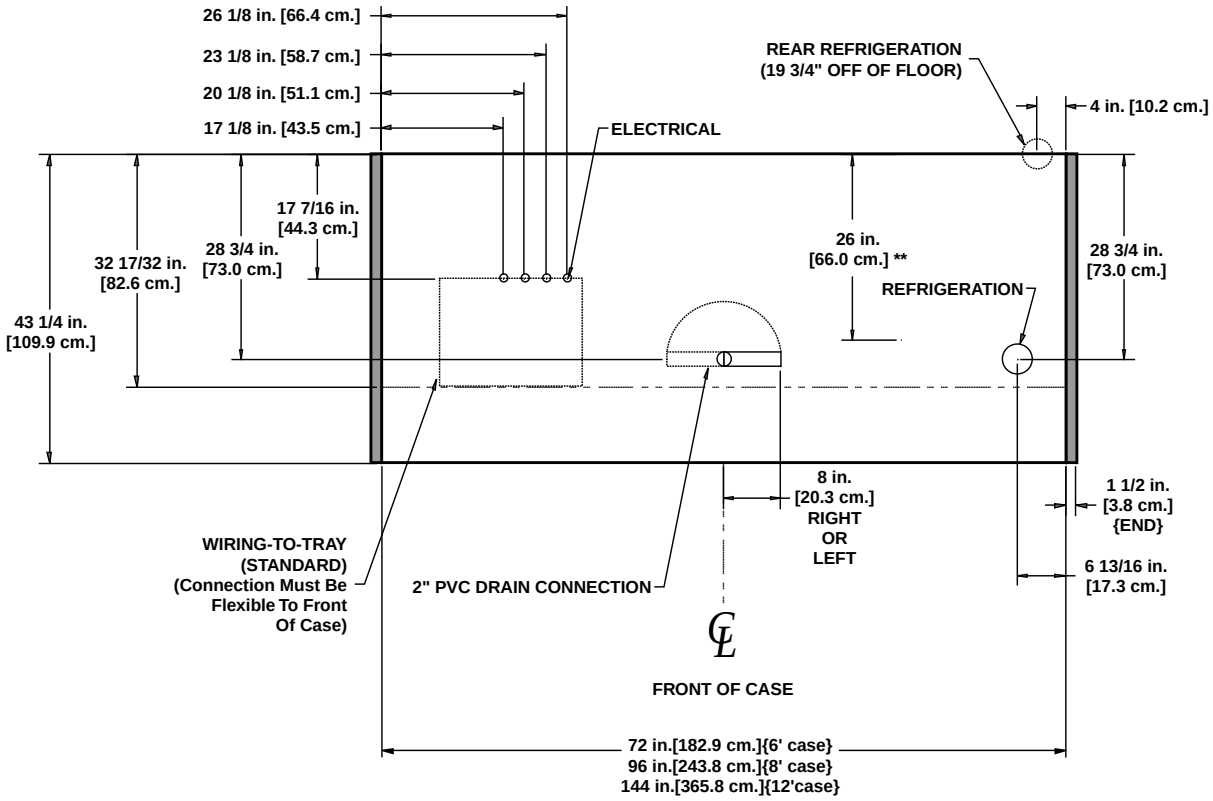

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

(For additional rear sill options refer to the *Merchandisers Accessories Guide)

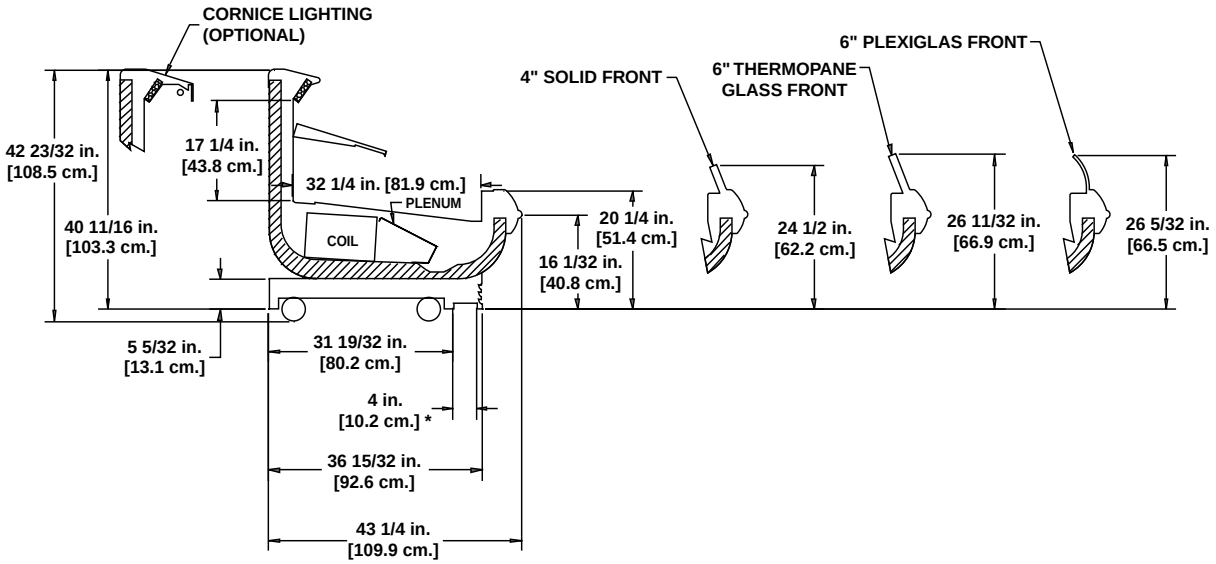

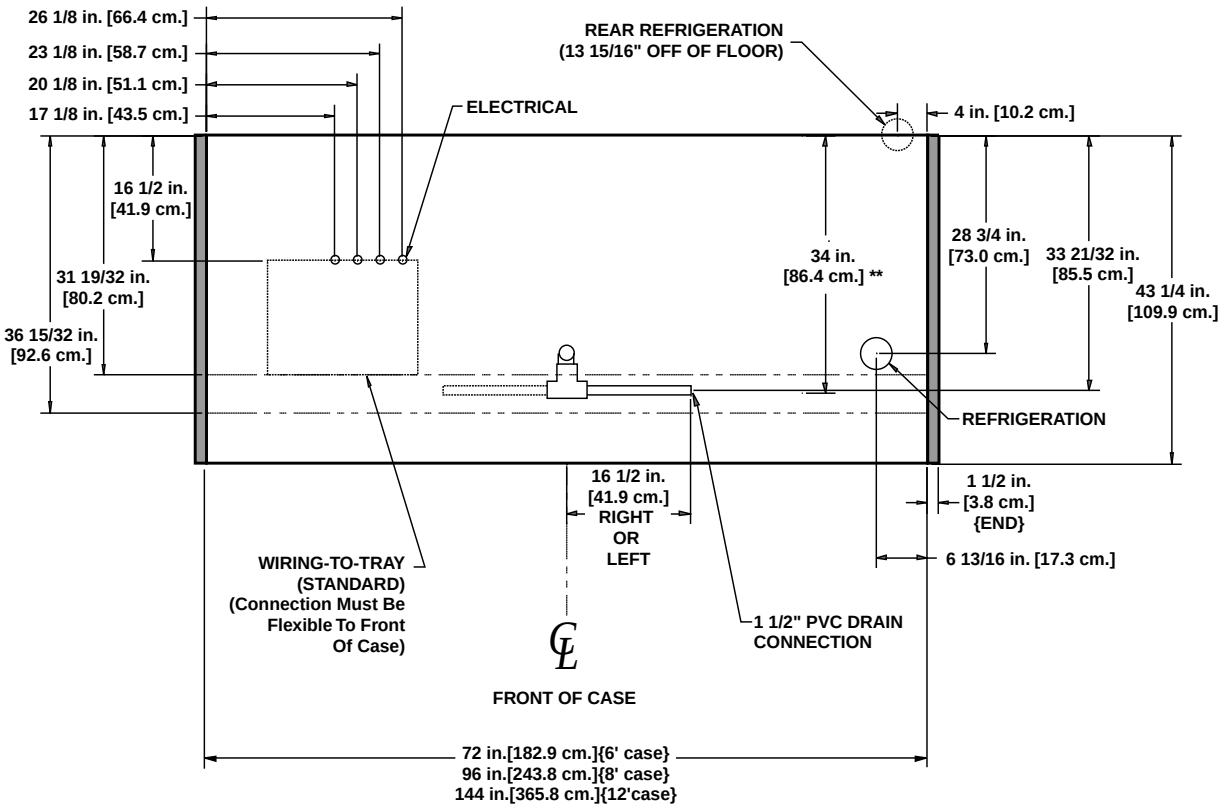

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

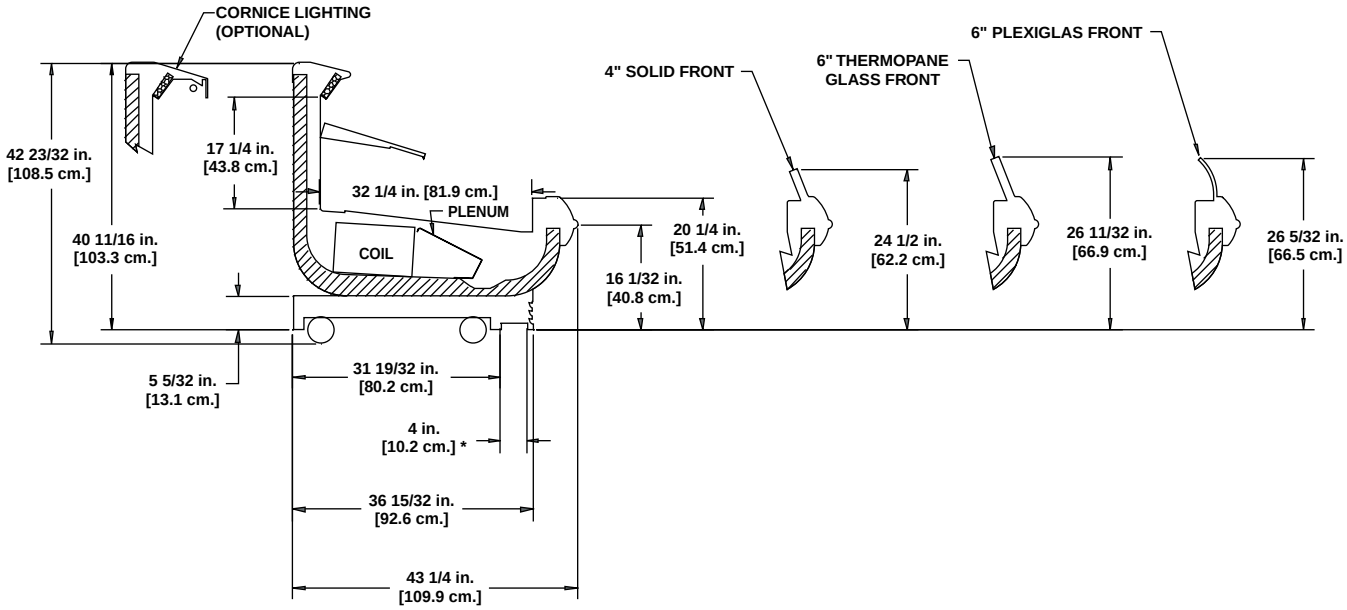

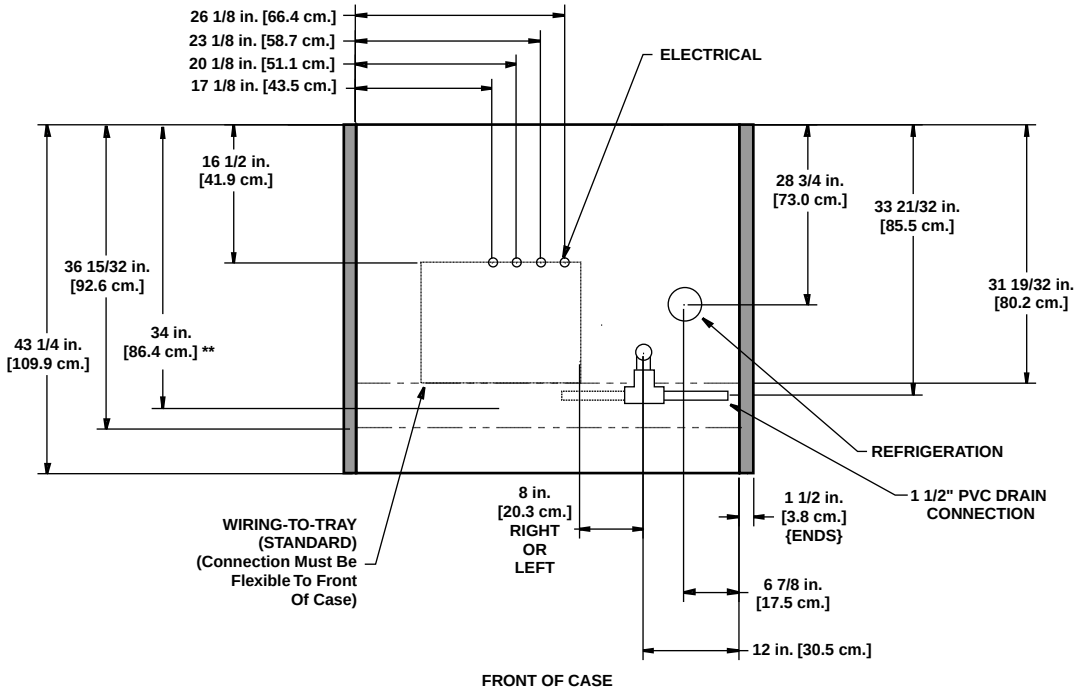

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Multi-Deck Dairy/Deli/Meat Merchandisers

O2.5UM - 4', 6', 8', & 12' low profile dairy/deli/meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters[1] 120 Volts Amps	Anti-Condensate Heaters[1] 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
O2.5UM	4'	2	1.00	60	0.60	40	0.14	17	1.90	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
O2.5UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model[2]	Front Sill Heights	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
O2.5UM	27", 31", 33"	1020	17	27	33	45	225

[2] Model O2.5UM only available for meat application with 33" front

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O2.5UM	3	40	47	45	45	26	39	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

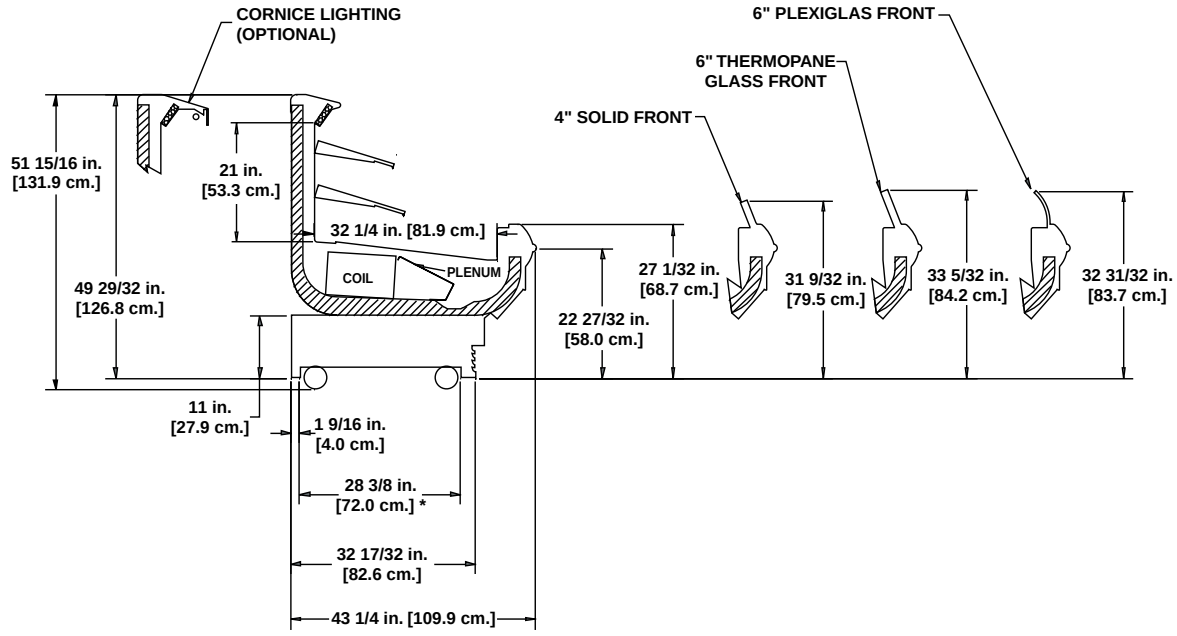

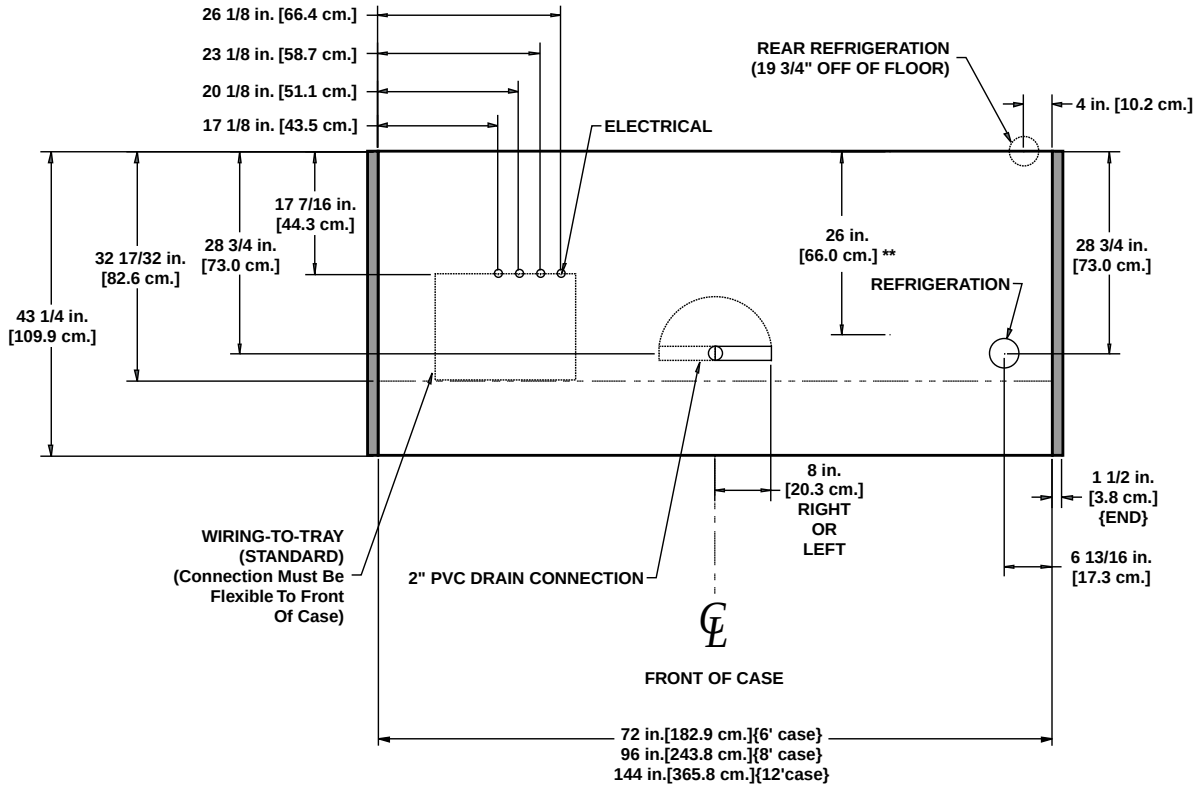

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

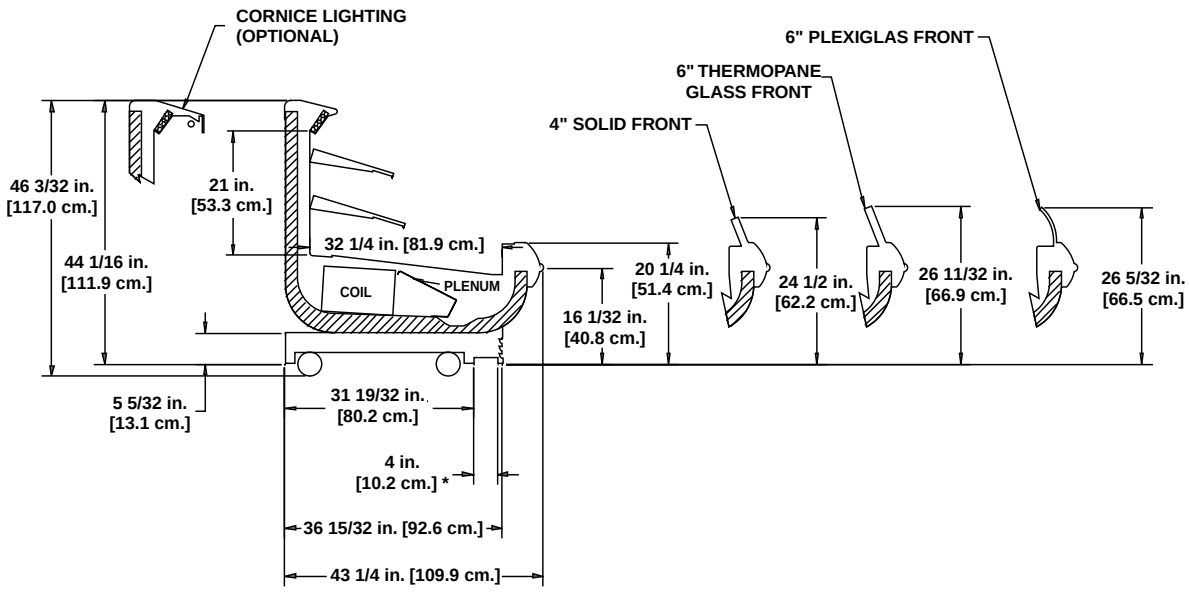

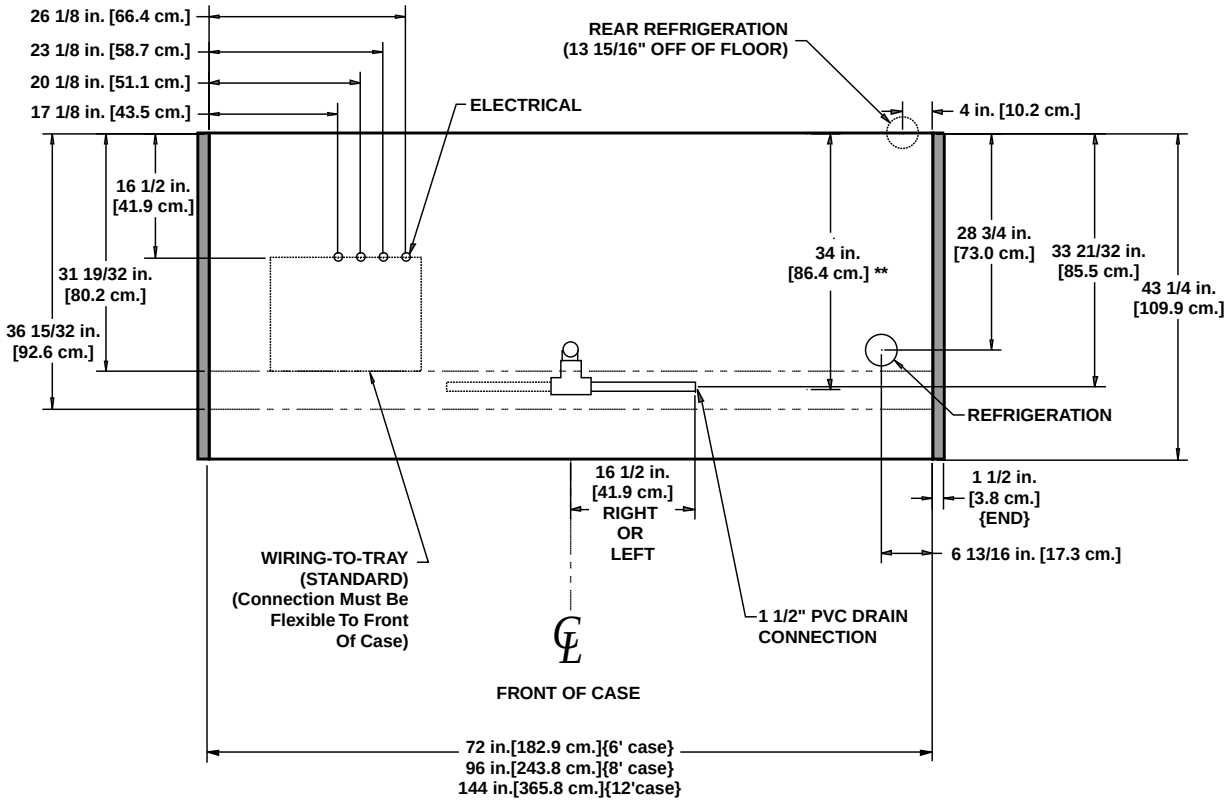

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

(Rear refrigerated box shown on the O2.5UM base model but is available on other OUM models.)

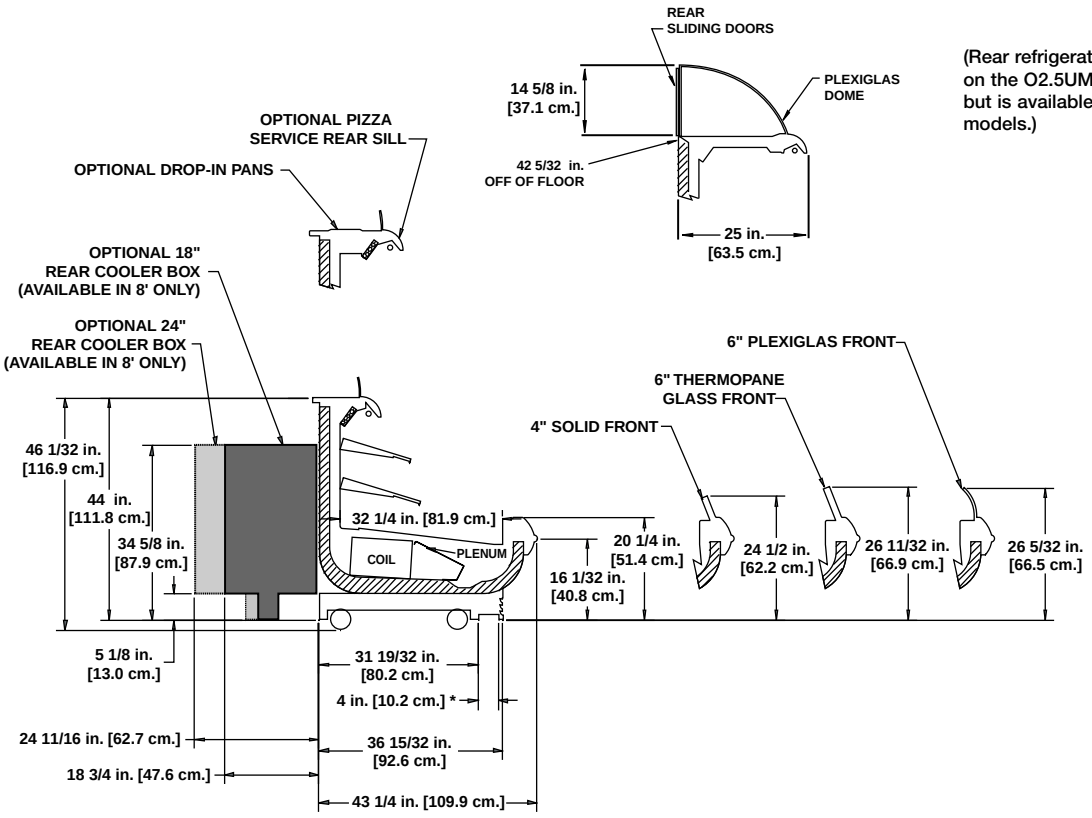

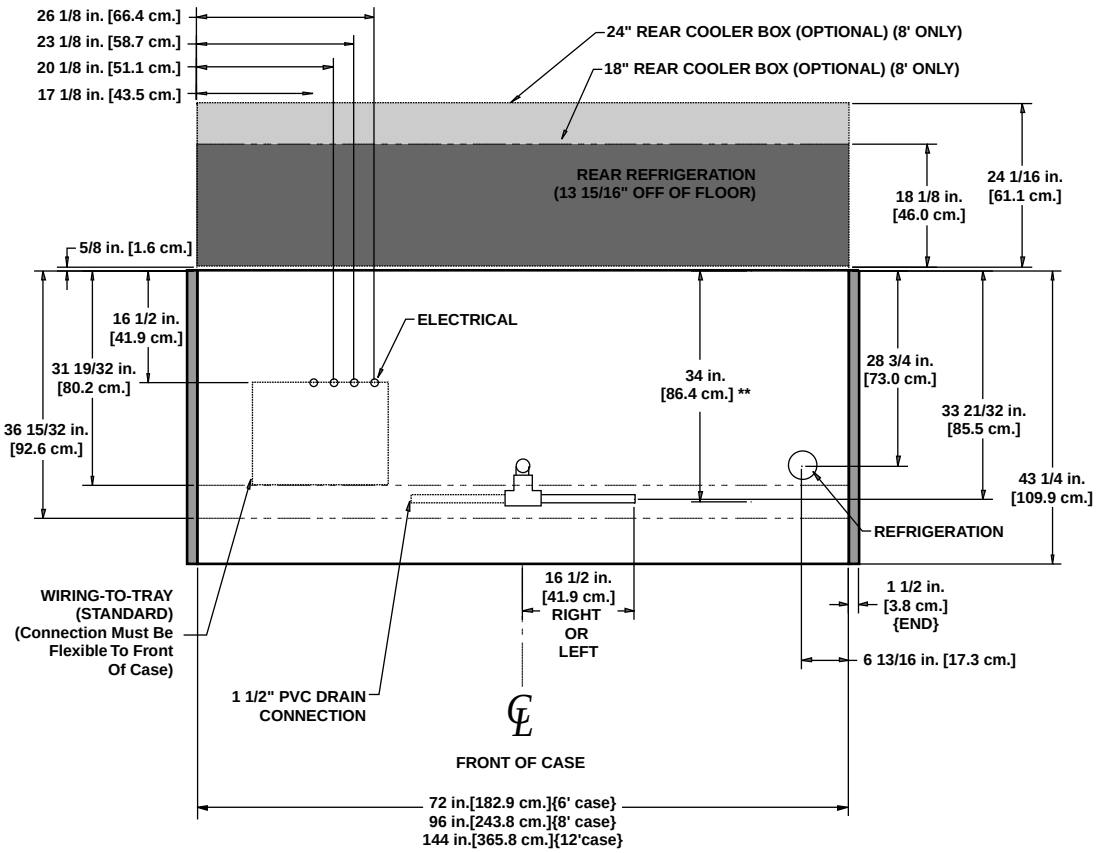

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Multi-Deck Dairy/Deli/Meat Merchandisers

O3UM - 4', 6', 8', & 12' low profile dairy/deli/meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters[1] 120 Volts Amps	Anti-Condensate Heaters[1] 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
O3UM	4'	2	1.00	60	0.60	40	0.14	17	1.90	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
O3UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model[2]	Front Sill Heights	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
O3UM	27", 31", 33"	1030	17	27	32	45	225

[2] Model O3UM only available for meat application with 33" front

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O3UM	3	40	47	45	45	26	39	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

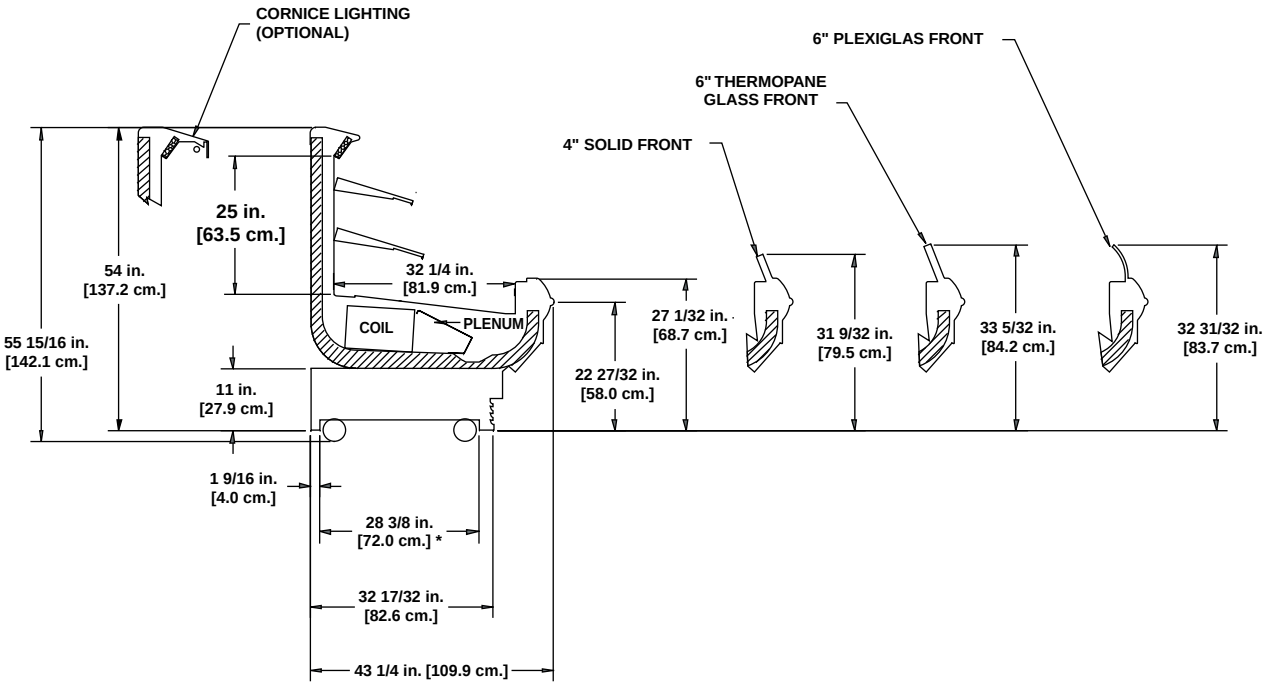

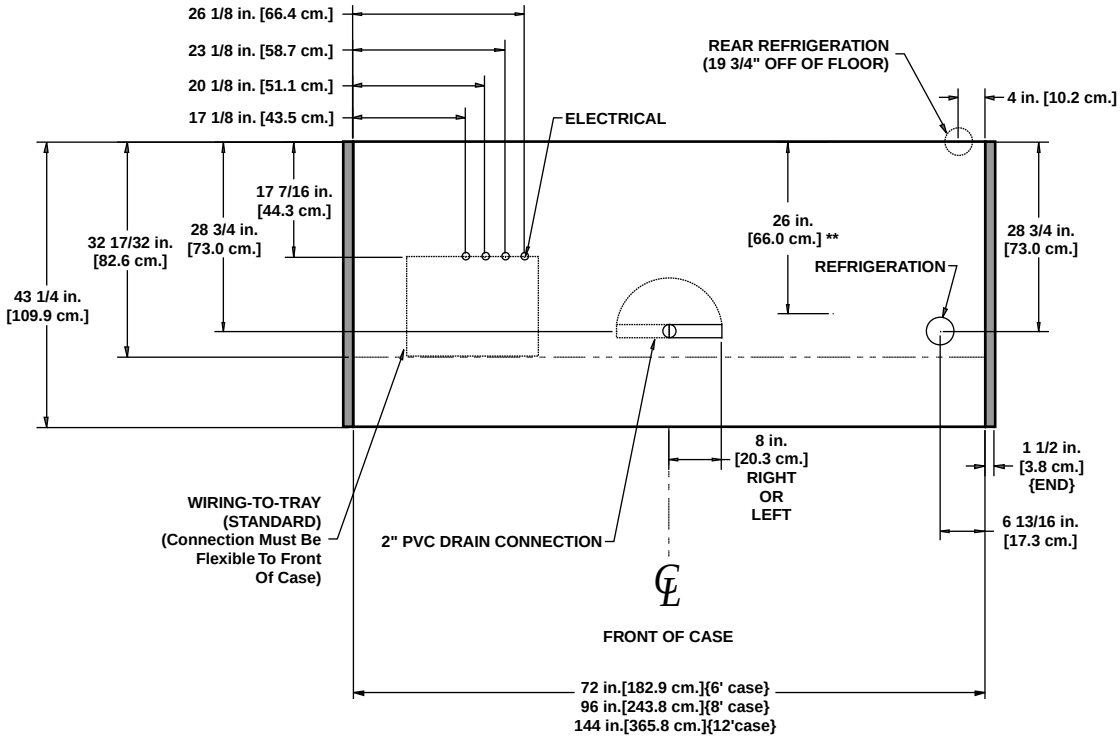

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

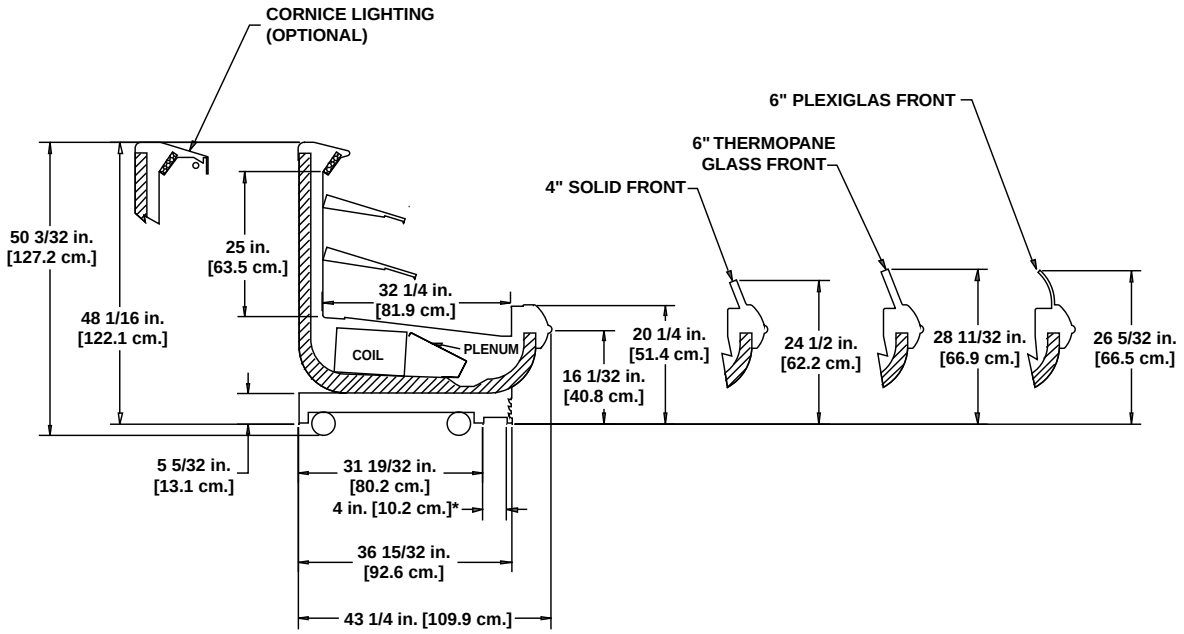

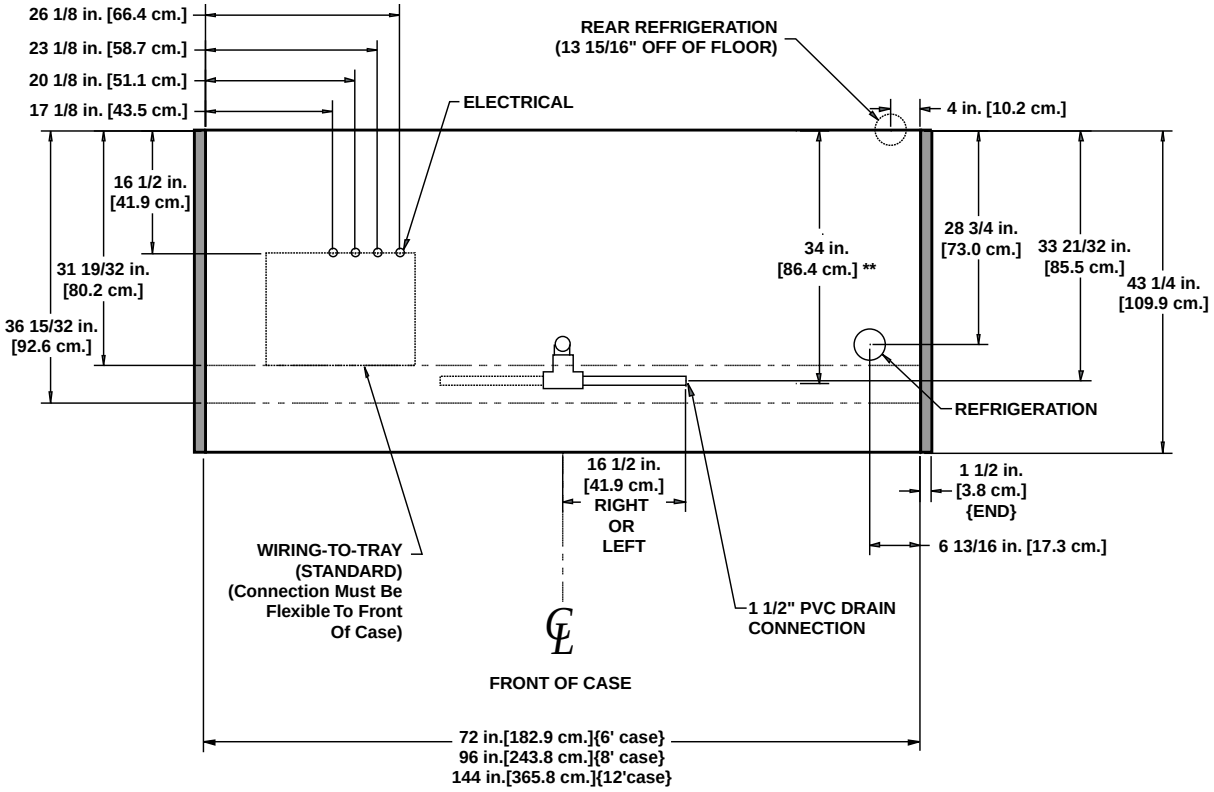

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

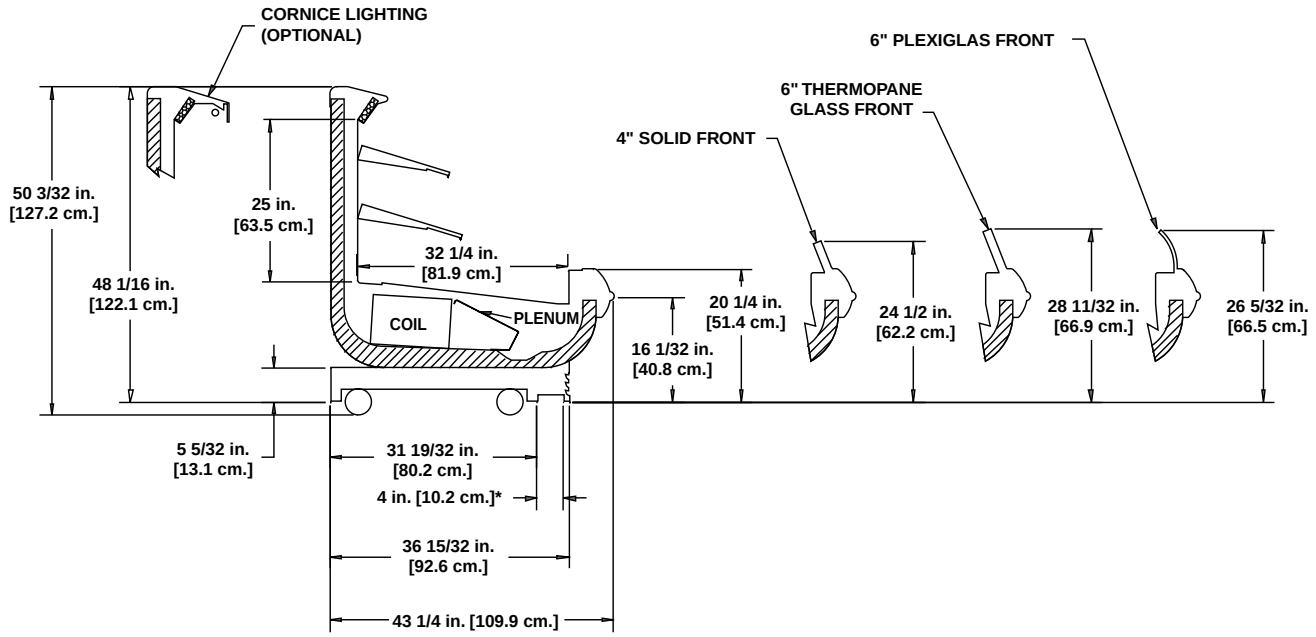

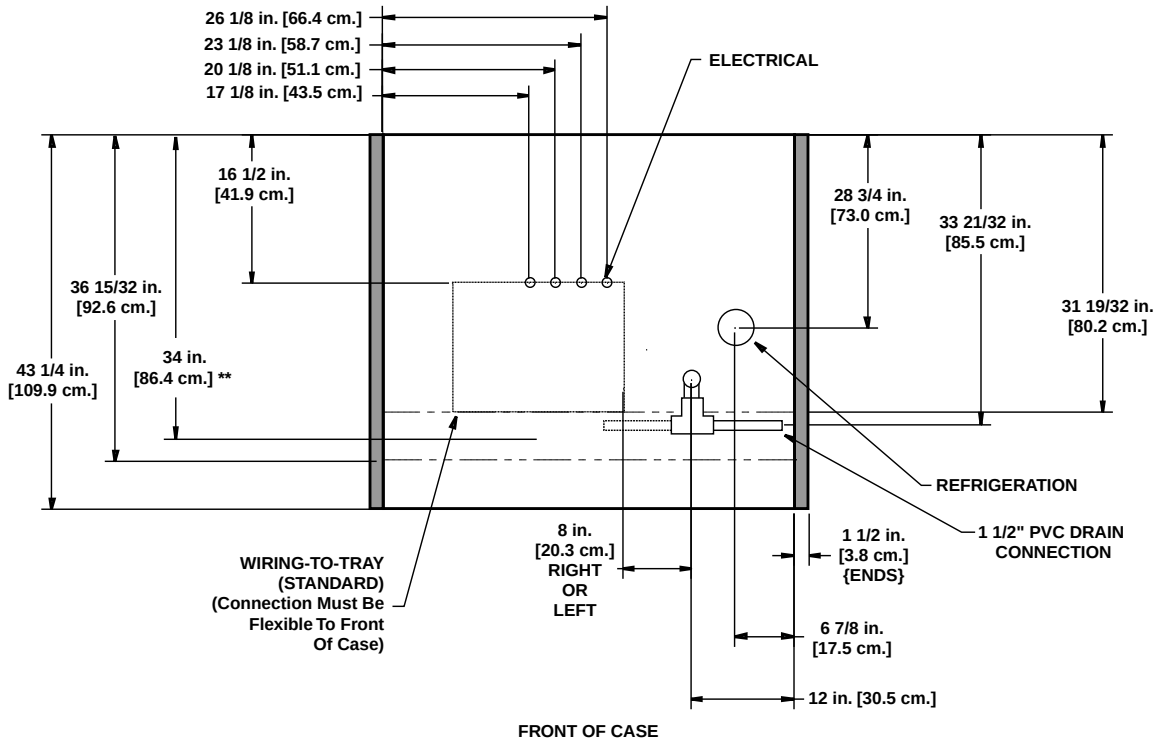

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Multi-Deck Dairy/Deli/Meat Merchandisers

O3.5UM - 4', 6', 8', & 12' low profile dairy/deli/meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters[1] 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3.5UM	4'	2	1.00	60	0.60	40	0.14	17	1.90	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
O3.5UM	4'	0.57	68	1.91	229
	6'	0.57	68	3.03	364
	8'	0.57	68	3.03	364
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model[2]	Front Sill Heights	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
O3.5UM	27", 31", 33"	1300	17	30	34	45	300

[2] Model O3.5UM only available for meat application with 33" front

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O3.5UM	3	40	47	45	45	26	39	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

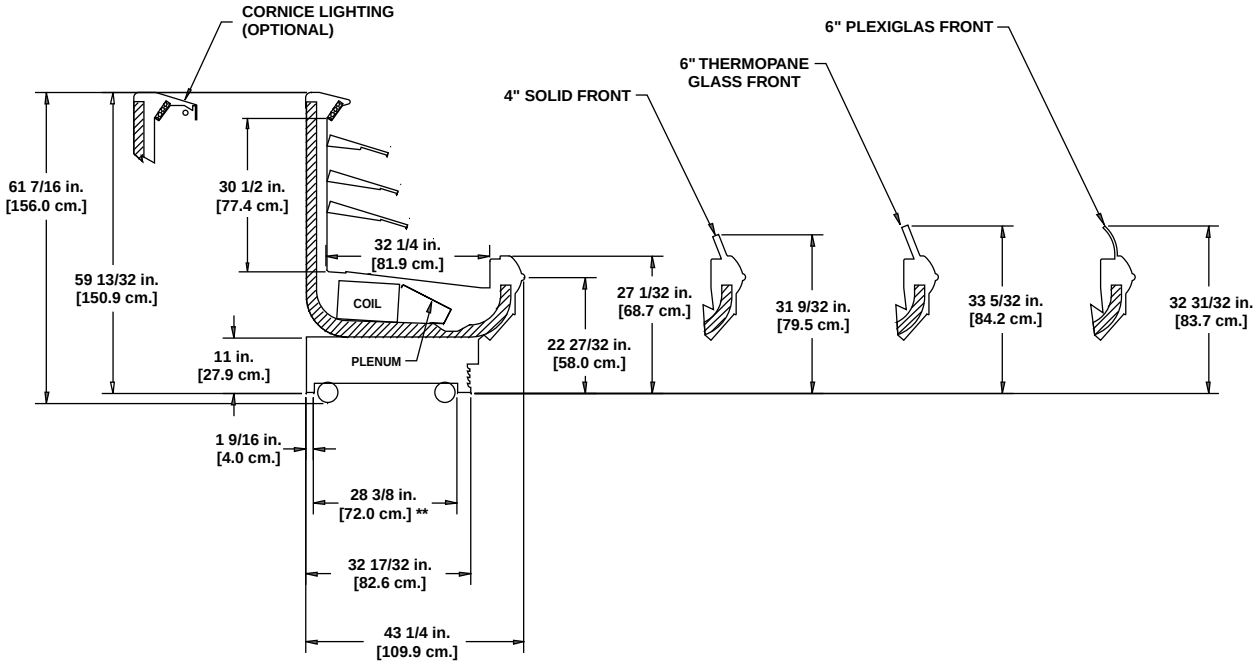

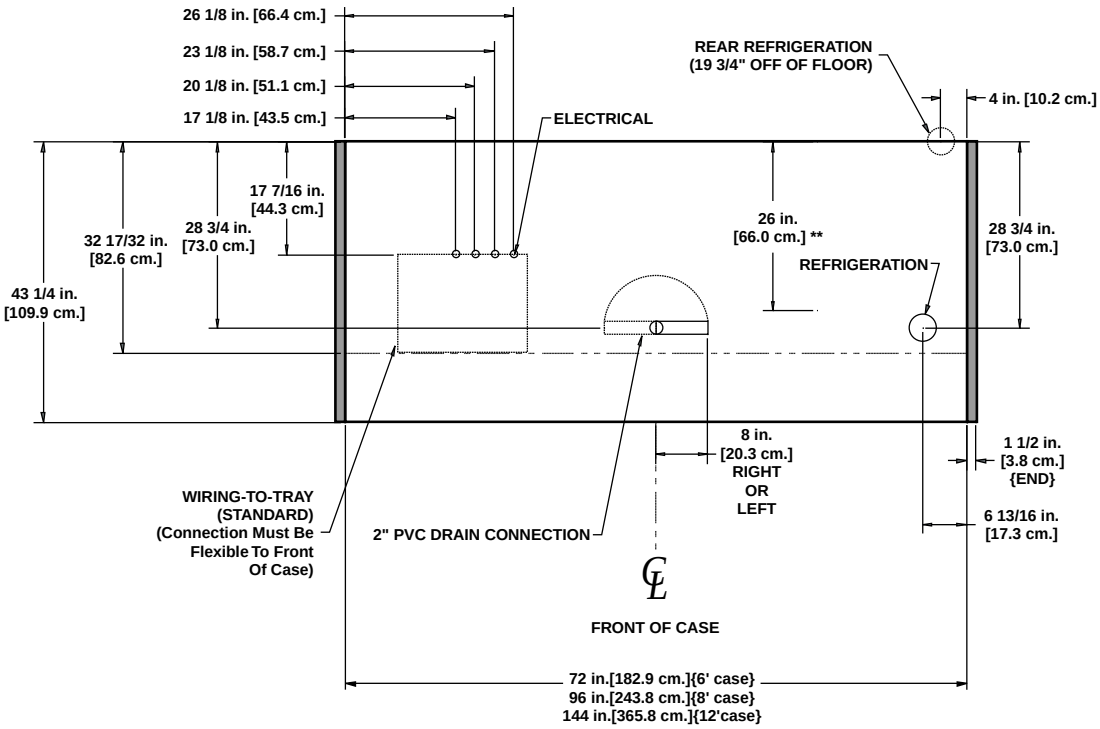

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

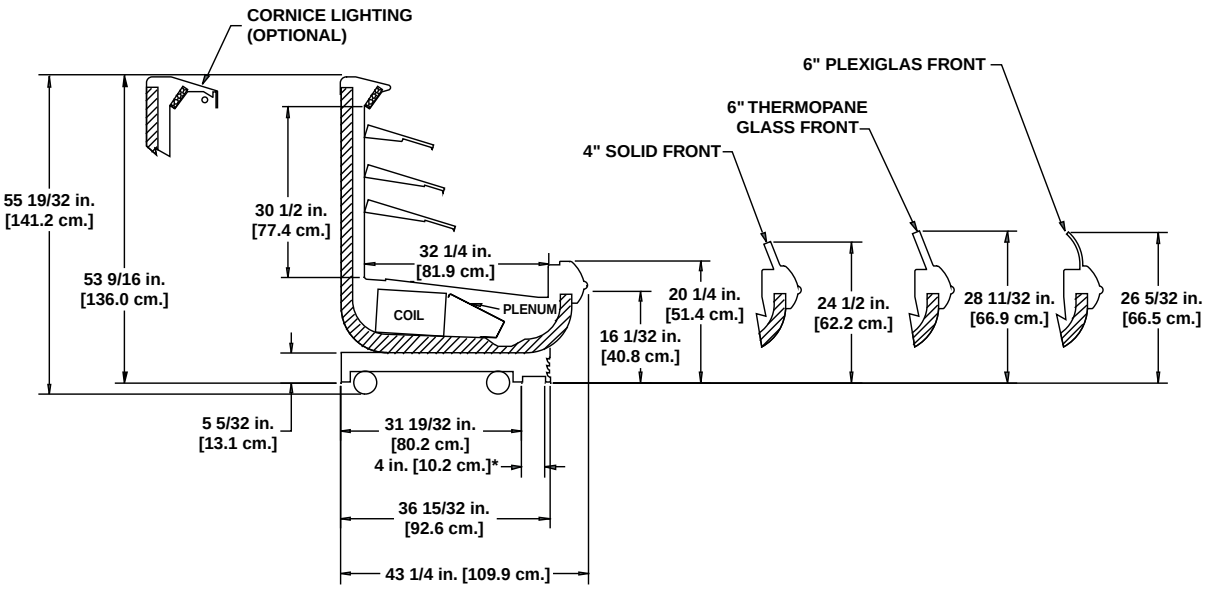

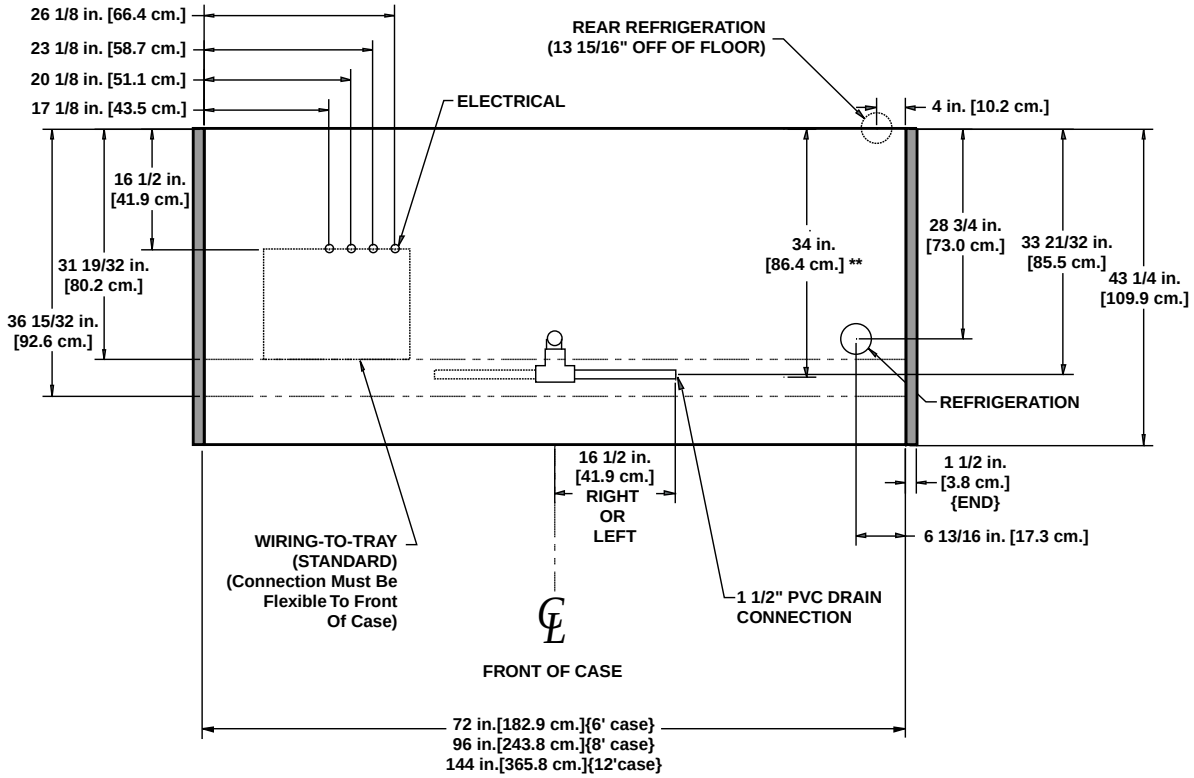

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

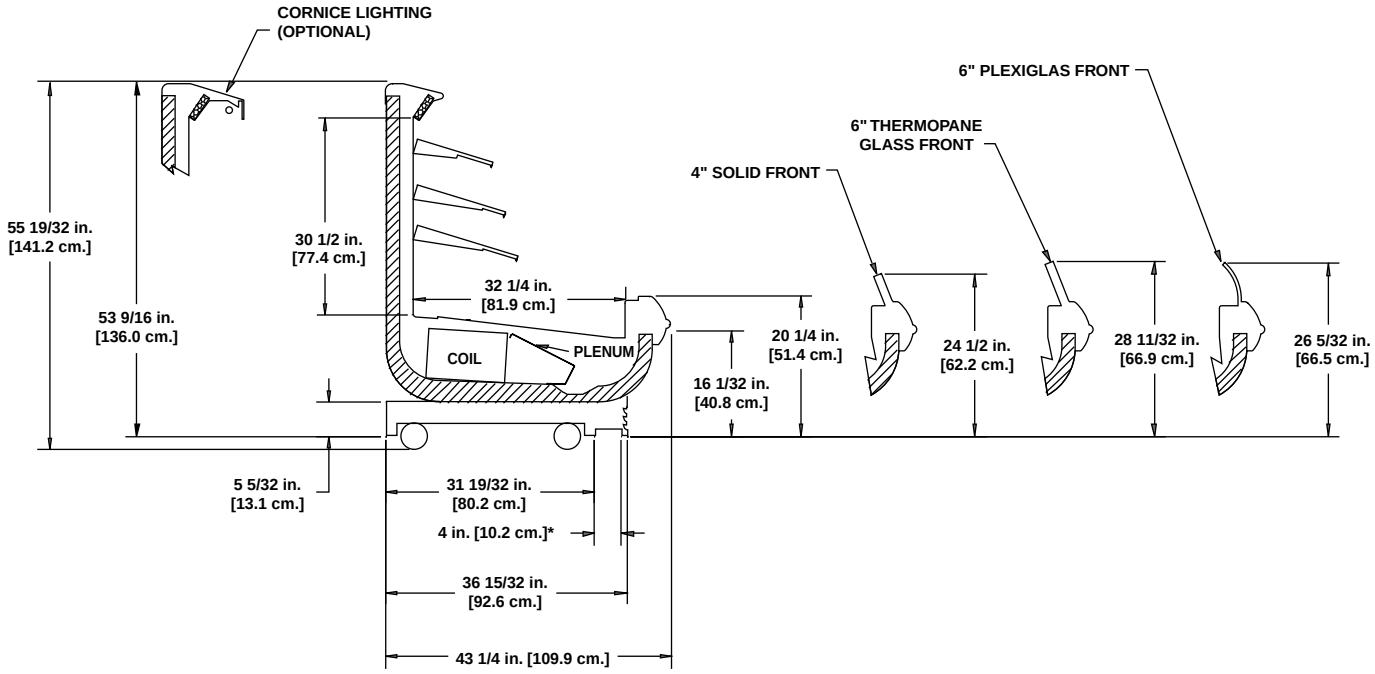

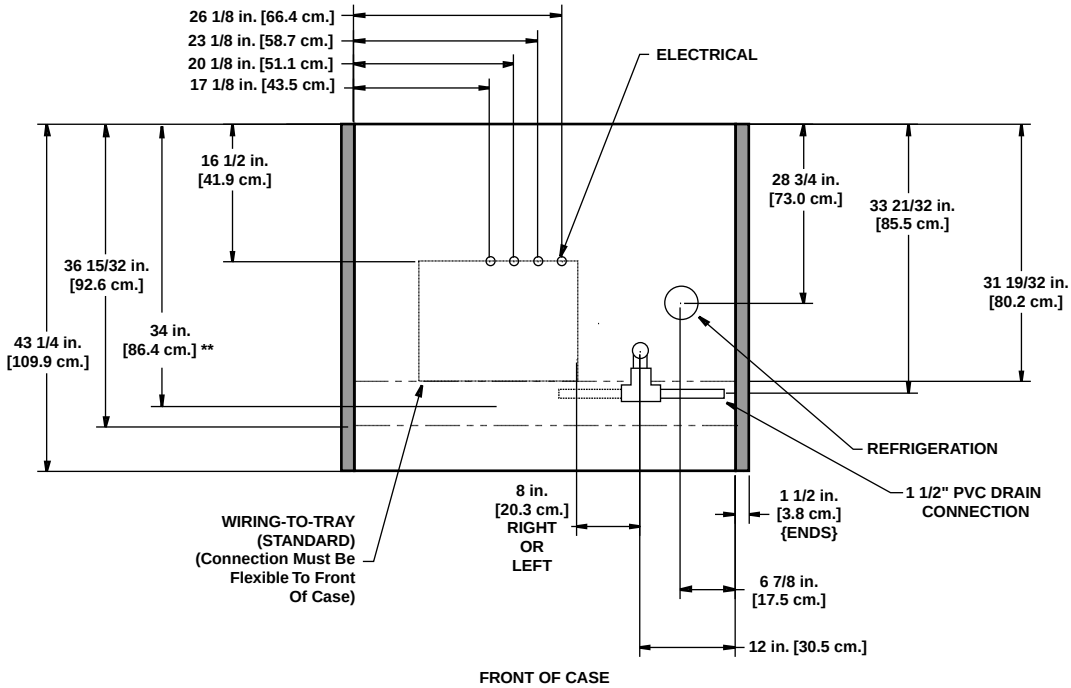

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE - 7/8", LIQUID LINE - 5/8"**

Multi-Deck Dairy/Deli Merchandisers

O4UM - 6', 8', & 12' multi-deck dairy/deli

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters[1] 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O4UM	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watts	Amps	Watts
O4UM	6'	0.57	68	3.03	364
	8'	0.57	68	3.03	364
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
O4UM	33"	1460	17	30	34	43	300

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O4UM	4	40	47	45	45	26	39	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

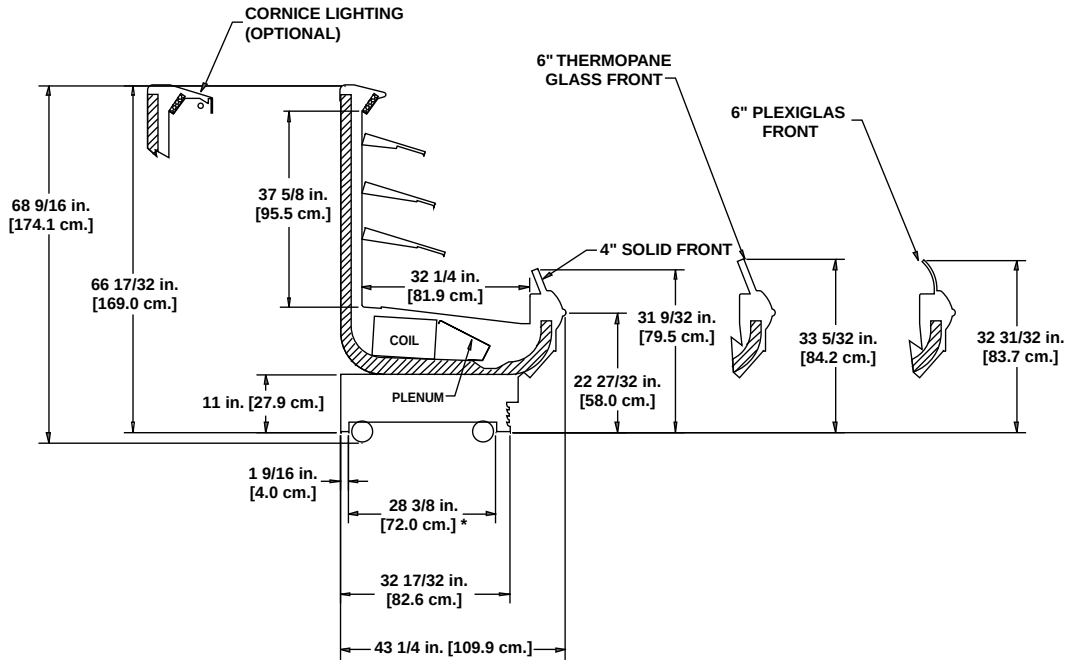

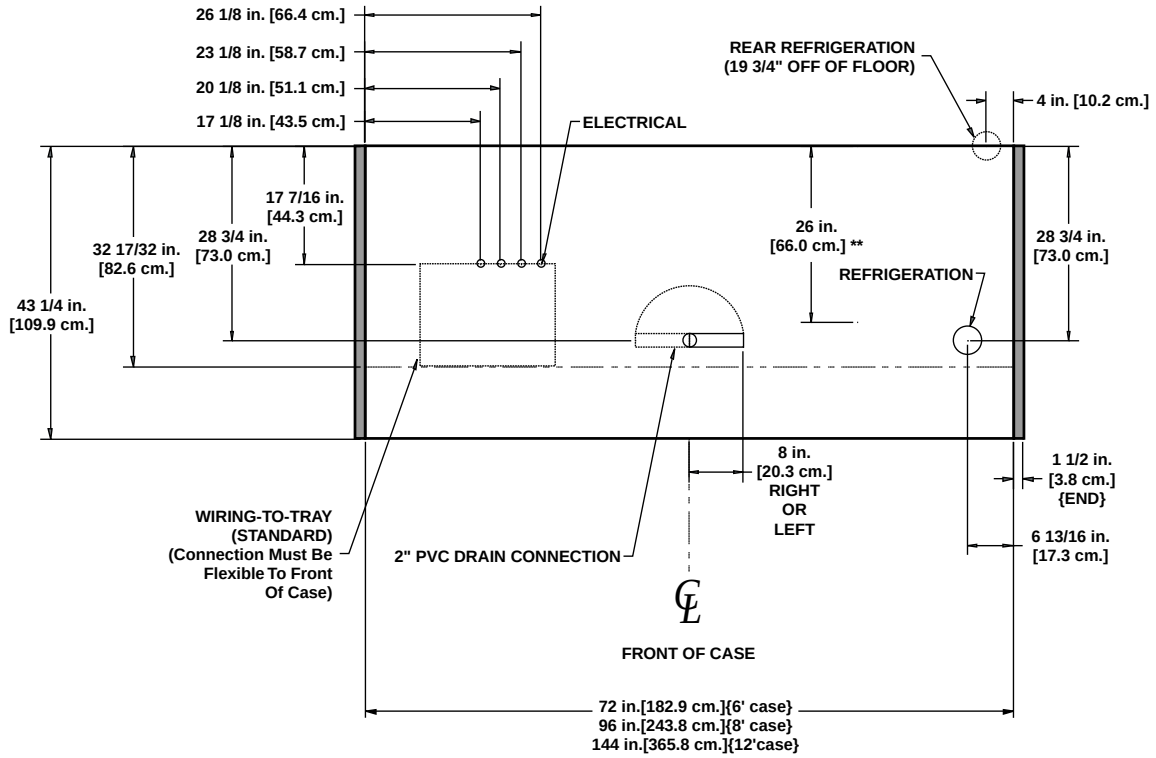

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Multi-Deck Dairy/Deli Merchandisers

O5UM - 6', 8', & 12' multi-deck dairy/deli

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters[1] 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5UM	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

[1] Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watts	Amps	Watts
O5UM	6'	0.57	68	3.33	400
	8'	0.57	68	3.33	400
	12'	0.77	92	5.07	608

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
O5UM	33"	1490	17	30	35	42	300

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O5UM	4	40	47	- - -[4]	- - -	26	39	45	45

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

*(For additional rear sill options refer to the *Merchandisers Accessories Guide)*

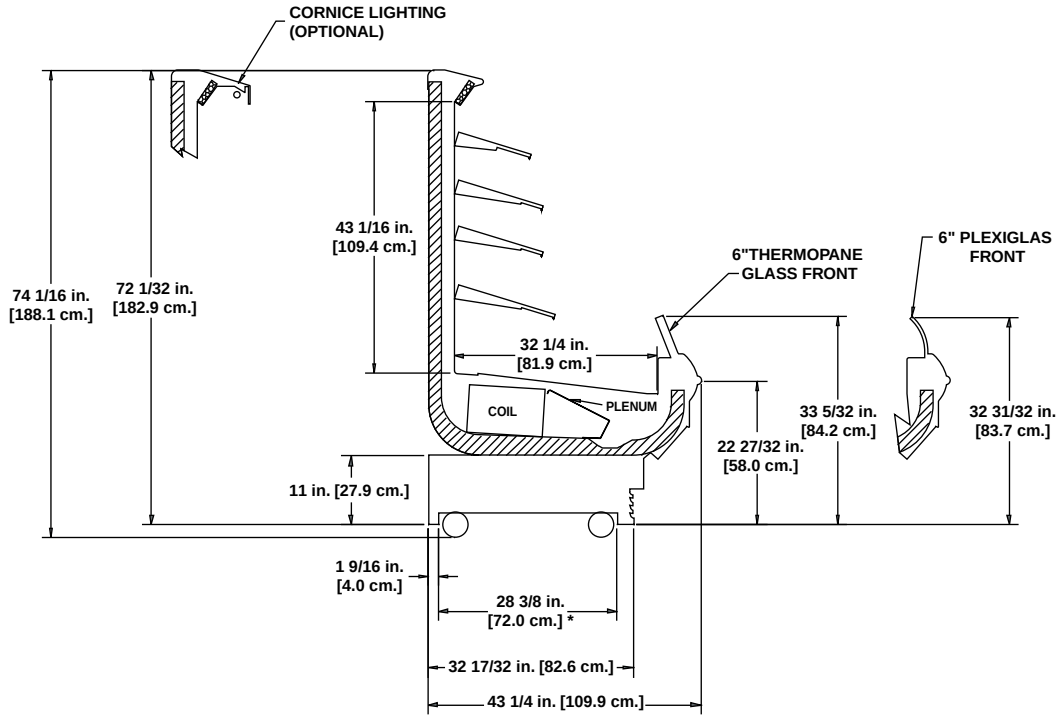

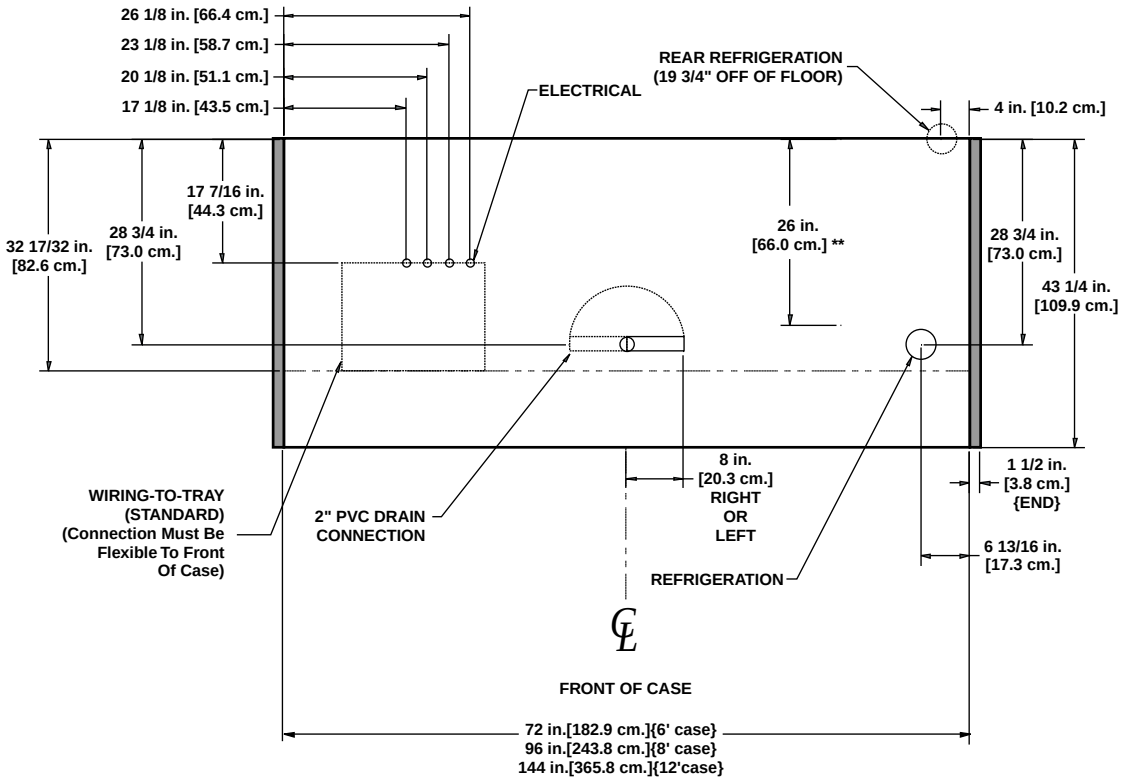

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 5/8"

Multi-Deck Rear Load Dairy Merchandisers

O5DR - 8' & 12' rear load dairy

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
O5DR	8'	4	2.00	120	1.20	56	- - -[1]	- - -	- - -	- - -	- - -	- - -
	12'	5	2.50	150	1.50	70	- - -	- - -	- - -	- - -	- - -	- - -

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
O5DR	8'	0.48	58	4.56	552
	12'	0.70	83	6.76	812

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
O5DR	18"	1502	17	32	36	47	275
	21"	1502	17	32	36	46	275
	23"	1453	17	32	35	42	275
	26"	1425	17	32	35	42	275
O5DR	18"	1389	22	35	37	48	275
	21"	1422	22	35	37	47	275

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O5DR	4	- - -	- - -	45	47	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

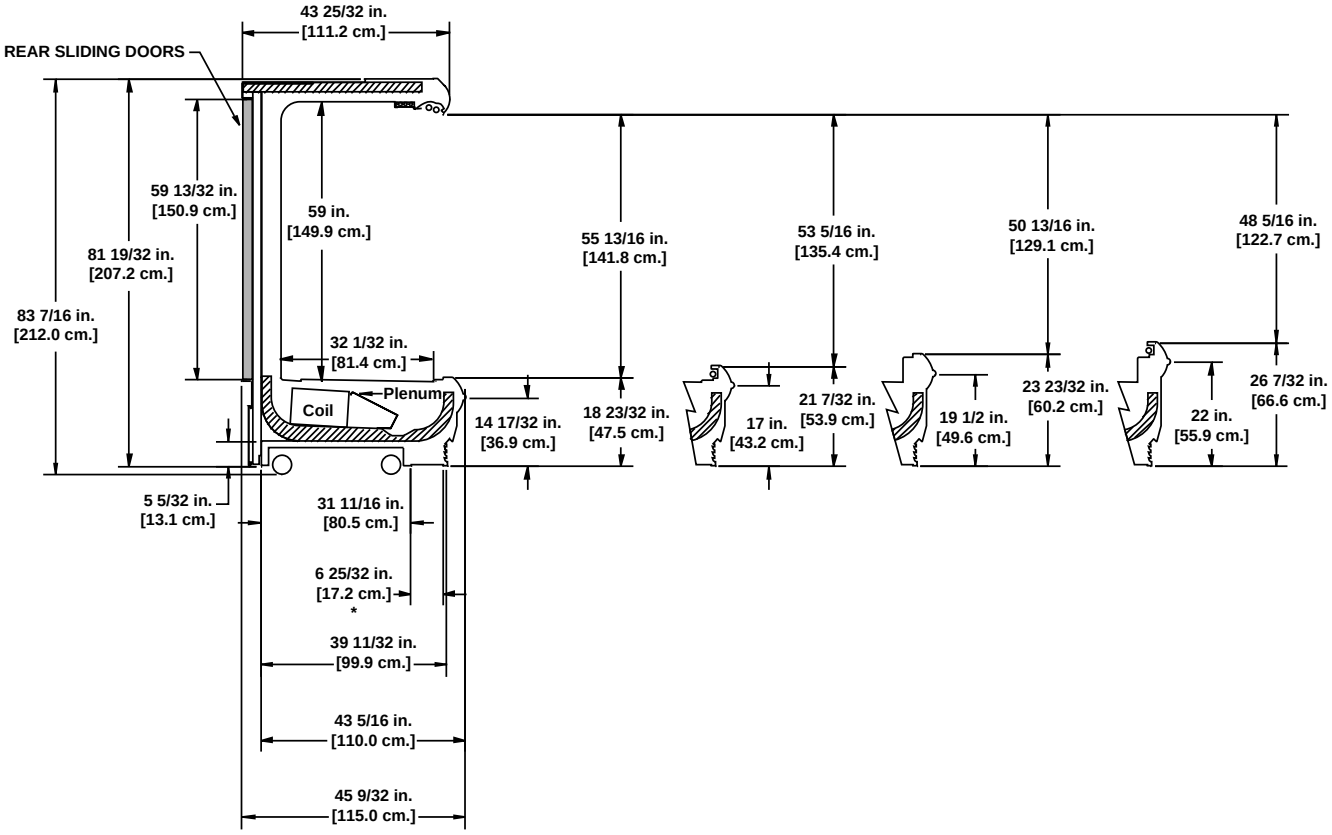

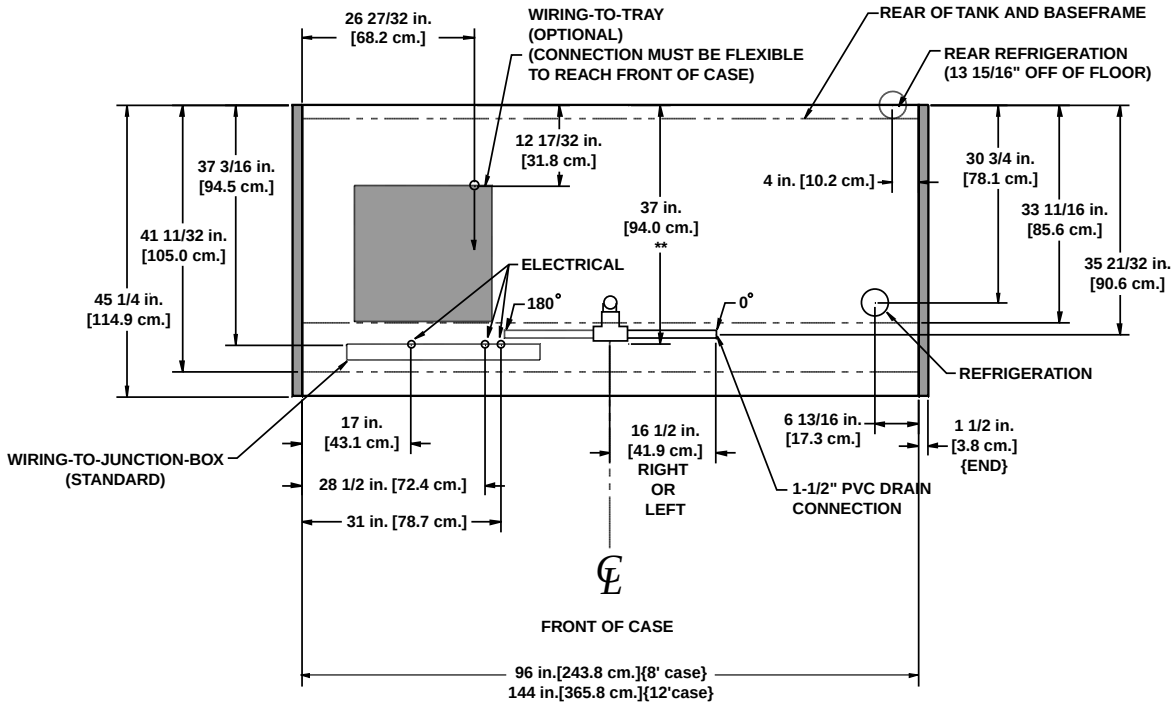

NOTE:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

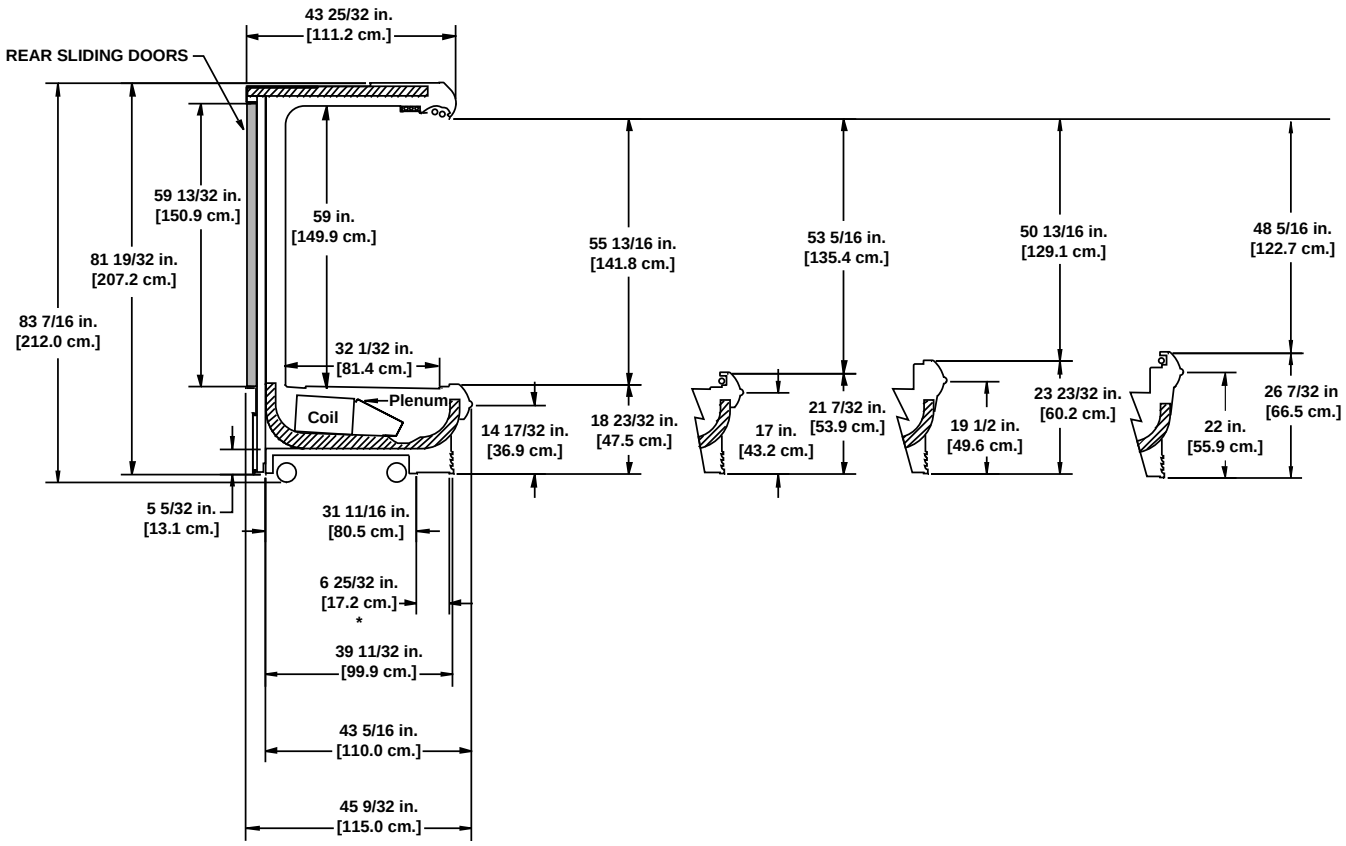

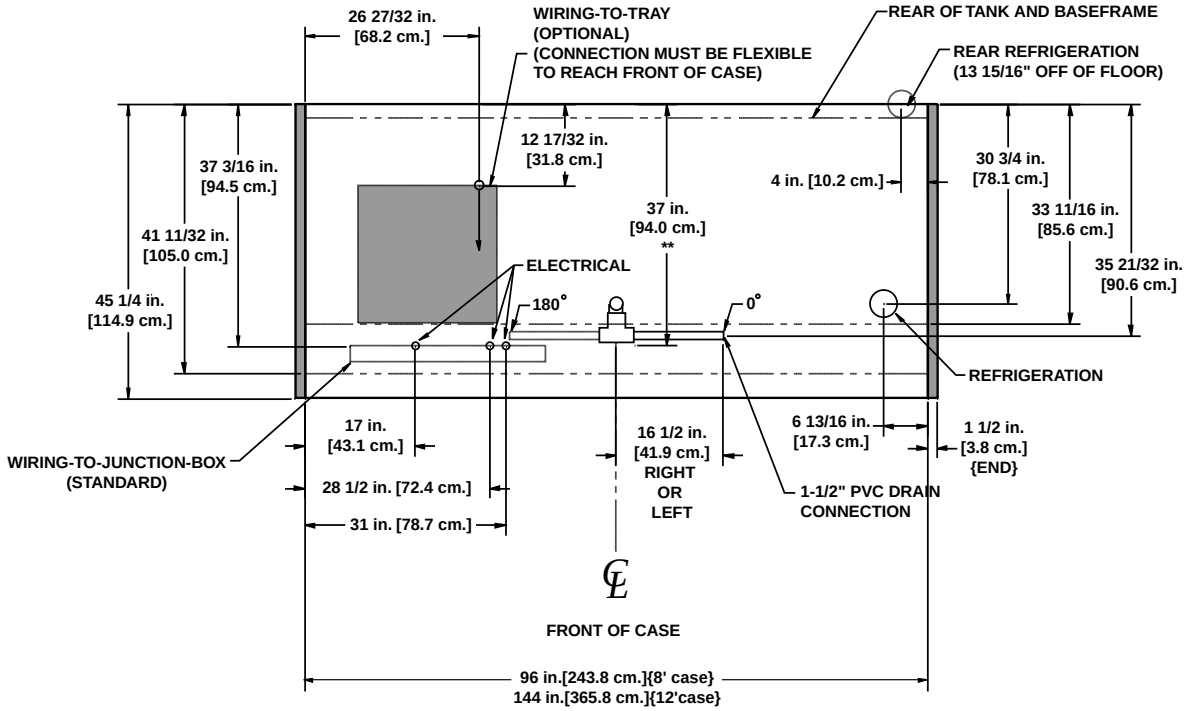

NOTE:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Multi-Deck Dairy/Deli/Produce Merchandisers

O5DM - 4', 6', 8', & 12' dairy/deli/produce

Electrical Data

Model		Fans per Case	Standard Fan 120 Volts Amps	Standard Fan 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
O5DM	4'	2	1.00	60	1.00	34	- - -[1]	- - -	1.92	400	2.22	532
	6'	2	1.00	60	1.00	34	- - -	- - -	2.88	600	3.33	798
	8'	3	1.50	90	1.50	51	- - -	- - -	3.85	800	4.44	1065
	12'	4	2.00	120	2.00	69	- - -	- - -	5.78	1200	6.67	1600

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
O5DM	4'	0.57	68	3.55	426
	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
O5DM Deli w/ Shelf Lights	21"	1570	17	30	35	44	250
	23"	1530	17	30	34	44	250
	26"	1500	17	30	33	44	250
O5DM Dairy Cut Produce w/ Shelf Lights	18"	1500	22	34	37	47	265
	21"	1460	22	34	36	47	265
	23"	1430	22	34	36	47	265
	26"	1400	22	34	36	47	265
O5DM Beverage Bulk Produce w/o Shelf Lights	18"	1490	27	36	39	52	250
	21"	1450	27	36	38	52	250
	23"	1420	27	36	38	52	250
	26"	1390	27	36	38	52	250

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O5DM Deli/Dairy/Produce	3	32	47	42	44	26	47	42	52

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

All measurements are taken per CRMA specifications.

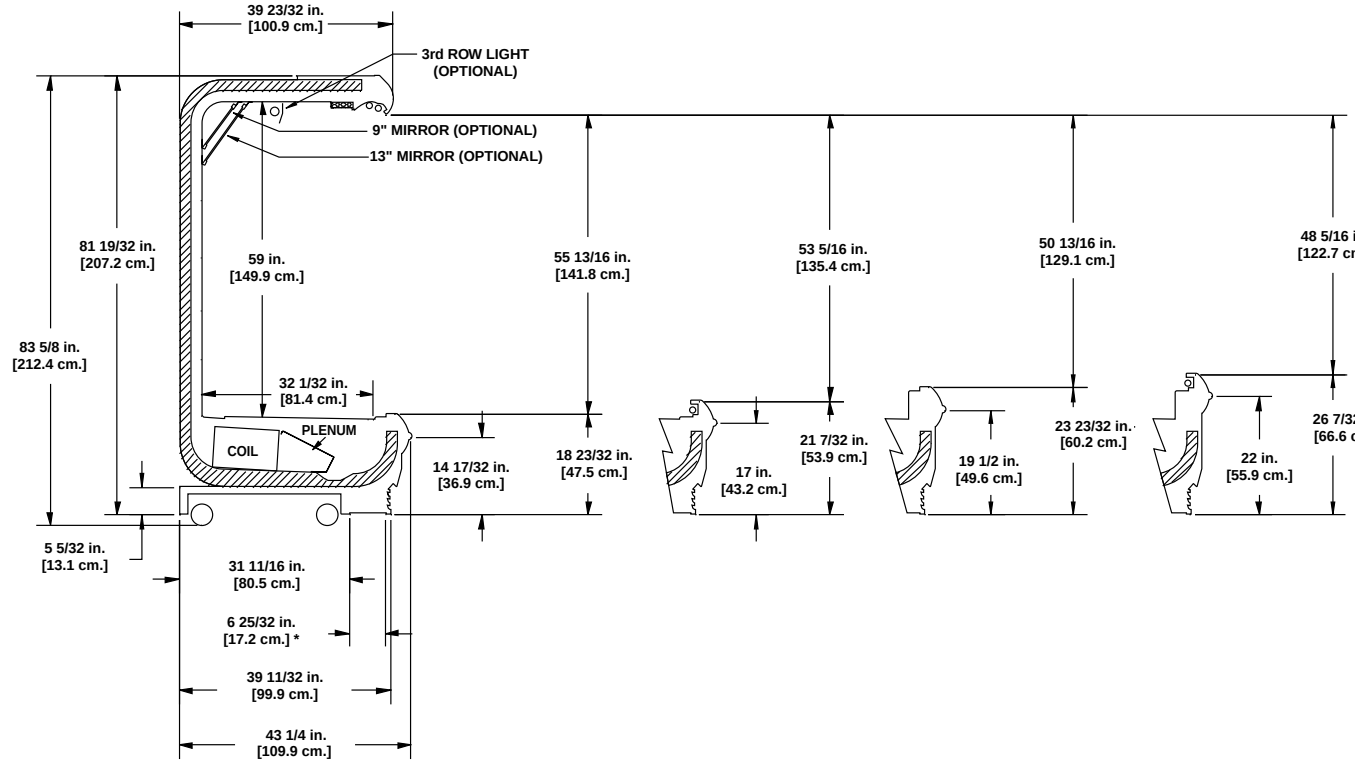

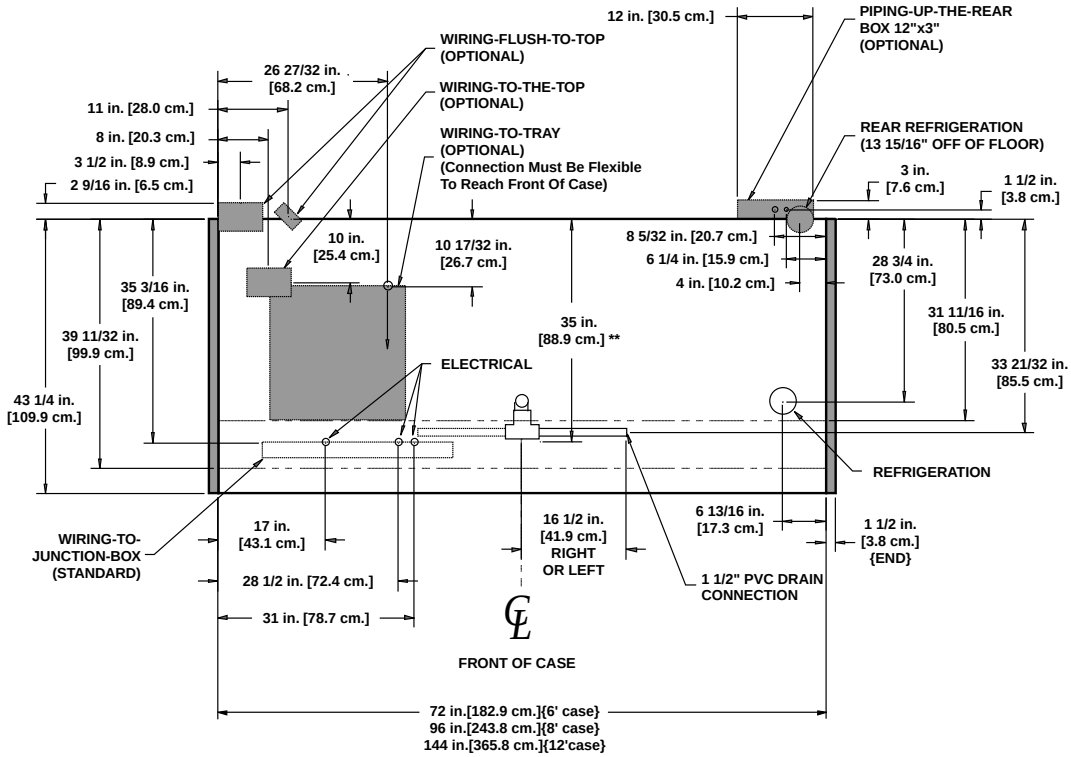

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

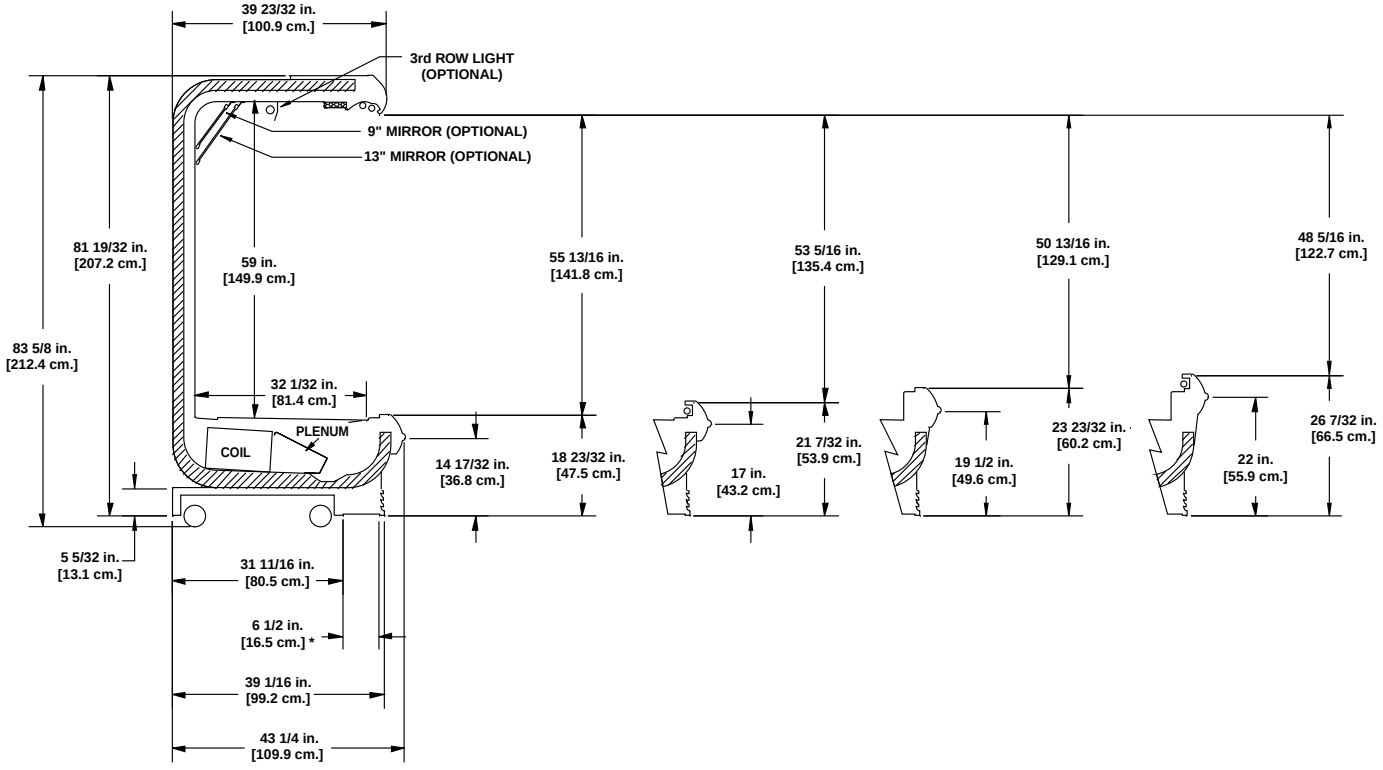

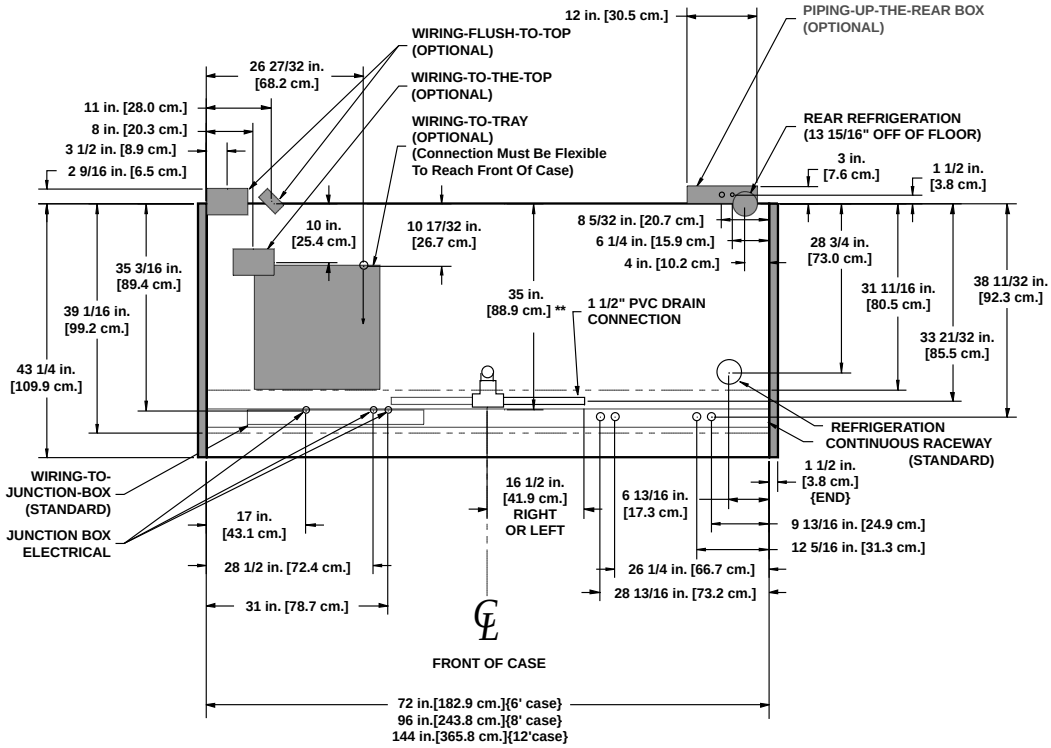

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

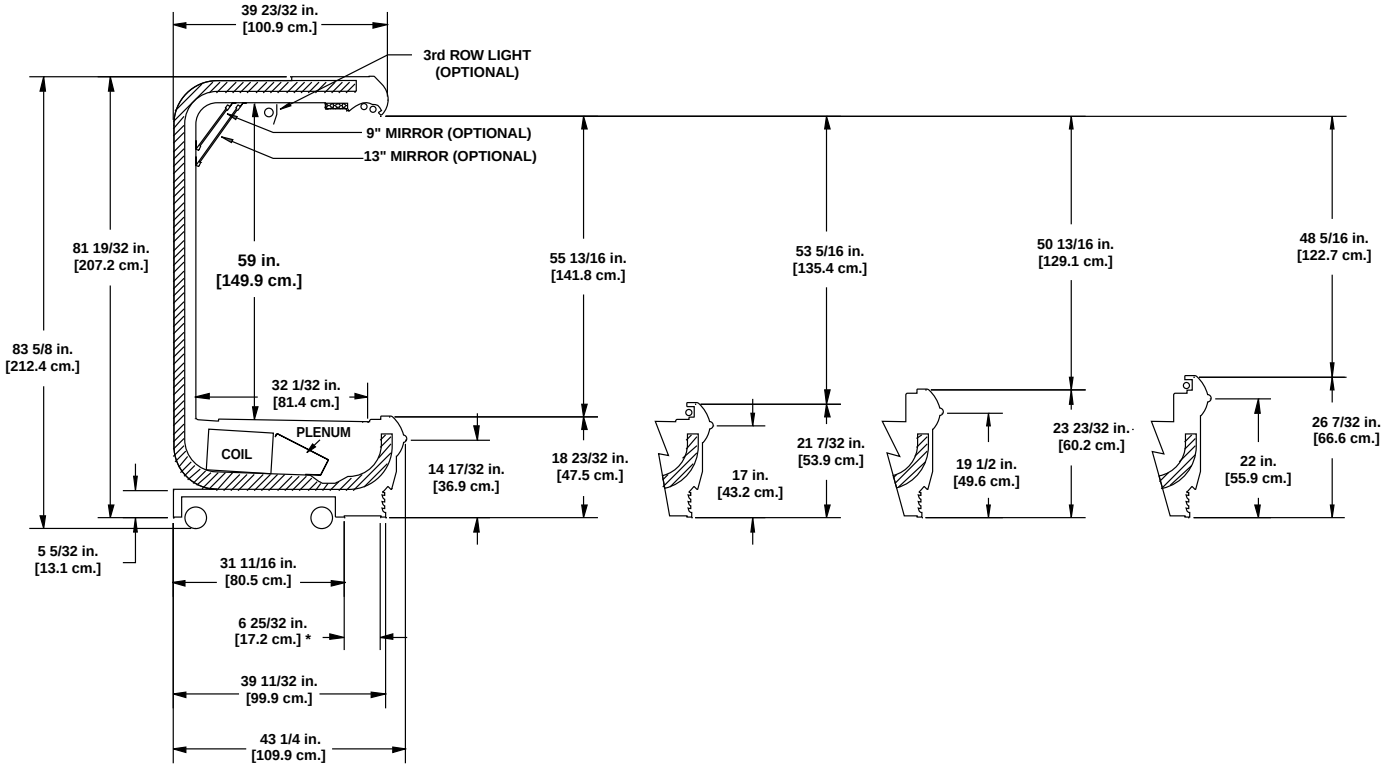

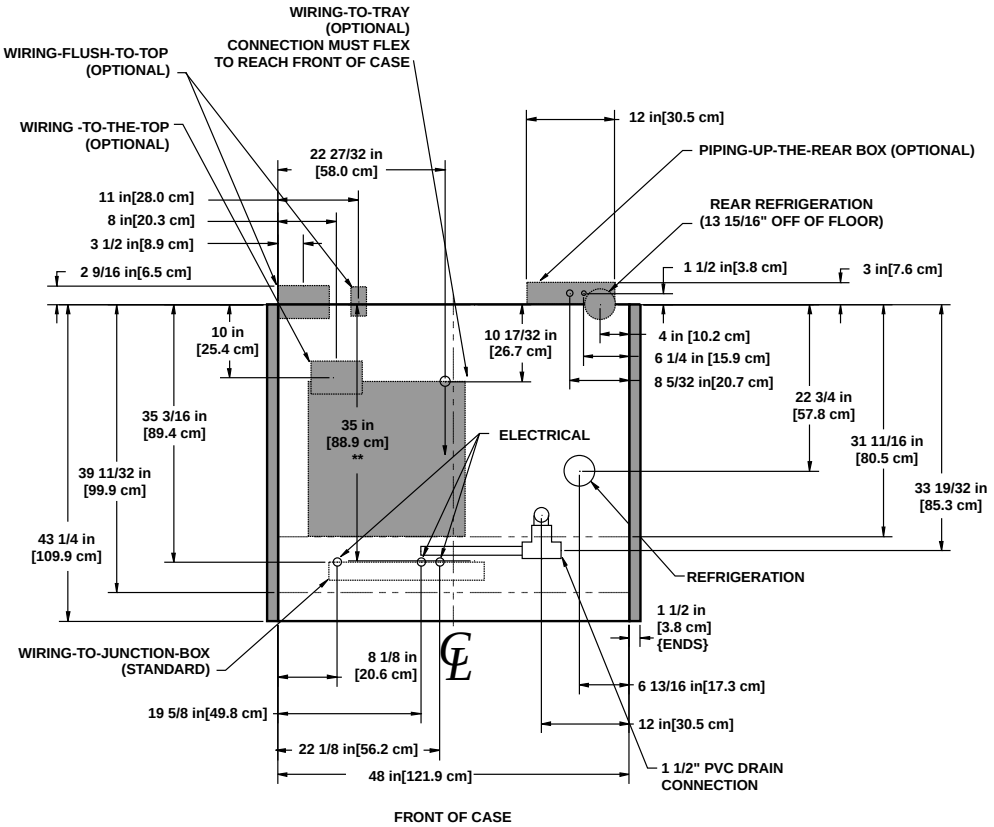

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE 7/8", LIQUID LINE - 5/8"**

O5DM-4'

(CURVED FRONT PANEL)

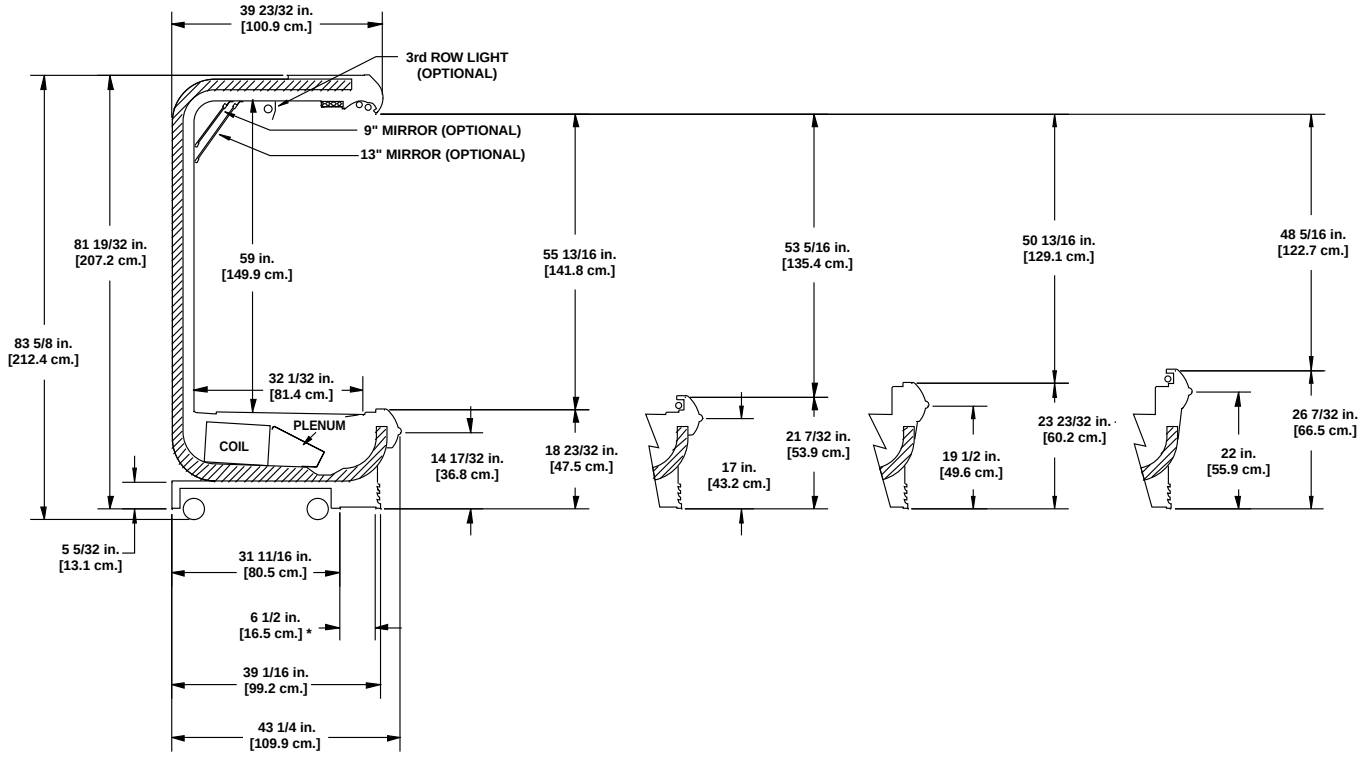

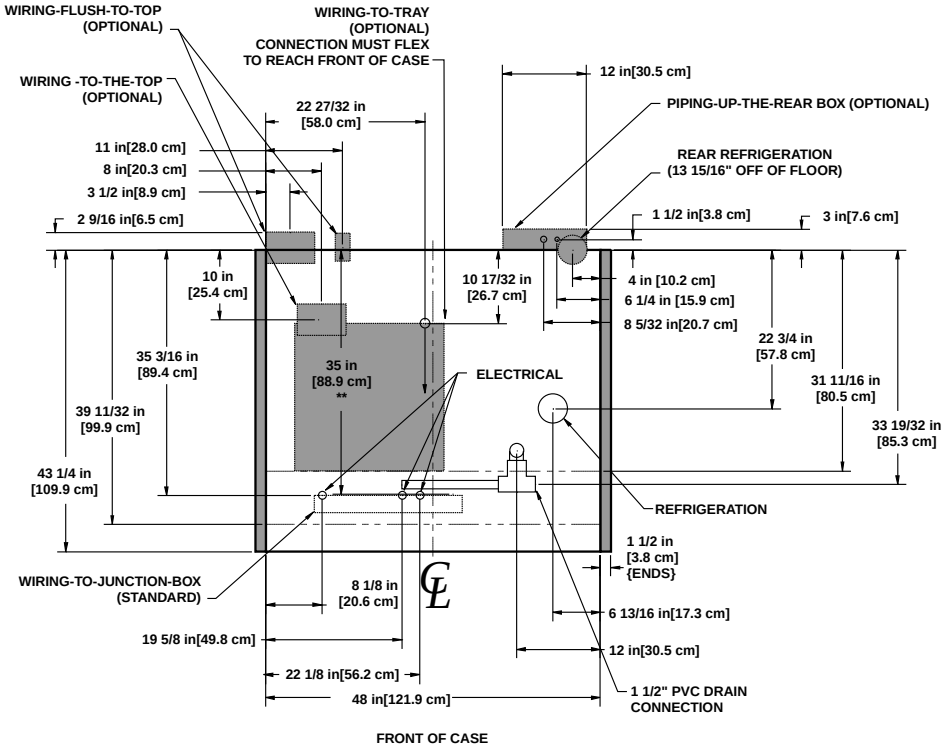

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

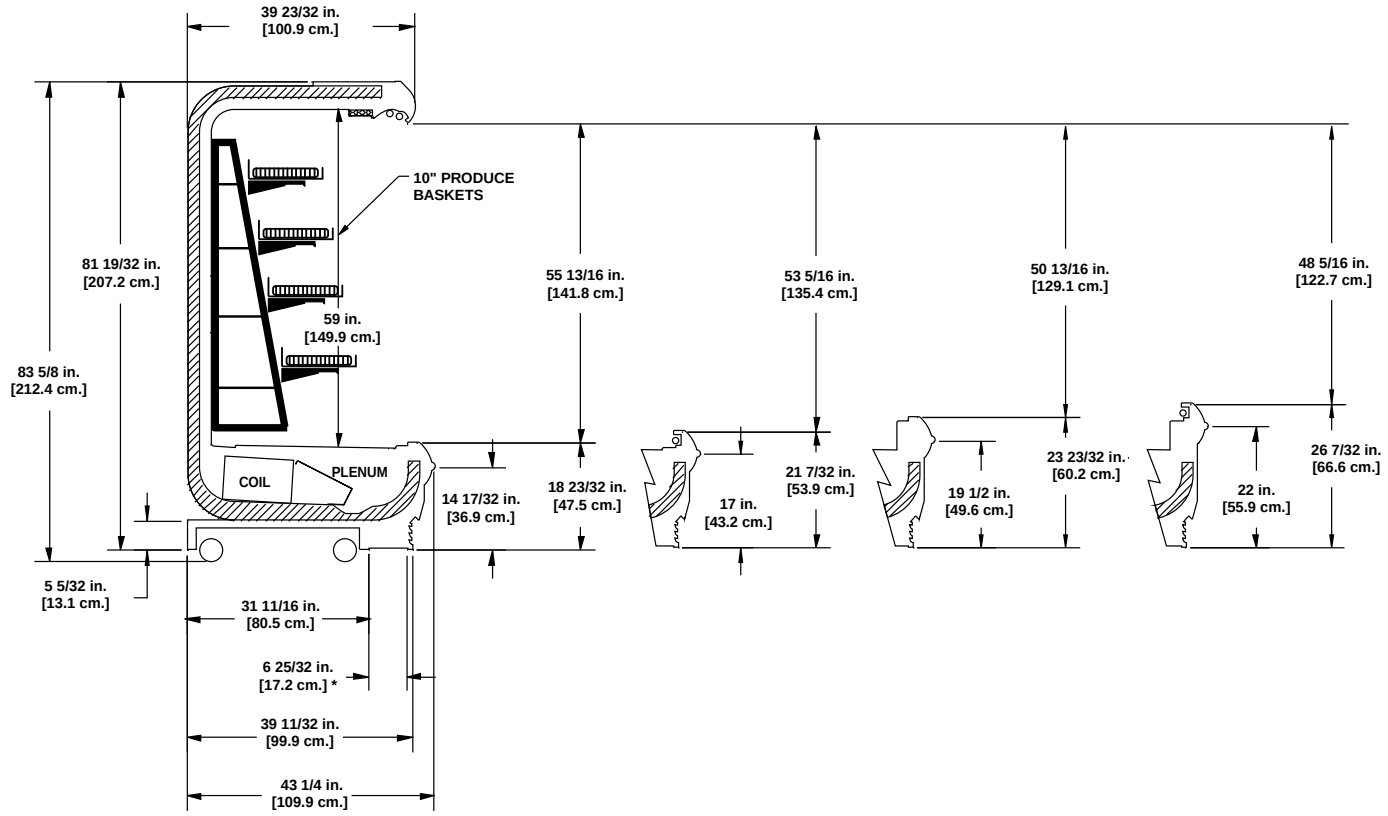

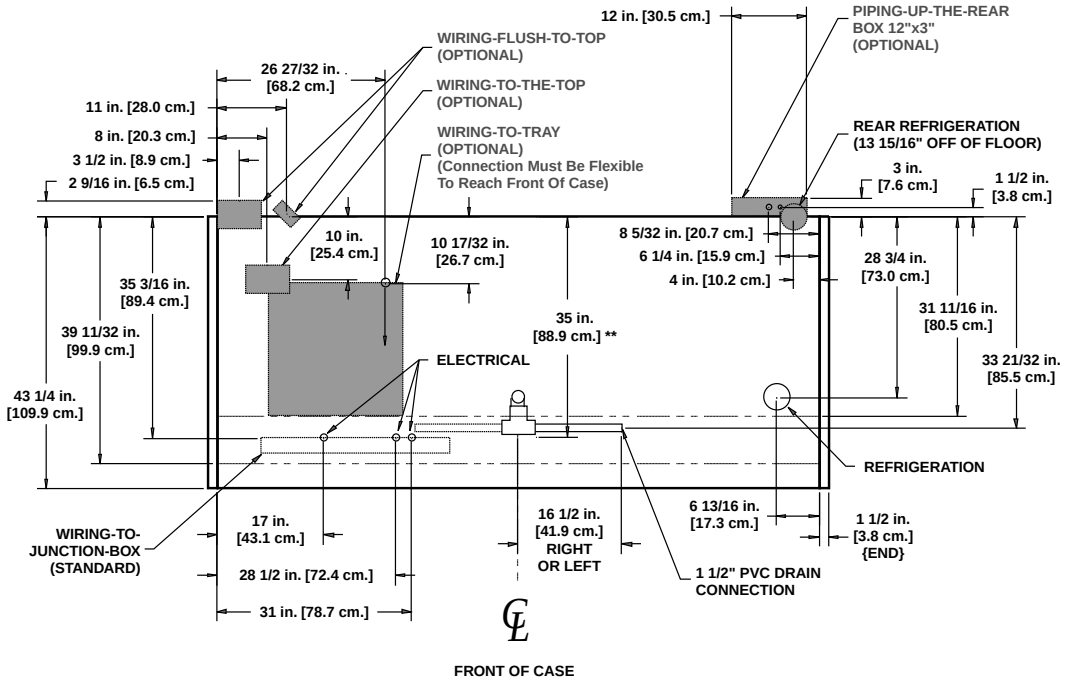

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Narrow Multi-Deck Dairy Merchandisers

ON5DM - 6', 8', & 12' narrow dairy

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
ON5DM Non-lighted Fronts/ Lighted Fronts	6'	3	1.50	90	1.50	51	- - -[1]	- - -	2.88	600	3.33	798
	8'	4	2.00	120	2.00	69	- - -	- - -	3.85	800	4.44	1065
	12'	5	2.50	150	2.50	85	- - -	- - -	5.77	1200	6.67	1600

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
ON5DM	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
ON5DM	18"	1815	17	32	35	47	215
	27"	1685	17	31	33	40	215

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
ON5DM	4	32	47	42	44	26	47	42	52

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

All measurements are taken per CRMA specifications.

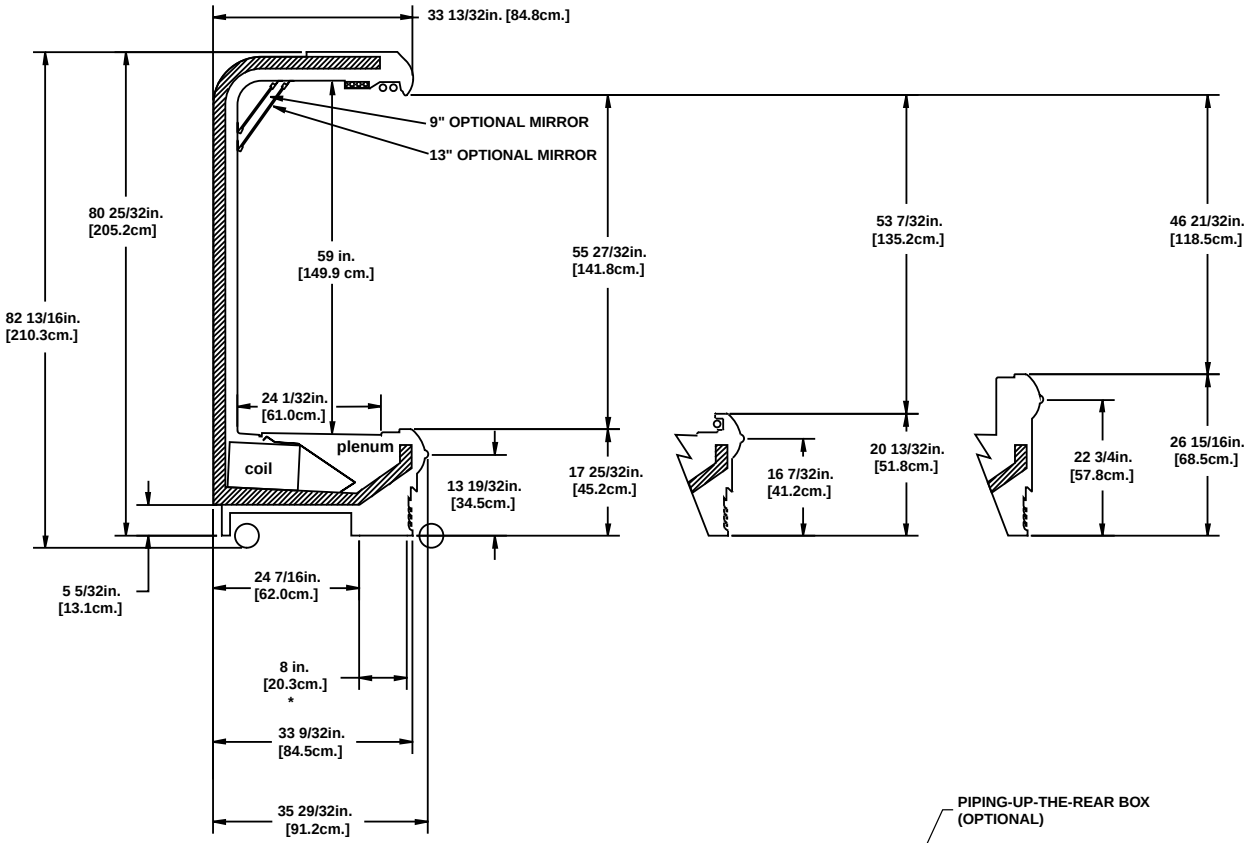

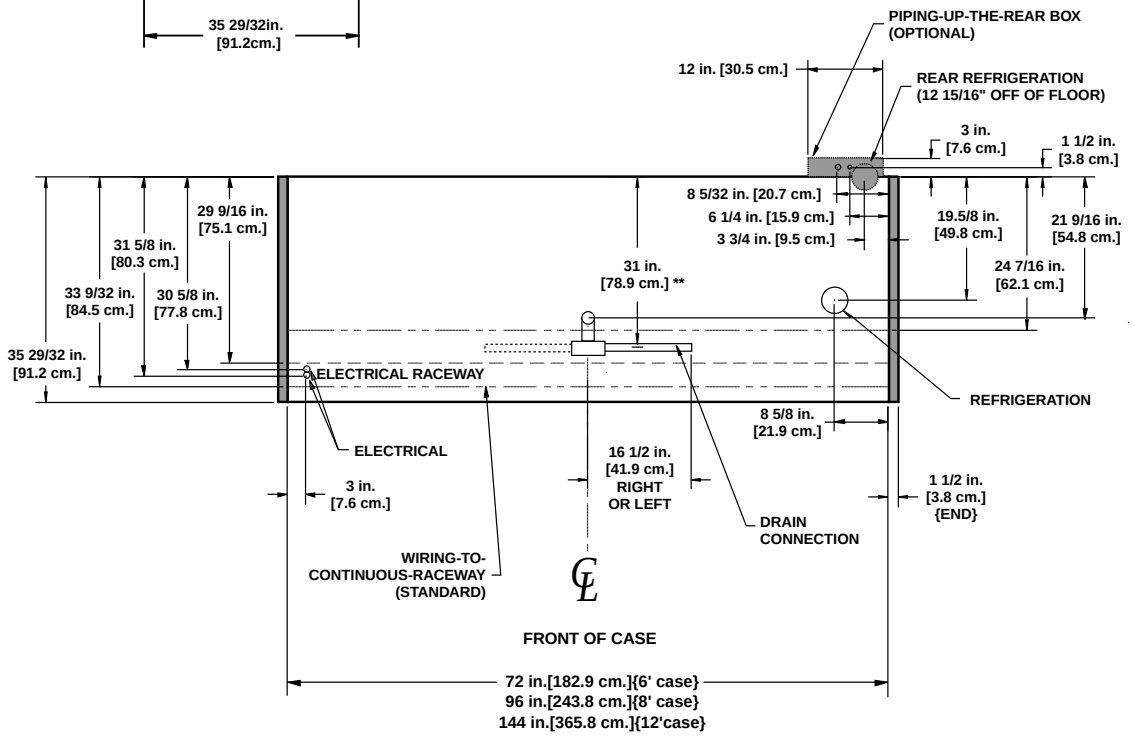

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE 7/8", LIQUID LINE - 5/8"**

Multi-Deck Frozen Food Merchandisers

O5Z - 6', 8', & 12' frozen food

Electrical Data

		Fans per Case				Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate[2] Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
		Pri.[1]	Sec.	Amb.	Total	Amps	Watts	Amps	Watts	Amps	Watts	Amps[3]	Watts	Amps[3]	Watts
O5Z	6'	4	2	2	8	4.56	280	2.04	187	2.25	270	10.00	3600	11.50	4794
	8'	5	3	2	10	5.70	352	2.55	233	3.10	344	13.30	4800	15.40	6390
	12'	7	4	3	14	7.98	490	3.57	327	4.68	562	20.00	7200	23.00	9585

[1] Pri.=Primary, Sec.=Secondary, Amb.=Ambient

[2] Cases equipped with windowed ends add 1.85 amps per end.

[3] 3 phase load. Figure given is maximum amps per phase.

Lighting Data

		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watt	Amps	Watts
O5Z	6'	0.57	68	1.71	205
	8'	0.57	68	1.71	205
	12'	0.77	92	2.31	277

Air Defrost Option

		Defrost Heaters 120 Volts	
		Amps	Watts
O5Z	6'	---[4]	---
	8'	6.69	803
	12'	9.20	1104

[4] NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft[5]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[6] (FPM) Pri.	Sec.	Amb.
O5Z	1840	-18	-5	0	0	650	425	275

[5] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[6] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O5Z	2	34	50	---	---	24	47	50	50

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

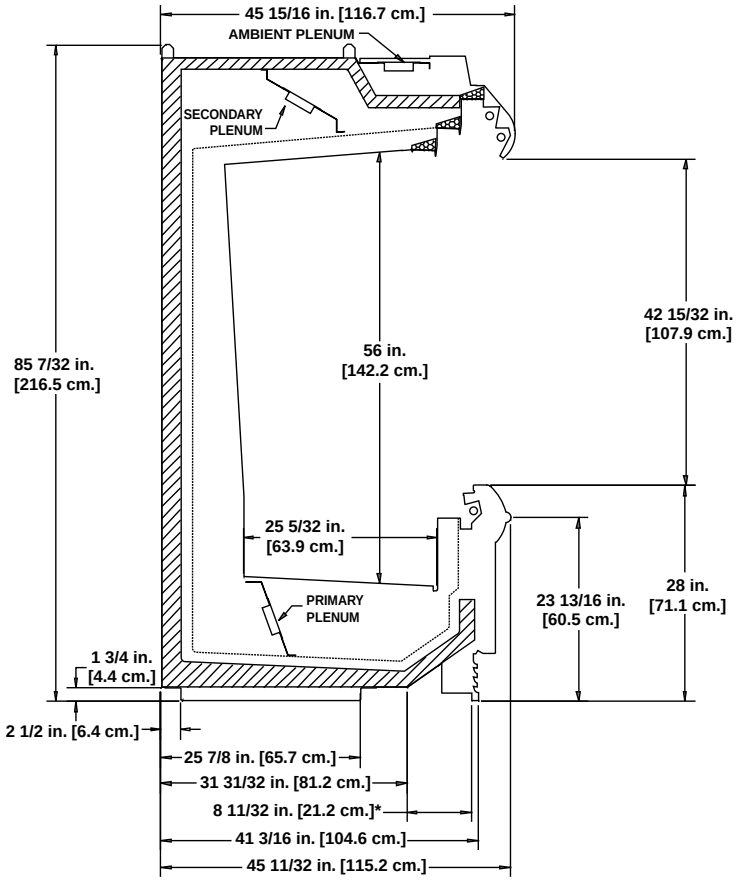
45 15/16 in. [116.7 cm.]
AMBIENT PLENUM
SECONDARY PLENUM
85 7/32 in. [216.5 cm.]
56 in. [142.2 cm.]
42 15/32 in. [107.9 cm.]
25 5/32 in. [63.9 cm.]
PRIMARY PLENUM
23 13/16 in. [60.5 cm.]
28 in. [71.1 cm.]
1 3/4 in. [4.4 cm.]
2 1/2 in. [6.4 cm.]
25 7/8 in. [65.7 cm.]
31 31/32 in. [81.2 cm.]
8 11/32 in. [21.2 cm.]*
41 3/16 in. [104.6 cm.]
45 11/32 in. [115.2 cm.]

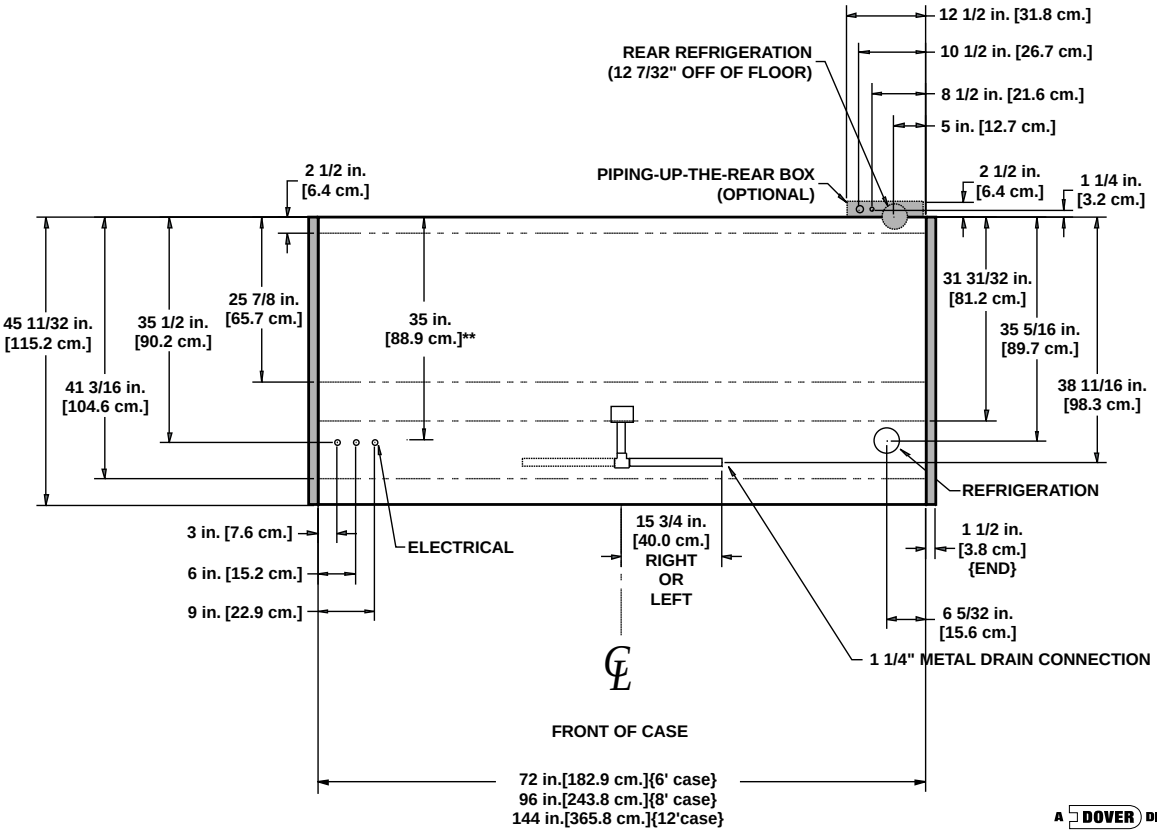
12 1/2 in. [31.8 cm.]
10 1/2 in. [26.7 cm.]
8 1/2 in. [21.6 cm.]
5 in. [12.7 cm.]
REAR REFRIGERATION (12 7/32" OFF OF FLOOR)
PIPING-UP-THE-REAR BOX (OPTIONAL)
2 1/2 in. [6.4 cm.]
2 1/2 in. [6.4 cm.]
1 1/4 in. [3.2 cm.]
45 11/32 in. [115.2 cm.]
35 1/2 in. [90.2 cm.]
25 7/8 in. [65.7 cm.]
35 in. [88.9 cm.]**
41 3/16 in. [104.6 cm.]
31 31/32 in. [81.2 cm.]
35 5/16 in. [89.7 cm.]
38 11/16 in. [98.3 cm.]
REFRIGERATION
3 in. [7.6 cm.]
6 in. [15.2 cm.]
9 in. [22.9 cm.]
ELECTRICAL
15 3/4 in. [40.0 cm.] RIGHT OR LEFT
1 1/2 in. [3.8 cm.] {END}
6 5/32 in. [15.6 cm.]
1 1/4" METAL DRAIN CONNECTION
FRONT OF CASE
72 in.[182.9 cm.]{6' case}
96 in.[243.8 cm.]{8' case}
144 in.[365.8 cm.]{12'case}

Multi-Deck Meat Merchandisers

OHM - 6', 8', & 12' high meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OHM	6'	2	1.00	60	1.00	34	0.40	48	2.88	600	3.33	798
	8'	3	1.50	90	1.50	51	0.58	70	3.85	800	4.44	1065
	12'	4	2.00	120	2.00	69	0.83	100	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OHM	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OHM Deli	27"	1448	17	28	35	40	350
OHM Fresh Meat	27"	1475	12	28	33	40	350
	31" & 33"	1341	17	28	34	40	350

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OHM	3	35	47	45	42	26	39	45	55

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

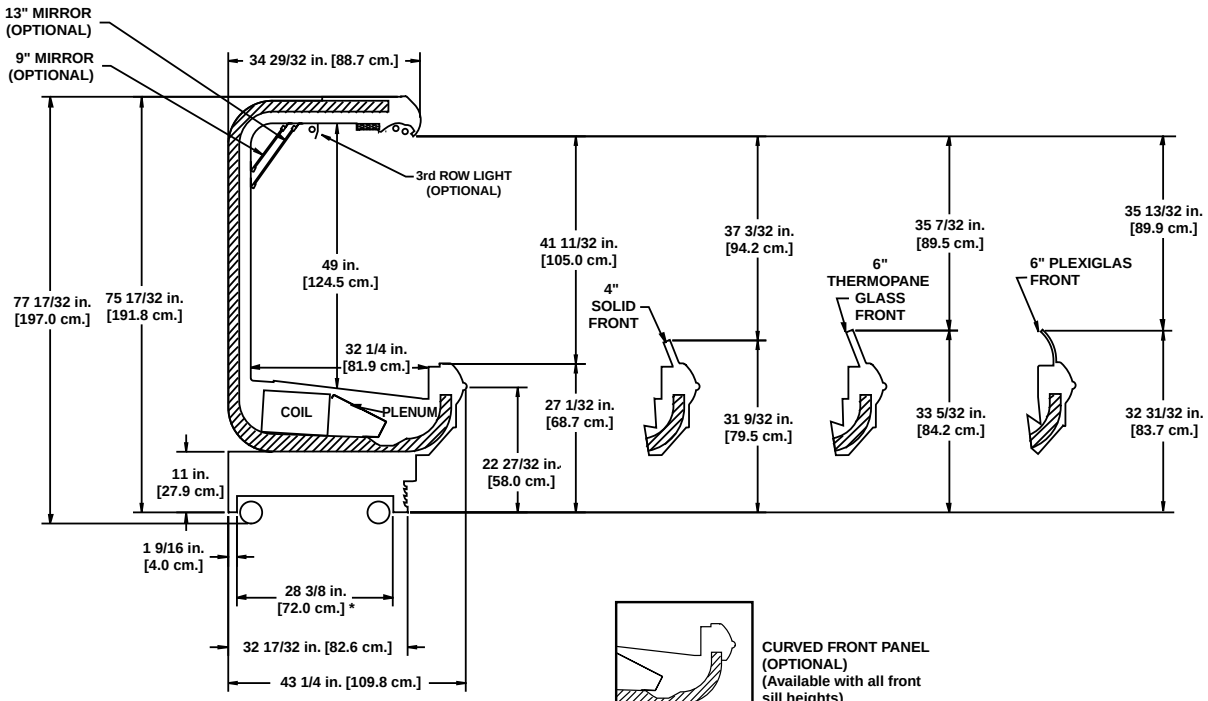

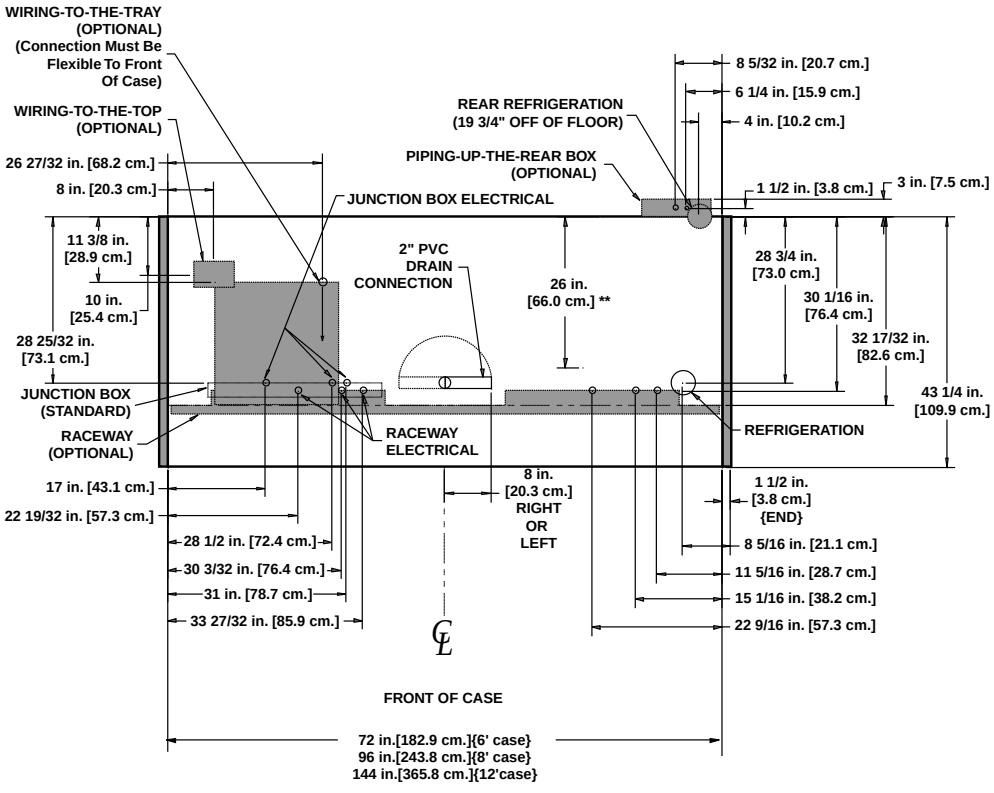

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Narrow Multi-Deck Meat Merchandisers

ONHM - 6', 8', & 12' narrow high meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
ONHM	6'	3	1.50	90	1.50	51	- - -[1]	- - -	2.88	600	3.33	798
	8'	4	2.00	120	2.00	69	- - -	- - -	3.85	800	4.44	1065
	12'	5	2.50	150	2.50	85	- - -	- - -	5.77	1200	6.67	1600

[1] NOTE: --- not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
ONHM	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
ONHM Deli	27"	1325	17	30	35	38	390
ONHM Fresh Meat	31" & 33"	1225	17	30	35	38	390

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
ONHM	3	35	47	45	42	26	39	45	55

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

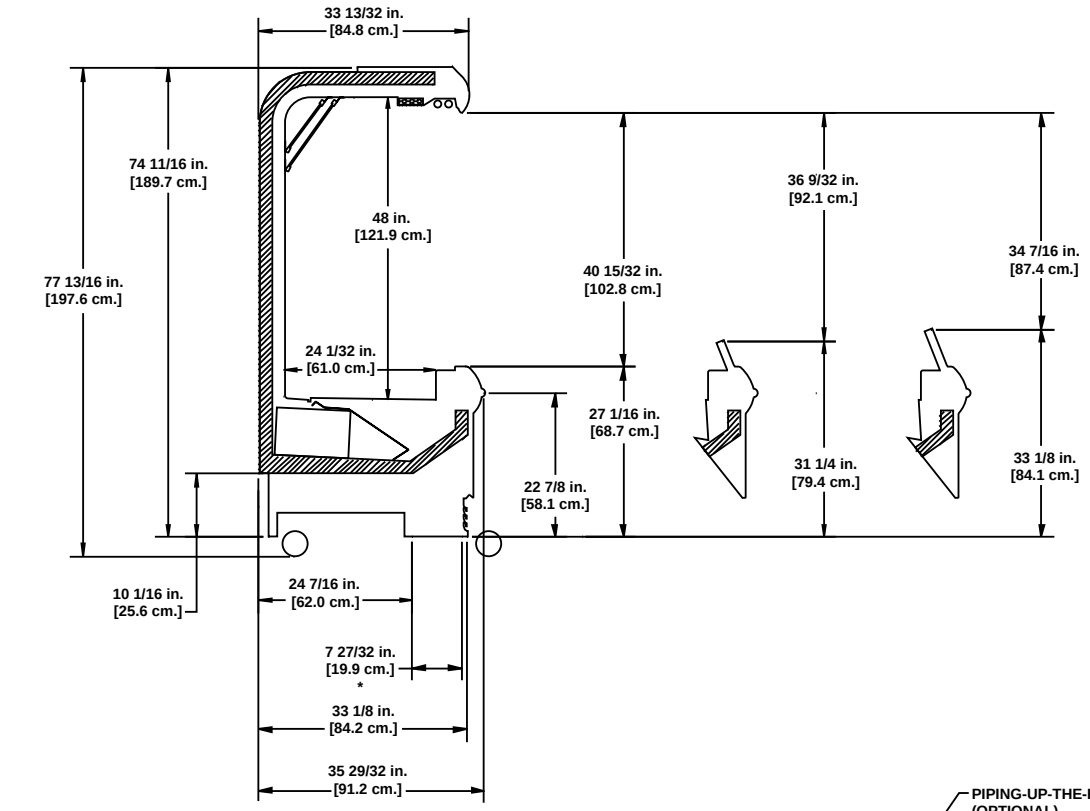

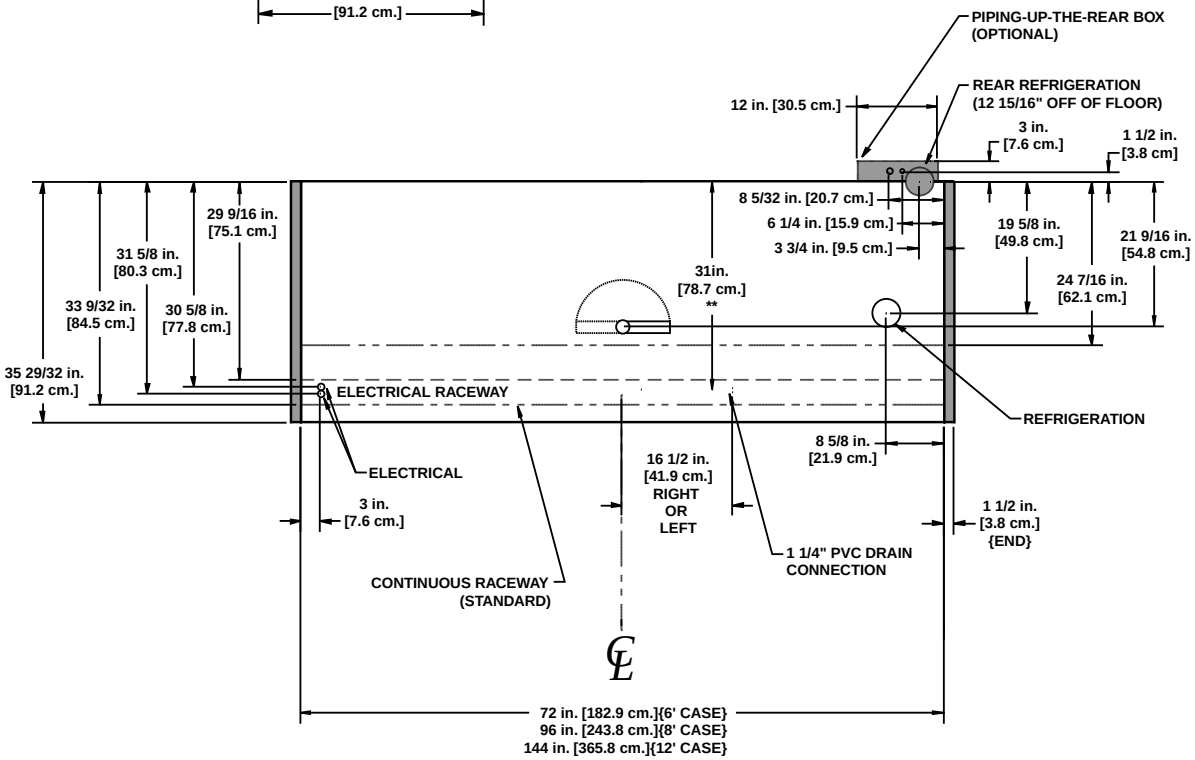

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

High Multi-Deck Meat Merchandisers

OHMH- 6', 8', & 12' high meat

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OHMH	6'	3	1.50	90	0.90	60	0.80	96	2.88	600	3.33	798
	8'	4	2.00	120	1.20	80	1.15	138	3.85	800	4.44	1065
	12'	5	2.50	150	1.50	100	1.67	200	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OHMH	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OHMH Deli	27"	1600	12	28	33	37	330
OHMH Fresh Meat	31" & 33"	1500	12	28	33	37	330

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OHMH	4	32	47	44	42	26	39	44	55

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

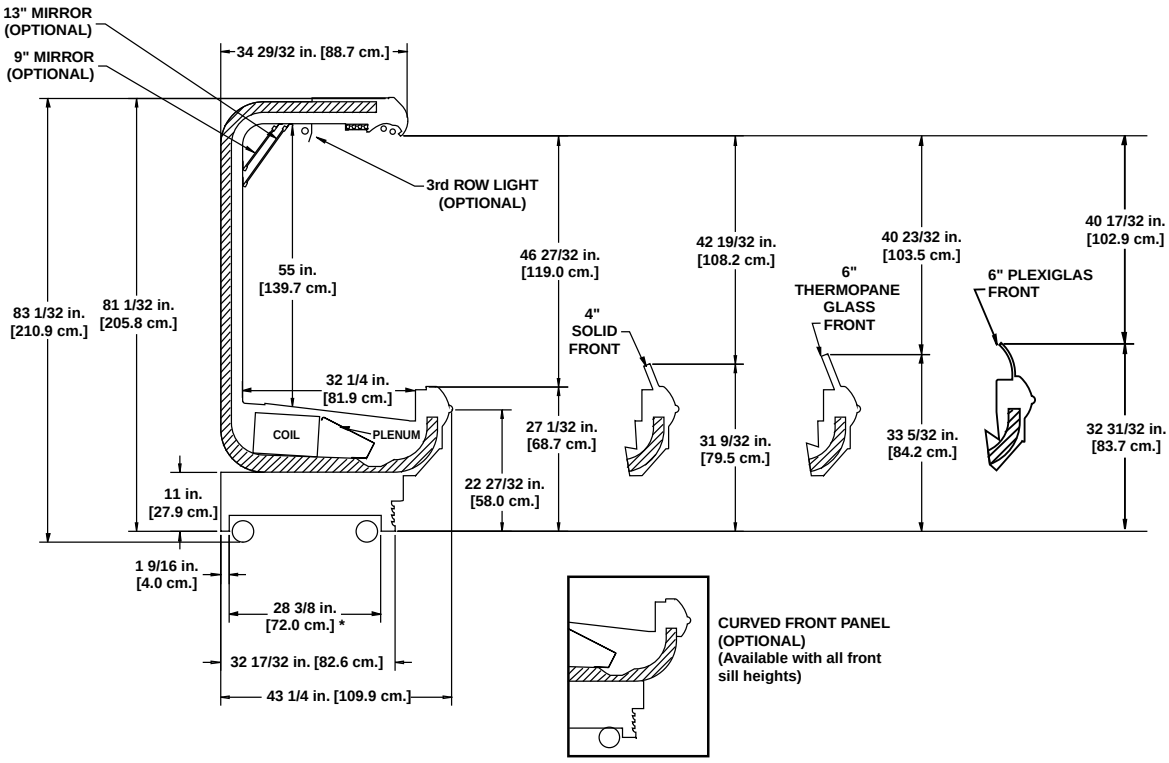

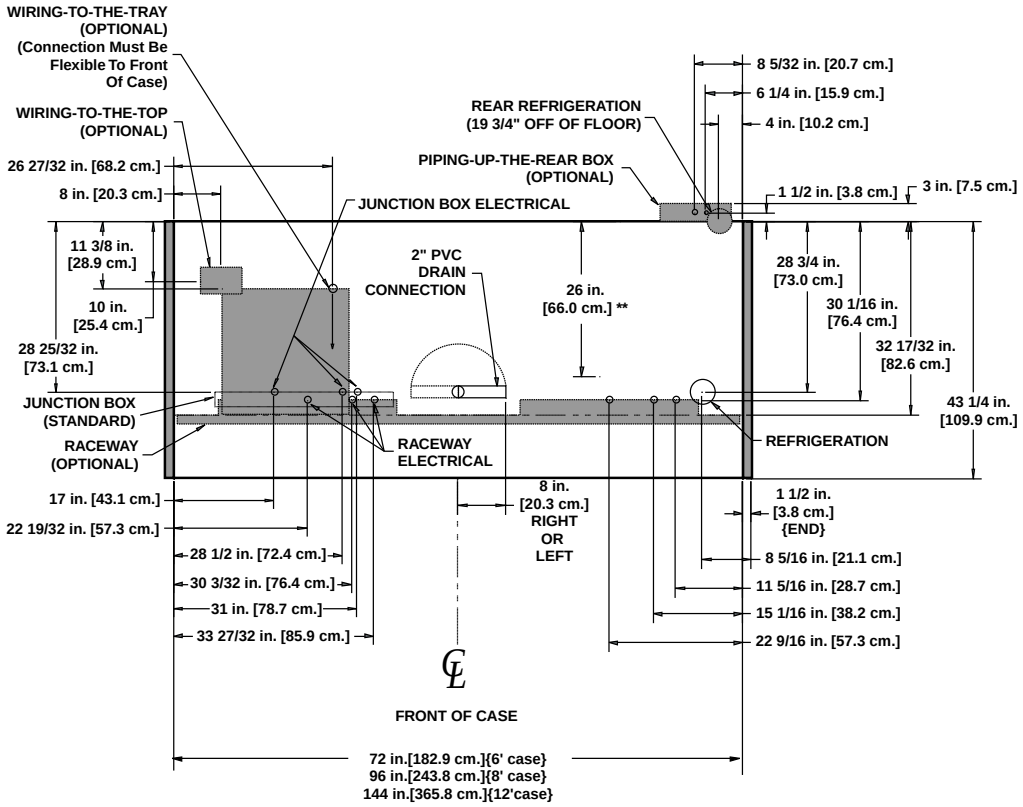

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)**
- **BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE**
- **SUCTION LINE 7/8", LIQUID LINE - 5/8"**

Multi-Deck Produce Merchandisers

OHP - 6', 8', & 12' high produce

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters[1] 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OHP	6'	2	1.00	60	0.64	34	0.40	48	2.88	600	3.33	798
	8'	3	1.50	90	0.96	51	0.58	70	3.85	800	4.44	1065
	12'	4	2.00	120	1.28	69	0.83	100	5.77	1200	6.67	1600

[1] Anti-condensate heater data for reduced (cut produce) temperature option only.

Lighting Data

Model		Typical per Light Row 120 Volts		Maximum Lighting 120 Volts	
		Amps	Watts	Amps	Watts
OHP	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
OHP Standard Temp.	27"	855	27	36	46	48	250
OHP Reduced Temp.	27"	1215	22	31	38	45	440

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OHP Standard Temp.	2	- - -[4]	- - -	56	40	- - -	- - -	56	40
OHP Reduced Temp.	3	24	48	30	48	20	39	30	48

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

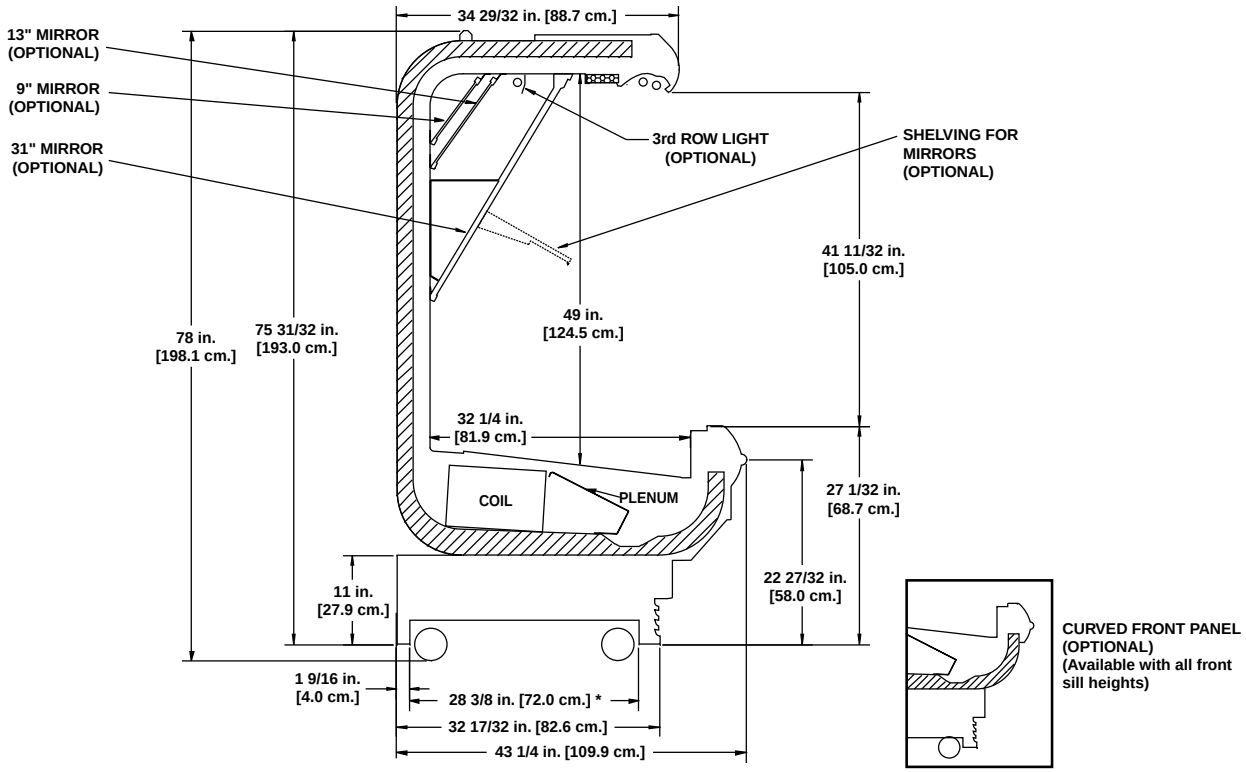

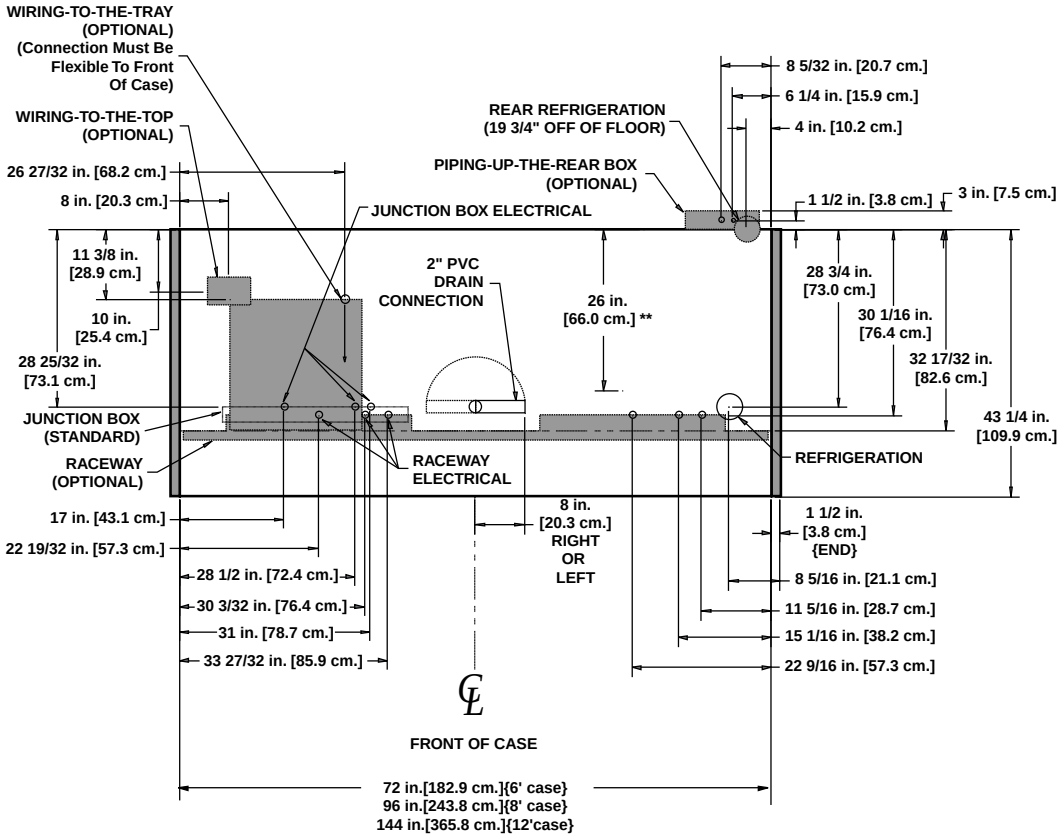

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

High Multi-Deck Produce Merchandisers

OHPH- 6', 8', & 12' high produce

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OHPH	6'	3	1.50	90	0.90	60	0.80	96	2.88	600	3.33	798
	8'	4	2.00	120	1.20	80	1.15	138	3.85	800	4.44	1065
	12'	5	2.50	150	1.50	100	1.67	200	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OHPH	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OHPH	27"	1460	17	30	37	45	315

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OHPH	3	35	52	50	50	26	39	50	50

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

All measurements are taken per CRMA specifications.

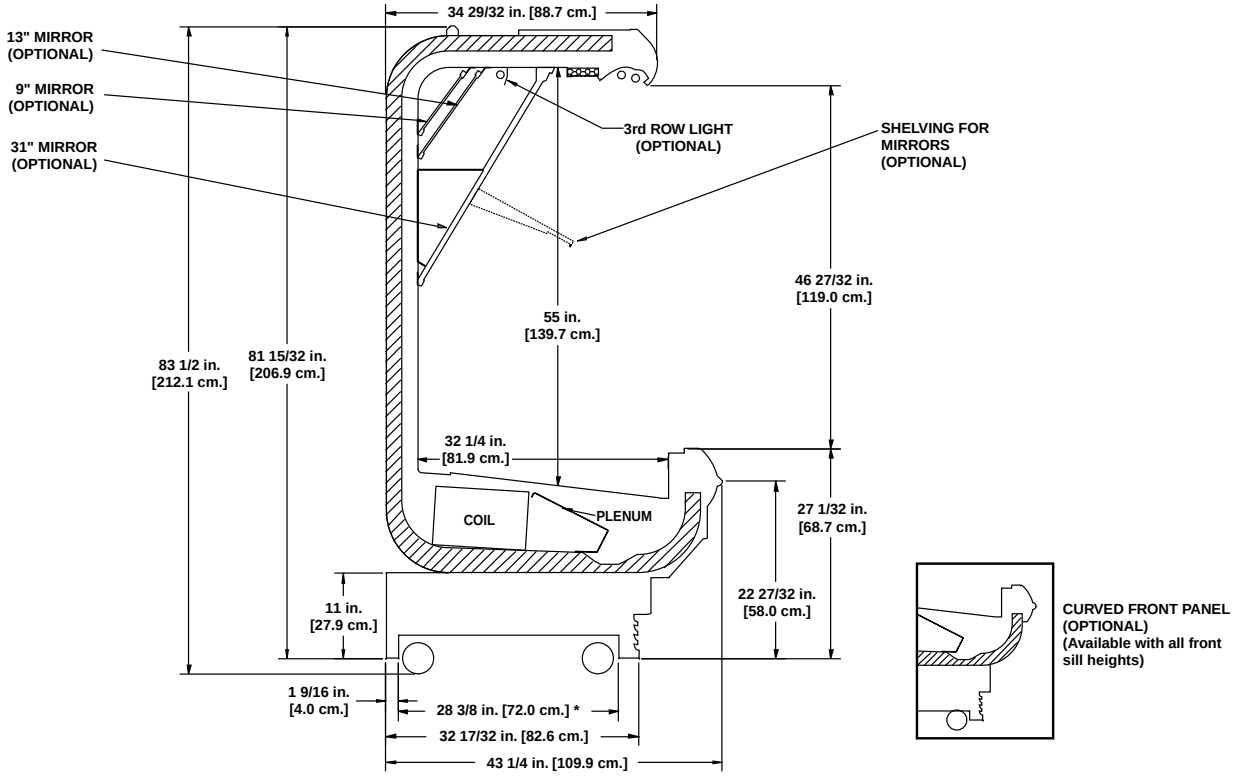

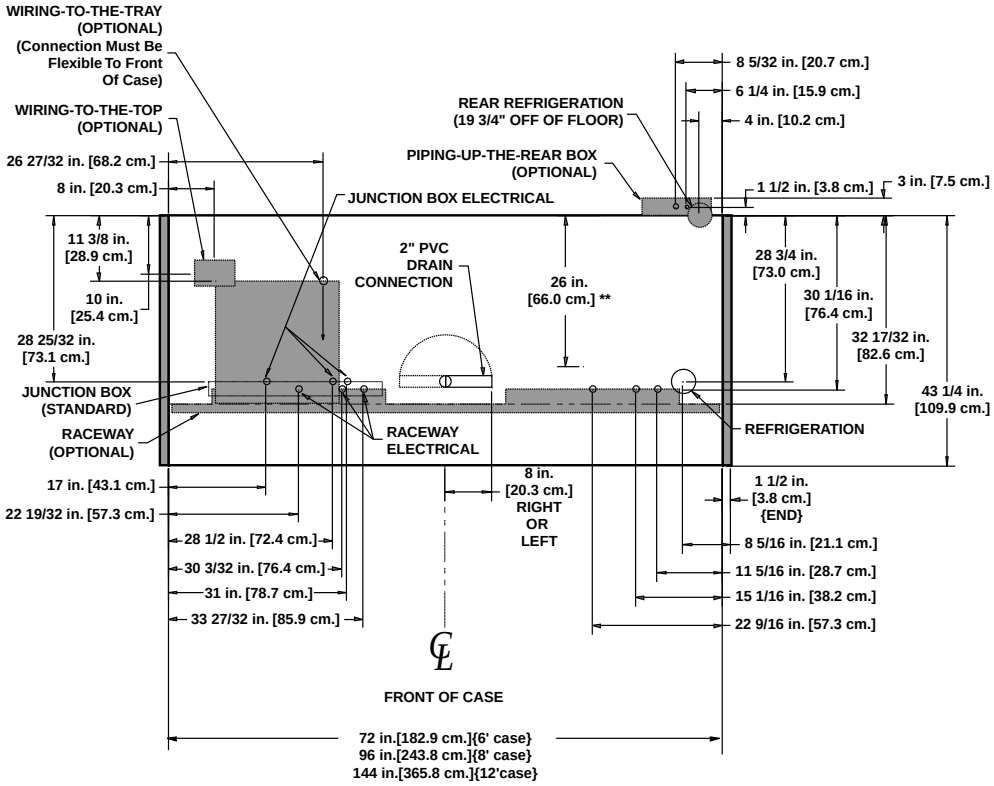

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Reach-in Door Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

Glass Door Reach-in Beverage Merchandisers

ORB - 2, 3, 4, & 5-door reach in beverage

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps[1]	Watts	Amps	Watts
ORB	2-door	2	1.00	60	1.00	34	2.40	288	4.39	914	5.06	1215
	3-door	3	1.50	90	1.50	51	3.28	394	4.96	1032	5.71	1370
	4-door	4	2.00	120	2.00	69	4.33	520	6.51	1355	7.55	1813
	5-door	5	2.50	150	2.50	86	5.30	636	7.96	1655	9.17	2201

Lighting Data

		Standard Lighting		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watt	Amps	Watts
ORB	2-door	NA[1]	NA	NA	NA	1.45	174
	3-door	NA	NA	NA	NA	1.94	233
	4-door	NA	NA	NA	NA	2.42	290
	5-door	NA	NA	NA	NA	2.91	349

[1] Not applicable.

Guidelines & Control Settings

Model	BTUH/door[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
ORB 1-door	900	22	27	39	30	280

[2] BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost[4]		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORB	1	46	73	- - -[5]	- - -	24	73	- - -	- - -

[4] For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73º F.

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

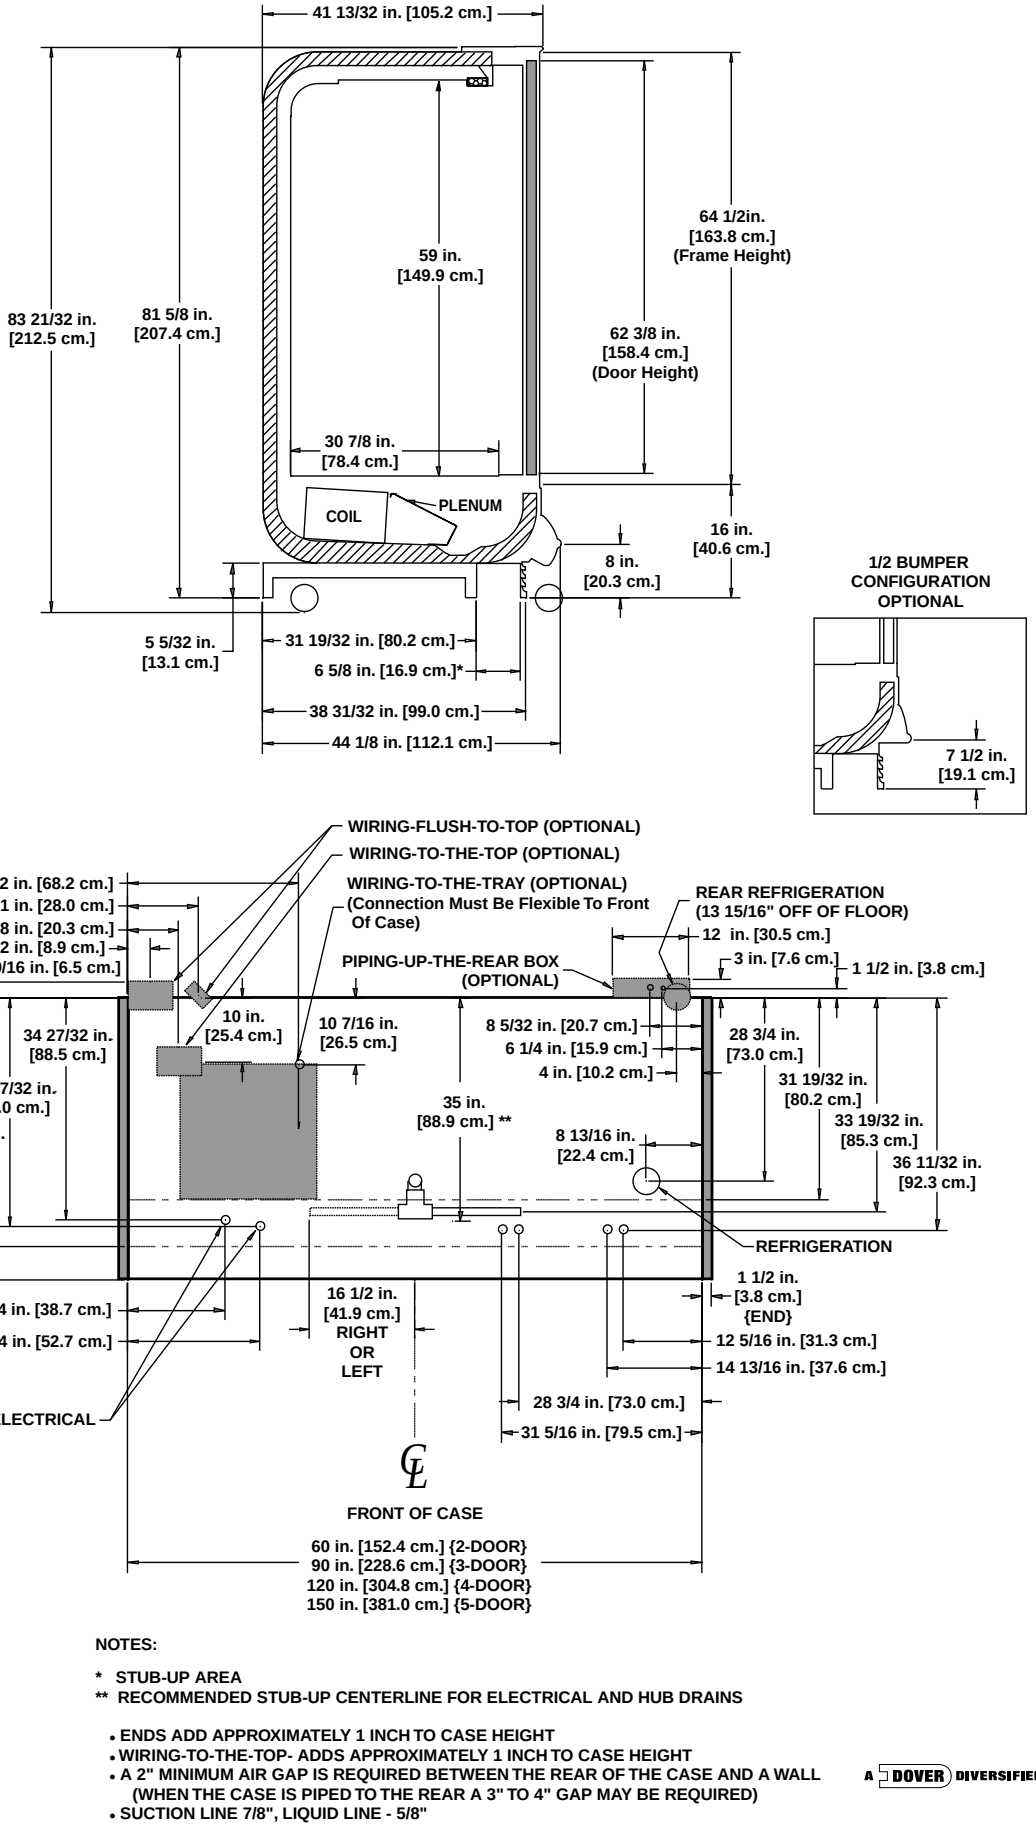

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Narrow Glass Door Reach-in Beverage Merchandisers

ONRB - 2, 3, 4, & 5-door reach in beverage

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
			120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Fans per Case	Amps	Watts	Amps	Watts	Amps	Watts	Amps[1]	Watts	Amps	Watts
ONRB	2-door	2	1.00	60	1.00	34	2.40	288	4.39	914	5.06	1215
	3-door	3	1.50	90	1.50	51	3.28	394	4.96	1032	5.71	1370
	4-door	4	2.00	120	2.00	69	4.33	520	6.51	1355	7.55	1813
	5-door	5	2.50	150	2.50	86	5.30	636	7.96	1655	9.17	2201

Lighting Data

		Standard Lighting		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watt	Amps	Watts
ONRB	2-door	NA[1]	NA	NA	NA	1.45	174
	3-door	NA	NA	NA	NA	1.94	233
	4-door	NA	NA	NA	NA	2.42	290
	5-door	NA	NA	NA	NA	2.91	349

[1] Not applicable.

Guidelines & Control Settings[2]

Model	BTUH/door[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
ONRB 1-door	900	22	32	35	35	460

[2] All data listed is for an ONRB configured with 20" shelves.

[3] BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost[5]		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRB	1	46	73	- - -[6]	- - -	24	73	- - -	- - -

[5] For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73º F.

[6] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

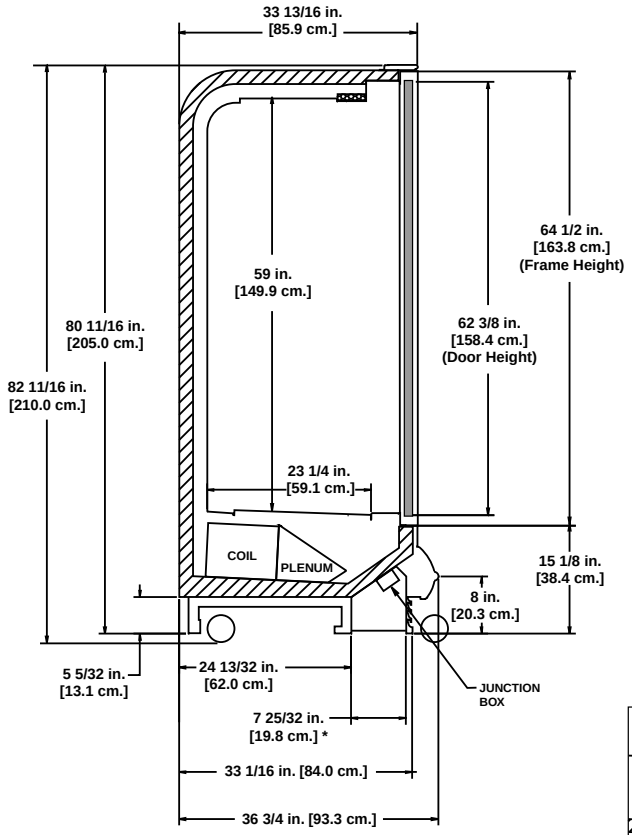



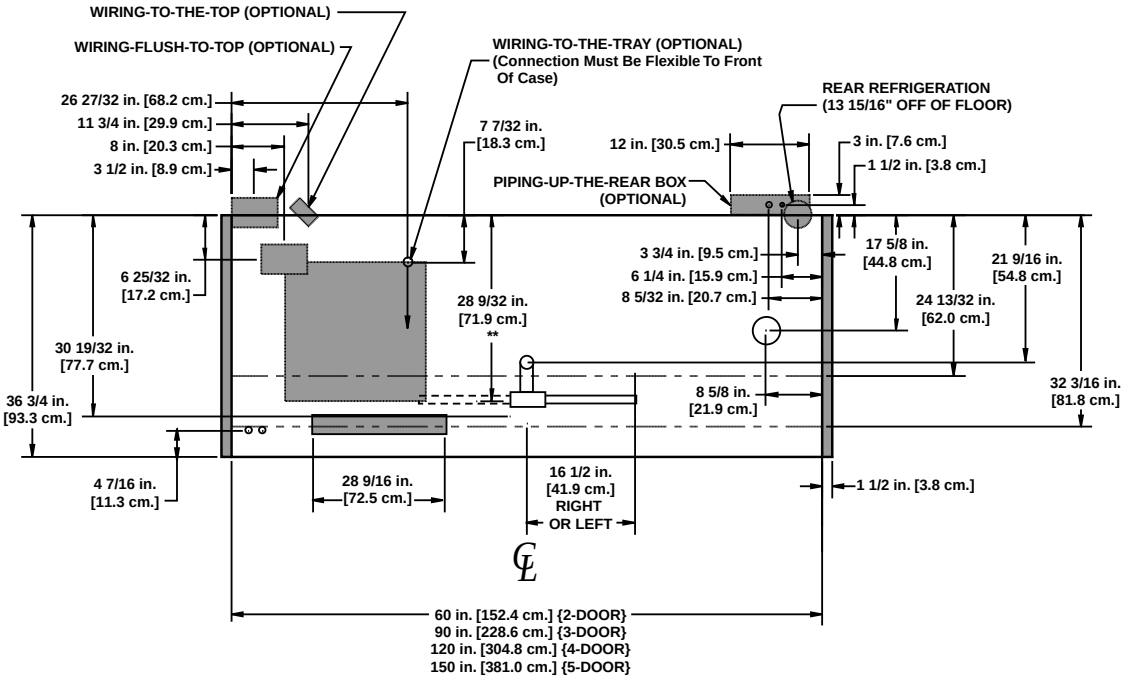

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Glass Door Reach-in Frozen Food/Ice Cream Merchandisers

ORZ - 2, 3, 4, & 5-door reach in freezer

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps[1]	Watts	Amps[1]	Watts
ORZ	2-door	2	1.00	60	0.64	27	3.82	458	7.61	2742	8.77	3645
	3-door	3	1.50	90	0.96	40	5.31	637	8.59	3096	9.89	4110
	4-door	4	2.00	120	1.28	54	6.93	832	11.28	4065	13.08	5439
	5-door	5	2.50	150	1.60	67	8.56	1027	13.78	4965	15.88	6603

[1] Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

		Standard Lighting		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watt	Amps	Watts
ORZ	2-door	NA[2]	NA	NA	NA	1.45	174
	3-door	NA	NA	NA	NA	1.94	233
	4-door	NA	NA	NA	NA	2.42	290
	5-door	NA	NA	NA	NA	2.91	349

[2] Not applicable.

Guidelines & Control Settings

Model	BTUH/DOOR[4]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[5] (FPM)
ORZ-F[3] ONE DOOR	1400	-13	-8	0	-5	280
ORZ-C ONE DOOR	1600	-23	-12	-3	-10	280

[3] F = Frozen food, C = Ice cream

[4] BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[5] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost[6]		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORZ	1	46	73	- - -[7]	- - -	24	73	- - -	- - -

[6] For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

[7] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

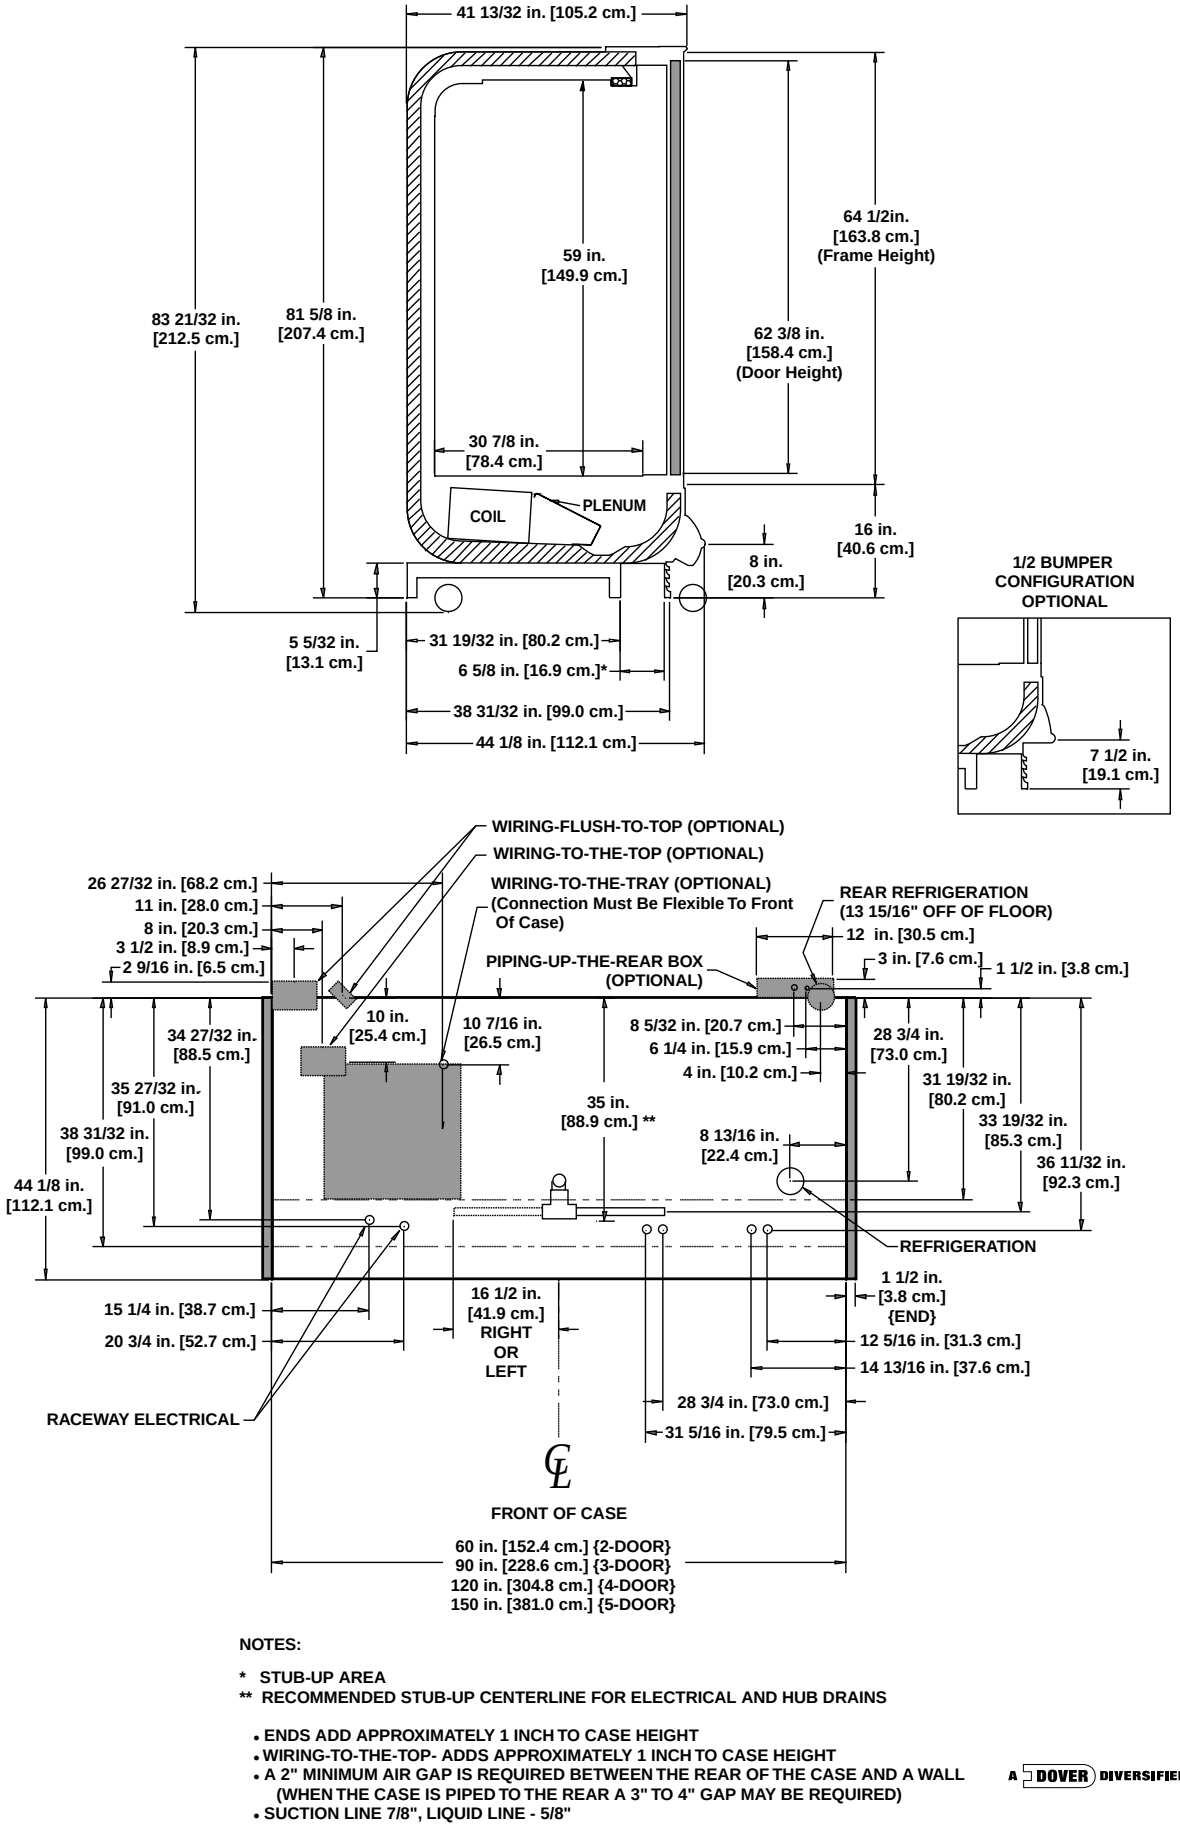

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- **ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT**
- **A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)**
- **SUCTION LINE 7/8", LIQUID LINE - 5/8"**

Narrow Glass Door Reach-in Frozen Food/Ice Cream Merchandisers

ONRZ - 2, 3, 4, & 5-door narrow reach in freezer

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps[1]	Watts	Amps[1]	Watts
ONRZ	2-door	2	1.00	60	0.64	27	3.82	458	7.61	2742	8.77	3645
	3-door	3	1.50	90	0.96	40	5.31	637	8.59	3096	9.89	4110
	4-door	4	2.00	120	1.28	54	6.93	832	11.28	4065	13.08	5439
	5-door	5	2.50	150	1.60	67	8.56	1027	13.78	4965	15.88	6603

[1] Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

		Standard Lighting		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watt	Amps	Watts
ONRZ	2-door	NA[2]	NA	NA	NA	1.45	174
	3-door	NA	NA	NA	NA	1.94	233
	4-door	NA	NA	NA	NA	2.42	290
	5-door	NA	NA	NA	NA	2.91	349

[2] Not applicable.

Guidelines & Control Settings[3]

Model	BTUH/DOOR[5]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[6] (FPM)
ONRZ-F[4] ONE DOOR	1500	-13	-2	0	2	460
ONRZ-C ONE DOOR	1600	-23	-12	-10	-8	460

[3] All data listed is for an ONRZ configured with 20" shelves.

[4] F = Frozen food, C = Ice cream.

[5] BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[6] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost[7]		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRZ	1	46	73	- - -[8]	- - -	24	73	- - -	- - -

[7] For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73º F.

[8] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

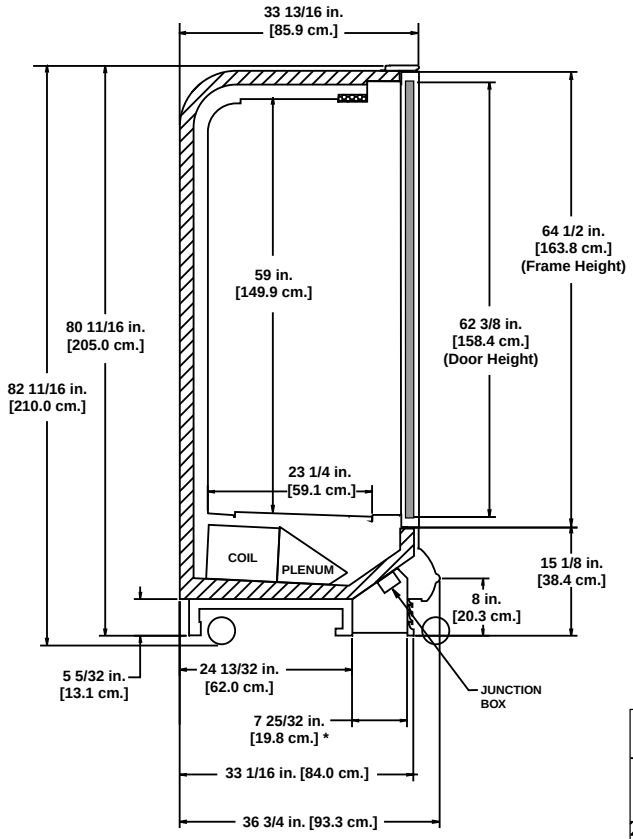



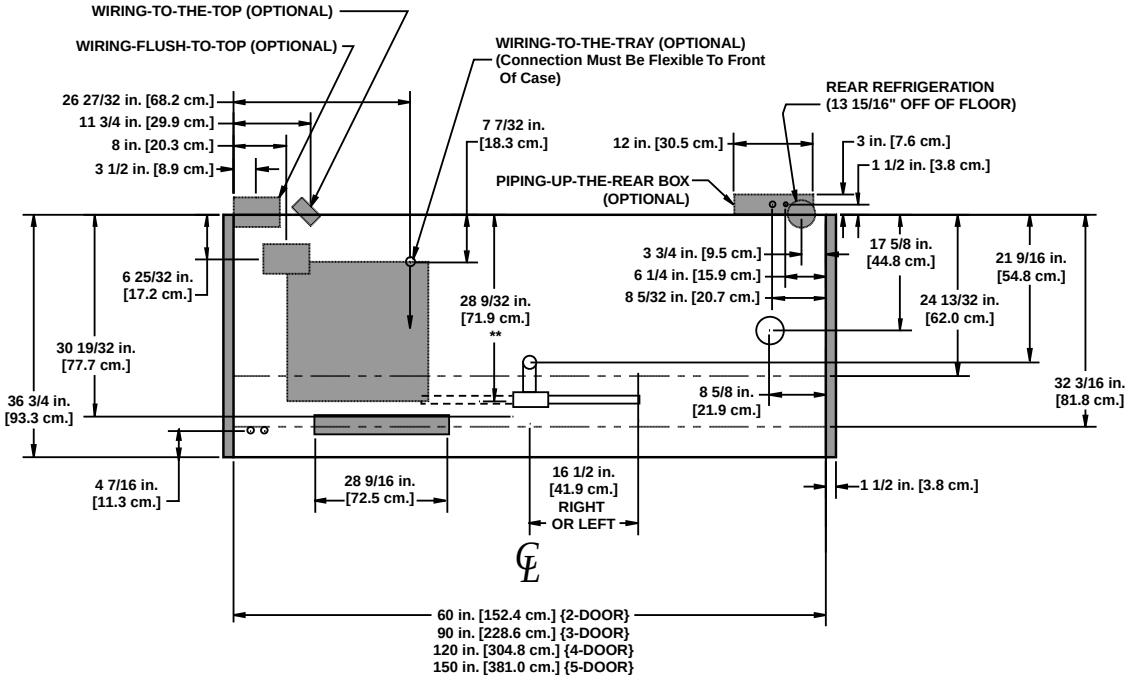

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

High Glass Door Reach-in Frozen Food/Ice Cream Merchandisers

ORZH - 2, 3, 4, & 5-door high reach in freezer

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps[1]	Watts	Amps[1]	Watts
ORZH	2-door	2	1.00	60	0.64	27	3.76	451	7.61	2742	8.77	3645
	3-door	3	1.50	90	0.96	40	5.30	636	8.59	3096	9.89	4110
	4-door	4	2.00	120	1.28	54	6.82	818	11.28	4065	13.08	5439
	5-door	5	2.50	150	1.60	67	8.45	1014	13.78	4965	15.88	6603

[1] Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

		Standard Lighting		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watt	Amps	Watts
ORZH	2-door	NA[2]	NA	NA	NA	2.02	242
	3-door	NA	NA	NA	NA	1.94	233
	4-door	NA	NA	NA	NA	2.42	290
	5-door	NA	NA	NA	NA	2.91	349

[2] Not applicable.

Guidelines & Control Settings

Model	BTUH/DOOR[4]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[5] (FPM)
ORZH-F[3] ONE DOOR	1500	-13	-3	0	-4	405
ORZH-C ONE DOOR	1600	-23	-12	-8	-4	405

[3] F = Frozen food, C = Ice cream

[4] BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[5] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost[6]		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORZH	1	46	73	- - -[7]	- - -	24	73	- - -	- - -

[6] For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73º F.

[7] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

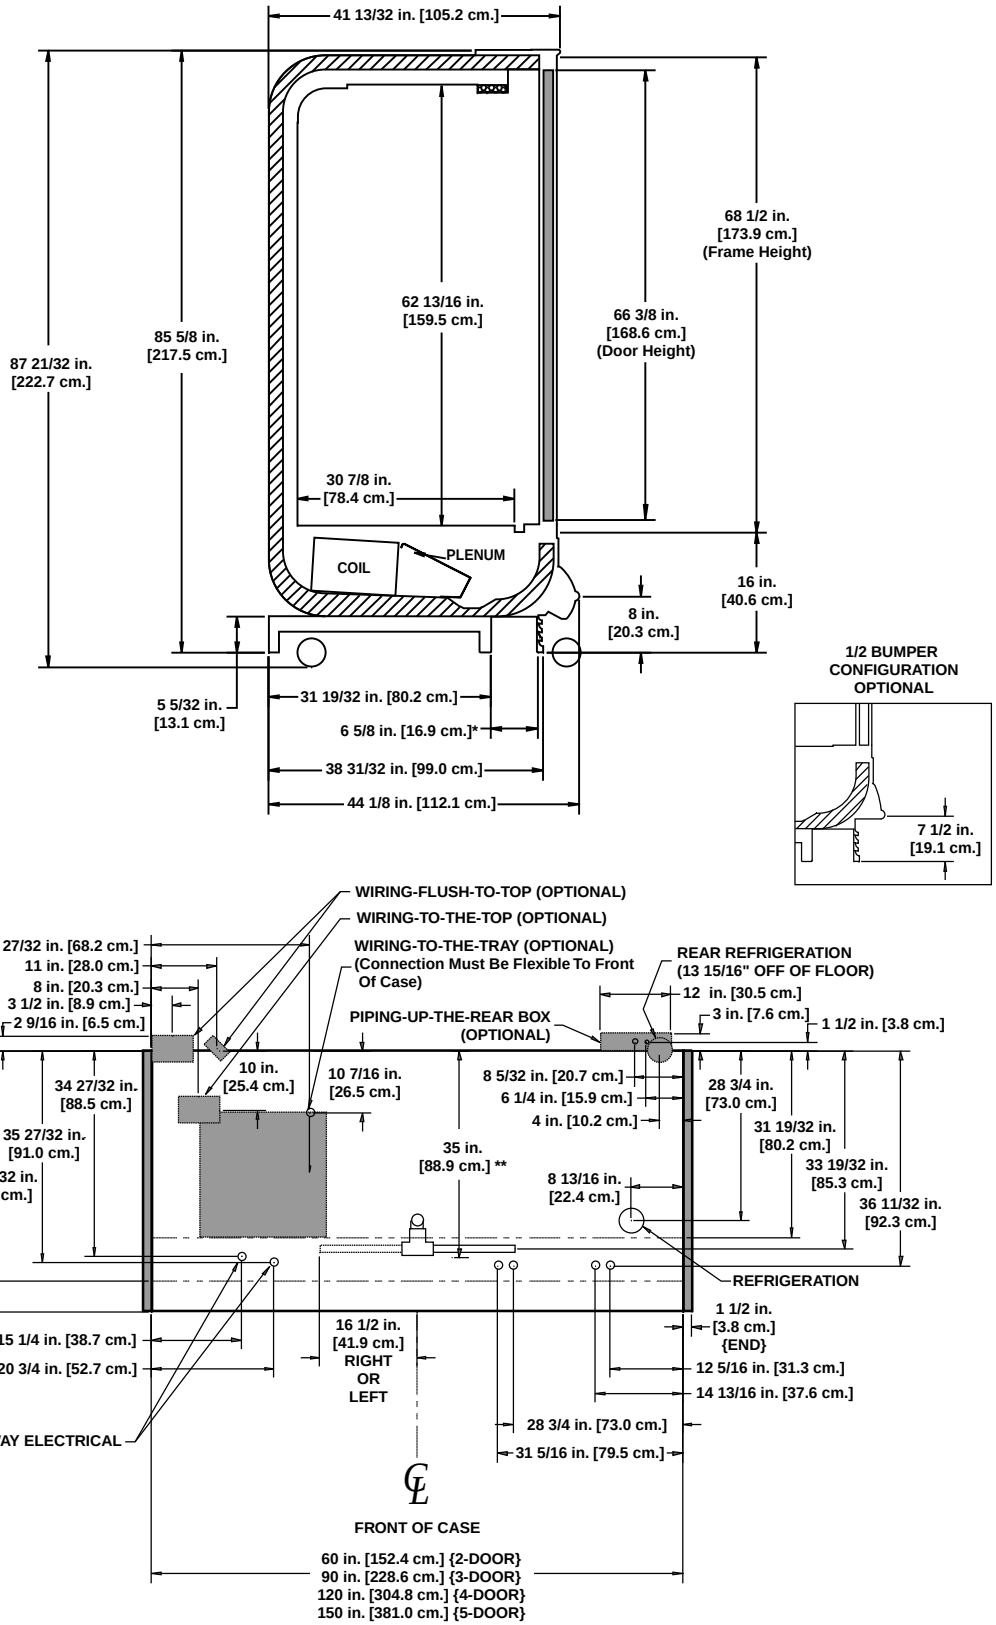

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 7/8", LIQUID LINE - 5/8"

Single Deck Island Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

Wide Island Meat/Deli Merchandisers

OIM - 8' & 12' wide island double wraparound ends
OIM(B) - 6', 8' & 12' wide island single wraparound end
OIM(BB) - 8' wide island double joint ends

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OIM	8'	6	2.04	102	0.90	66	0.82	98	4.34	902	5.00	1200
	12'	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000
OIM(B)	6'	4	1.36	76	0.60	44	0.57	68	3.25	676	3.75	900
	8'	6	2.04	102	0.90	66	0.75	90	4.34	902	5.00	1200
	12'	8	2.72	136	1.20	88	1.17	140	7.22	1502	8.33	2000
OIM(BB)	8'	6	2.04	102	0.90	66	0.92	110	4.34	902	5.00	1200

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OIM	8'	NA[1]	NA	5.04	605
	12'	NA	NA	6.50	780
OIM(B)	6'	NA	NA	3.15	378
	8'	NA	NA	4.61	529
	12'	NA	NA	5.87	704
OIM(BB)	8'	NA	NA	3.78	454

[1] Not applicable.

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
OIM/OIM(B)/OIM(BB) Meat	770[4]	12	26	34	31	140
OIM/OIM(B)/OIM(BB) Deli	560[5]	17	28	36	33	140

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

[4] OIM (meat): +400 BTUH per wraparound end.

[5] OIM (deli): +250 BTUH per wraparound end.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIM/OIM(B) /OIM(BB)	3	40	42	- - -[6]	- - -	26	39	- - -	- - -

[6] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

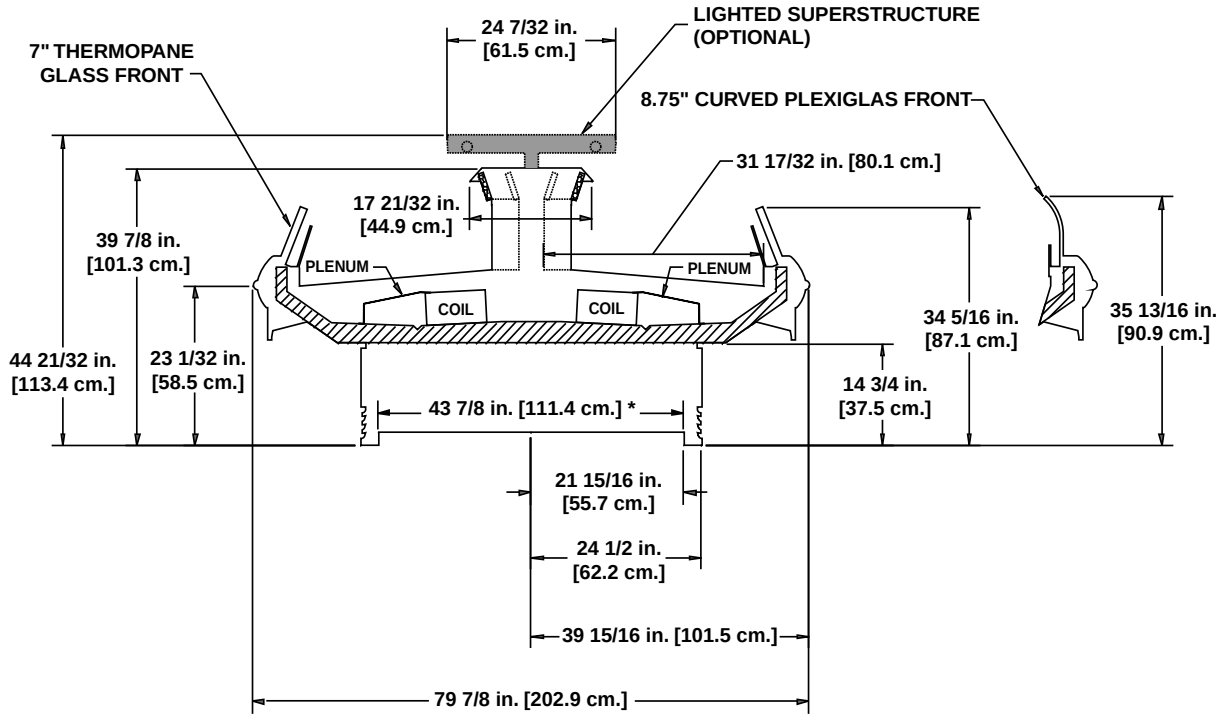

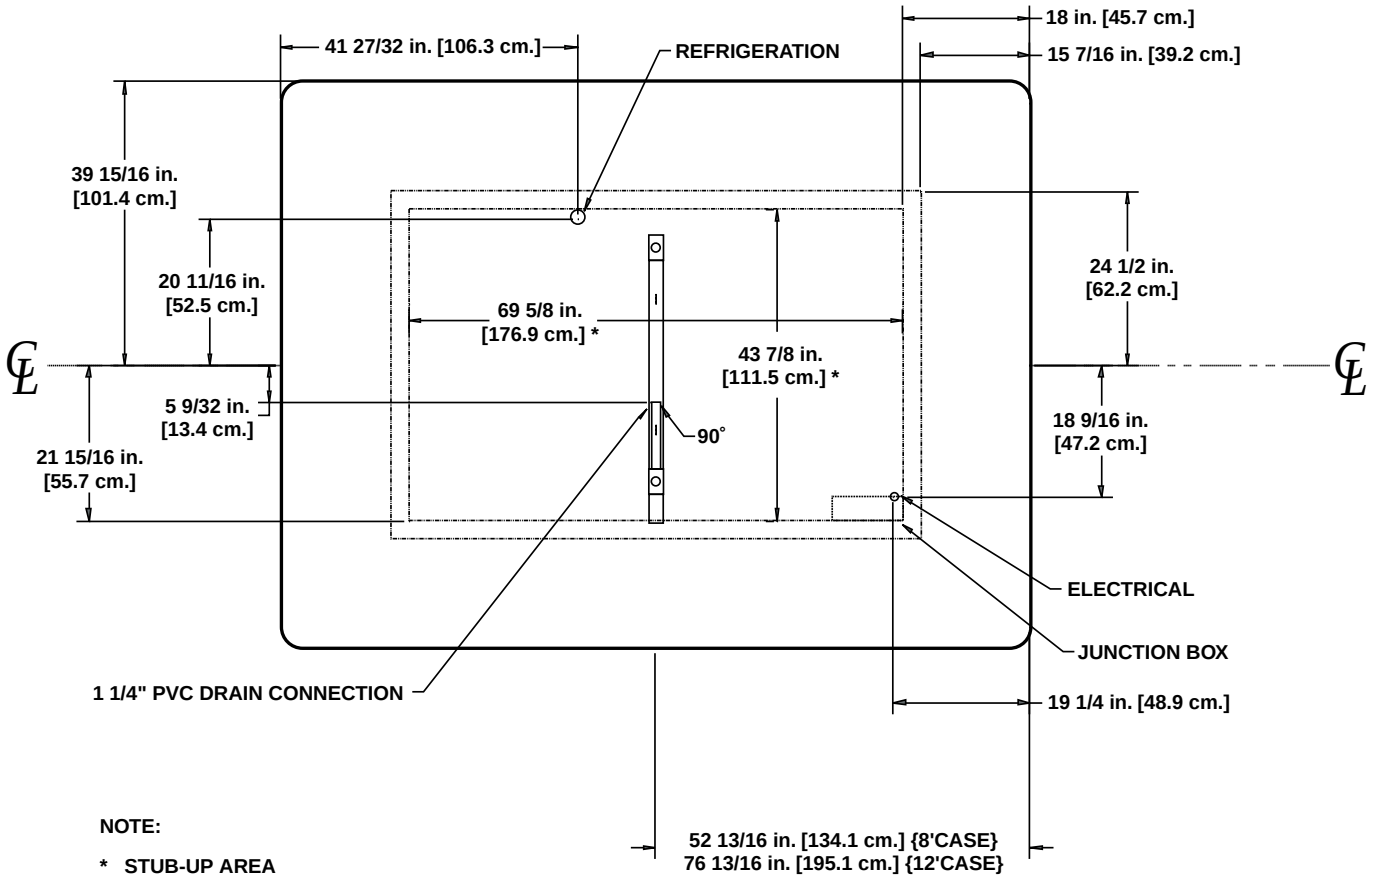

NOTE:

* STUB-UP AREA

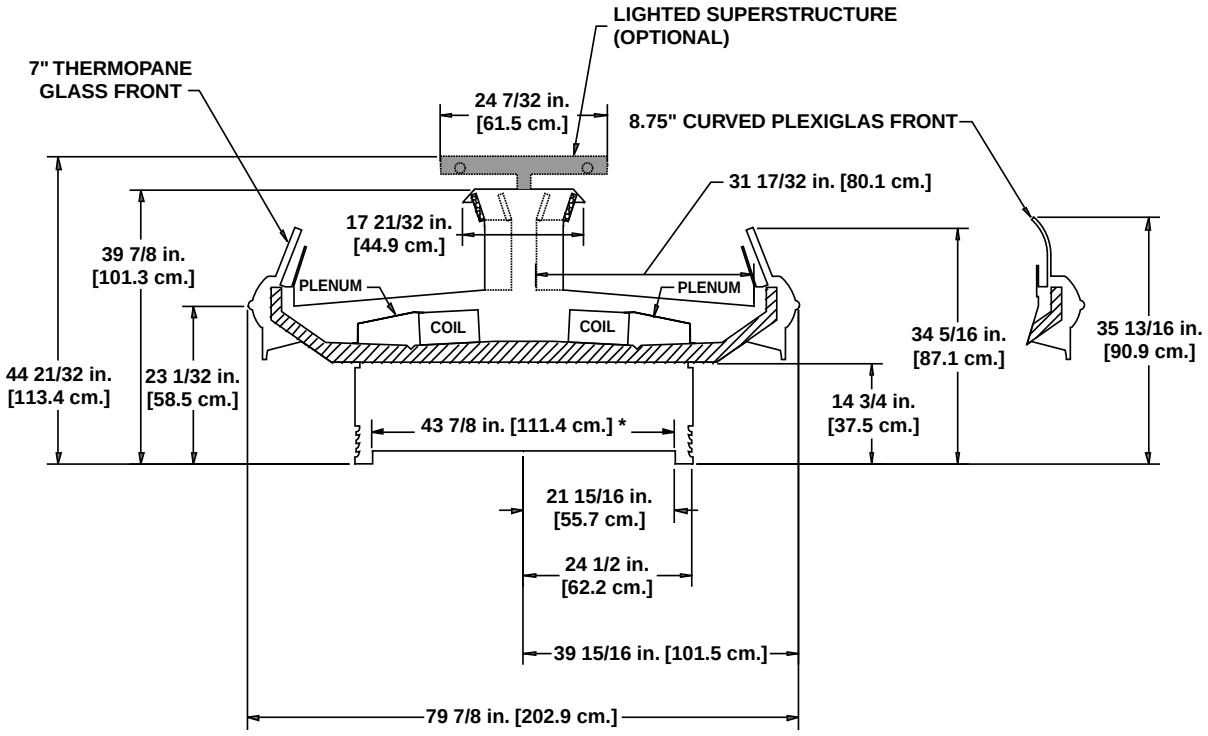

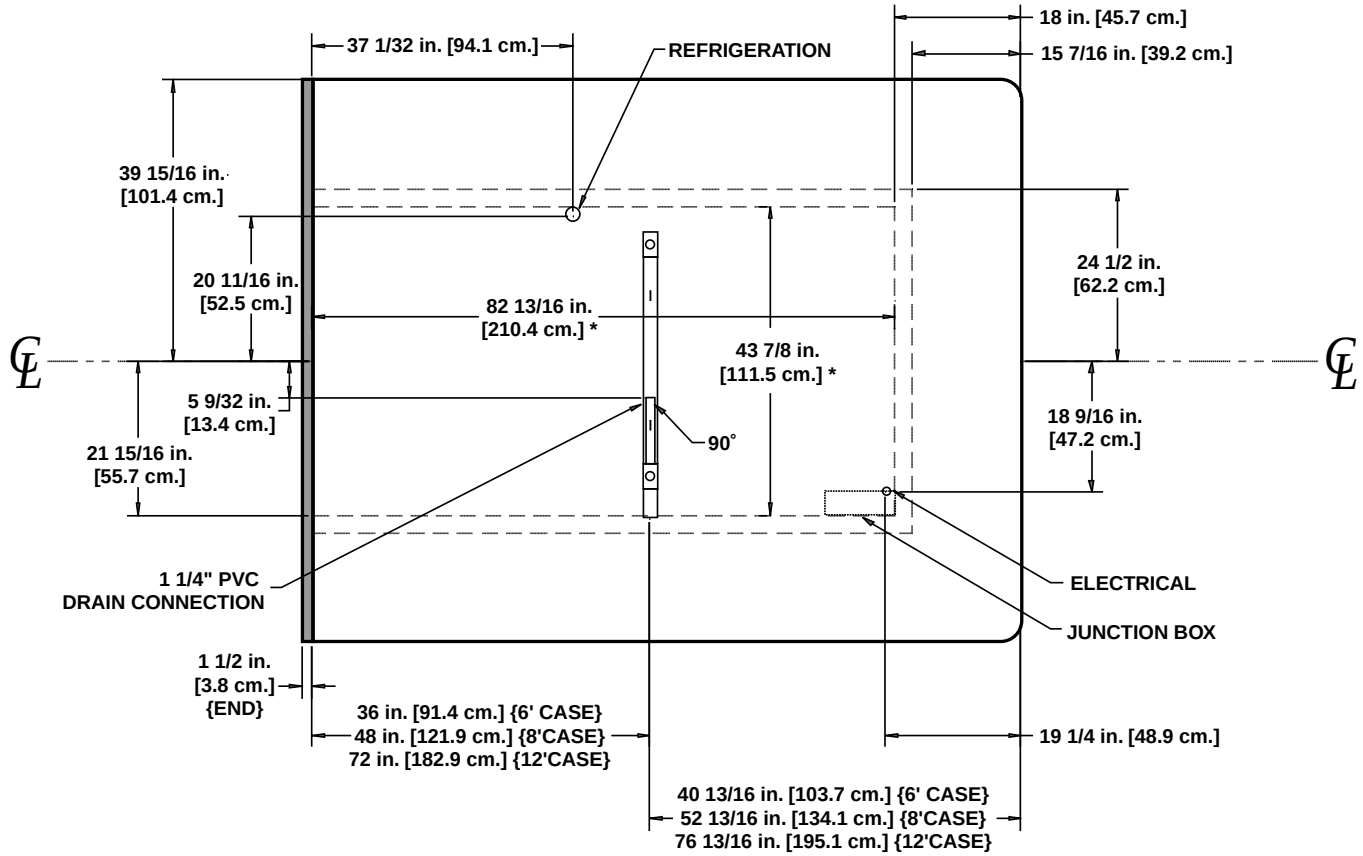

NOTE:

* STUB-UP AREA

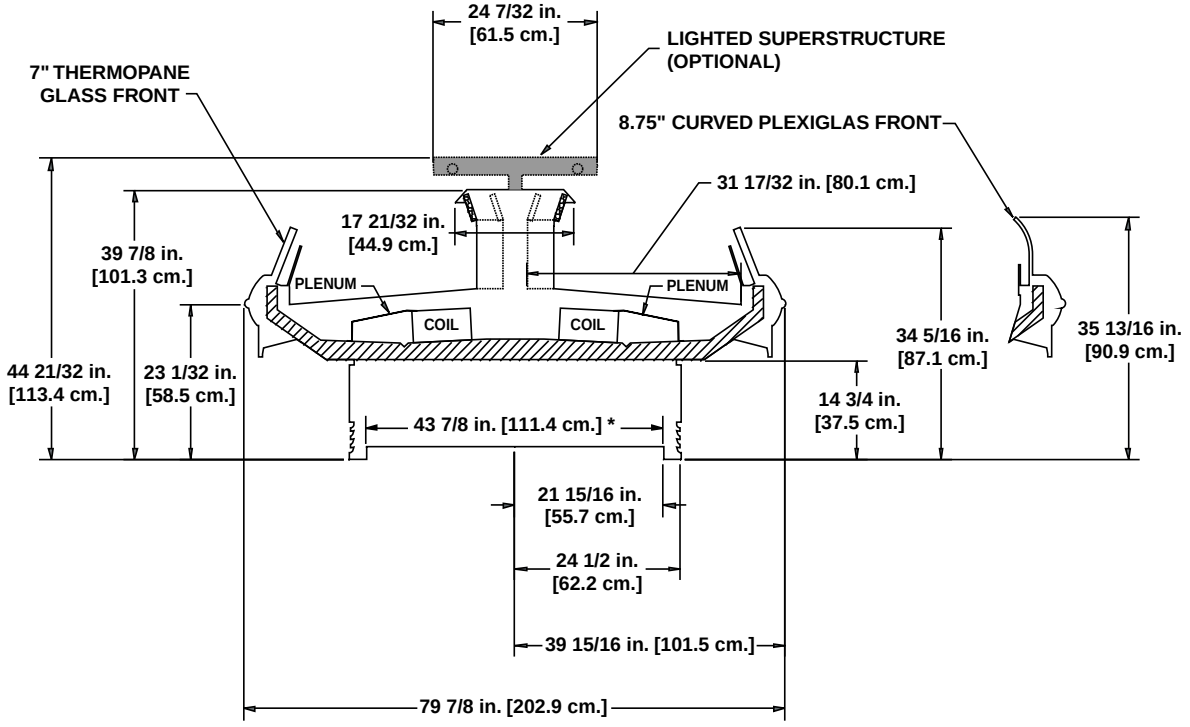

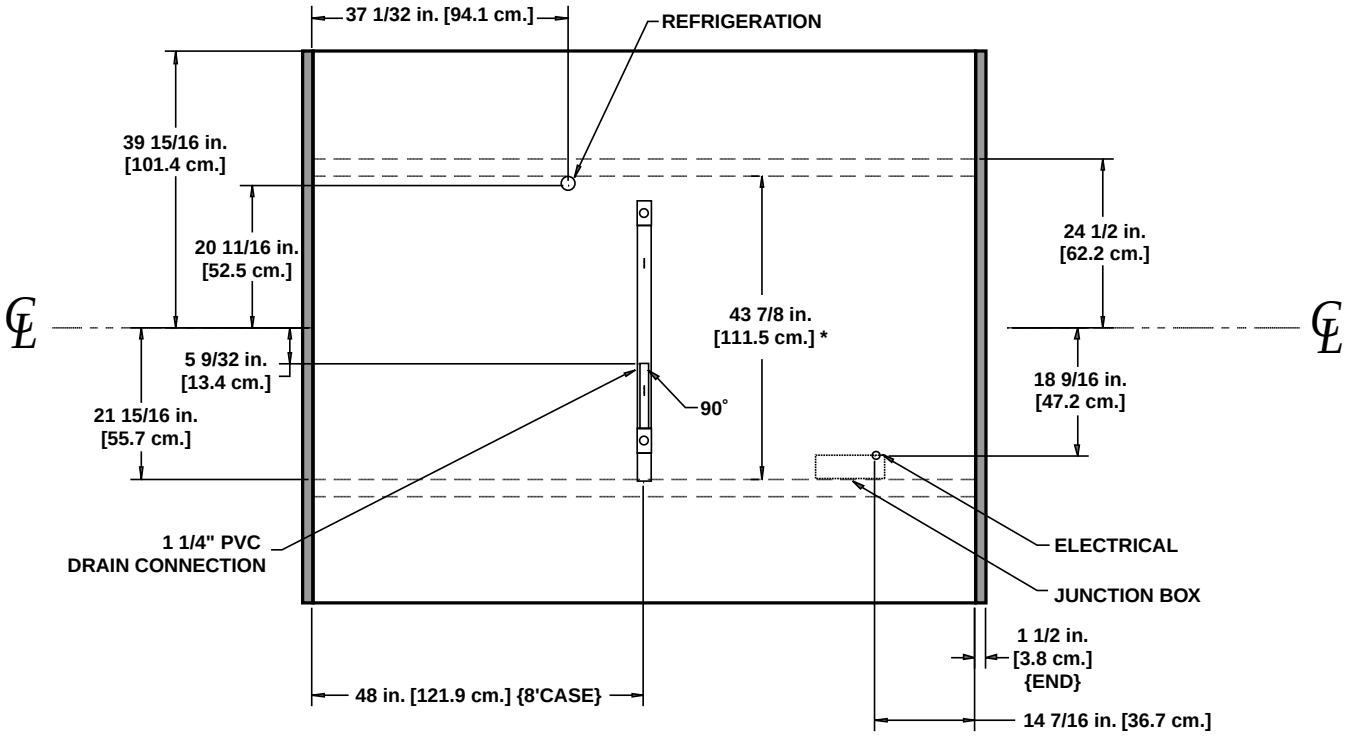

NOTE:

* STUB-UP AREA

Narrow Island Meat/Deli Merchandisers

ONIM - 8’ & 12’ wide island double wraparound ends
ONIM(B) - 8’ & 12’ wide island single wraparound end

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
ONIM	8’	6	2.04	102	0.90	66	0.82	98	4.34	902	5.00	1200
	12’	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000
ONIM(B)	8’	6	2.04	102	0.90	66	0.75	90	4.34	902	5.00	1200
	12	8	2.72	136	1.20	88	1.17	140	7.22	1502	8.33	2000

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
ONIM	8’	NA[1]	NA	1.26	151
	12’	NA	NA	1.46	175
ONIM(B)	8’	NA	NA	1.26	151
	12’	NA	NA	1.46	175

[1] Not applicable.

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
ONIM/ONIM(B) Meat	885[4]	12	25	33	34	180
ONIM/ONIM(B) Deli	860[5]	17	28	36	37	180

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

[4] ONIM (meat): +400 BTUH per wraparound end.

[5] ONIM (deli): +250 BTUH per wraparound end.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
ONIM/ONIM(B)	3	35	47	- - - [6]	- - -	26	39	- - -	- - -

[6] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

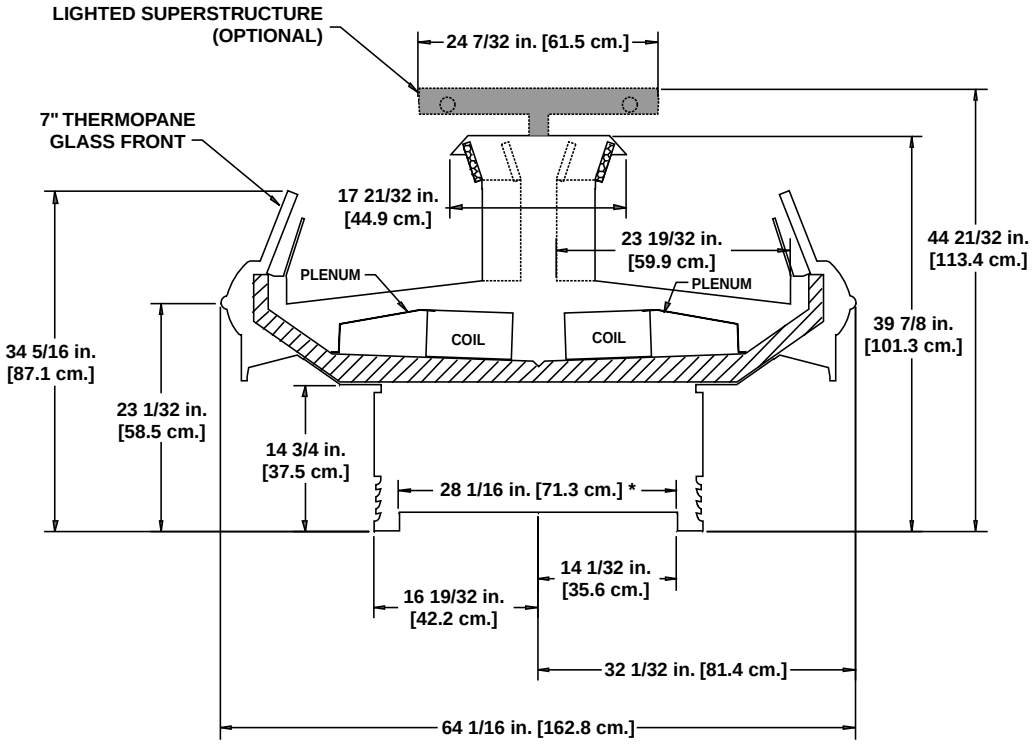

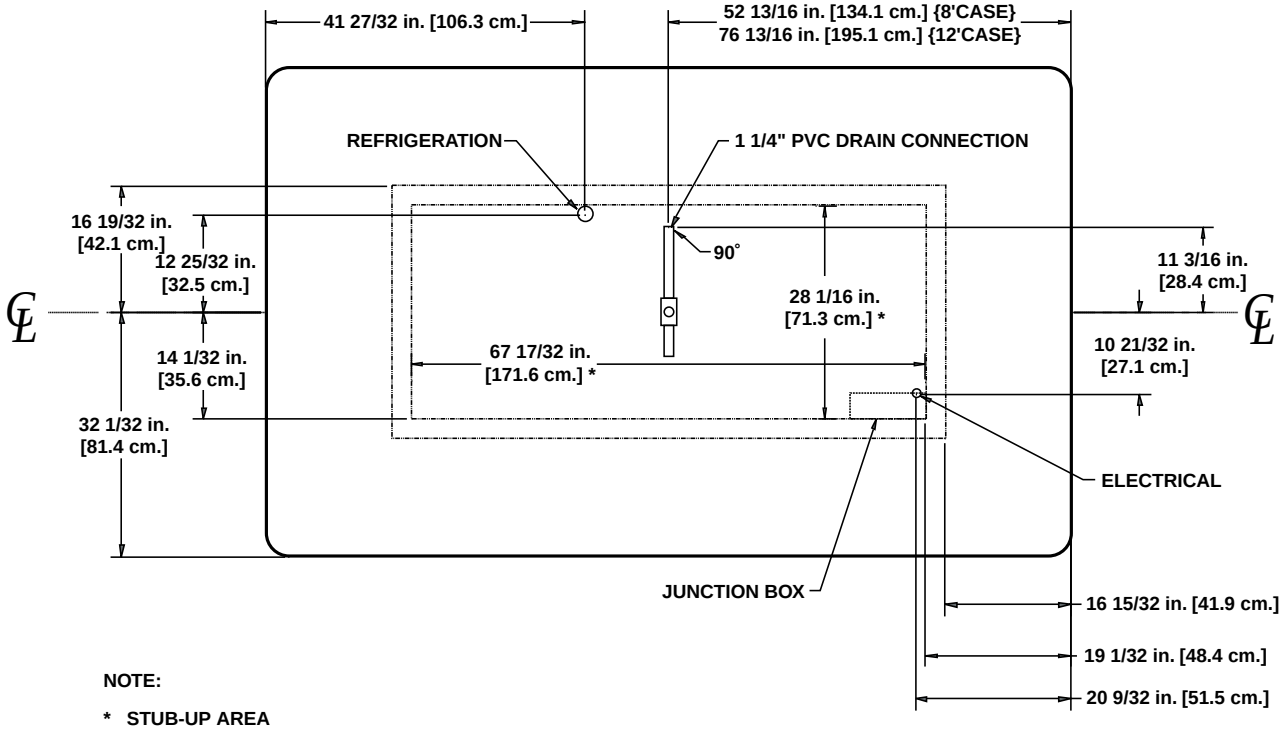

NOTE:

* STUB-UP AREA

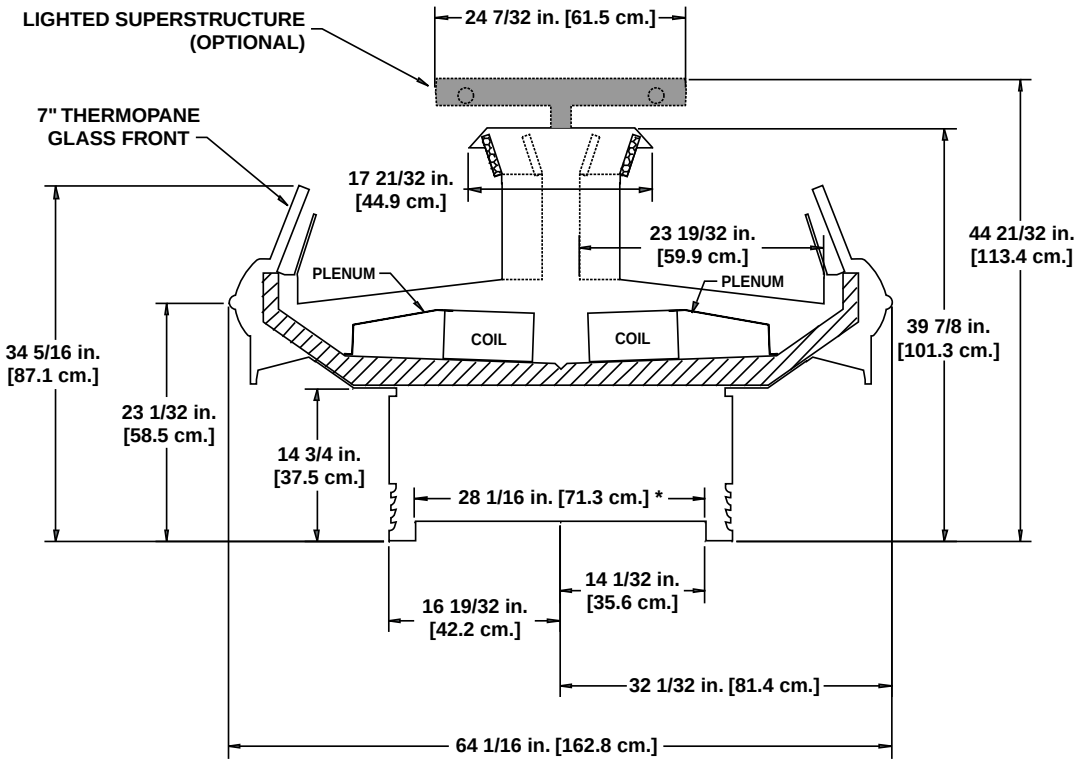

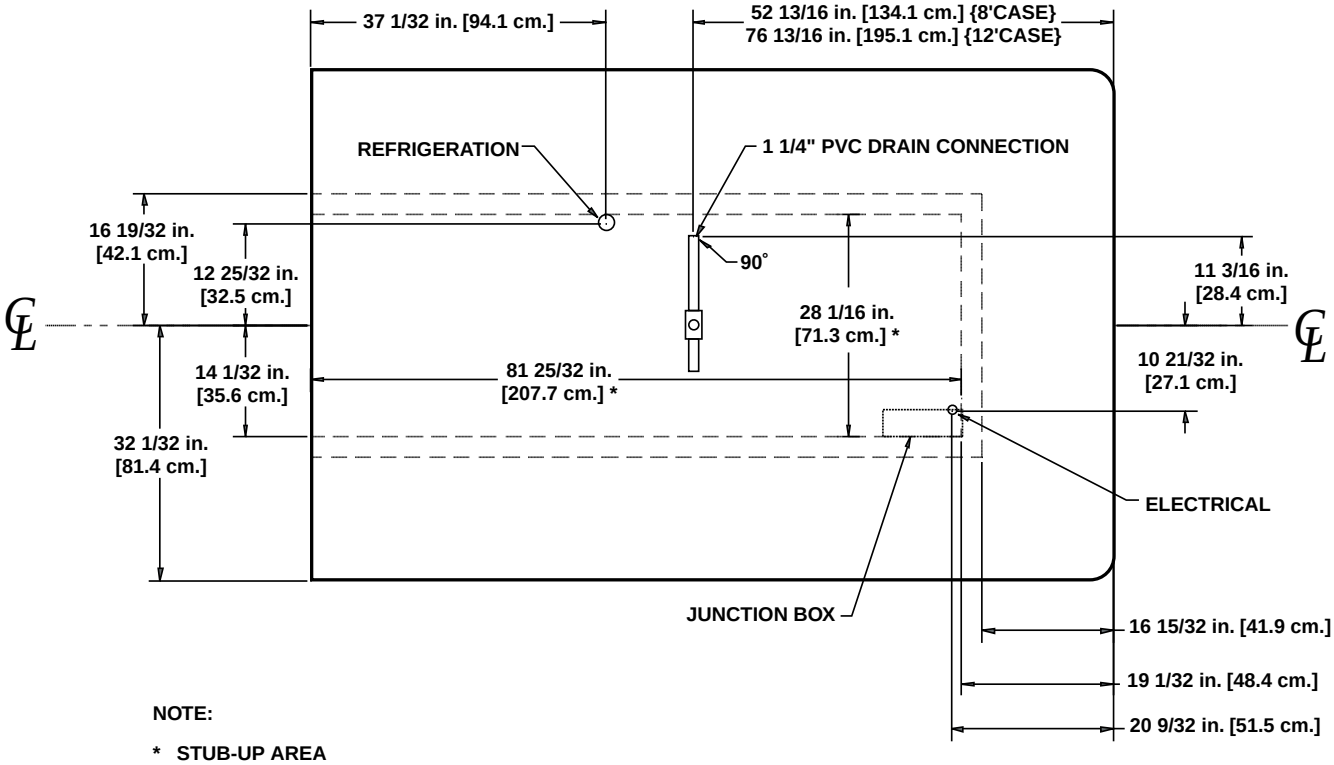

NOTE:

* STUB-UP AREA

Wide Island Produce Merchandisers

OIP - 8’ & 12’ wide island double wraparound end
OIP(B) - 6’, 8’, 10’ & 12’ wide island single wraparound end
OIP(BB) - 8’ & 12’ wide island double joint

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OIP	8’	6	2.04	102	0.90	66	0.23	28	- - -[1]	- - -	- - -	- - -
	12’	8	2.72	136	1.20	88	0.55	66	- - -	- - -	- - -	- - -
OIP(B)	6’	4	1.36	76	0.60	44	0.31	37	- - -	- - -	- - -	- - -
	8’	6	2.04	102	0.90	66	0.46	55	- - -	- - -	- - -	- - -
	10’	6	2.04	102	0.90	66	0.66	79	- - -	- - -	- - -	- - -
	12’	8	2.72	136	1.20	88	0.78	94	- - -	- - -	- - -	- - -
OIP(BB)	8’	6	2.04	102	0.90	66	0.84	101	- - -	- - -	- - -	- - -
	12’	8	2.72	136	1.20	88	1.26	151	- - -	- - -	- - -	- - -

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OIP	8’	NA[2]	NA	3.78	454
	12’	NA	NA	5.04	605
OIP(B)	6’	NA	NA	1.89	227
	8’	NA	NA	3.15	378
	10’	NA	NA	- - -	- - -
	12’	NA	NA	4.41	529
OIP(BB)	8’	NA	NA	2.52	302
	12’	NA	NA	3.78	454

[2] Not applicable.

Guidelines & Control Settings

Model	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
OIP/OIP(B)/ OIP(BB)	650[5]	22	34	40	48	140

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

[5] OIP: +600 BTUH per wraparound end.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIP/OIP(B) /OIP(BB)	3	- - -	- - -	44	38	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

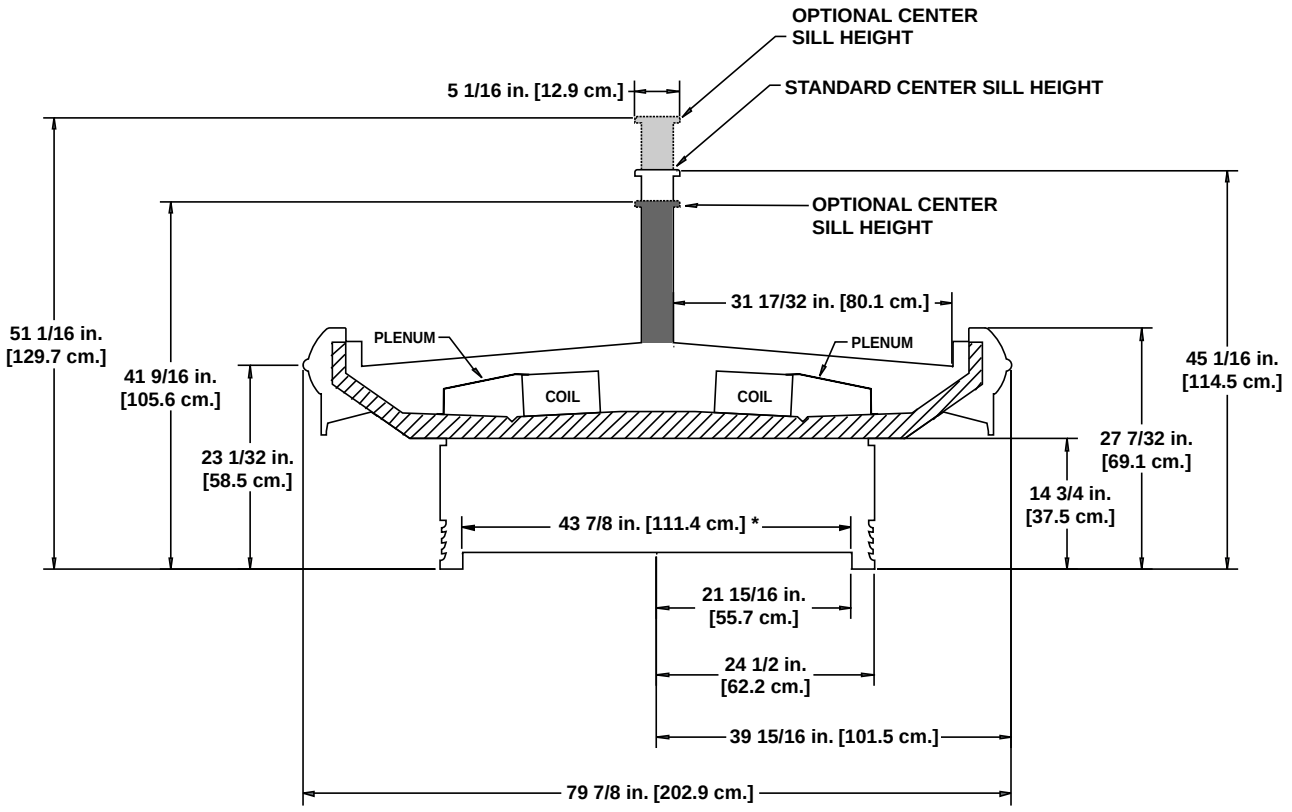

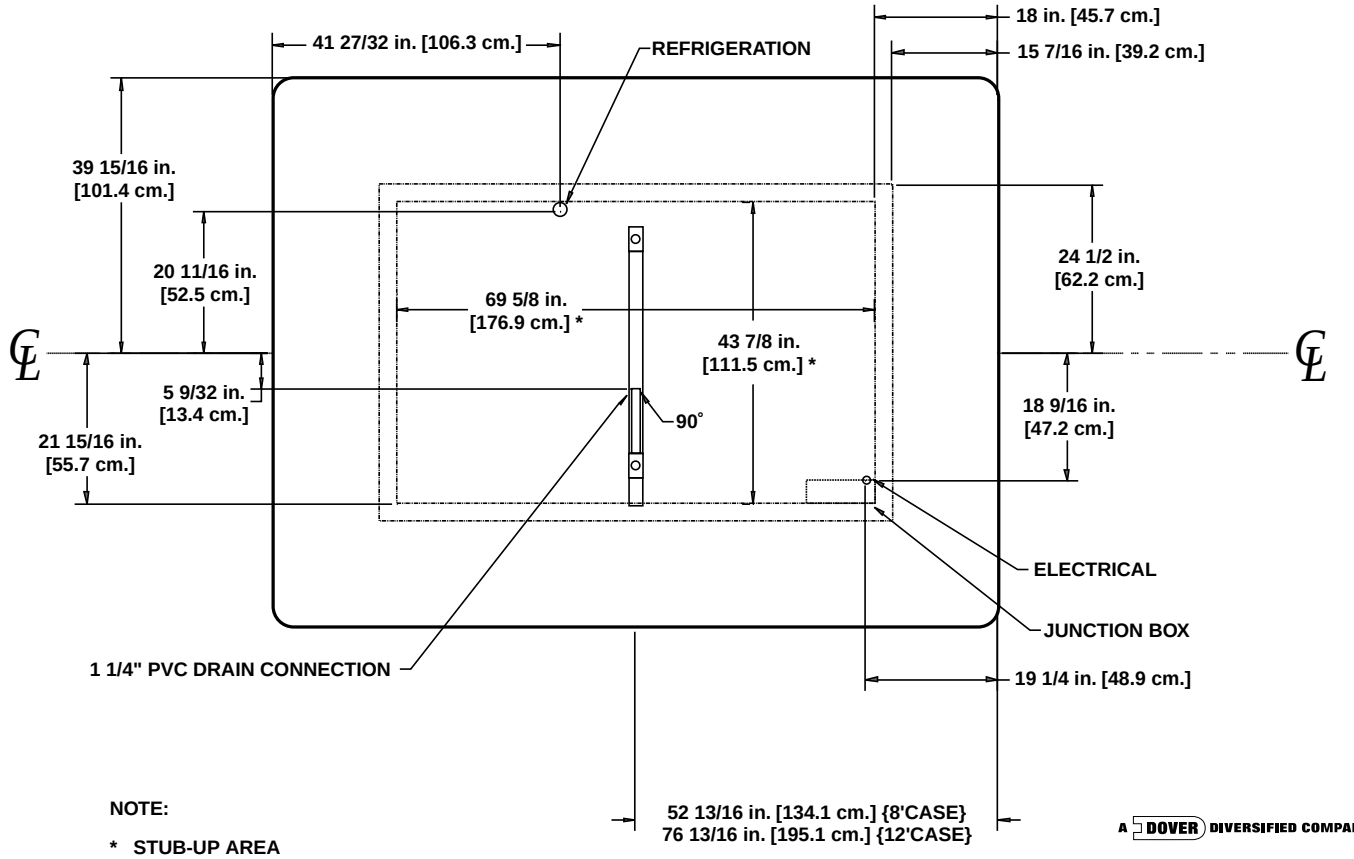

NOTE:

* STUB-UP AREA

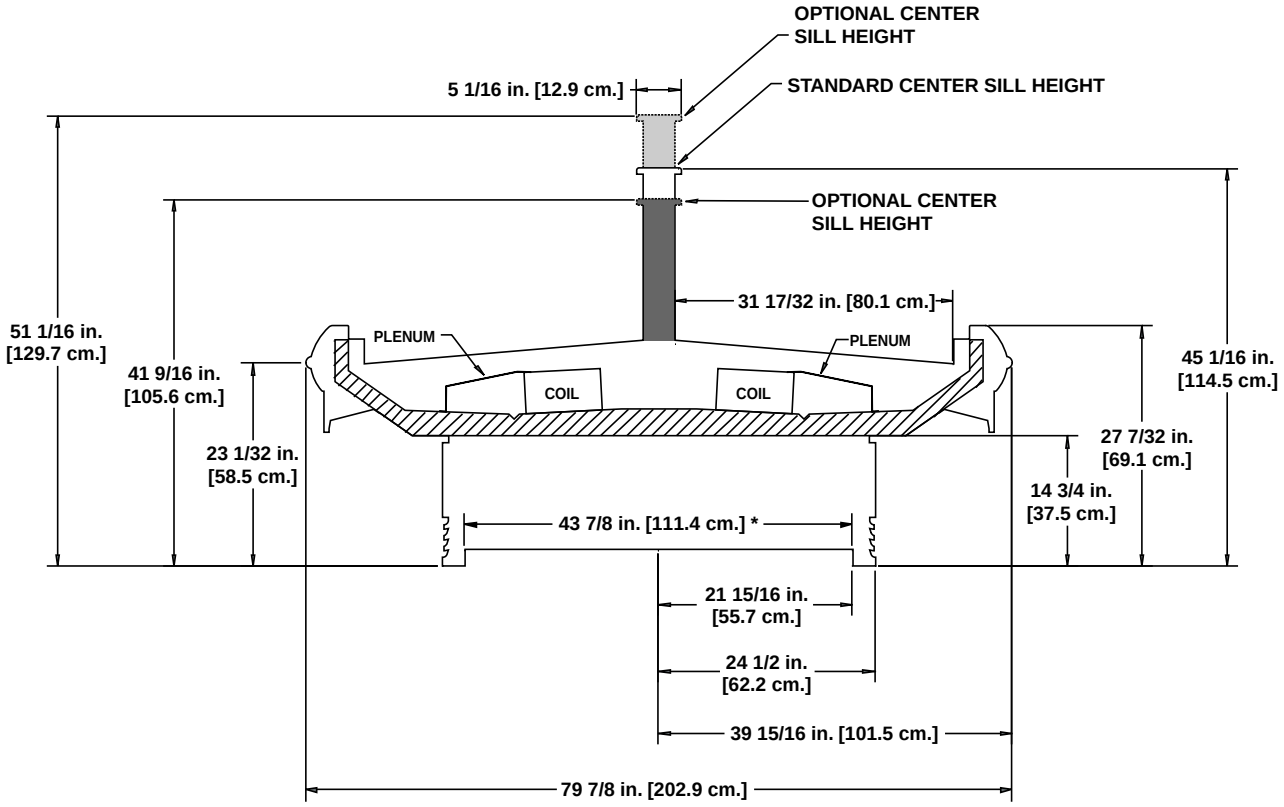

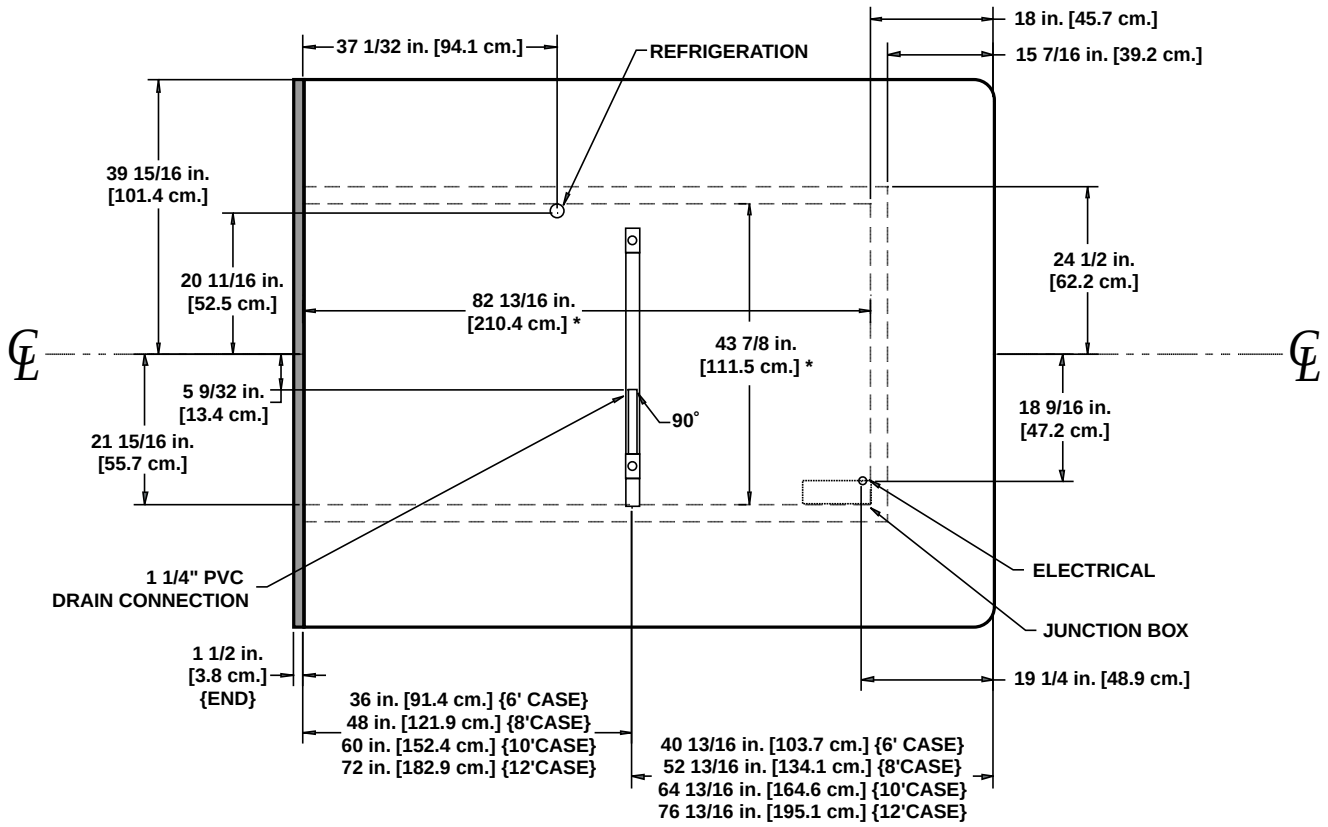

NOTE:

* STUB-UP AREA

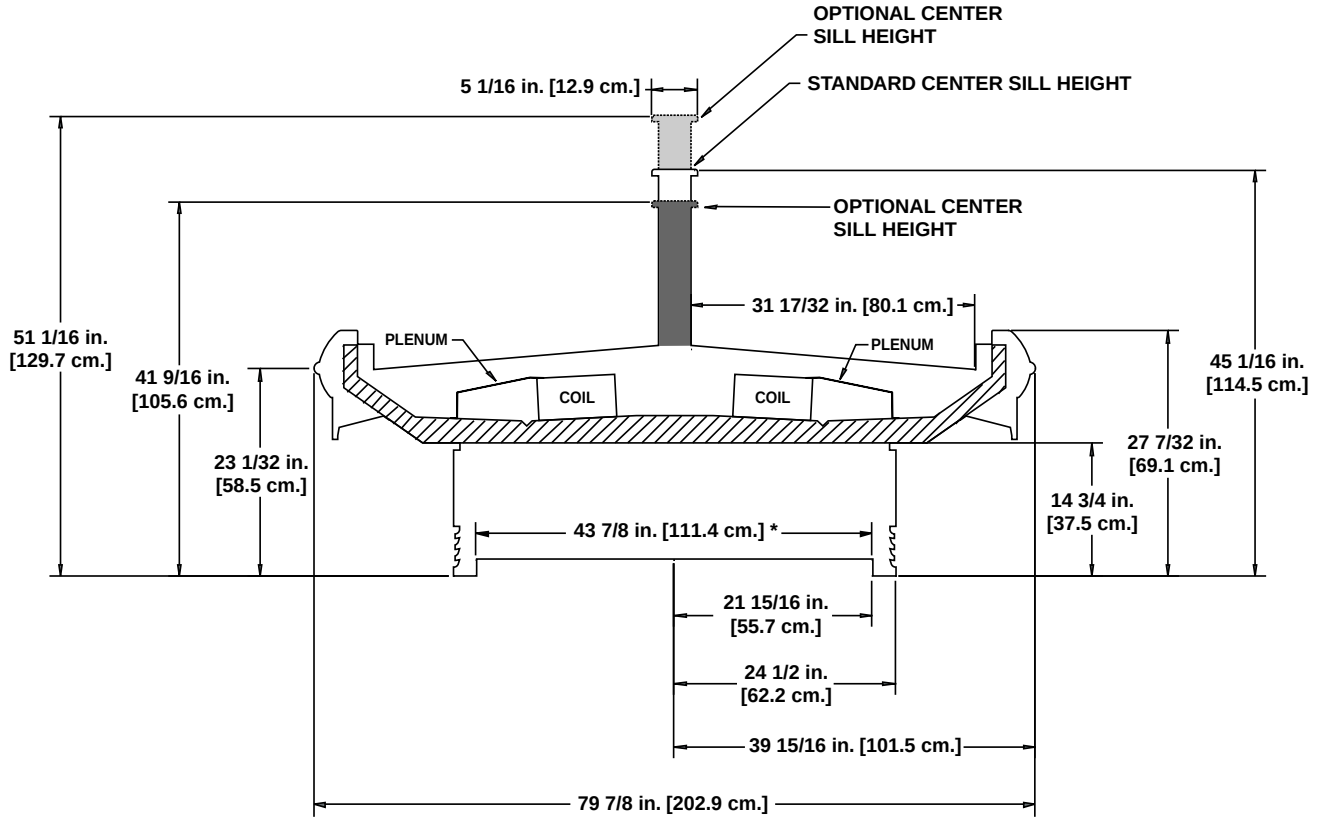

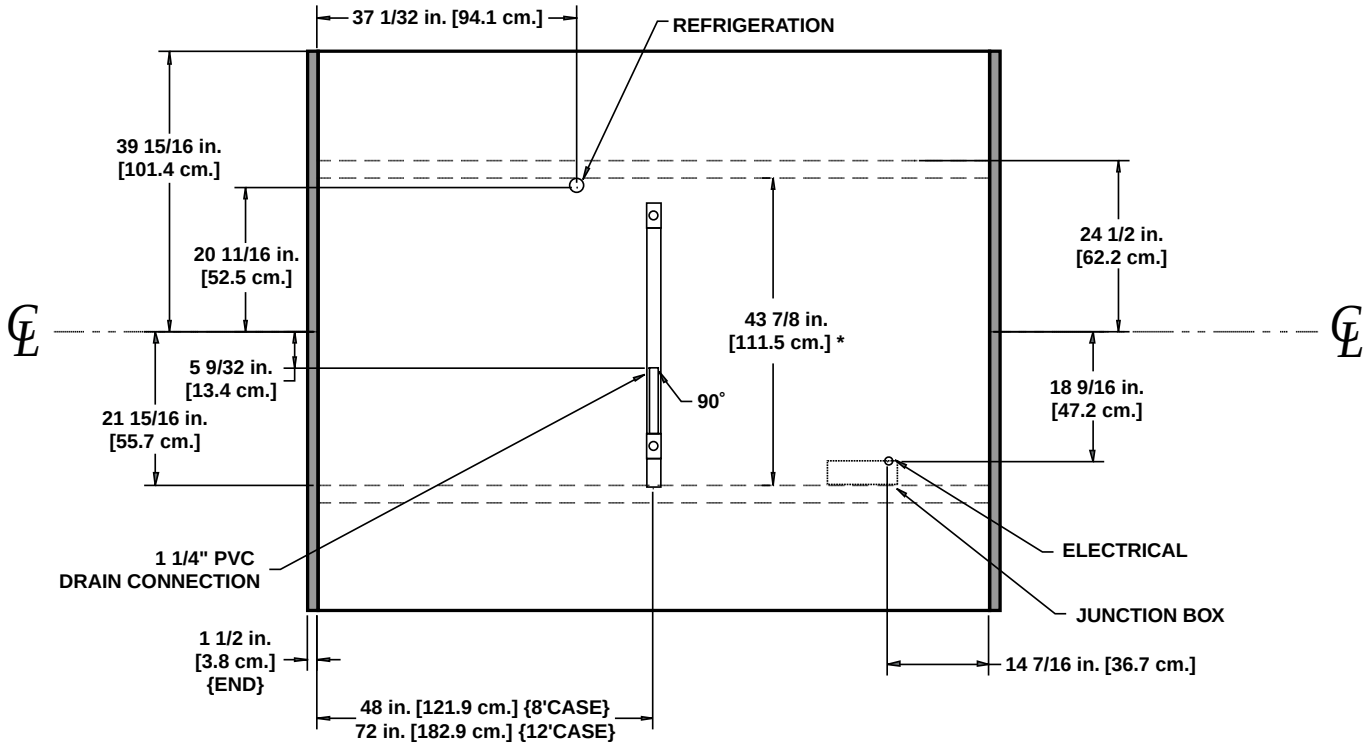

NOTE:

* STUB-UP AREA

Wide Island Frozen Food/Ice Cream Merchandisers

OWIZ - 8' & 12' wide island freezer
OWIZ(G) - 8' & 12' wide island freezer with front glass

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate[2] Heaters 120 Volts Amps	Anti-Condensate[2] Heaters 120 Volts Watts	Defrost Heaters[3] 208 Volts Amps	Defrost Heaters[3] 208 Volts Watts	Defrost Heaters[3] 240 Volts Amps	Defrost Heaters[3] 240 Volts Watts	Drain Heaters 120 Volts Amps	Drain Heaters 120 Volts Watts
OWIZ	F-8'[1]	4	1.36	68	0.60	44	3.19	383	7.69	1600	8.88	2130	0.26	30
	F-12'	6	2.04	102	0.90	66	4.81	577	11.54	2400	13.31	3195	0.26	30
	C-8'	4	1.36	68	0.60	44	3.19	383	11.54	2400	13.31	3195	0.26	30
	C-12'	6	2.04	102	0.90	66	4.81	577	17.31	3600	19.98	4795	0.26	30
OWIZ(G)	F-8'	4	1.36	68	0.60	44	4.58	550	7.69	1600	8.88	2130	0.26	30
	F-12'	6	2.04	102	0.90	66	6.68	802	11.54	2400	13.31	3195	0.26	30
	C-8'	4	1.36	68	0.60	44	4.58	550	11.54	2400	13.31	3195	0.26	30
	C-12'	6	2.04	102	0.90	66	6.68	802	17.31	3600	19.98	4795	0.26	30

[1] F = frozen food, C = ice cream.

[2] Anti-Condensate heater data for No Wrap End configuration. For solid fronts add 0.28 amps per wrap end. For glass fronts add 0.68 amps per wrap end.

[3] Defrost data for one side of case only.

Lighting Data[4]

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OWIZ/	8'	1.14	137	4.56	547
OWIZ(G)	12'	1.71	205	6.84	821

[4] Lighting is for cases with superstructures.

Guidelines & Control Settings

Model	BTUH/ft[5]	Evaporator °F	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[6] (FPM)
OWIZ-F	600	-18	-10	0	0	180
OWIZ-C	700	-33	-20	-4	-12	180
OWIZ(G)-F	600	-18	-12	0	0	180
OWIZ(G)-C	700	-33	-20	-4	-12	180

[5] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[6] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OWIZ-F & C OWIZ(G)-F & C	1	60	49	- - -[7]	- - -	20	59	- - -	- - -

[7] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

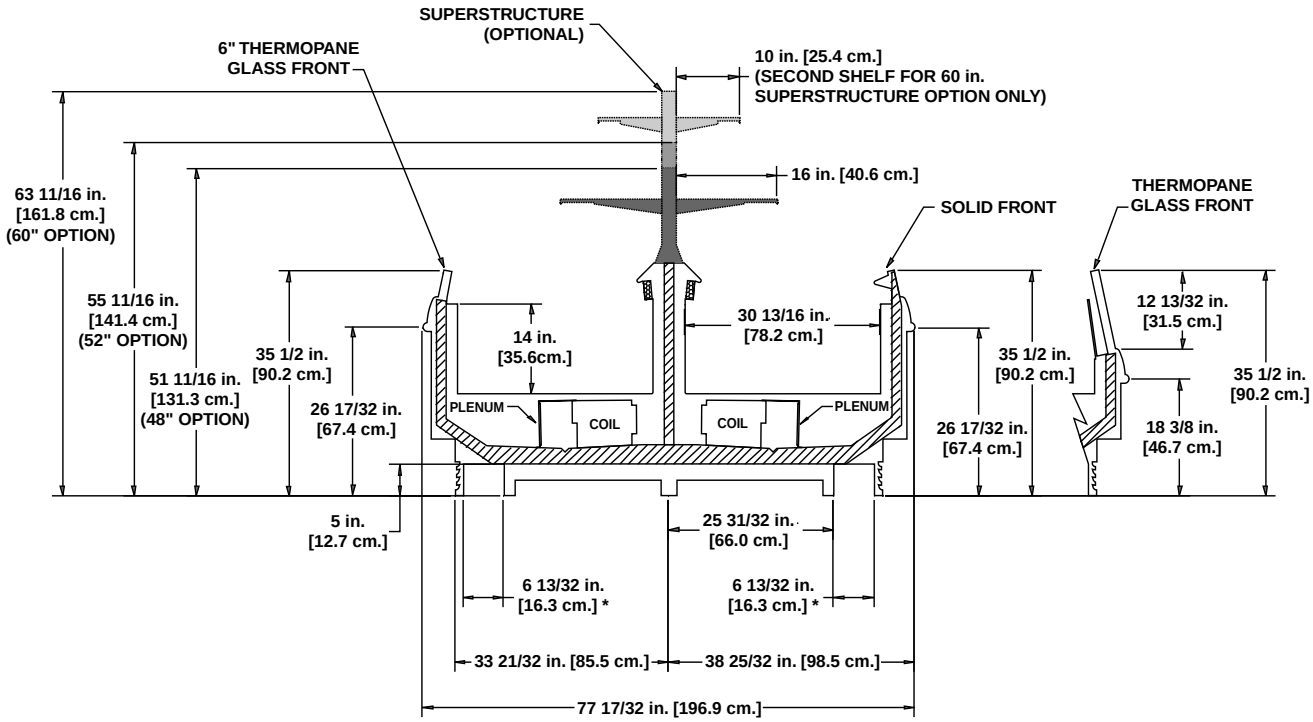

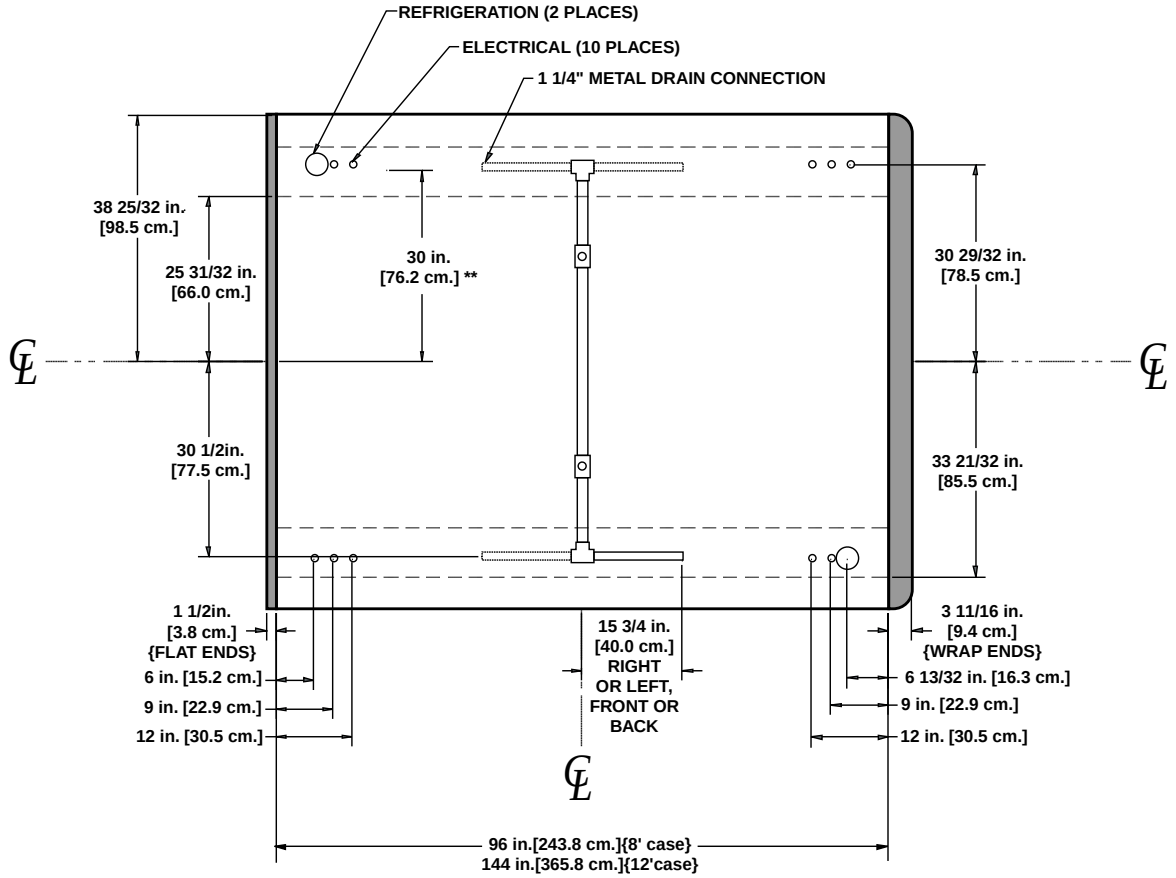

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

Wide Island Frozen Food/Ice Cream Merchandisers

OWEZ - wide island freezer end case
OWEZ(G) - wide island freezer end case with front glass

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts	Drain Heater 120 Volts Amps	Drain Heater 120 Volts Watts
OWEZ	F[1]	2	0.68	34	0.30	22	1.56	187	5.77	1200	6.65	1596	0.13	15
	C	2	0.68	34	0.30	22	1.56	187	8.65	1800	9.98	2394	0.13	15
OWEZ(G)	F	2	0.68	34	0.30	22	2.46	295	5.77	1200	6.65	1596	0.13	15
	C	2	0.68	34	0.30	22	2.46	295	8.65	1800	9.97	2394	0.13	15

[1] F = Frozen food, C = Ice cream

Lighting Data

Model	Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OWEZ/	- - -[2]	- - -	- - -	- - -
OWEZ(G)	- - -	- - -	- - -	- - -

[2] NOTE: - - - not an option on this case model.

Guidelines & Control Settings

Model	BTUH/cs[3]	Evaporator °F	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
OWEZ-F	2700	-18	-12	0	0	200
OWEZ-C	3300	-33	-22	-1	-12	200
OWEZ(G)-F	2700	-18	-12	0	0	200
OWEZ(G)-C	3300	-33	-22	-1	-12	200

[5] BTUH's/case listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[6] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OWEZ-F & C OWEZ(G)-F & C	1	60	49	- - -	- - -	20	59	- - -	- - -

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

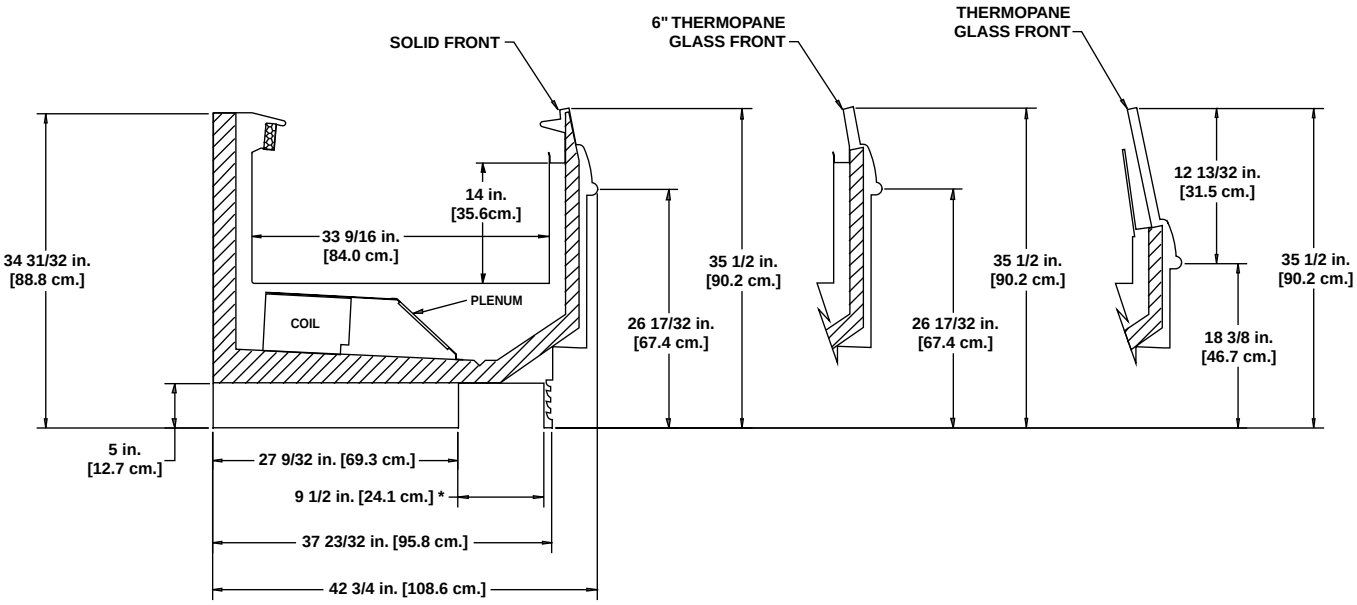

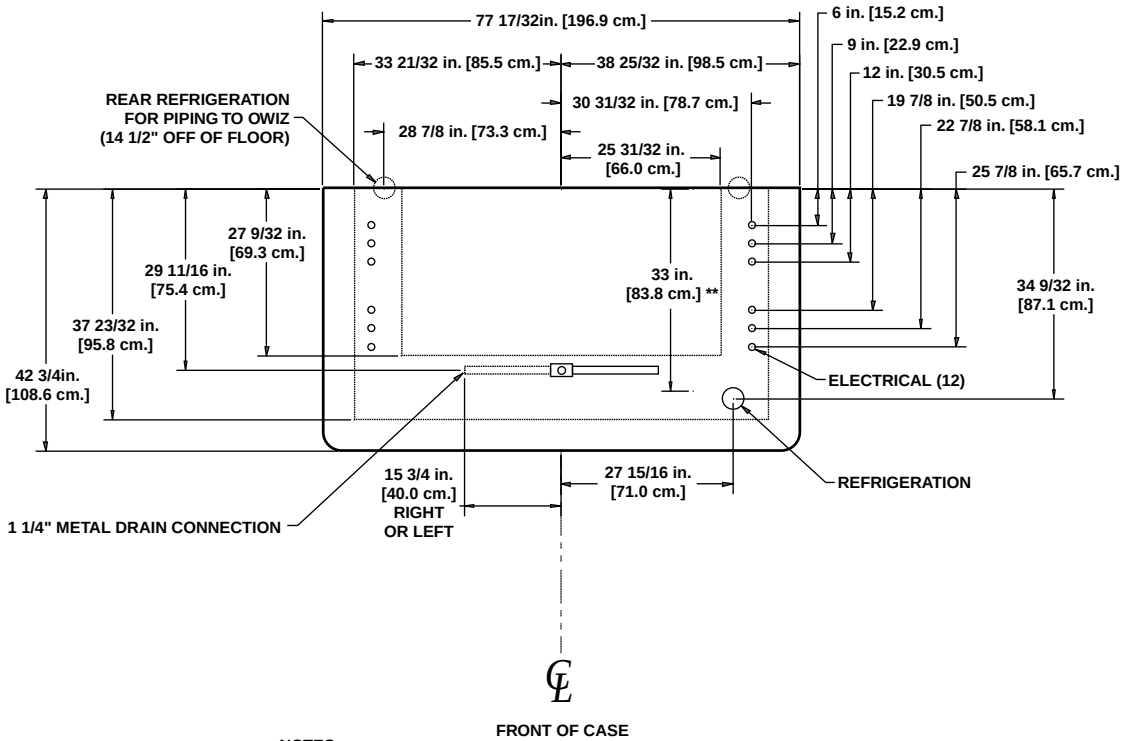

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

Island Frozen Food Merchandisers

OIZ - 8’ & 12’ intermediate island freezer

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts	Drain Heater 120 Volts Amps	Drain Heater 120 Volts Watts
OIZ	8’	3	1.02	51	0.45	33	1.31	157	15.38	3200	17.75	4260	0.13	15
	12’	4	1.36	68	0.60	44	1.99	239	23.08	4800	26.63	6390	0.13	15

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OIZ	8’	- - -[1]	- - -	- - -	- - -
	12’	- - -	- - -	- - -	- - -

[1] NOTE: - - - not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[3] (FPM)
OIZ	520	-24	-12	-3	-4	200

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIZ	1	45	43	- - -	- - -	20	59	- - -	- - -

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

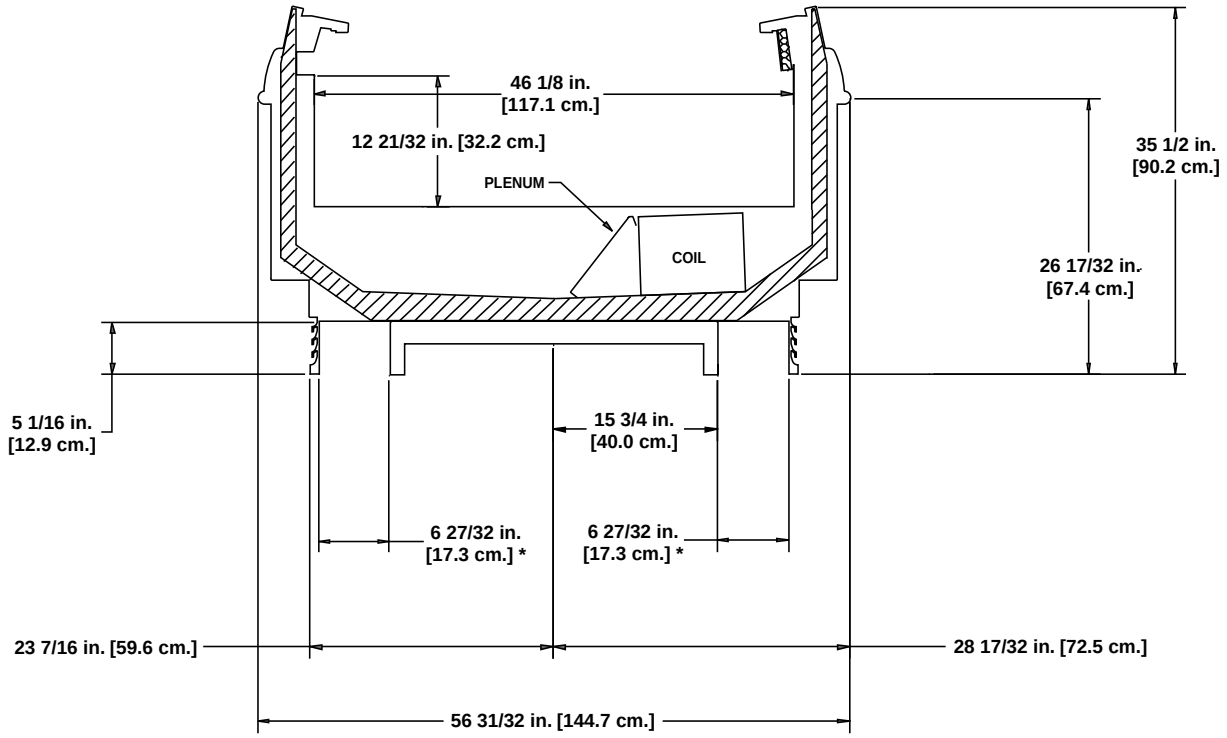

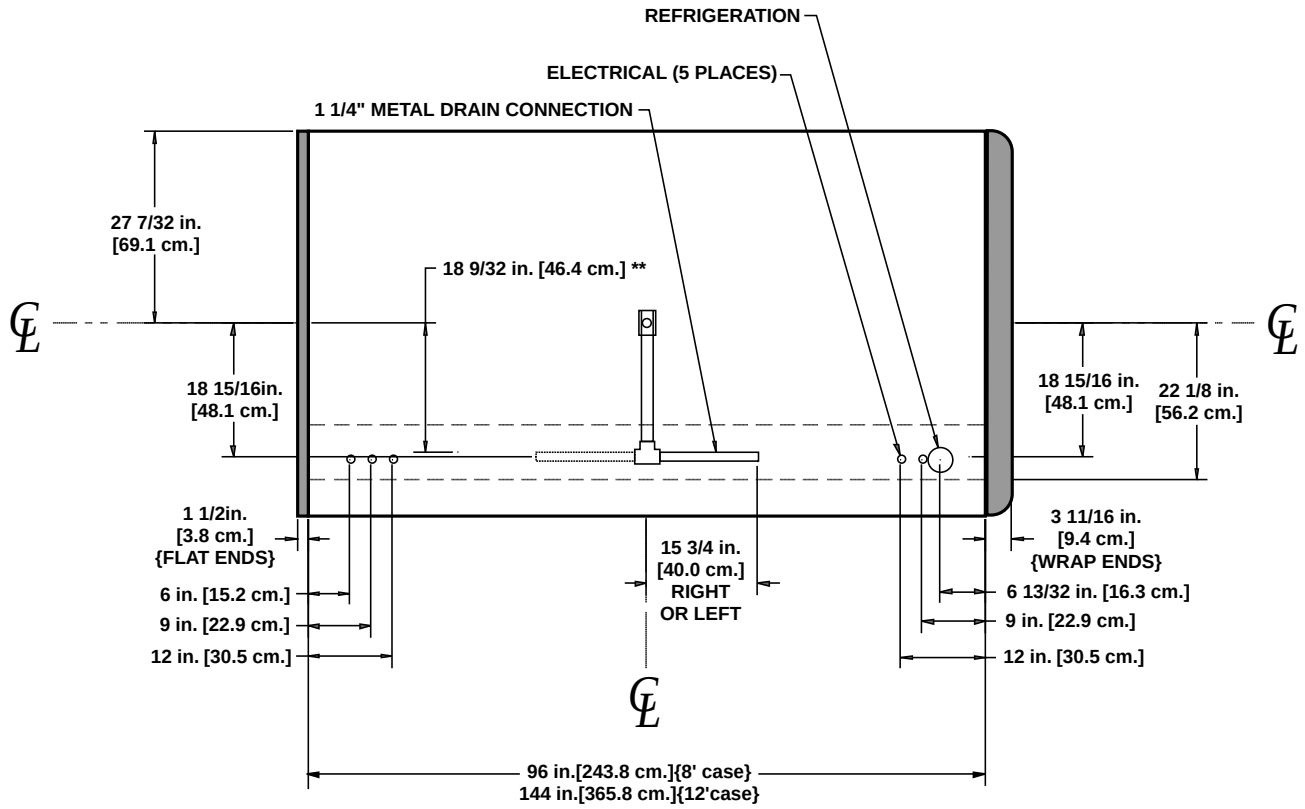

NOTES:

*** STUB-UP AREA**
**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

Narrow Island Frozen Food/Ice Cream Merchandisers

ONIZ(G) - 8' & 12' narrow island freezer

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate[2] Heaters 120 Volts Amps	Anti-Condensate[2] Heaters 120 Volts Watts	Defrost Heaters[3] 208 Volts Amps	Defrost Heaters[3] 208 Volts Watts	Defrost Heaters[3] 240 Volts Amps	Defrost Heaters[3] 240 Volts Watts	Drain Heaters 120 Volts Amps	Drain Heaters 120 Volts Watts
ONIZ	F-8'[1]	2	0.68	34	0.30	22	1.46	175	7.69	1600	8.88	2130	0.13	15
	F-12'	3	1.02	51	0.45	33	1.87	224	11.54	2400	13.31	3195	0.13	15
	C-8'	2	0.68	34	0.30	22	1.46	175	15.38	3200	17.75	4260	0.13	15
	C-12'	3	1.02	51	0.45	33	1.87	224	23.08	4800	26.63	6390	0.13	15
ONIZ(G)	F-8'	2	0.68	34	0.30	22	3.12	374	7.69	1600	8.88	2130	0.13	15
	F-12'	3	1.02	51	0.45	33	3.40	408	11.54	2400	13.31	3195	0.13	15
	C-8'	2	0.68	34	0.30	22	3.12	374	15.38	3200	17.75	4260	0.13	15
	C-12'	3	1.02	51	0.45	33	3.40	408	23.08	4800	26.63	6390	0.13	15

[1] F = Frozen food, C = Ice cream.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
ONIZ/ONIZ(G)-F	8'	- - -[2]	- - -	- - -	- - -
	12'	- - -	- - -	- - -	- - -
ONIZ/ONIZ(G)-C	8'	- - -	- - -	- - -	- - -
	12'	- - -	- - -	- - -	- - -

[2] NOTE: - - - not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
ONIZ/ONIZ(G)-F	369	-23	-12	-1	0	180
ONIZ/ONIZ(G)-C	412	-33	-22	-11	-9	180

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
ONIZ/ONIZ(G)-F	1	48	47	- - -	- - -	20	59	- - -	- - -
ONIZ/ONIZ(G)-C	1	48	47	- - -	- - -	20	59	- - -	- - -

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

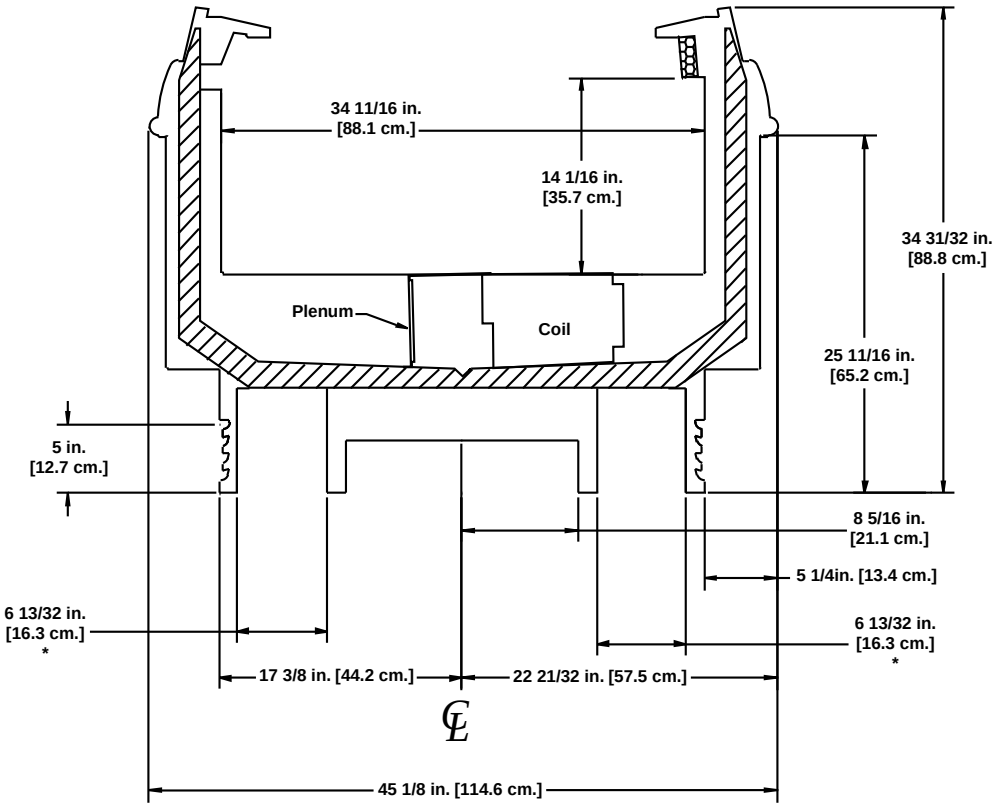

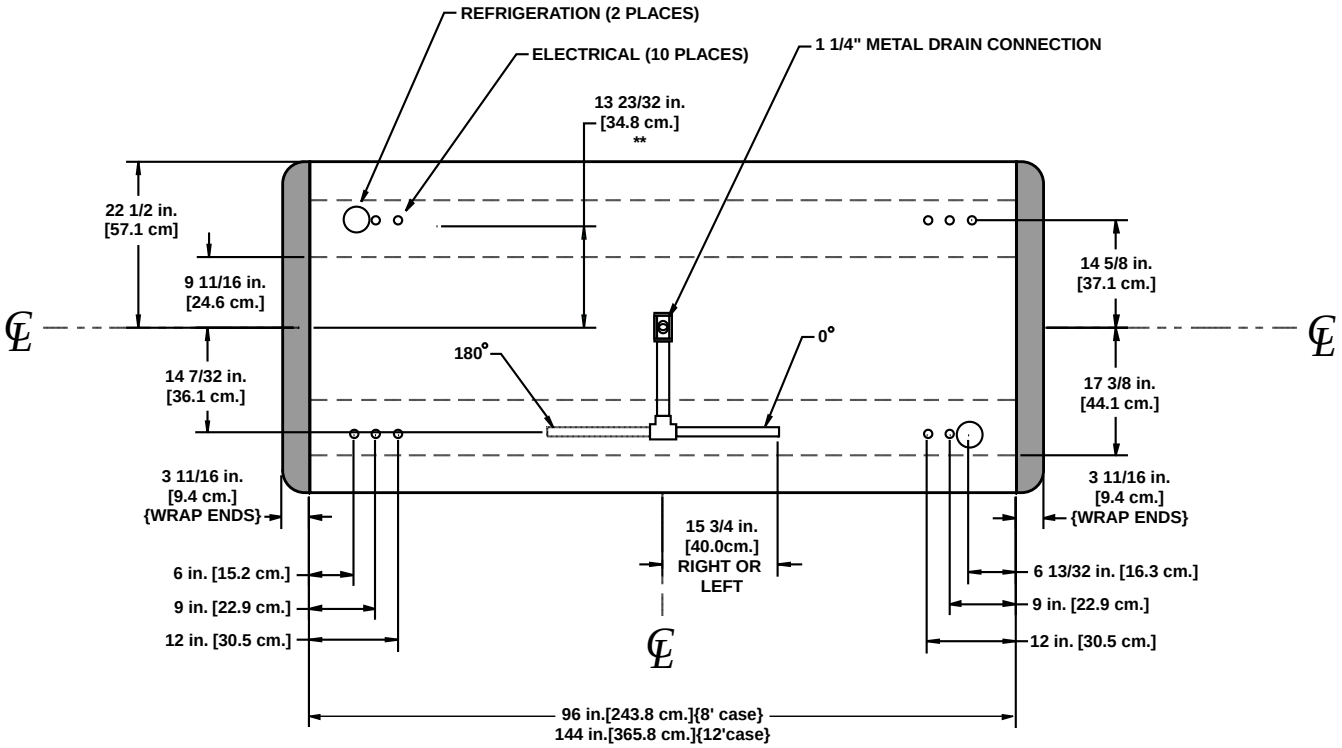

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

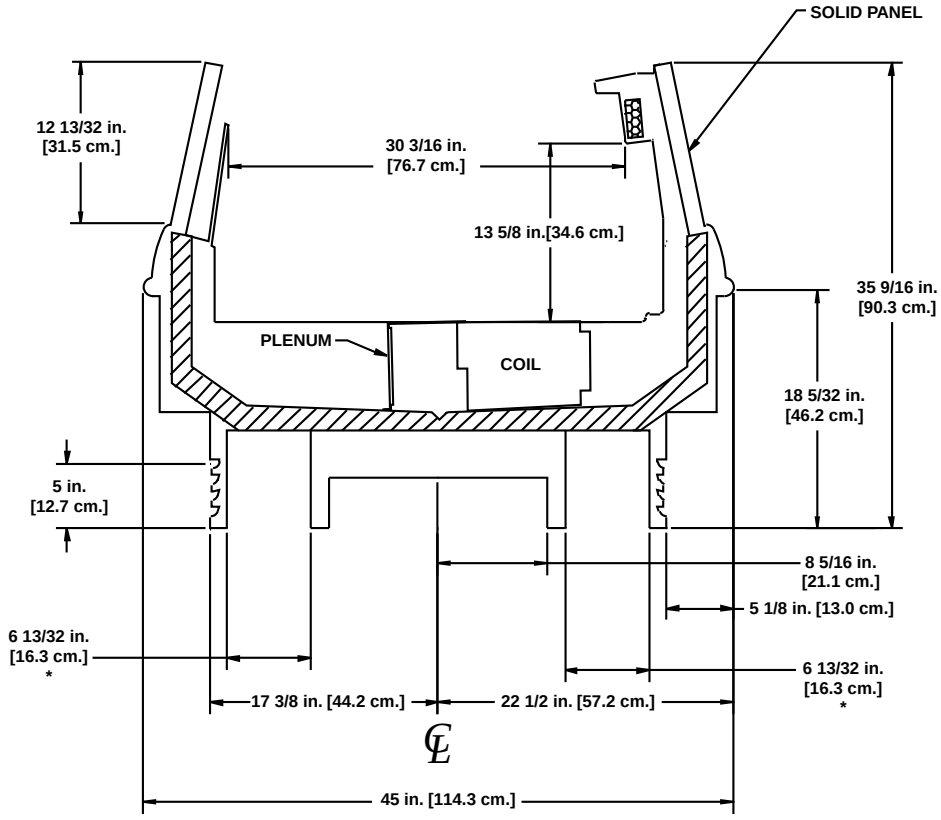
SOLID PANEL
12 13/32 in.
[31.5 cm.]
30 3/16 in.
[76.7 cm.]
13 5/8 in.[34.6 cm.]
35 9/16 in.
[90.3 cm.]
PLENUM
COIL
18 5/32 in.
[46.2 cm.]
5 in.
[12.7 cm.]
8 5/16 in.
[21.1 cm.]
5 1/8 in. [13.0 cm.]
6 13/32 in.
[16.3 cm.]
*
6 13/32 in.
[16.3 cm.]
*
17 3/8 in. [44.2 cm.]
22 1/2 in. [57.2 cm.]
45 in. [114.3 cm.]

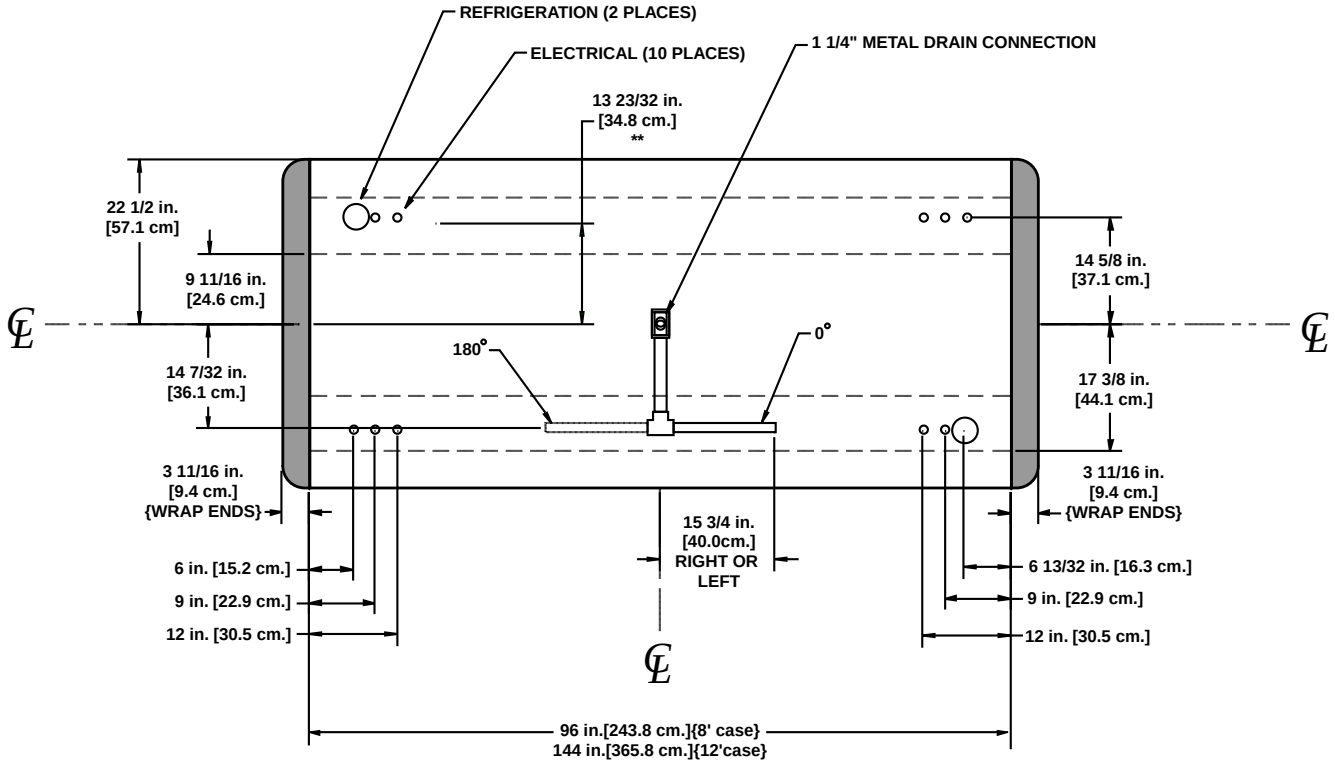
REFRIGERATION (2 PLACES)
ELECTRICAL (10 PLACES)
1 1/4" METAL DRAIN CONNECTION
13 23/32 in.
[34.8 cm.]
**
22 1/2 in.
[57.1 cm]
9 11/16 in.
[24.6 cm.]
14 7/32 in.
[36.1 cm.]
14 5/8 in.
[37.1 cm.]
17 3/8 in.
[44.1 cm.]
180°
0°
3 11/16 in.
[9.4 cm.]
{WRAP ENDS}
3 11/16 in.
[9.4 cm.]
{WRAP ENDS}
15 3/4 in.
[40.0cm.]
RIGHT OR
LEFT
6 in. [15.2 cm.]
9 in. [22.9 cm.]
12 in. [30.5 cm.]
6 13/32 in. [16.3 cm.]
9 in. [22.9 cm.]
12 in. [30.5 cm.]
96 in.[243.8 cm.]{8' case}
144 in.[365.8 cm.]{12'case}

NOTES:

Multi-Deck Island Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

Wide Island Multi-Deck Cheese Merchandisers

O3IC - 8’ & 12’ wide island double wraparound end
O3IC(B) - 6’, 8’, & 12’ wide island single wraparound end

Electrical Data

			Standard Fans		Hi Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IC	8’	6	2.04	102	0.90	66	0.82	98	4.34	902	5.00	1200
	12’	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000
O3IC(B)	6’	4	1.36	76	0.60	44	0.57	68	3.25	676	3.75	900
	8’	6	2.04	102	0.90	66	0.75	90	4.34	902	5.00	1200
	12’	8	2.72	136	1.20	88	1.17	141	7.22	1502	8.33	2000

Lighting Data

		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts	
Model		Amps	Watts	Amps	Watts
O3IC	8’	NA[1]	NA	5.71	546
	12’	NA	NA	7.46	779
O3IC(B)	6’	NA	NA	3.50	363
	8’	NA	NA	4.76	514
	12’	NA	NA	6.02	665

[1] Not applicable.

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
O3IC/O3IC(B)	1150[3]	17	29	37	48	160

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Add 700 BTUH per wrap end.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3IC/O3IC(B)	4	30	55	- - -[5]	- - -	26	55	- - -	- - -

[5] NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

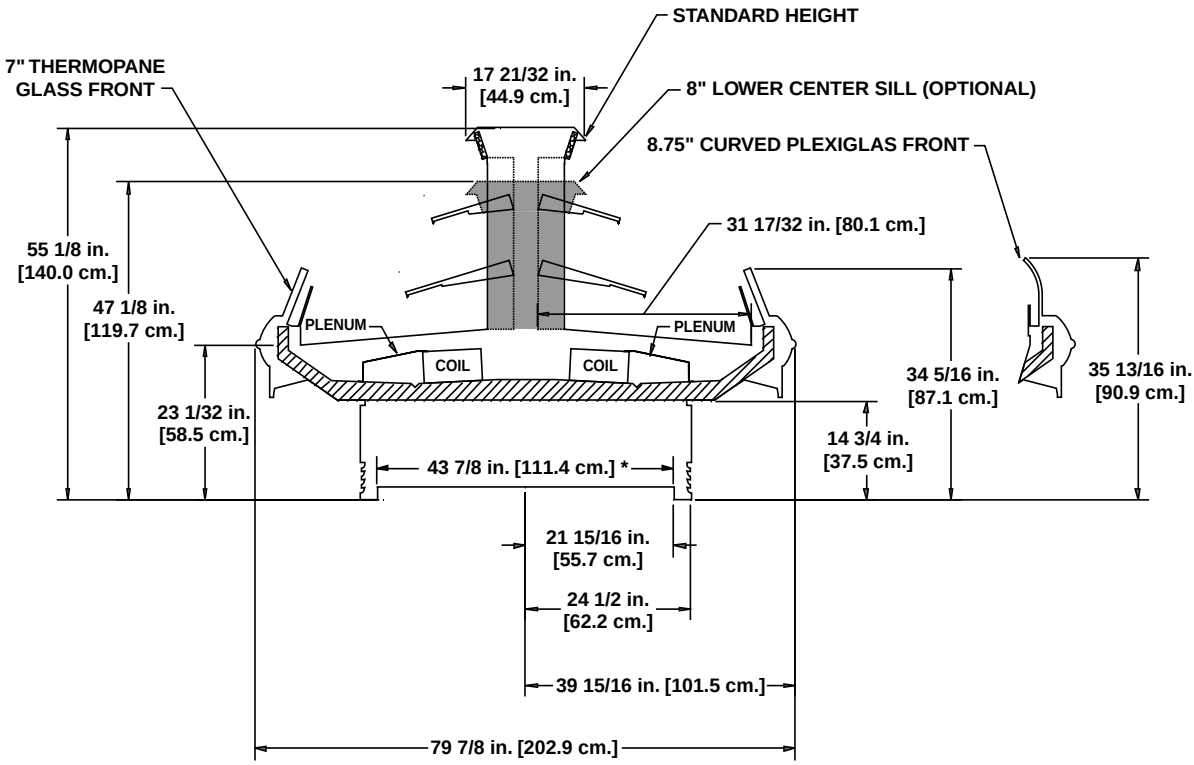

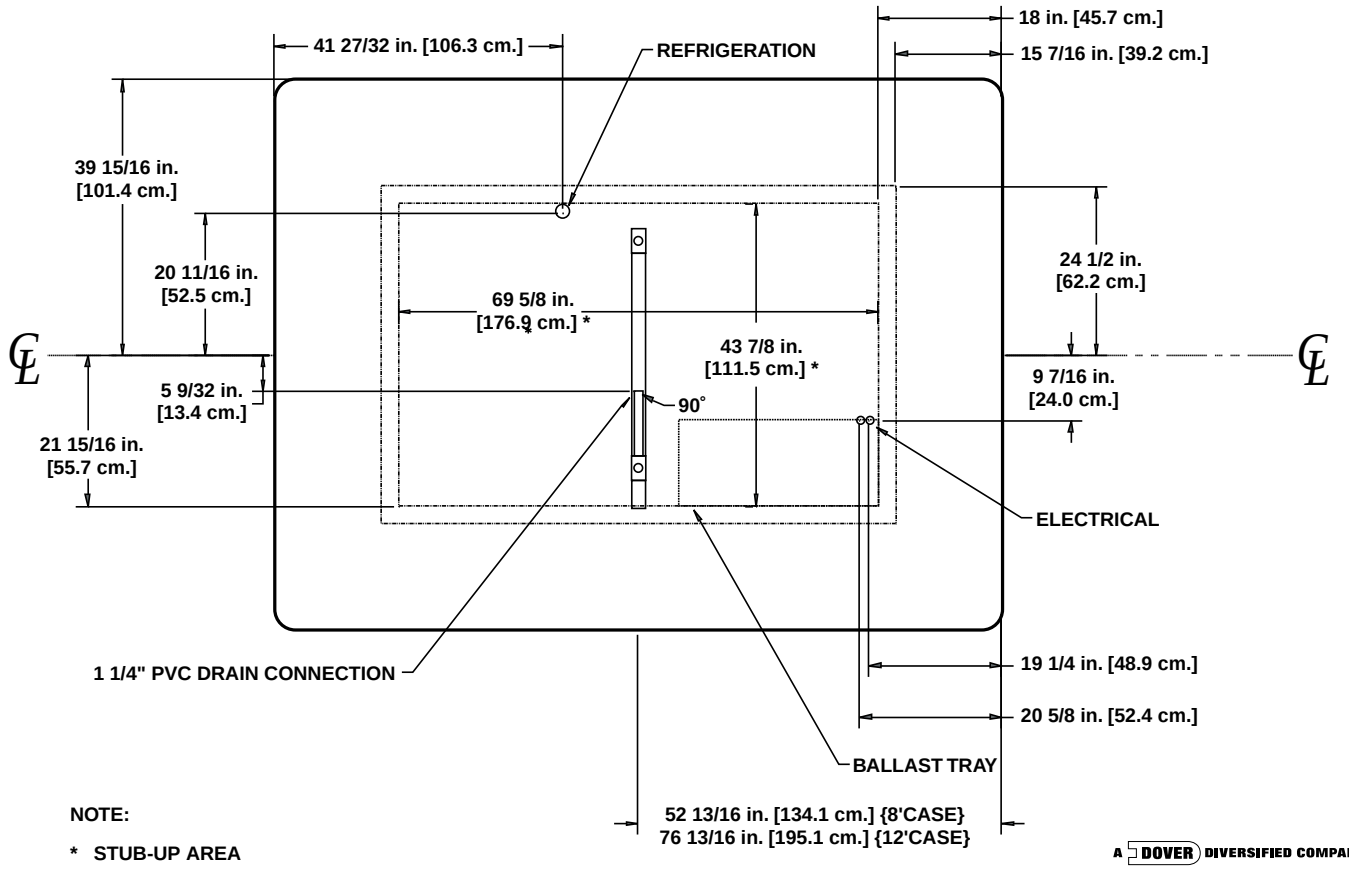

NOTE:

* STUB-UP AREA

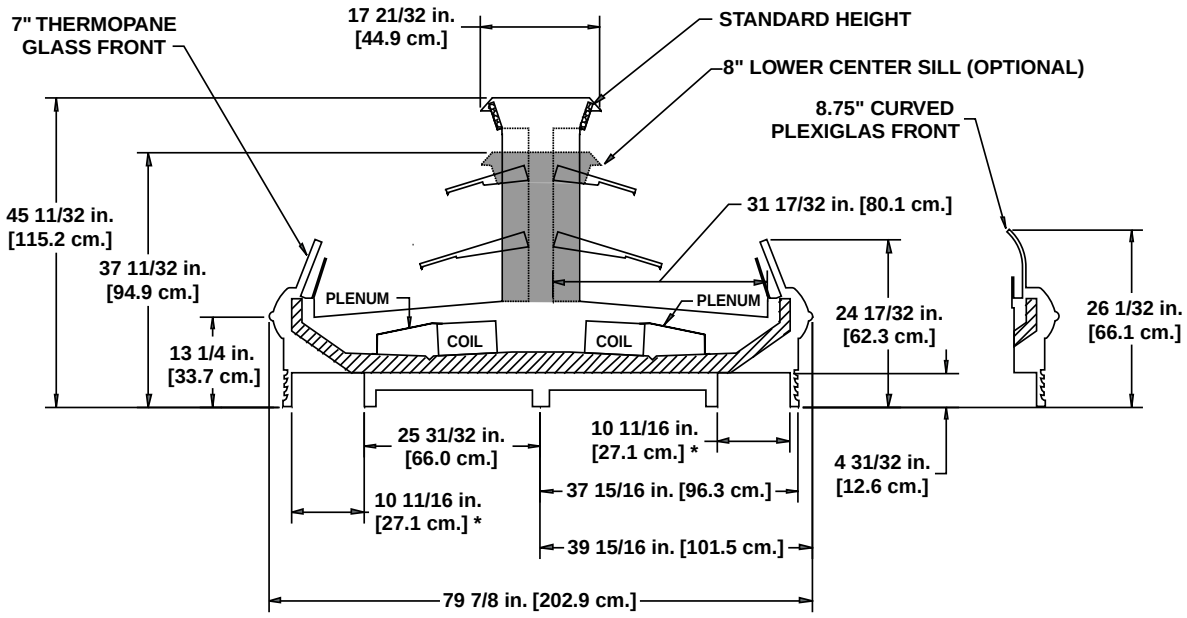

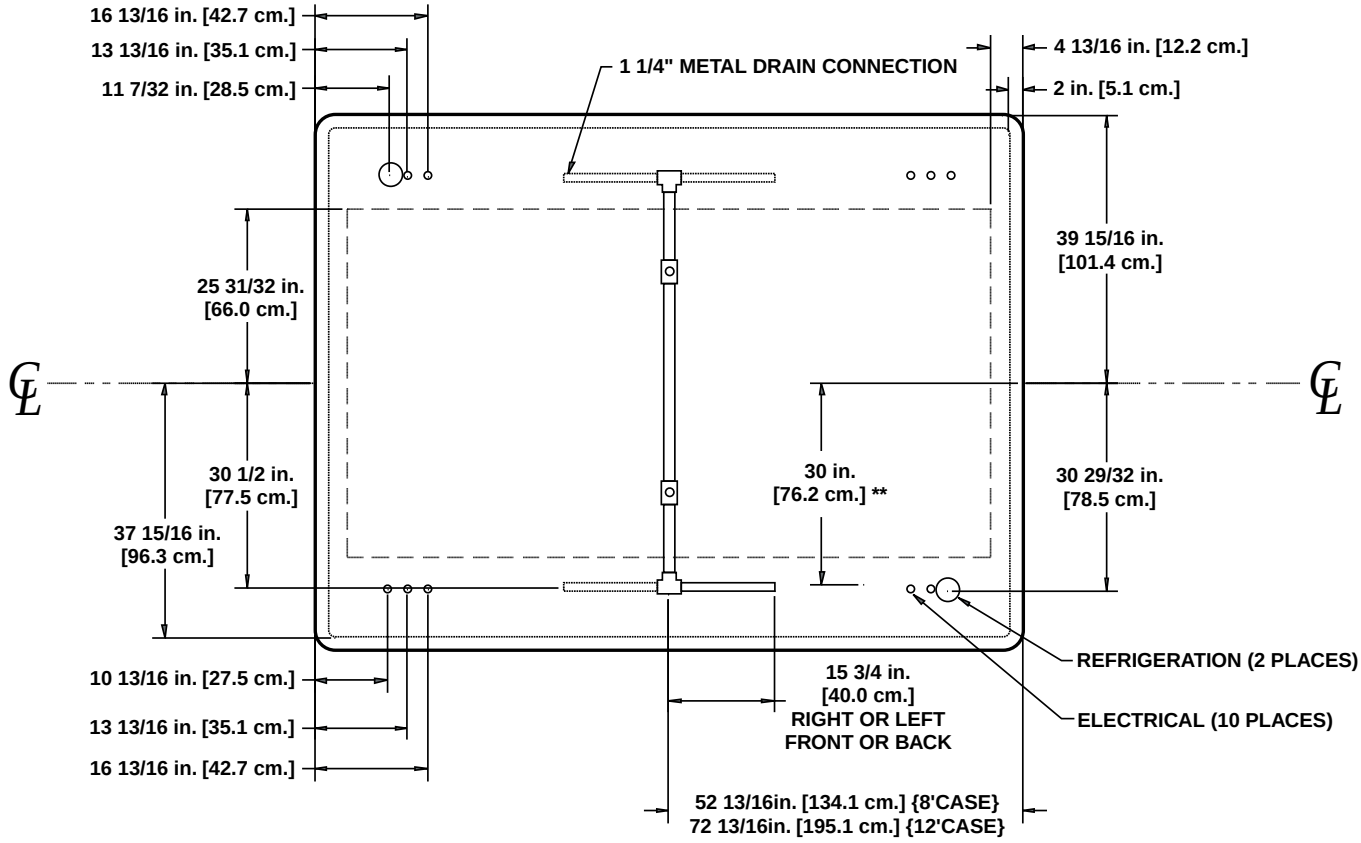

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

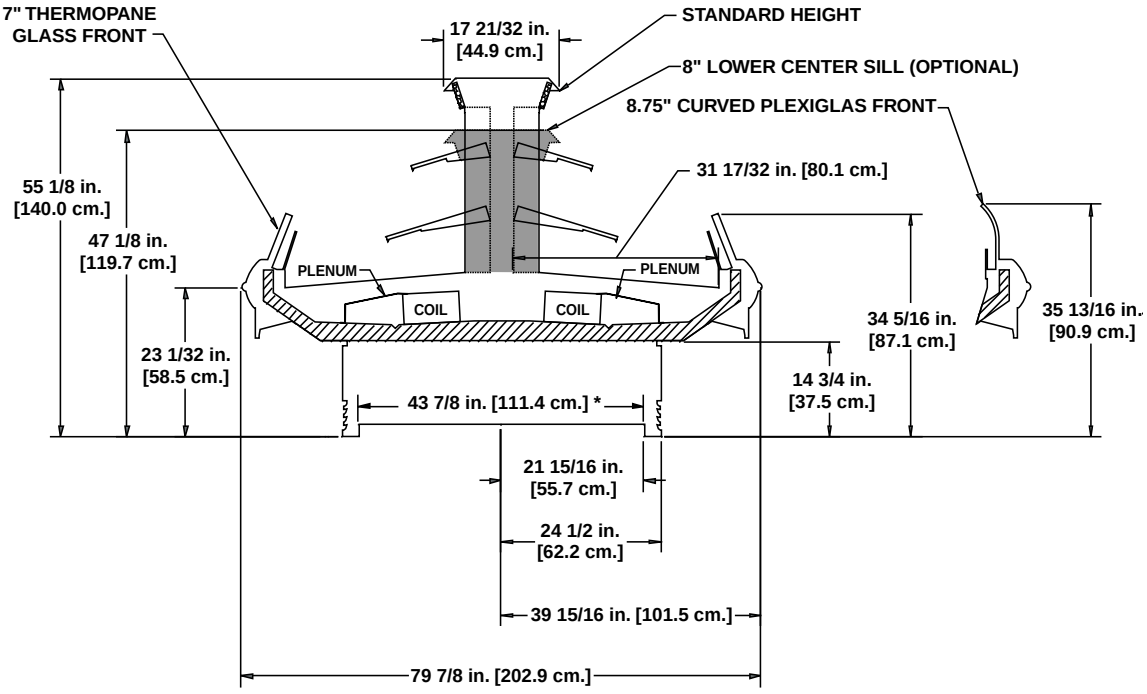

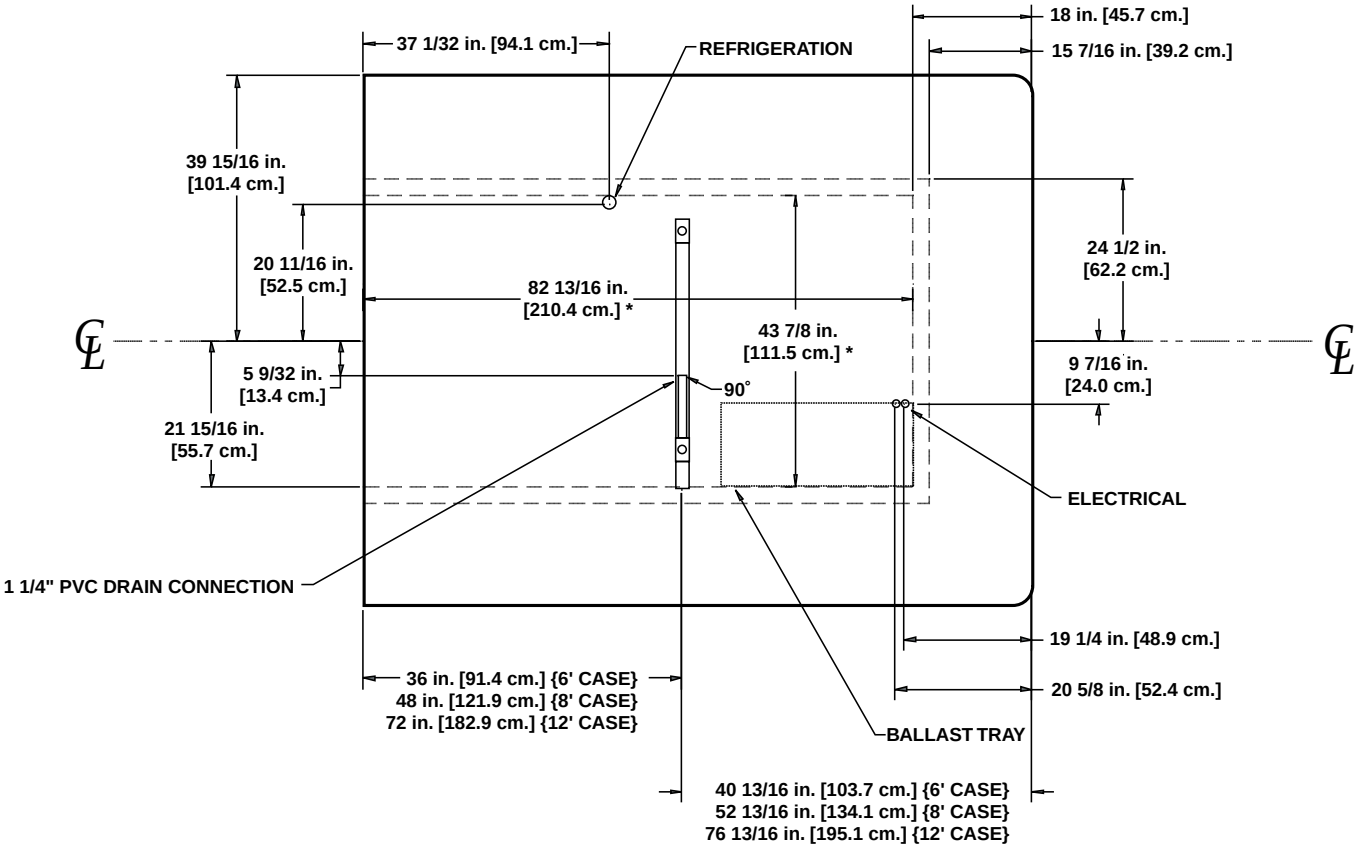

NOTE:

* STUB-UP AREA

O3IC(B)

(5" BASEFRAME)

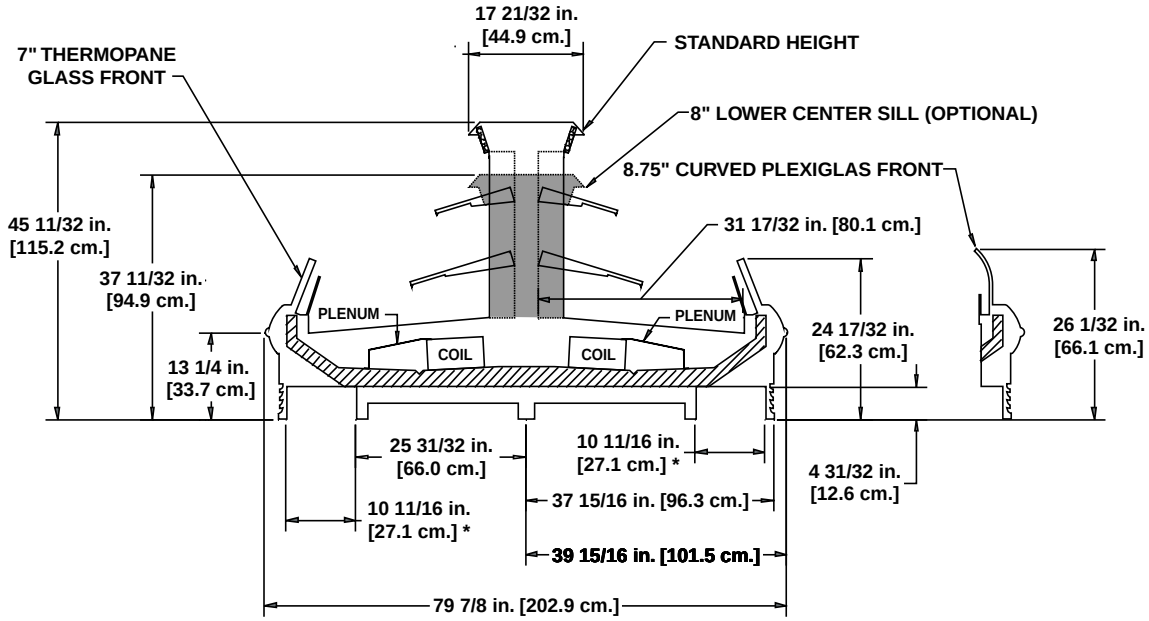

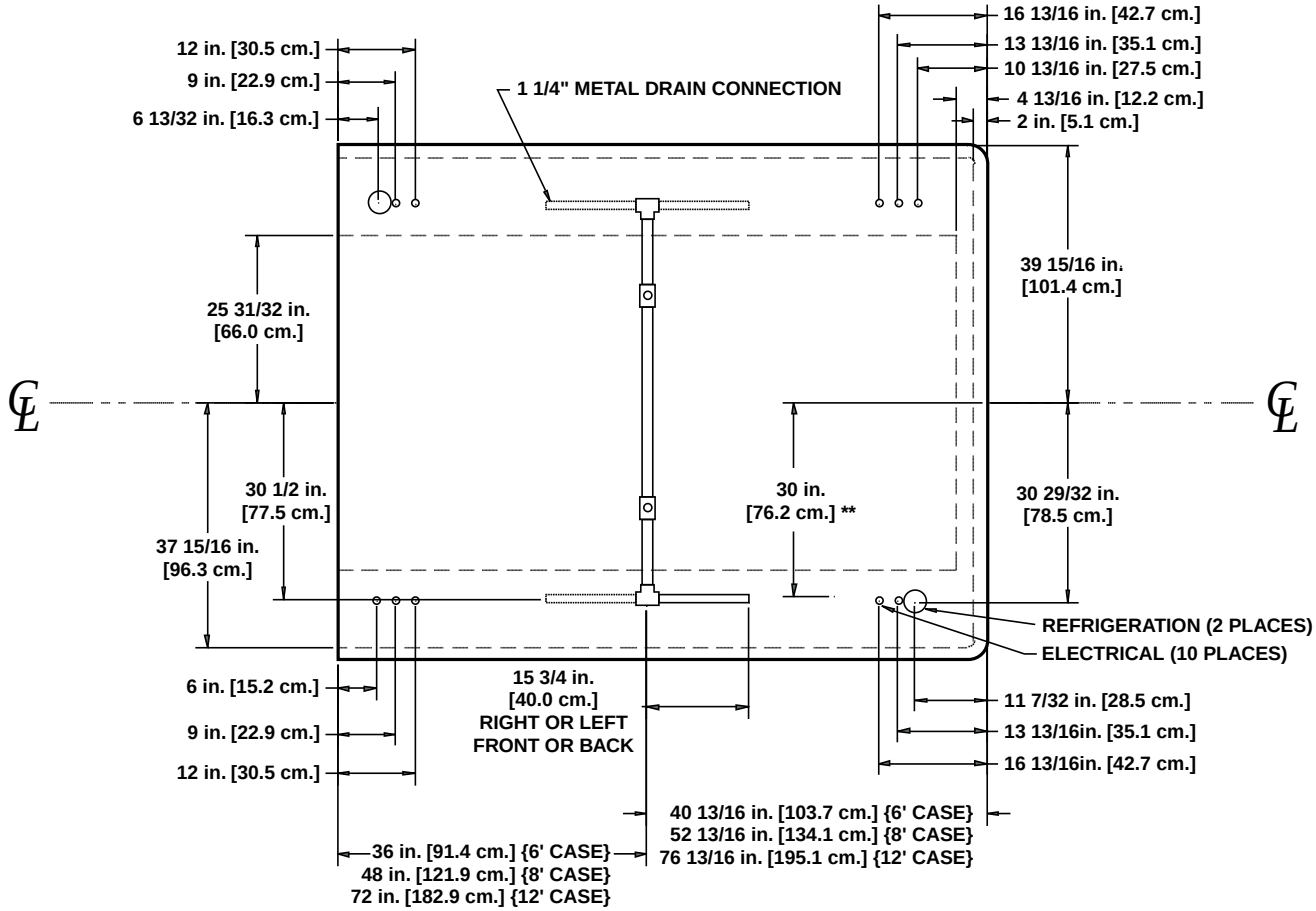

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

Wide Island Multi-Deck Produce Merchandisers

O3IP - 8’ & 12’ wide island double wraparound end
O3IP(B) - 8’ & 12’ wide island single wraparound end

Electrical Data

			Standard Fans		Hi Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IP	8’	6	2.04	102	0.90	66	0.82	98	- - -[1]	- - -	- - -	- - -
	12’	8	2.72	136	1.20	88	1.08	130	- - -	- - -	- - -	- - -
O3IP(B)	8’	6	2.04	102	0.90	66	0.75	90	- - -	- - -	- - -	- - -
	12’	8	2.72	136	1.20	88	1.17	140	- - -	- - -	- - -	- - -

[1] NOTE: --- not an option on this case model.

Lighting Data

		Typical per Light Row		Maximum Lighting	
		120 Volts		120 Volts	
Model		Amps	Watts	Amps	Watts
O3IP	8’	NA[2]	NA	5.71	546
	12’	NA	NA	7.46	779
O3IP(B)	8’	NA	NA	4.76	514
	12’	NA	NA	6.02	665

[2] Not applicable.

Guidelines & Control Settings

Model	BTUH/ft[3]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[5] (FPM)
O3IP/O3IP(B)	1050[4]	22	34	41	48	160

[3] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[4] Add 650 BTUH per wrap end.

[5] Average discharge air velocity at peak of defrost.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3IP/O3IP(B)	4	- - -	- - -	44	38	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

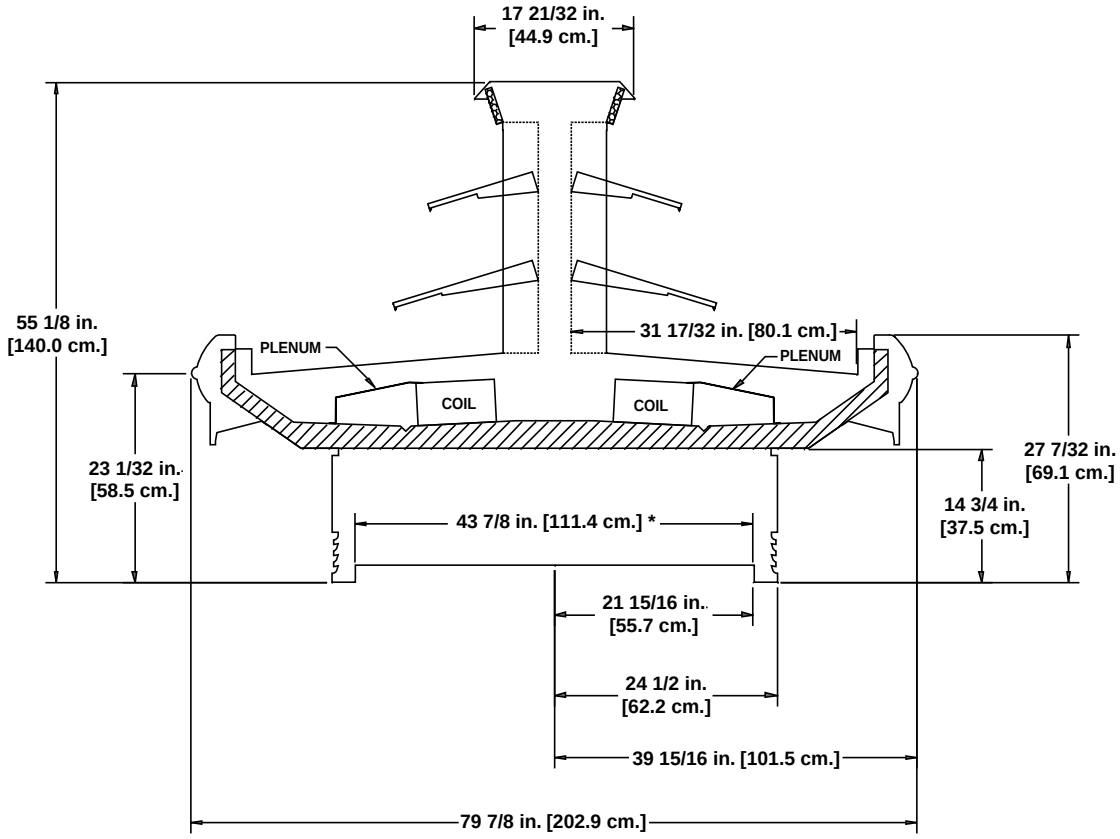

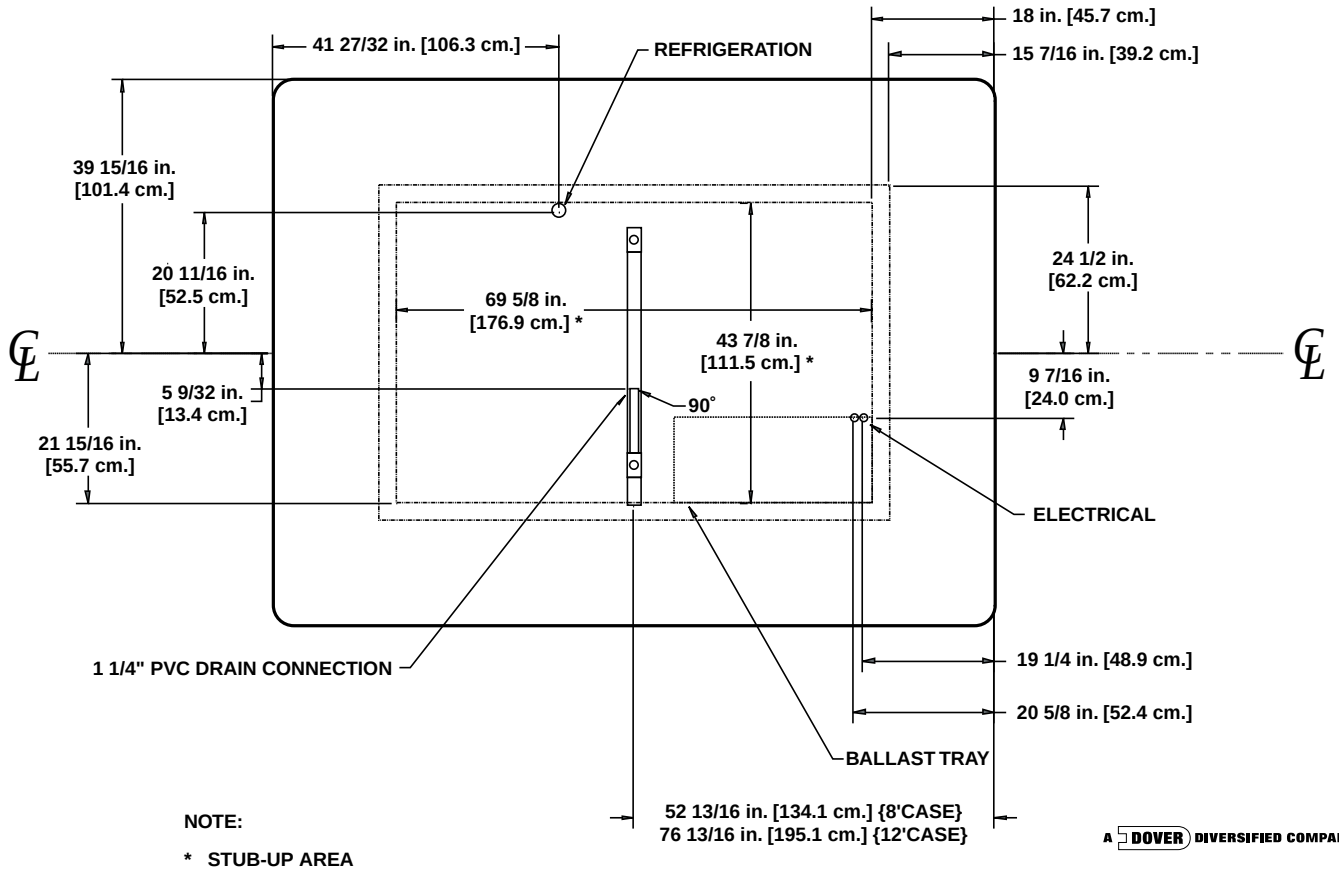

NOTE:

* STUB-UP AREA

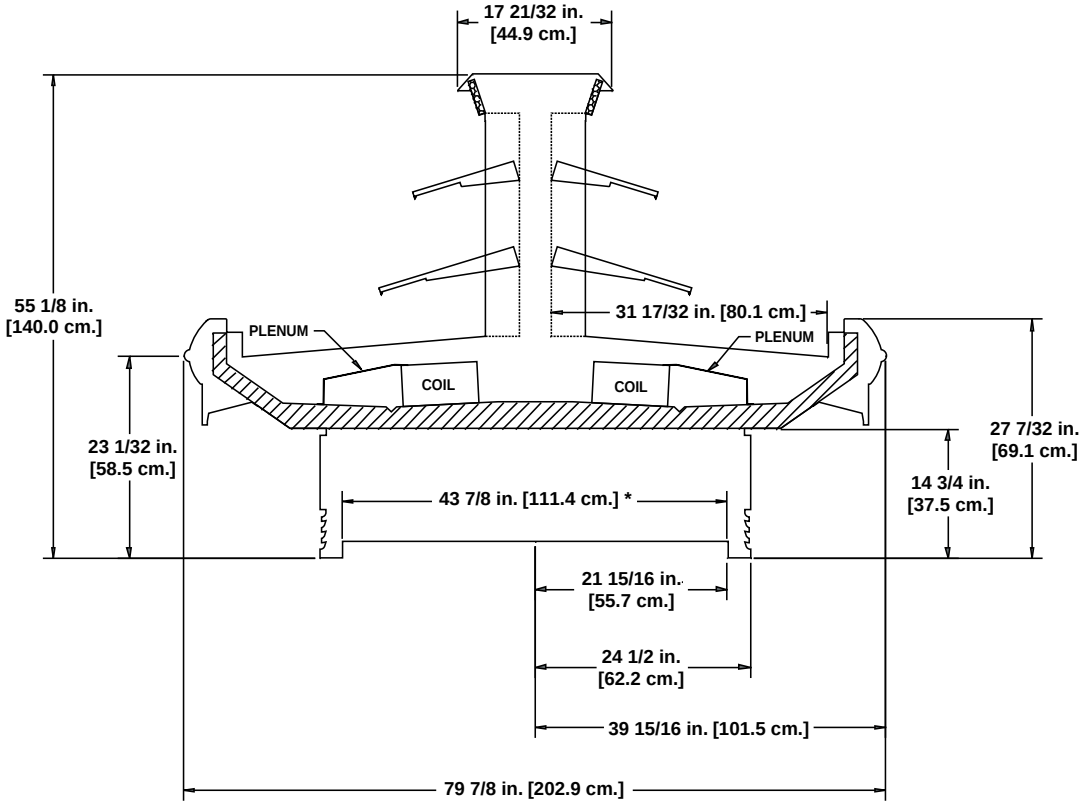

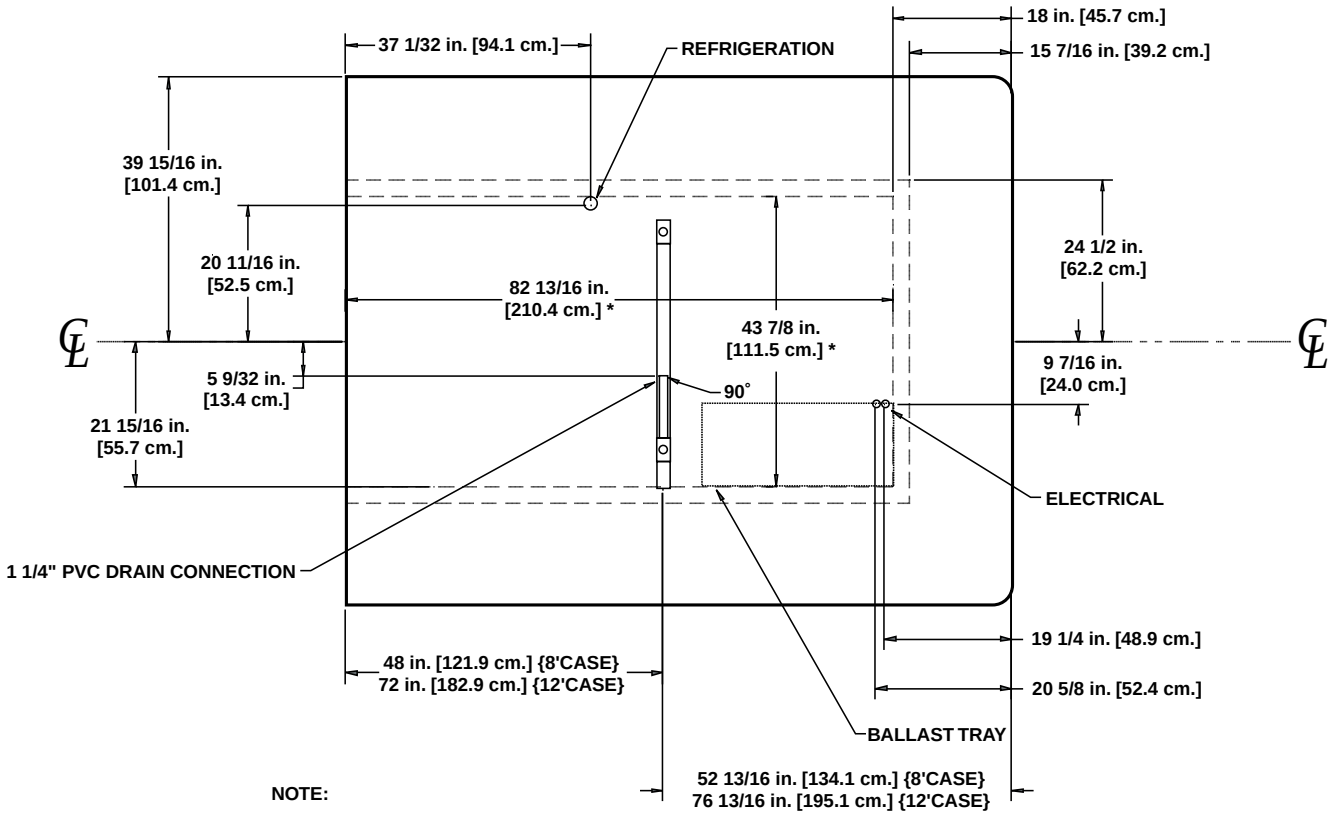

NOTE:

* STUB-UP AREA

A DOVER DIVERSIFIED COMPANY

Service Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** *Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

American Style Deli Merchandisers

OSA - 6', 8', & 12' american style full service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OSA	6'	2	0.68	34	0.30	22	0.42	50	2.88	600	3.33	798
	8'	3	1.02	51	0.45	33	0.97	116	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.50	180	5.77	1200	6.66	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OSA	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	3.85	462

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OSA w/ Shelf Lights	320	22	24	37	39	235
OSA w/o Shelf Lights	290	22	24	35	39	235

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost[3] Fail-safe (min)	Timed Off Defrost[3] Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OSA	2	35	50	75	50	- - -[4]	- - -	- - -	- - -

[3] Not recommended on this model due to long defrost time.

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

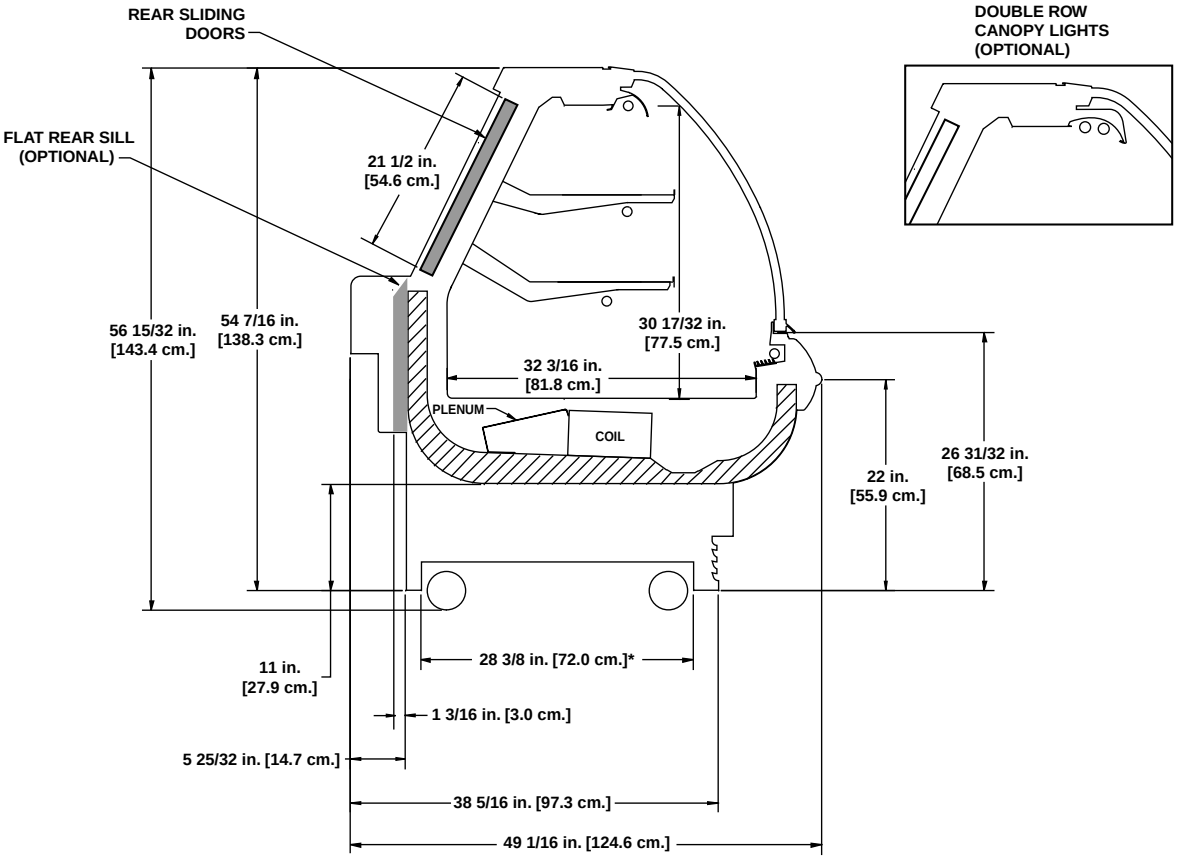

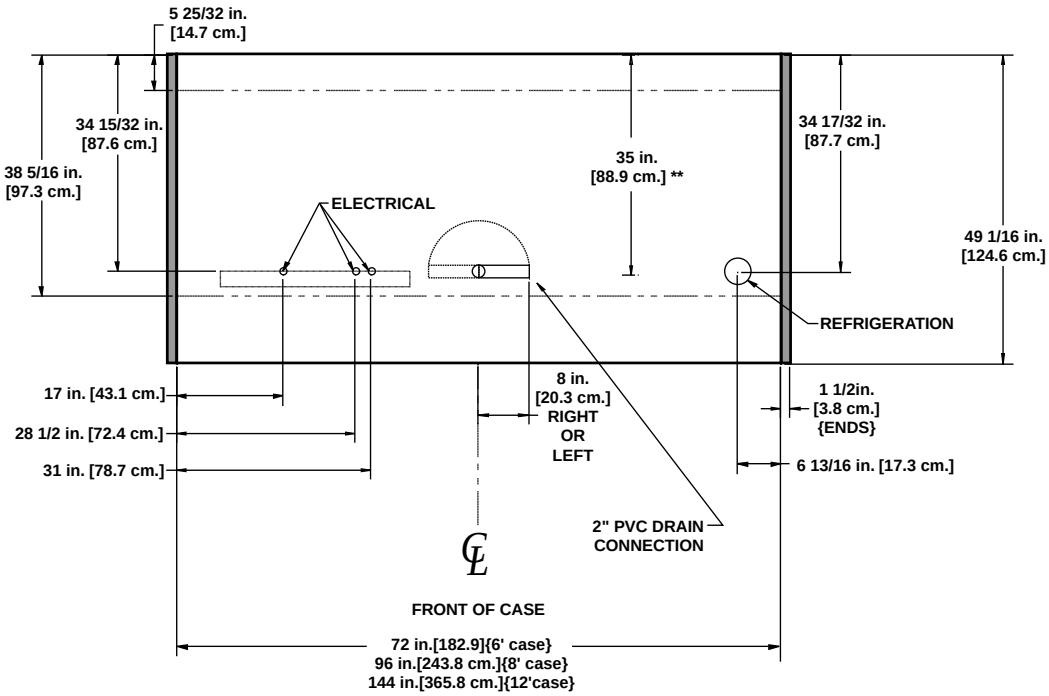

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

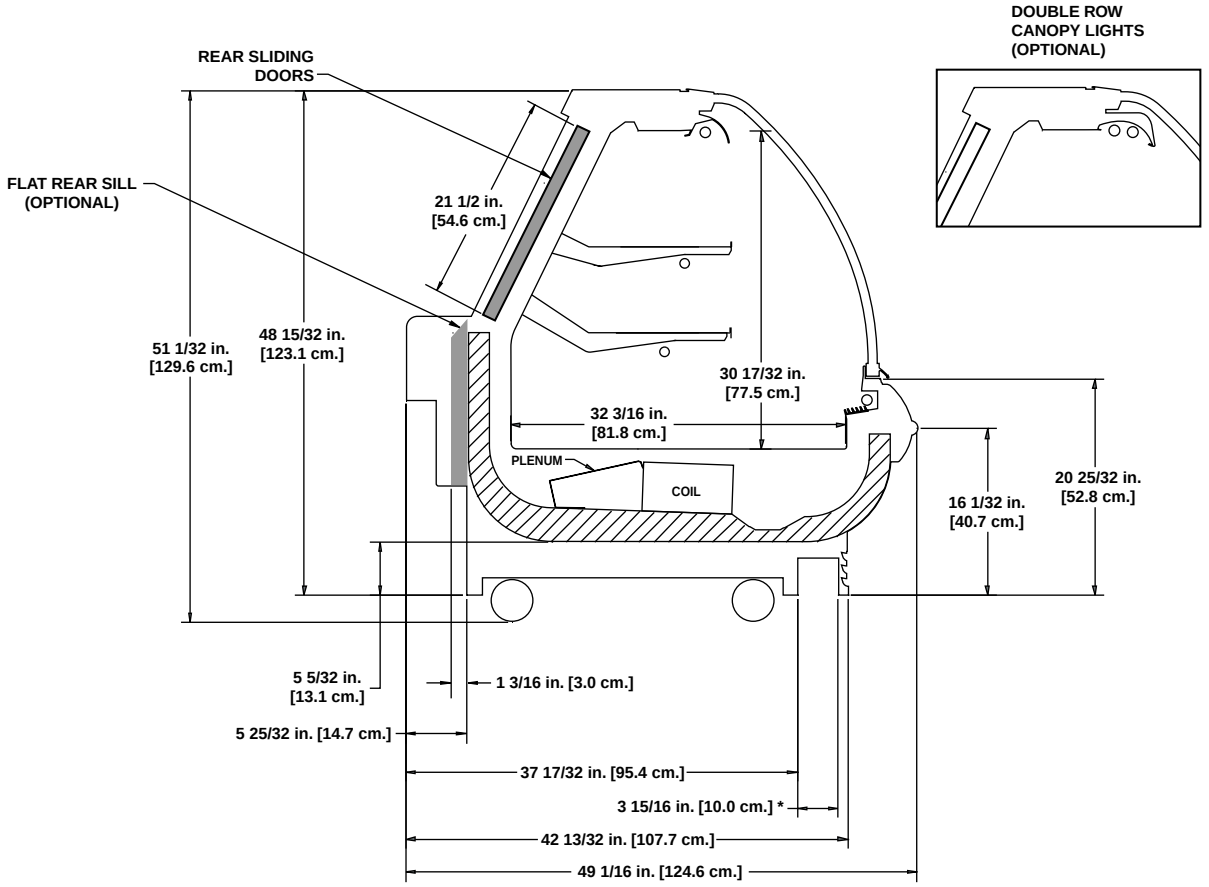

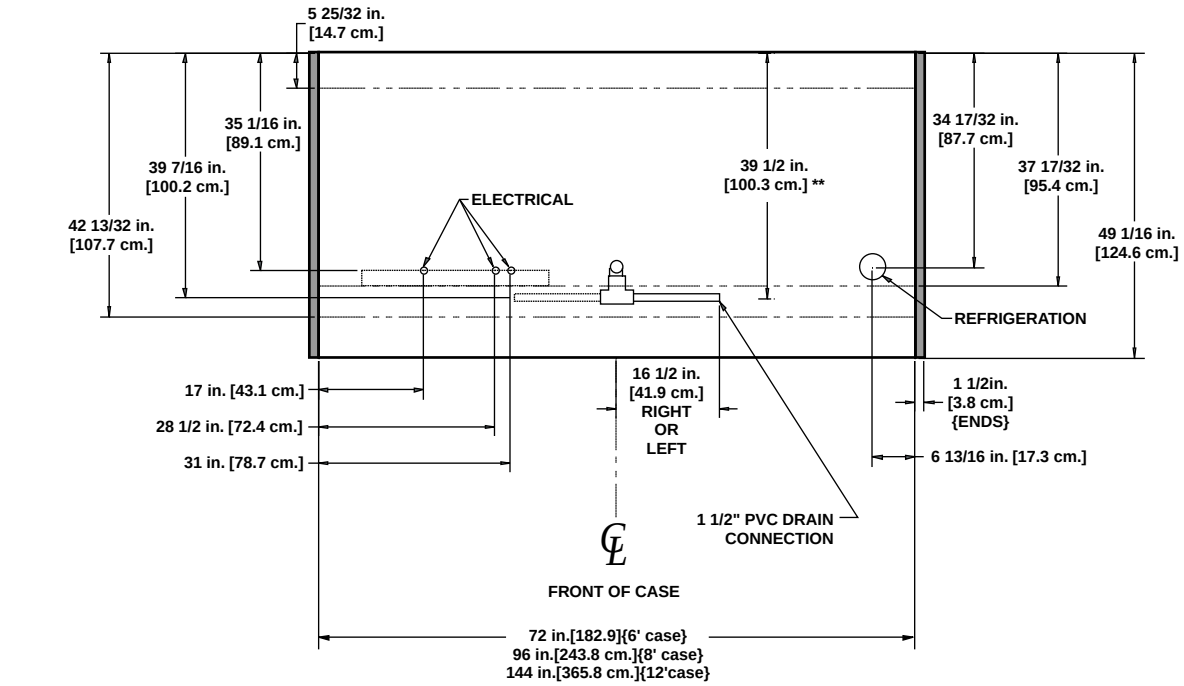

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

American Style Flat Glass Deli Merchandisers

OSM - 8' & 12' american style flat glass full service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OSM	8'	3	1.02	51	0.45	33	0.97	116	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.50	180	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OSM	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OSM	320	22	24	37	39	235

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost[3] Fail-safe (min)	Timed Off Defrost[3] Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OSM	2	35	50	75	50	- - -[4]	- - -	- - -	- - -

[3] Not recommended on this model due to long defrost time.

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

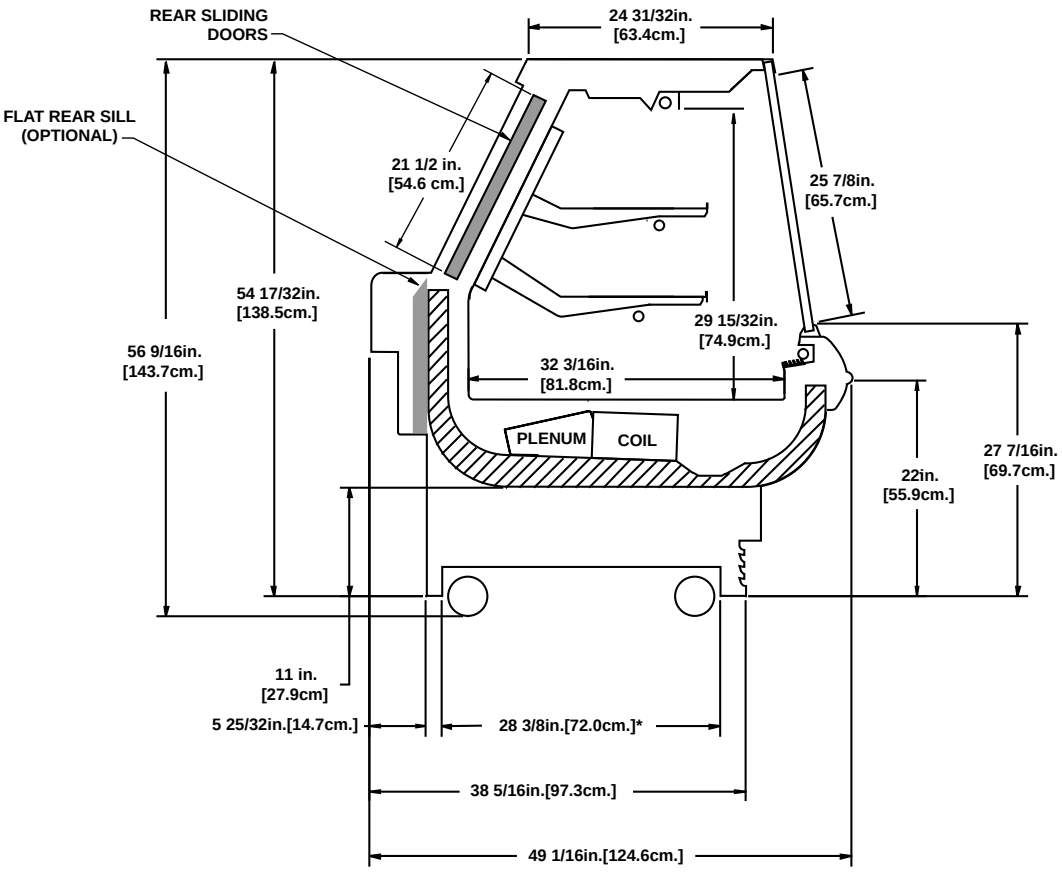

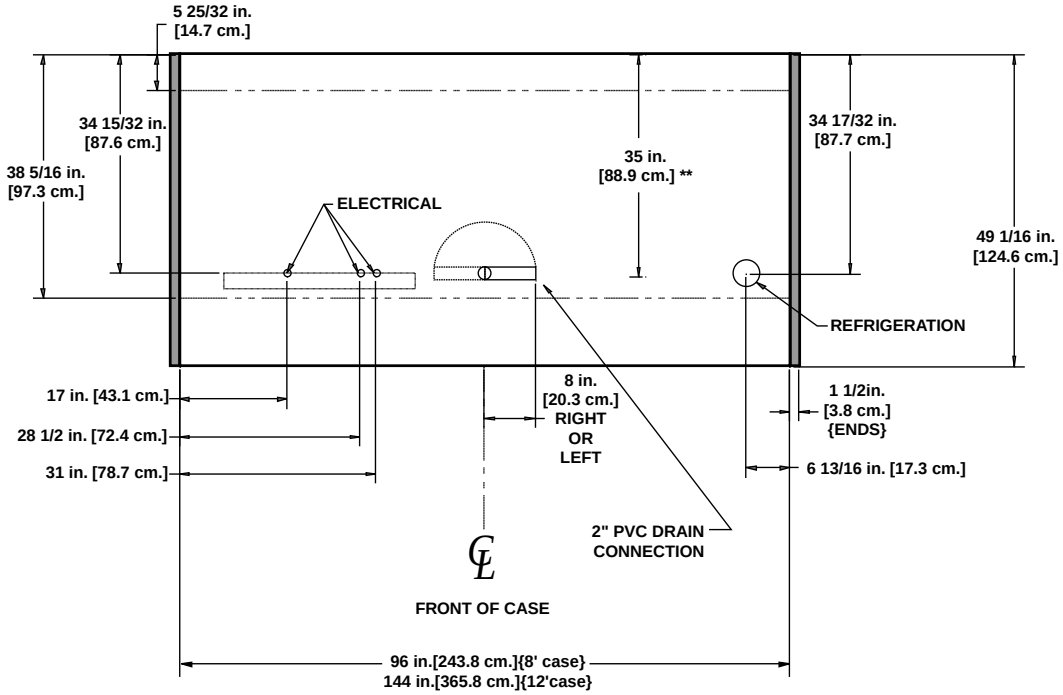

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

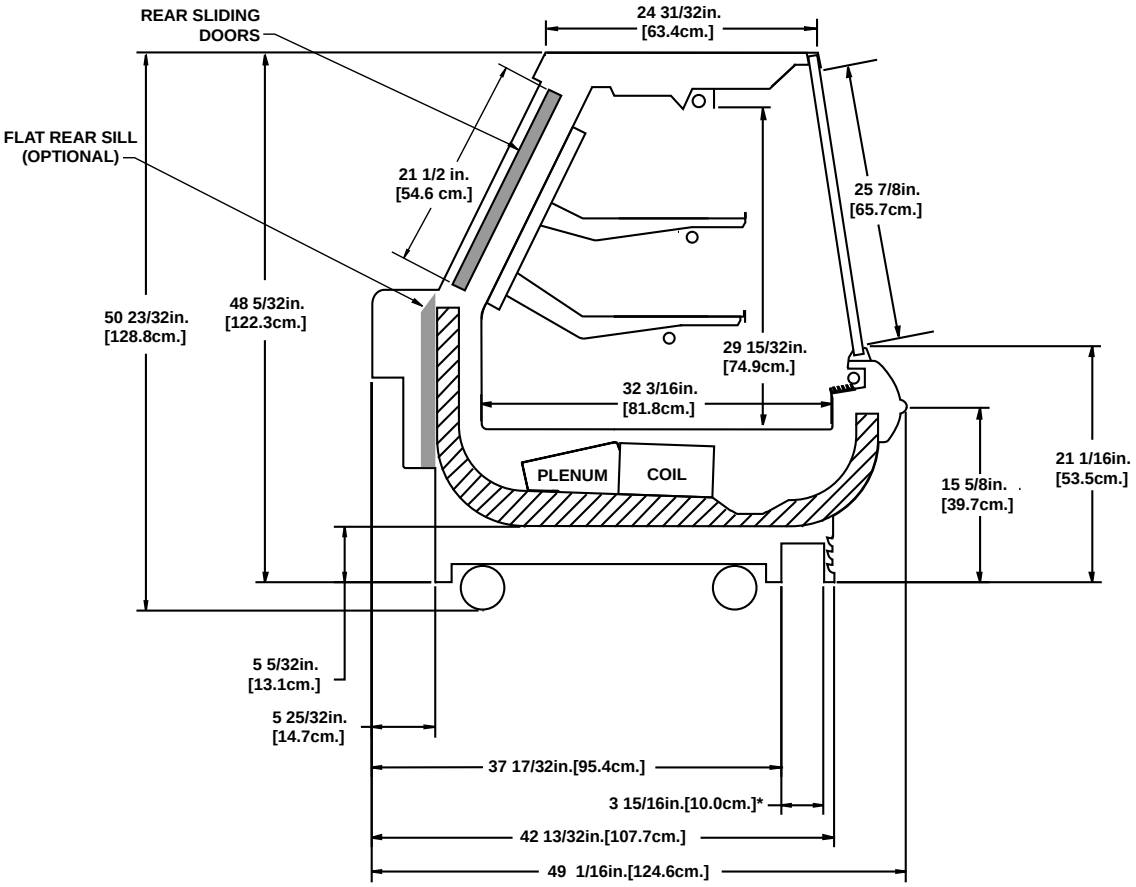

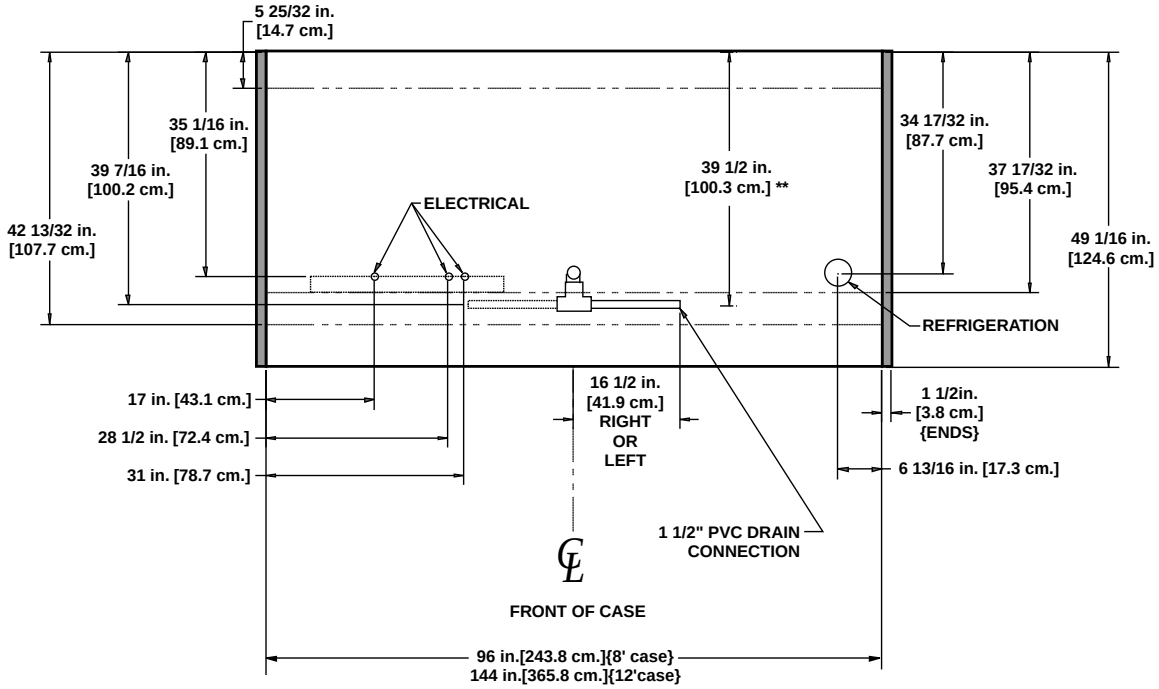

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

American Style Meat/Deli/Seafood Gravity Coil Merchandisers

OSAG - 8' & 12' american style full service, gravity coil

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OSAG	8'	3	1.02	51	0.45	33	0.97	116	- - -[1]	- - -	- - -	- - -
	12'	4	1.36	68	0.60	44	1.50	180	- - -	- - -	- - -	- - -

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OSAG	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air[3] (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
OSAG	270	12	21-31	37	38	125

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Measured 1" below louver.

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OSAG	2	- - -	- - -	65	46	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

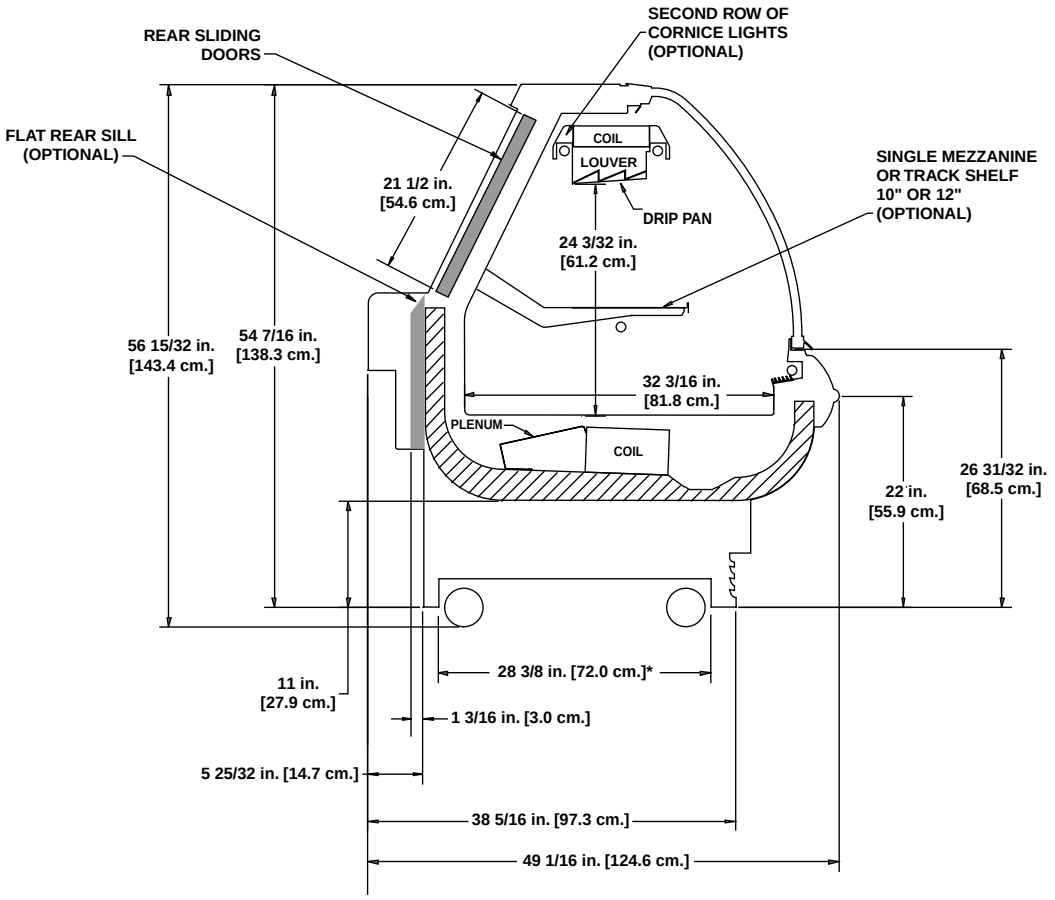

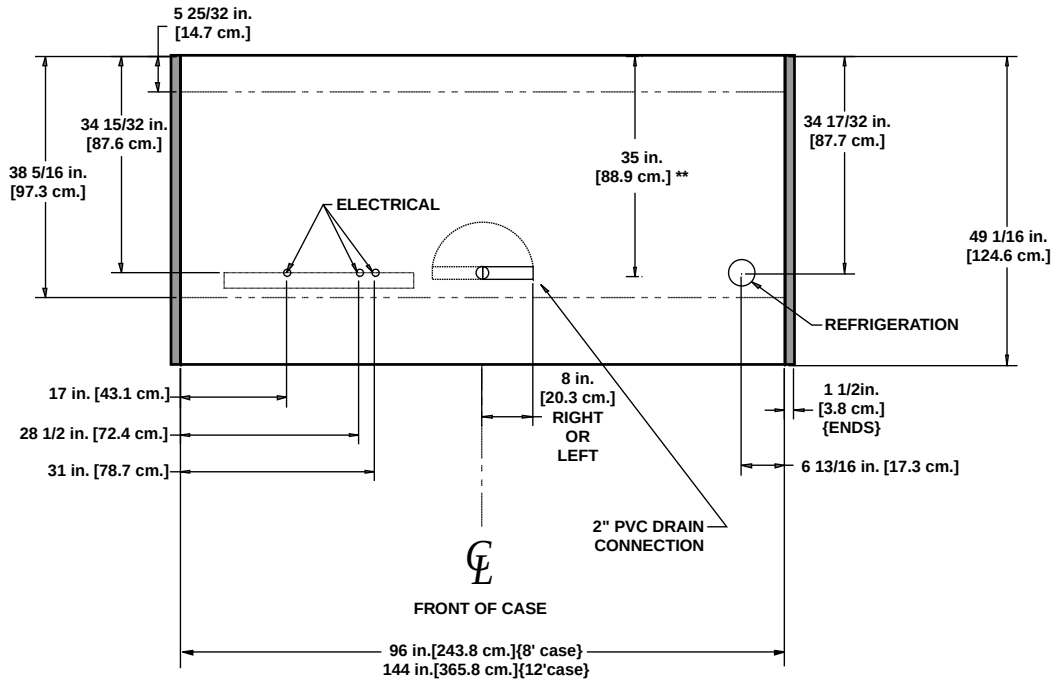

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SERPENTINE COIL AVAILABLE FOR FISH/SEAFOOD APPLICATION ONLY

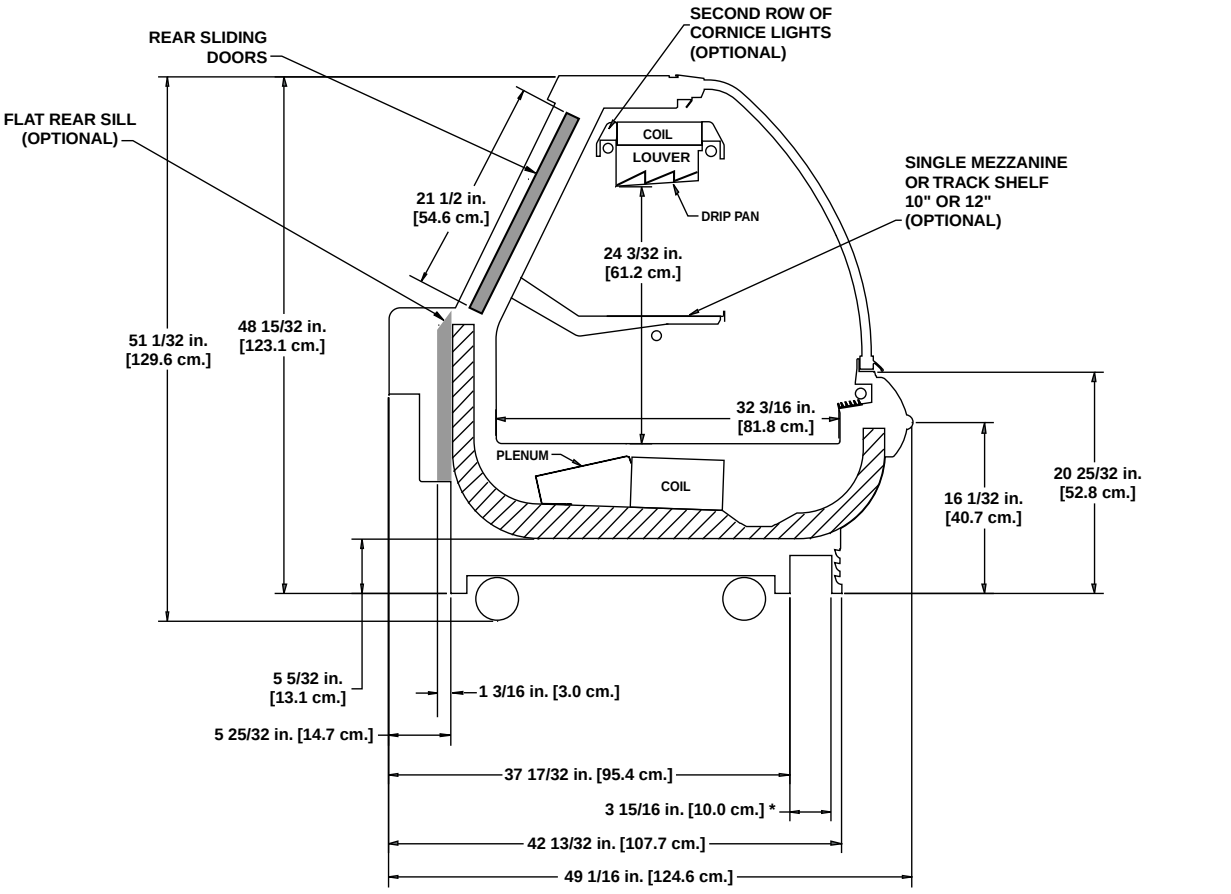

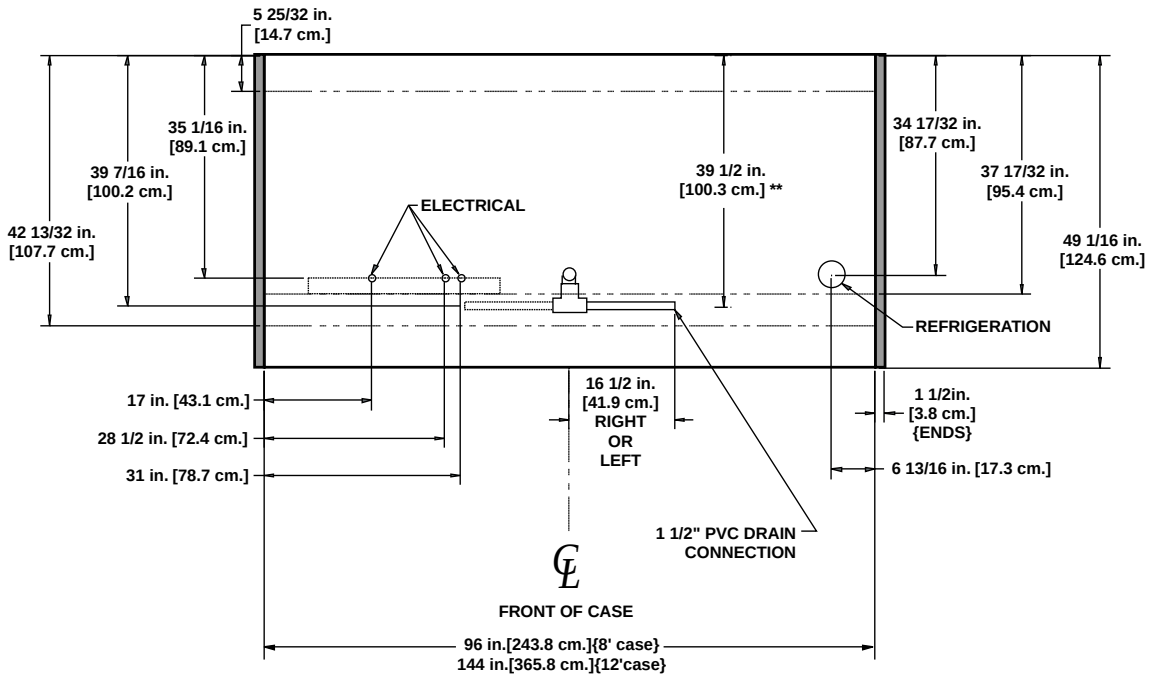

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SERPENTINE COIL AVAILABLE FOR FISH/SEAFOOD APPLICATION ONLY

American Style Flat Glass Meat/Deli/Seafood Gravity Coil Merchandisers

OGM - 8' & 12' american style flat glass full service, gravity coil

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OGM	8'	0	- - -[1]	- - -	- - -	- - -	0.97	116	- - -	- - -	- - -	- - -
	12'	0	- - -	- - -	- - -	- - -	1.50	180	- - -	- - -	- - -	- - -

[1] NOTE: - - - not an option on this case model.

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OGM	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	BTUH/ft[2]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[4] (FPM)
OGM	226	17	NA[3]	35	NA	NA

[2] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[3] Not applicable

[4] Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OGM	2	- - -	- - -	65	46	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

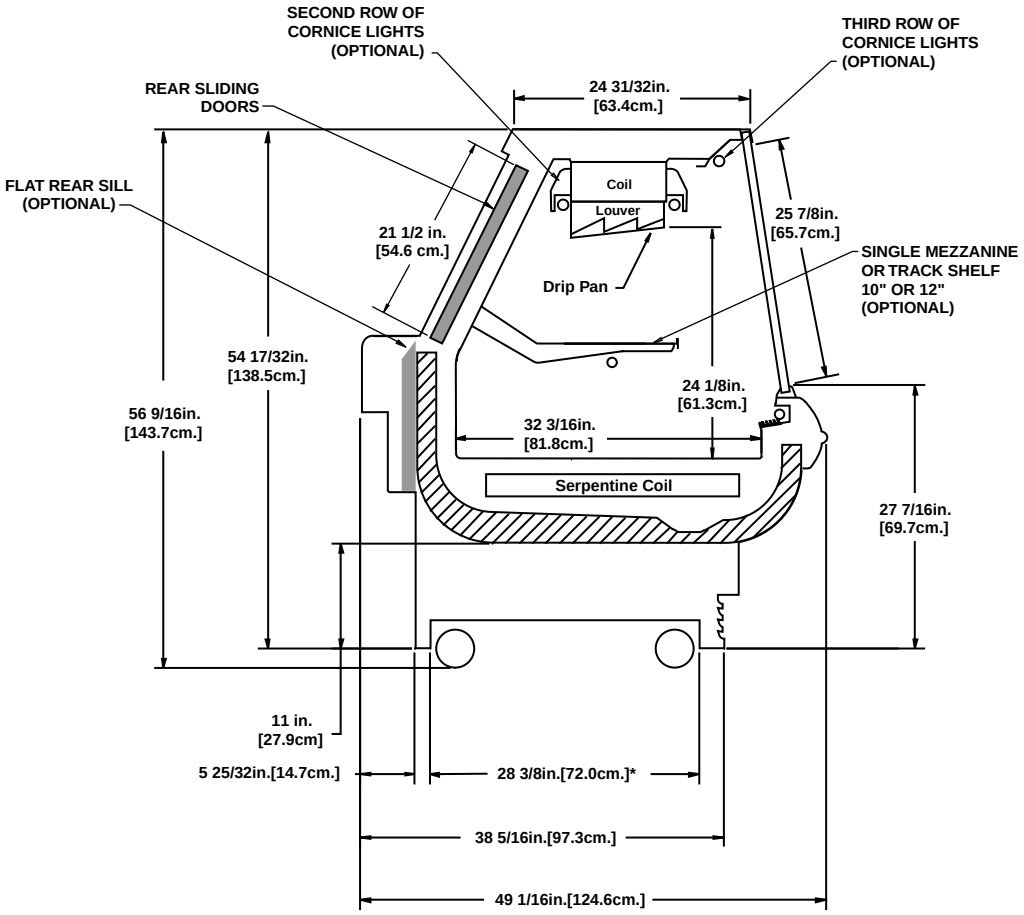

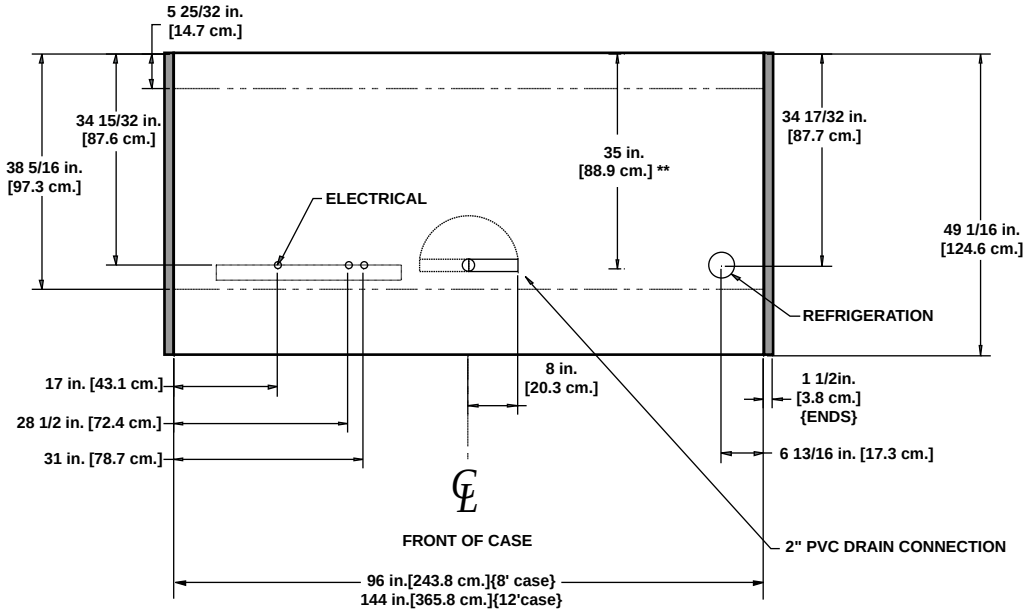

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

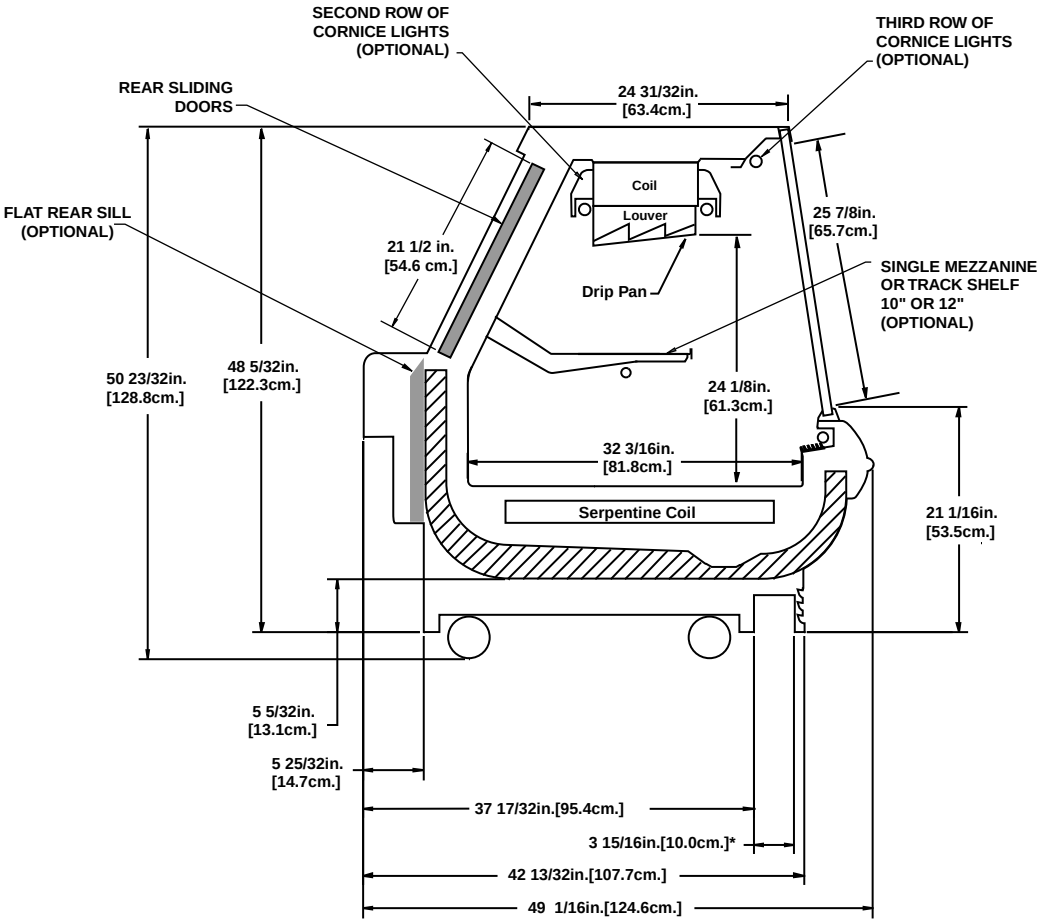

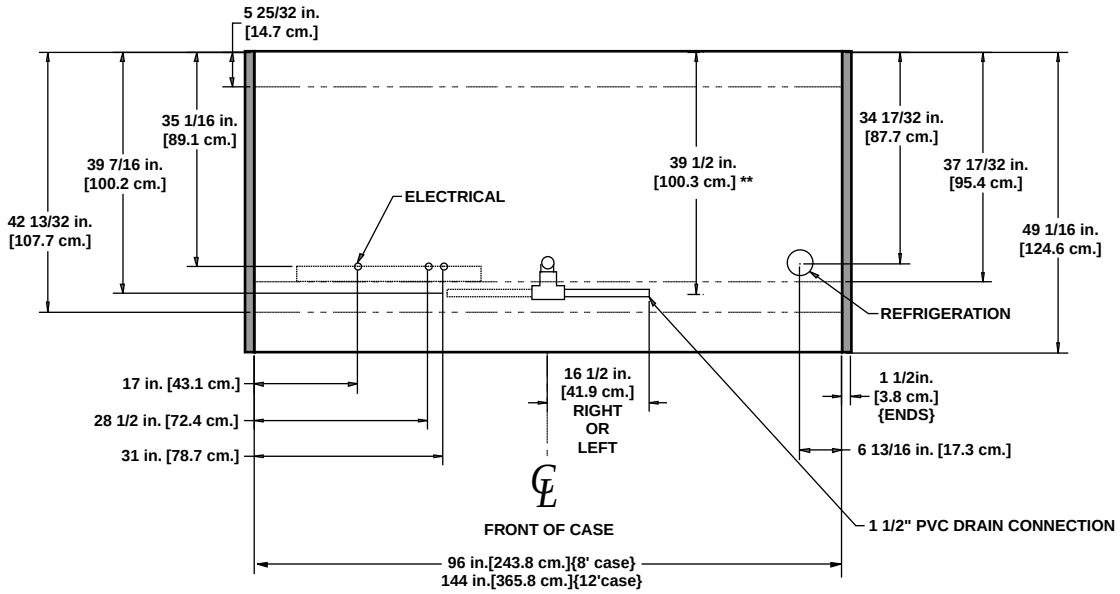

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

International Style Meat/Deli/Seafood Merchandisers

OSI - 4', 6', 8', & 12' international style full service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OSI	4'	2	0.68	34	0.30	22	0.55	66	1.92	400	2.22	532
	6'	2	0.68	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.02	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OSI	4'	0.57	68	1.14	137
	6'	0.57	68	1.16	139
	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OSI[3]	350	22	31	36	38	175

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

[3] Humidification system required on this case when used for Fresh Meat application

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost[4] Fail-safe (min)	Timed Off Defrost[4] Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OSI	3	30	60	70	60	- - -[5]	- - -	- - -	- - -

[4] Not recommended on this model due to long defrost time.

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

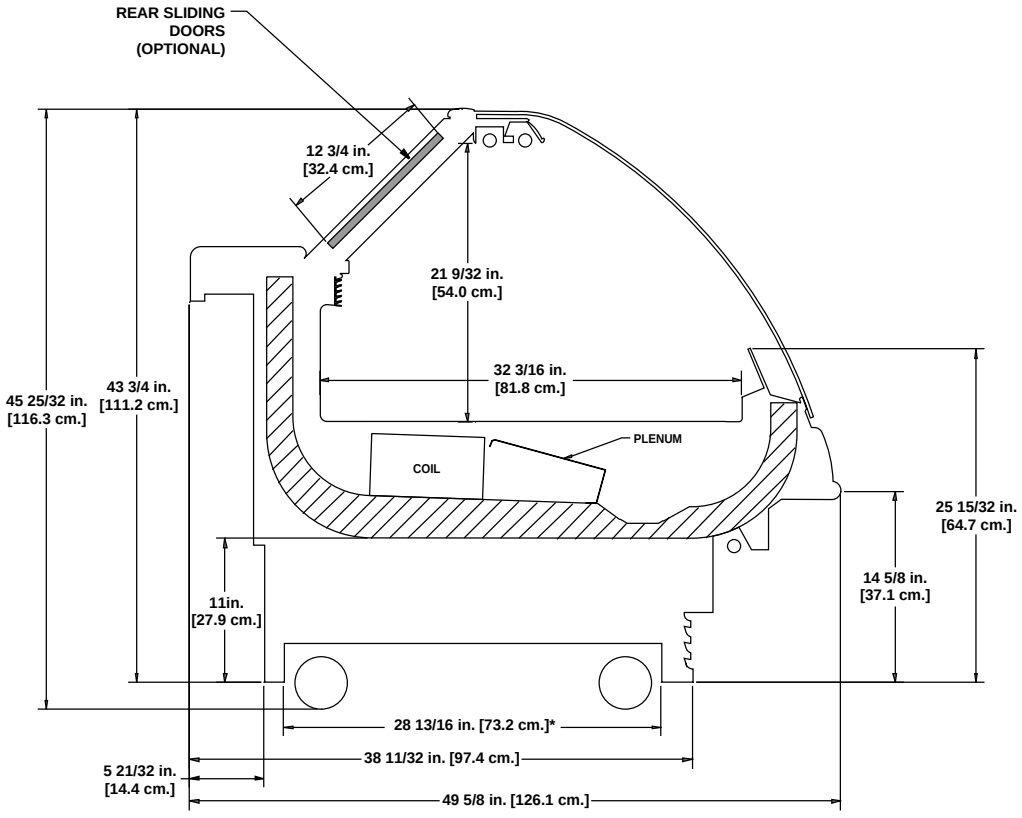

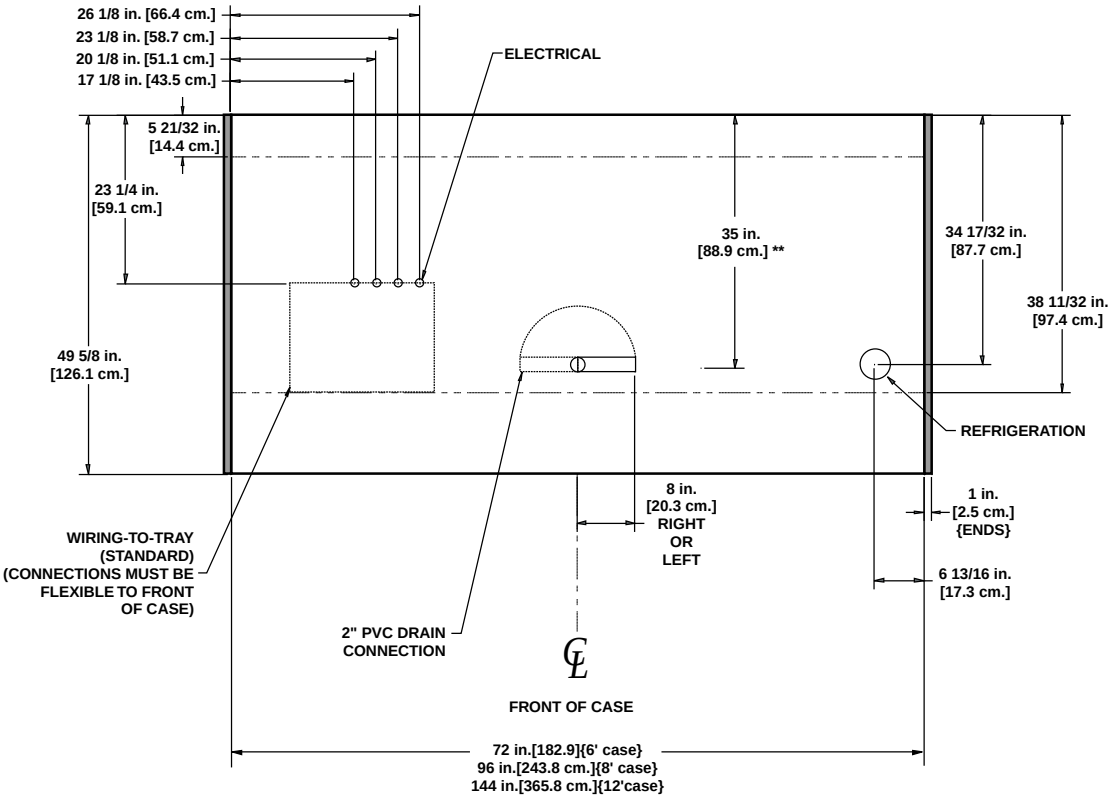

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

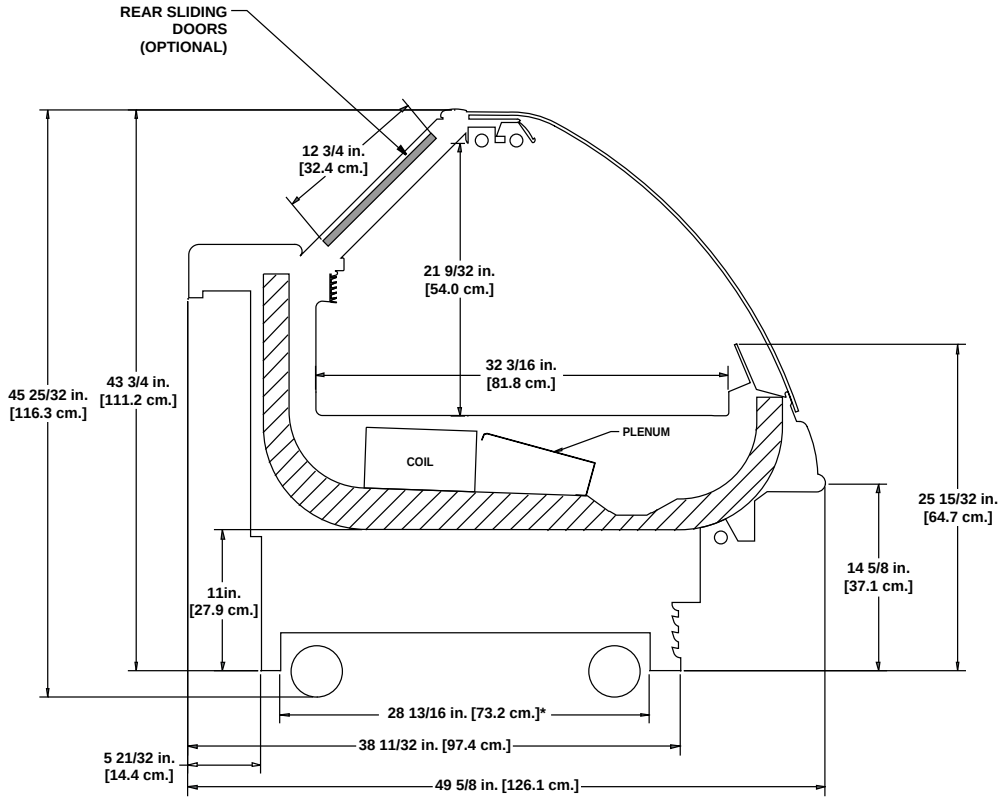

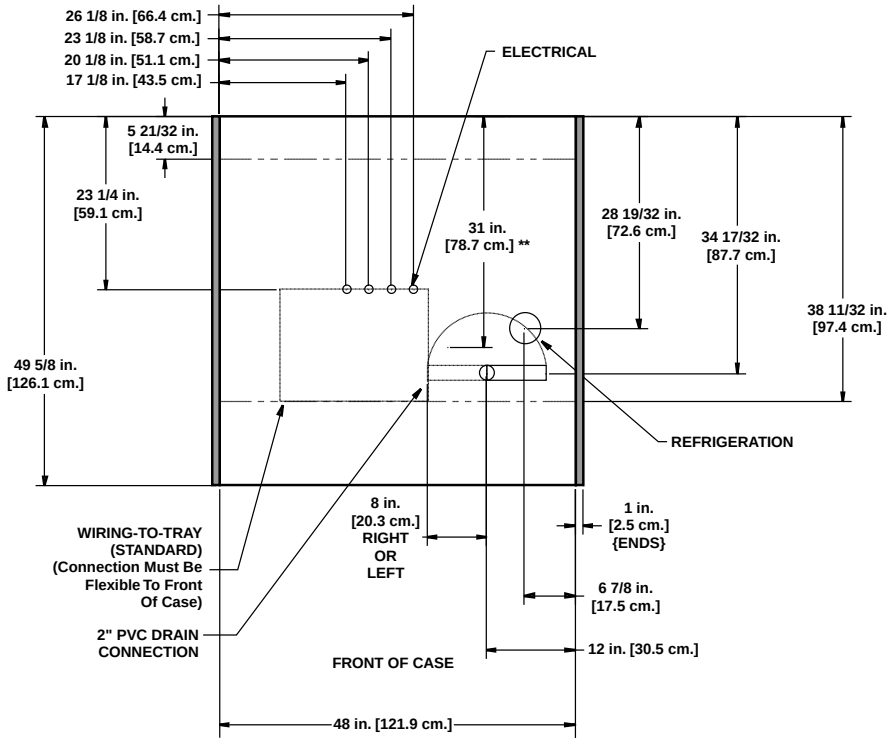

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Wide International Style Meat/Deli/Seafood Merchandisers

OWSI - 6', 8', & 12' international style full service

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts Amps	Standard Fans 120 Volts Watts	High Efficiency Fans 120 Volts Amps	High Efficiency Fans 120 Volts Watts	Anti-Condensate Heaters 120 Volts Amps	Anti-Condensate Heaters 120 Volts Watts	Defrost Heaters 208 Volts Amps	Defrost Heaters 208 Volts Watts	Defrost Heaters 240 Volts Amps	Defrost Heaters 240 Volts Watts
OWSI	6'	2	0.68	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.02	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.36	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model		Typical per Light Row 120 Volts Amps	Typical per Light Row 120 Volts Watts	Maximum Lighting 120 Volts Amps	Maximum Lighting 120 Volts Watts
OWSI	6'	0.57	68	1.16	139
	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft[1]	Evaporator (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OWSI[3]	450	22	31	36	38	175

[1] BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

[2] Average discharge air velocity at peak of defrost.

[3] Humidification system required on this case when used for Fresh Meat application

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost[4] Fail-safe (min)	Timed Off Defrost[4] Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OWSI	3	30	60	70	60	- - -[5]	- - -	- - -	- - -

[4] Not recommended on this model due to long defrost time.

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

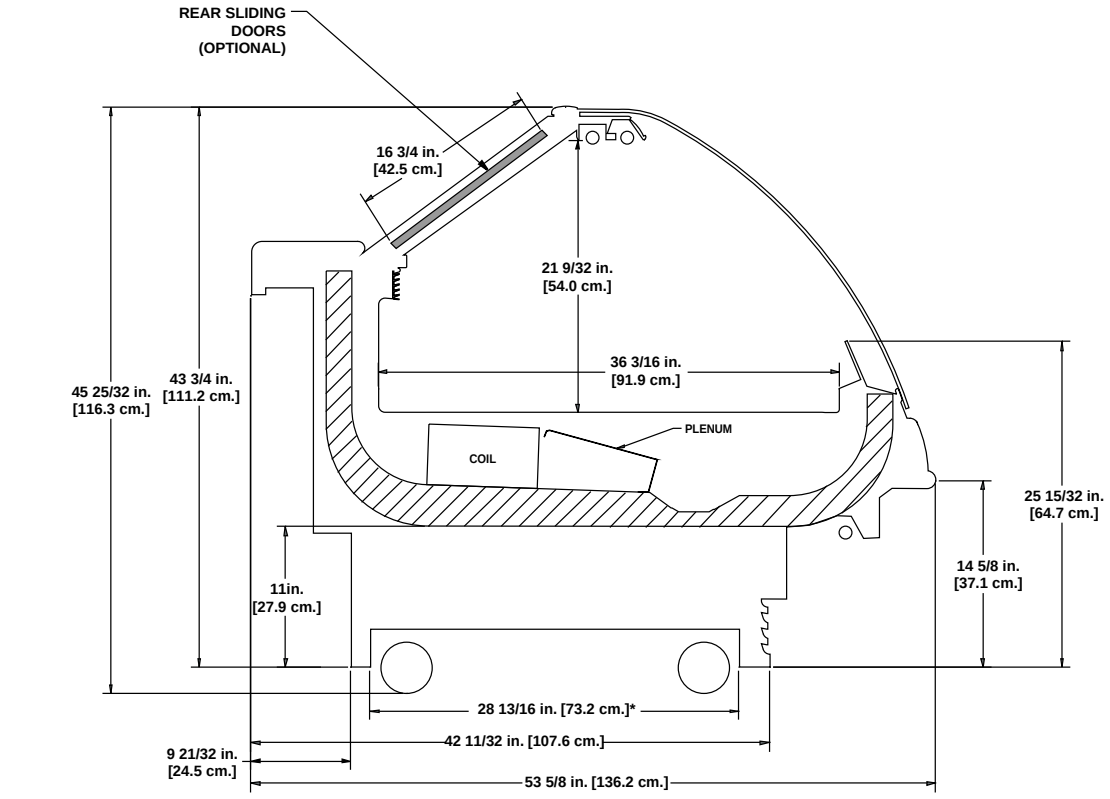

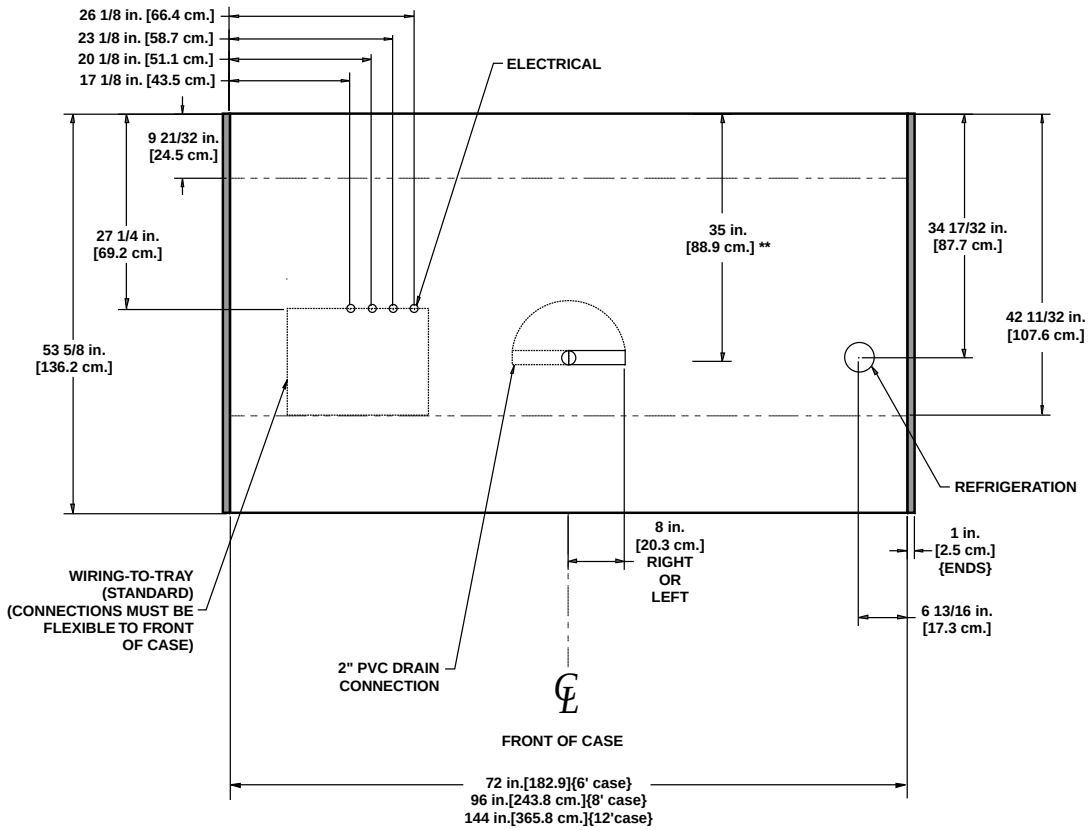

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

International Style Hot Foods Merchandisers

OSIH - 4', 6', & 8' hot foods

Electrical Data (Domestic)

Model		Number of Hot Wells	Single Phase						Three Phase					
			208 Volts			220 Volts			208 Volts			220 Volts		
			Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker
OSIH	4'	3	16	3300	20	17.1	3800	25	10.0	3300	15	10.7	3800	15
	6'	5	25.3	5600	35	28.6	6300	40	15.8	5600	20	17.6	6300	25
	8'	7	36.9	7700	50	41.6	8700	55	23.7	7700	30	26.7	8700	35

Electrical Data (European)

Model		Number of Hot Wells	Single Phase			Three Phase		
			220 Volts			380 Volts		
			Amps	Watts	Breaker	Amps	Watts	Breaker
OSIH	4'	3	17.1	3800	25	- - -	- - -	- - -
	6'	5	- - -	- - -	- - -	10.2	6300	15
	8'	7	- - -	- - -	- - -	15.3	8700	20

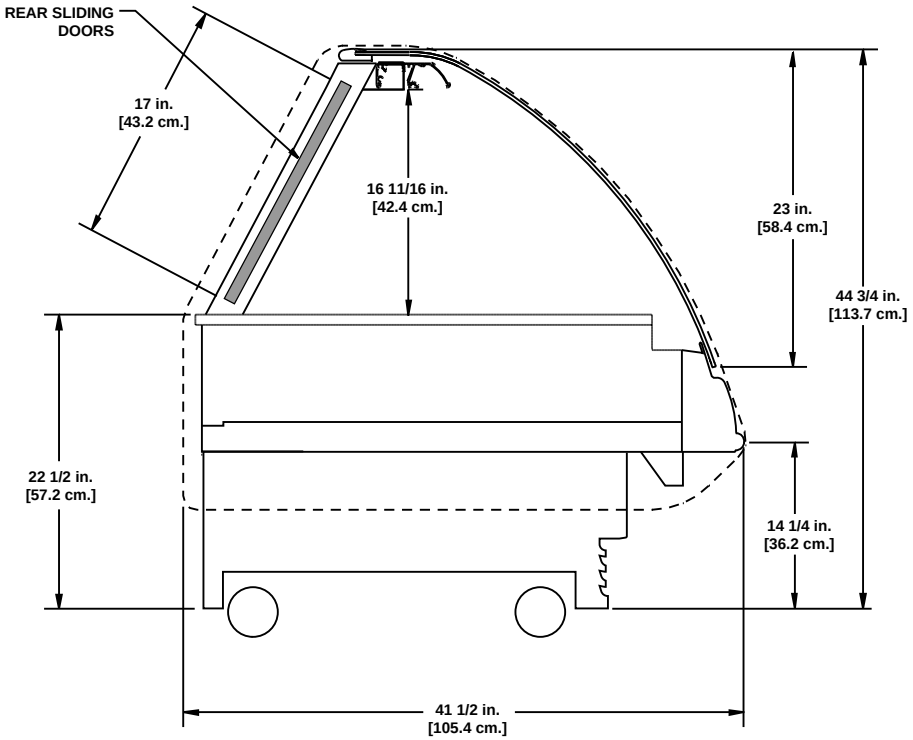

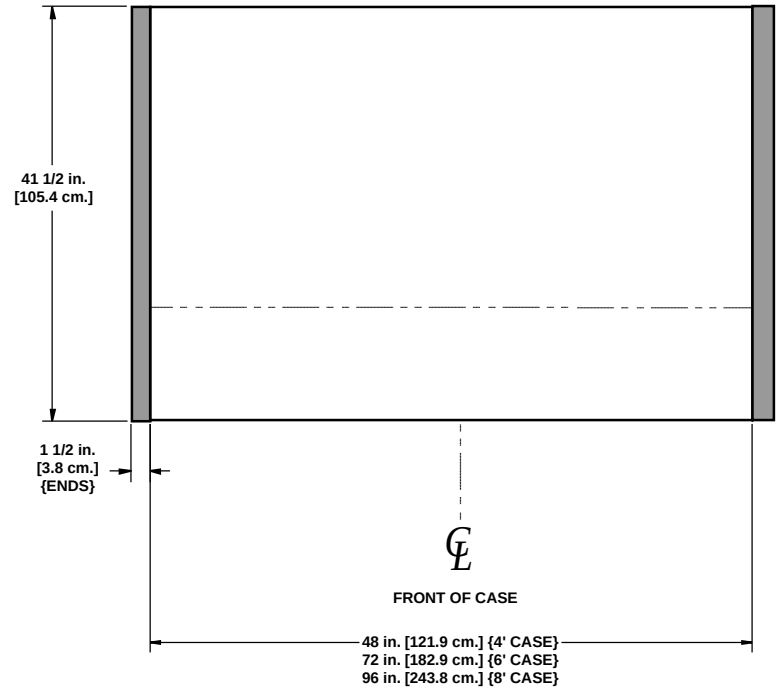

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Self-Contained Merchandisers

Notes:

- *Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.*
- *Cases meet FDA** Food Code 1997 product temperature requirements for hazardous foods when used for their prescribed applications.*
- *Allow for an extra 1/8" per joint when lining up merchandisers.*
- *Front sill height does not affect case performance unless specifically shown.*

* *American Society of Heating Refrigeration and Air Conditioning Engineers*

** *Food and Drug Administration*

International Style Self-Service Deli/Seafood Self-Contained Mobile Merchandisers

OSIOA-4' - self service mobile self-contained deli/seafood

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIOA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
OSIOA-4'	14.1	12-14	6-8	26	33	34	182

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[2] (amps)	LRA[3] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIOA-4'	115	1	60	1/2	10.4	48.0	R134A	3.25	45	440	162

[2] RLA - Running Load Amps.

[3] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
		Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIOA-4'	4	40	47	- - -[4]	- - -	- - -	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

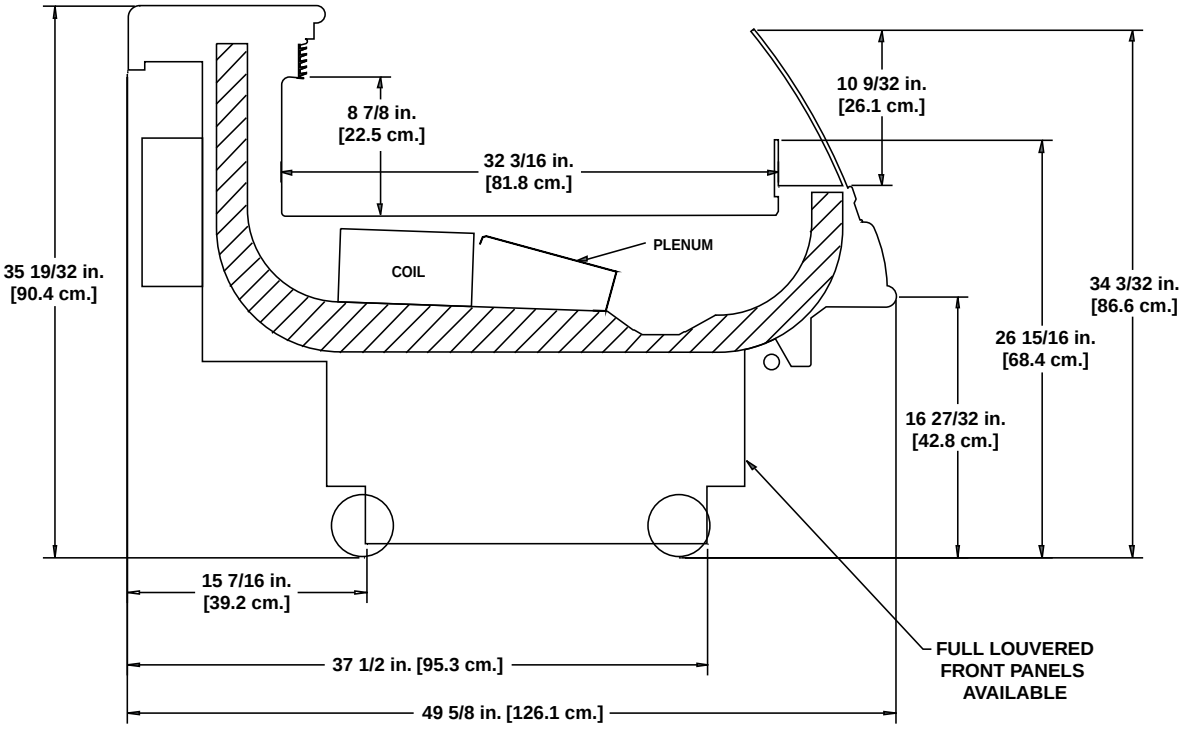

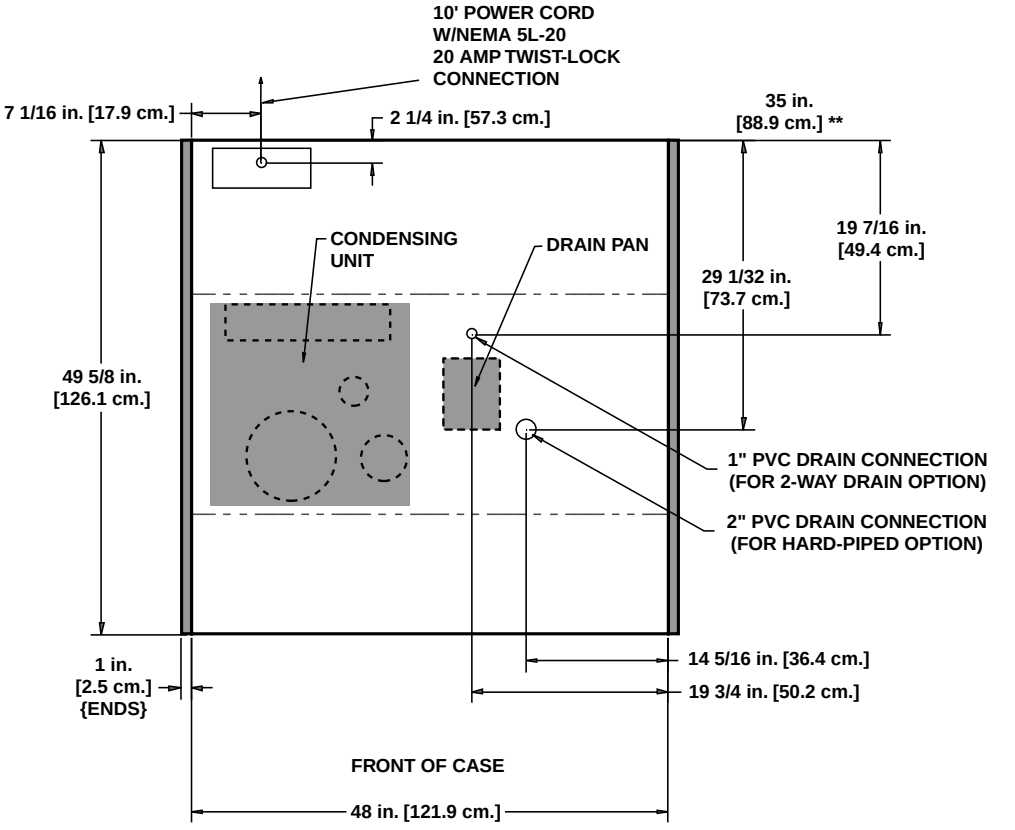

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

International Style Self-Service Dual Temp. Self-Contained Mobile Merchandisers

OSIOZA-4' - self-service mobile self-contained dual temp.

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIOZA-4'	120	1	60	NEMA 5L30	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
OSIOZA-4'	25.0	12-14	3-4	-24	-6	-10	220

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[2] (amps)	LRA[3] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIOZA-4'	115	1	60	3/4	10.9	85.5	R404A	3.75	0	440	162

[2] RLA - Running Load Amps.

[3] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIOZA-4'	2	47	47	- - -[4]	- - -	- - -	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

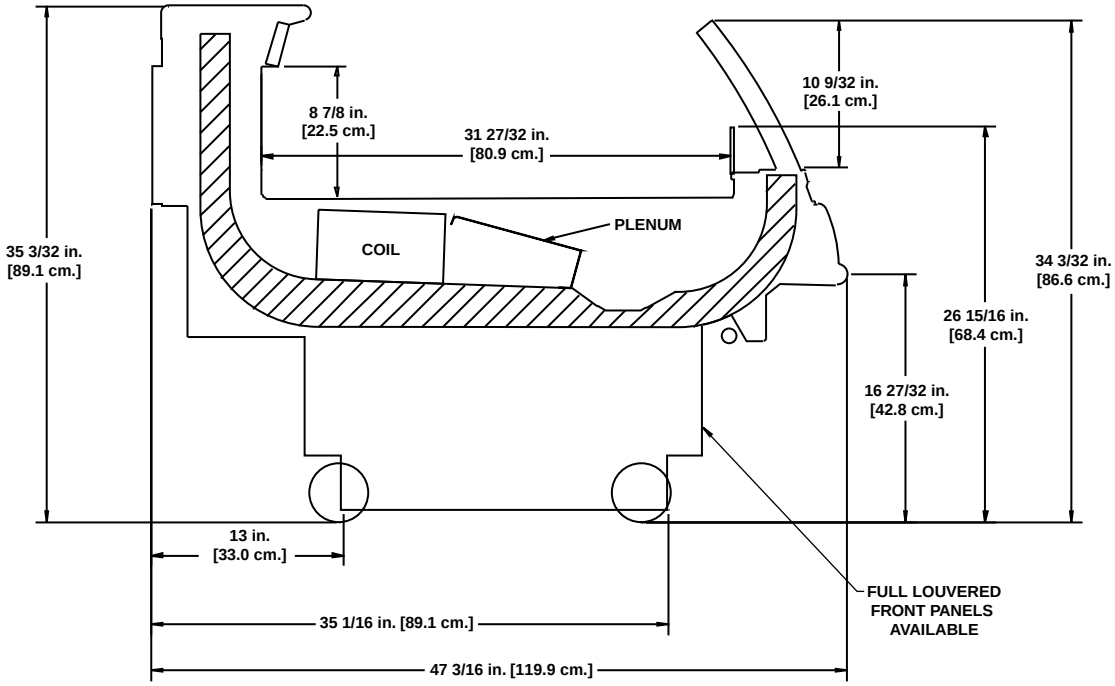

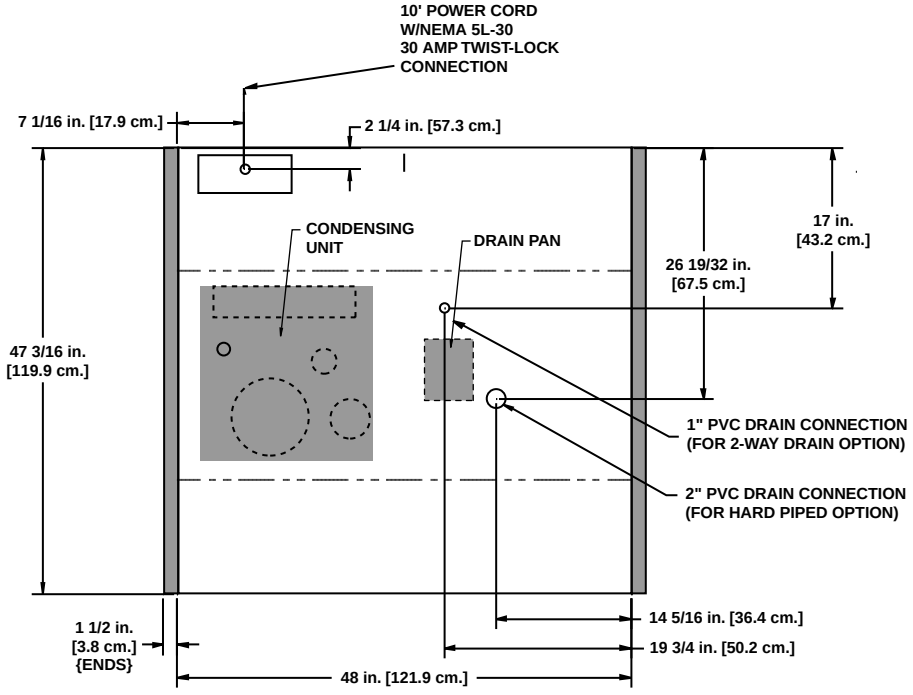

FRONT OF CASE

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Multi-Deck Dairy/Deli/Meat Self-Contained Mobile Merchandisers

O2.5UMA-4' - mobile low profile self-contained

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
O2.5UMA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
O2.5UMA-4' Produce	27"[1]	32.3	12-14	6-8	29-30	37	40-42	228
Deli	31"	30.2	12-14	6-8	25-27	35	39-41	230
Meat	33"	30.3	12-14	6-8	25-26	34	36-38	226

[1] Note: when ordering the 27" front a 4" piece of straight plexiglass must be placed in front of the return air baffle.

[2] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O2.5UMA-4'	115	1	60	1/2	12.9	66.3	R134A	3.6	25	440	162

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O2.5UMA-4'	3	40	49	- - -[5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

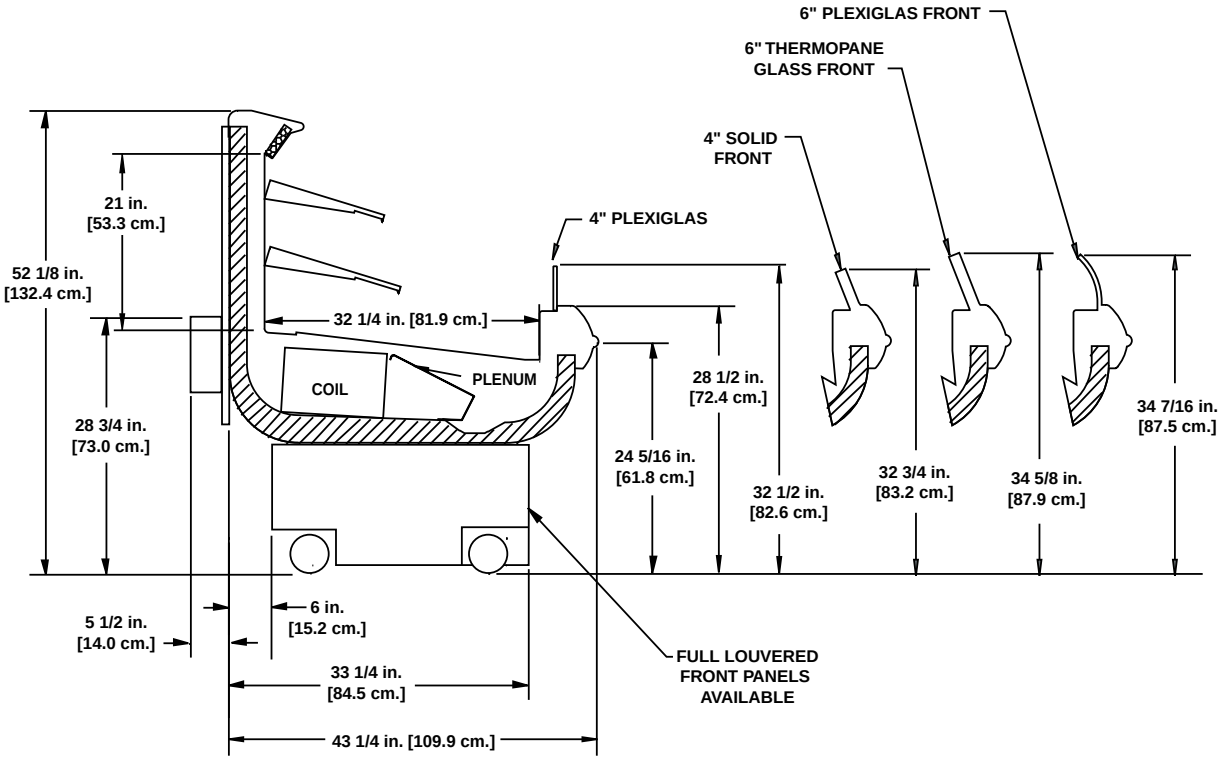

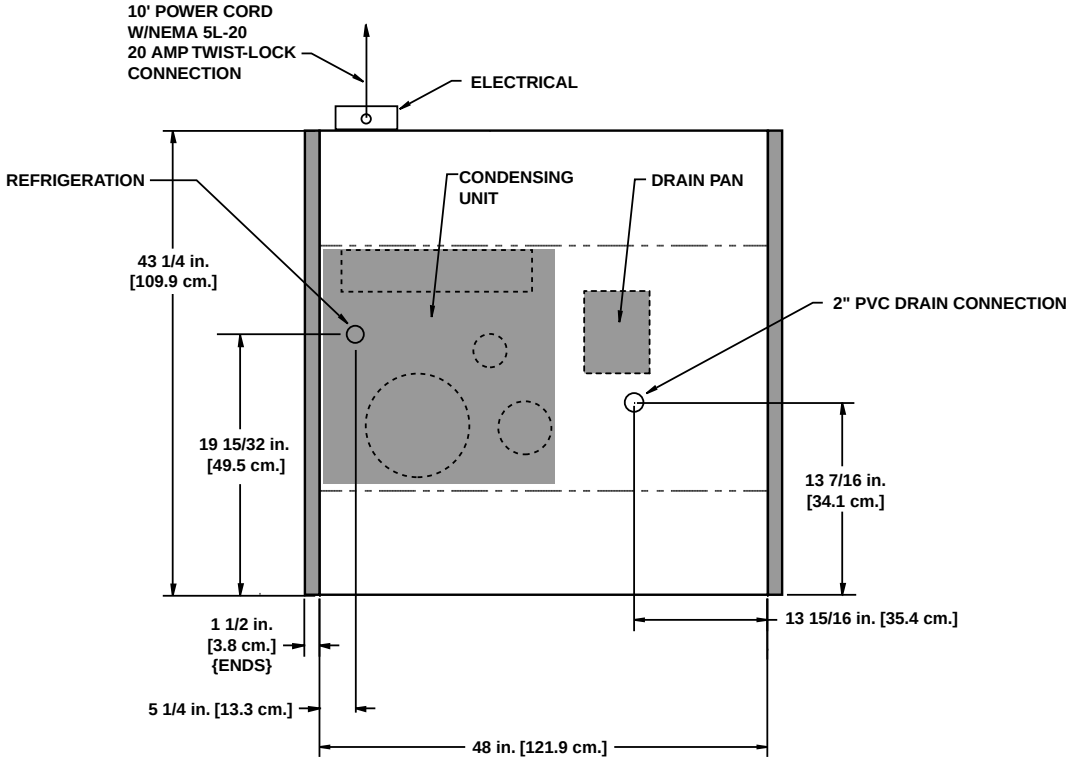

FRONT OF CASE

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Multi-Deck Dairy/Deli/Meat Self-Contained Mobile Merchandisers

O3UMA-4' - low profile self-contained

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
O3UMA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
O3UMA-4'	31"	31.8	12-14	6-8	26	32	35	230

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3UMA-4'	115	1	60	1/2	12.9	66.3	134A	3.6	25	440	162

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3UMA-4'	3	40	49	- - -[5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

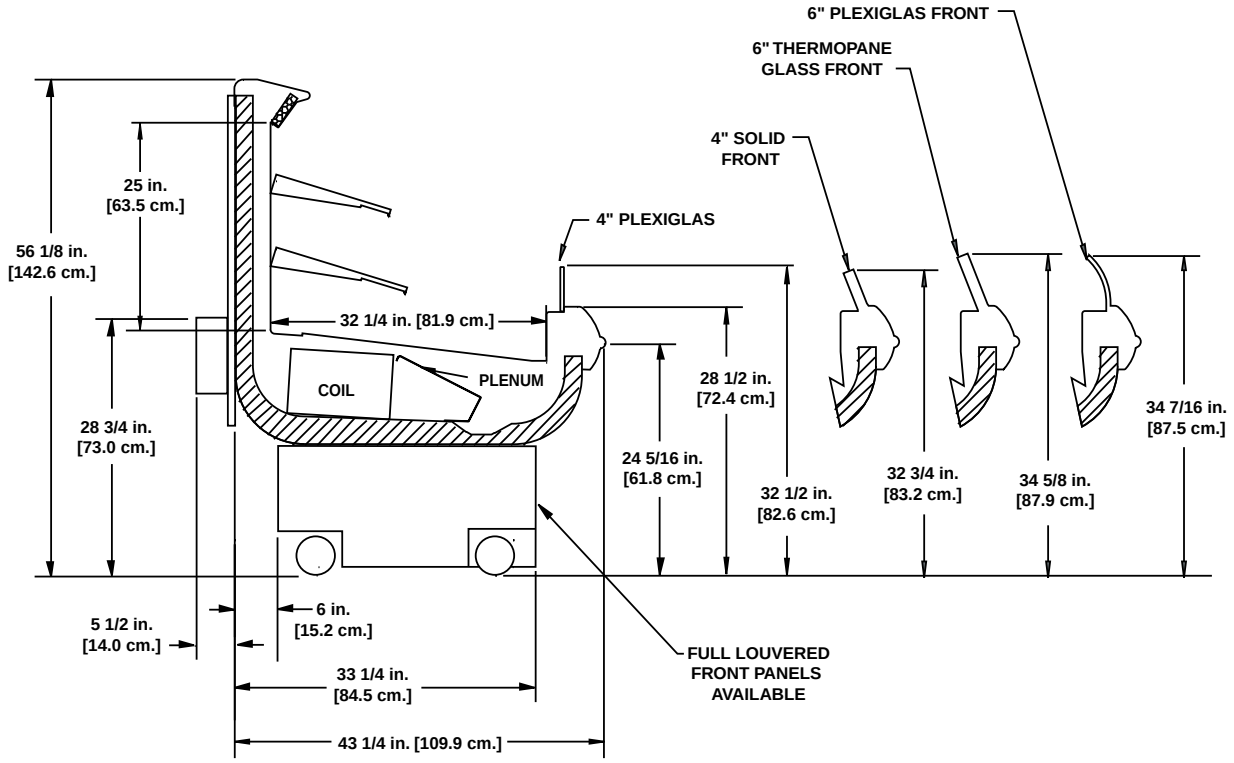

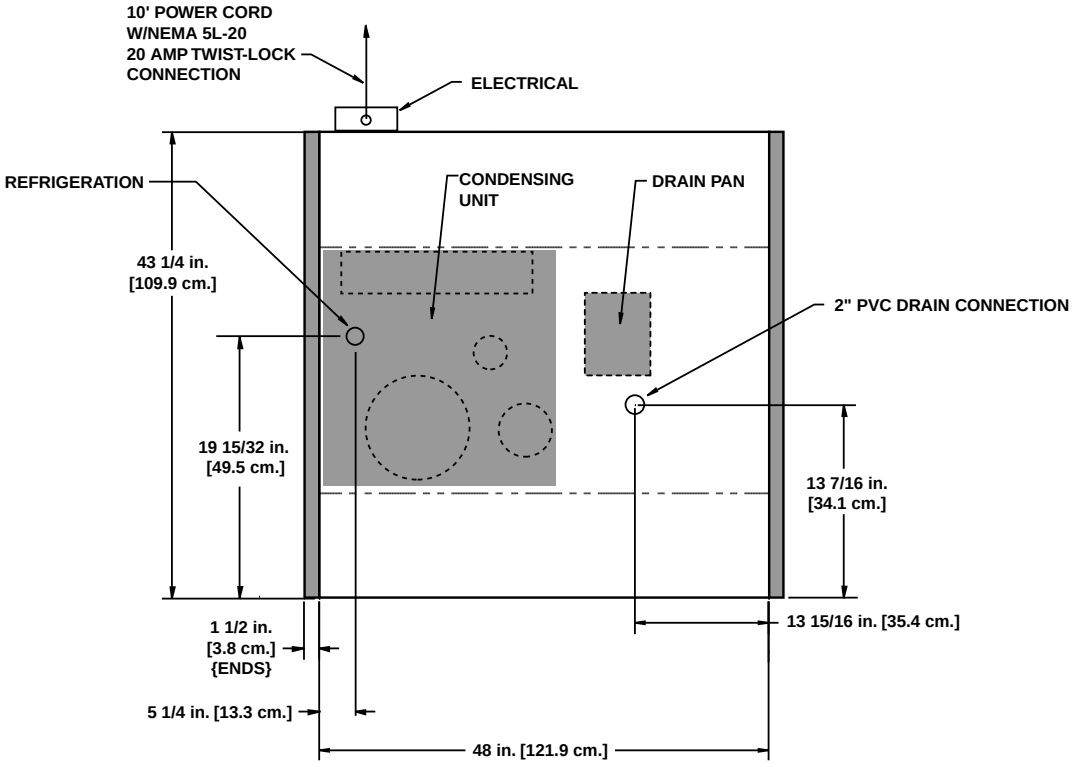

FRONT OF CASE

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Multi-Deck Self-Contained Dairy/Deli/Produce Merchandisers

O5DMA - 4', 6', & 8' self-contained dairy/deli/produce

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O5DMA	4'	208/230	1	60	3 wire + ground	27.90	30
	6'	208/230	1	60	3 wire + ground	28.90	40
	8'	208/230	1	60	3 wire + ground	29.40	40

Electrical Data

			Standard Fans		High Efficiency Fans		Drain Pump		Drain Heater		Maximum Lights	
		Fans per Case	120 Volts		120 Volts		120 Volts		240 Volts		120 Volts	
Model			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5DMA	4'	2	1.00	60	1.00	34	1.10	132	6.28	1500	2.63	316
	6'	2	1.00	60	1.00	34	1.10	132	6.28	1500	4.47	536
	8'	3	1.50	90	1.50	51	1.10	132	6.28	1500	4.10	492

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
O5DMA-4'		52	6-8	30	35	44	250
O5DMA-6'		52	6-8	30	35	44	250
O5DMA-8'		52	6-8	30	35	44	250

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[2] (amps)	LRA[3] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O5DMA-4'	208	1	60	1	11	51	404A	4.5	45	500	174
O5DMA-6'	208	1	60	1 3/4	10.9	56	404A		45	500	174
O5DMA-8'	208	1	60	2	12.4	61	404A		45	500	174

[2] RLA - Running Load Amps.

[3] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5DMA	3	- - -[4]	- - -	42	44	- - -	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

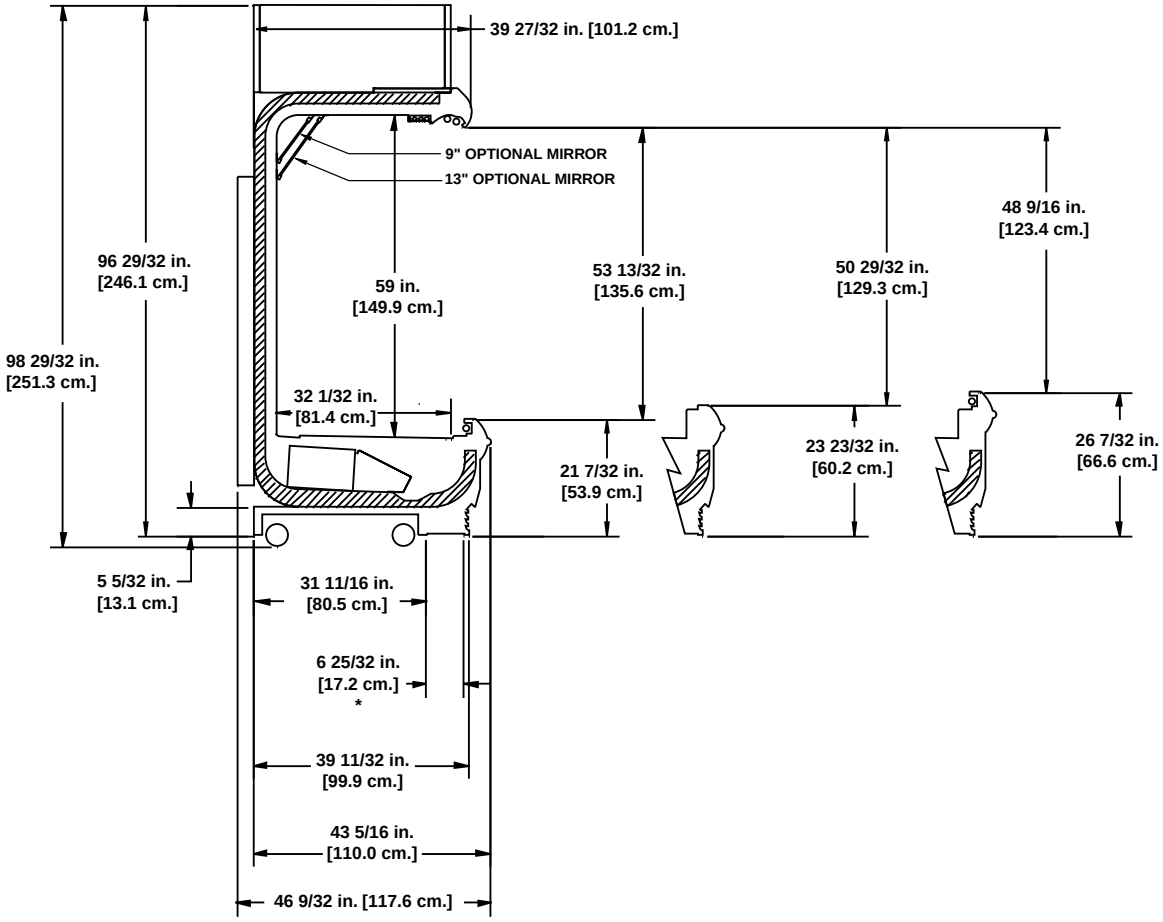

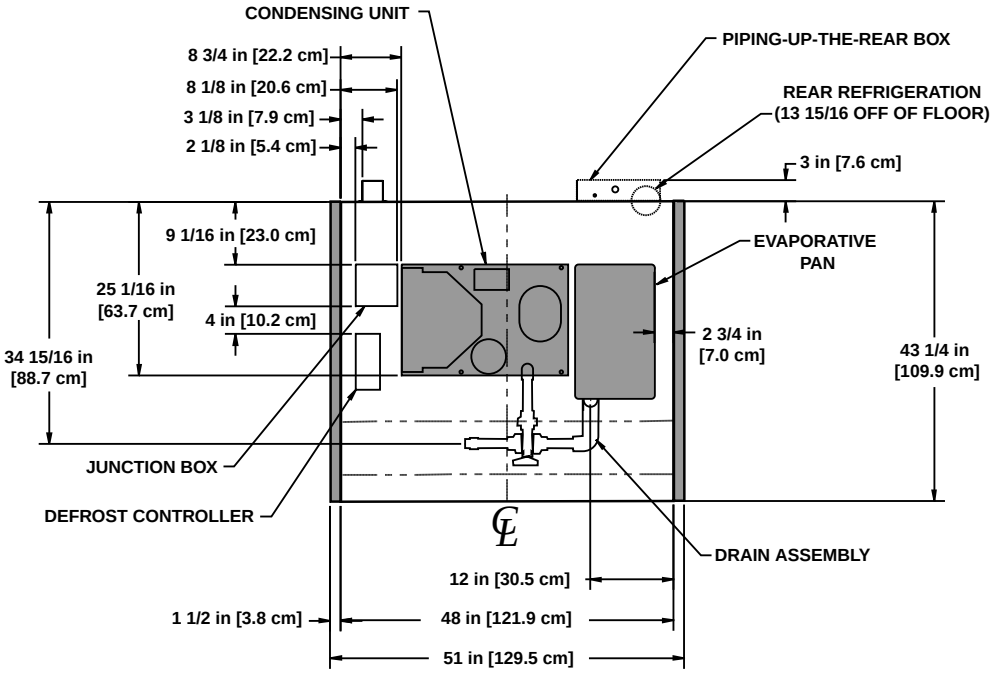

NOTES:

- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 5/8", LIQUID LINE - 3/8"

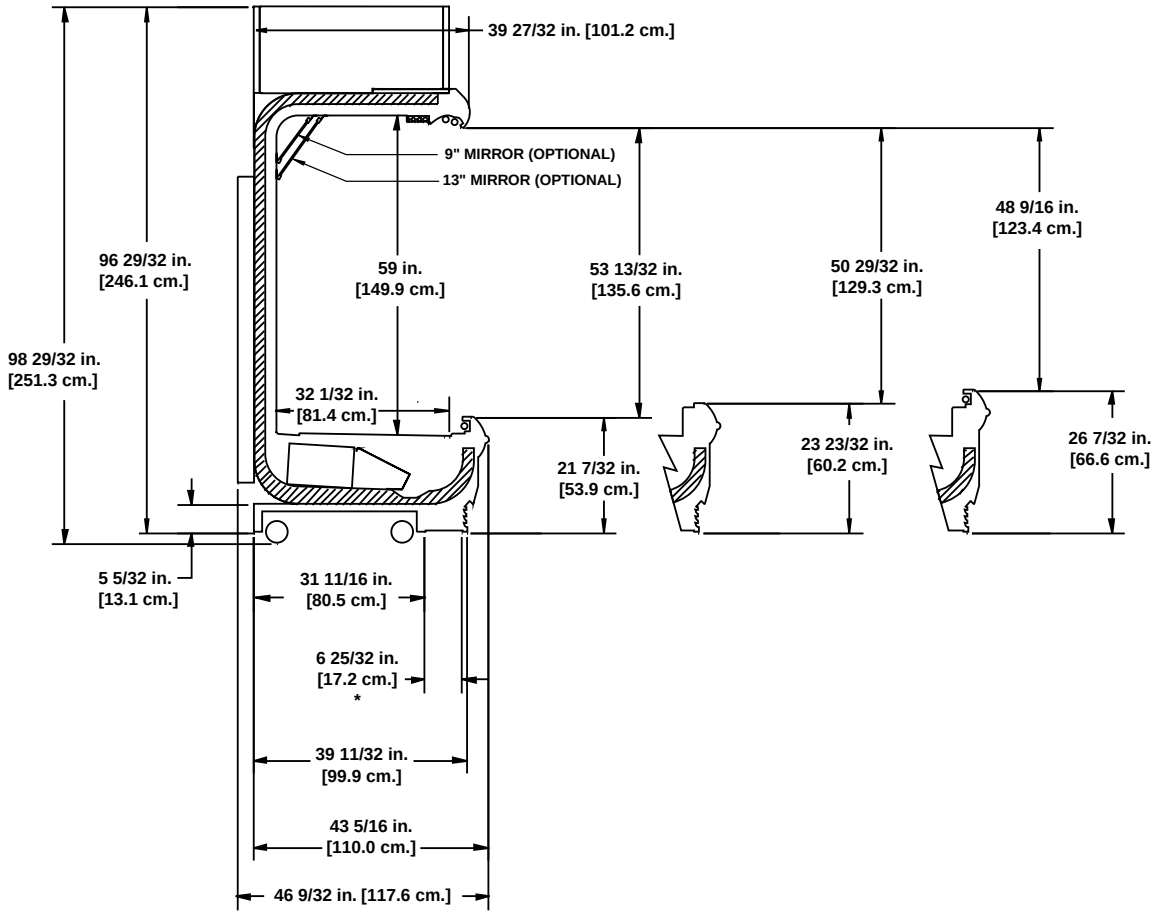

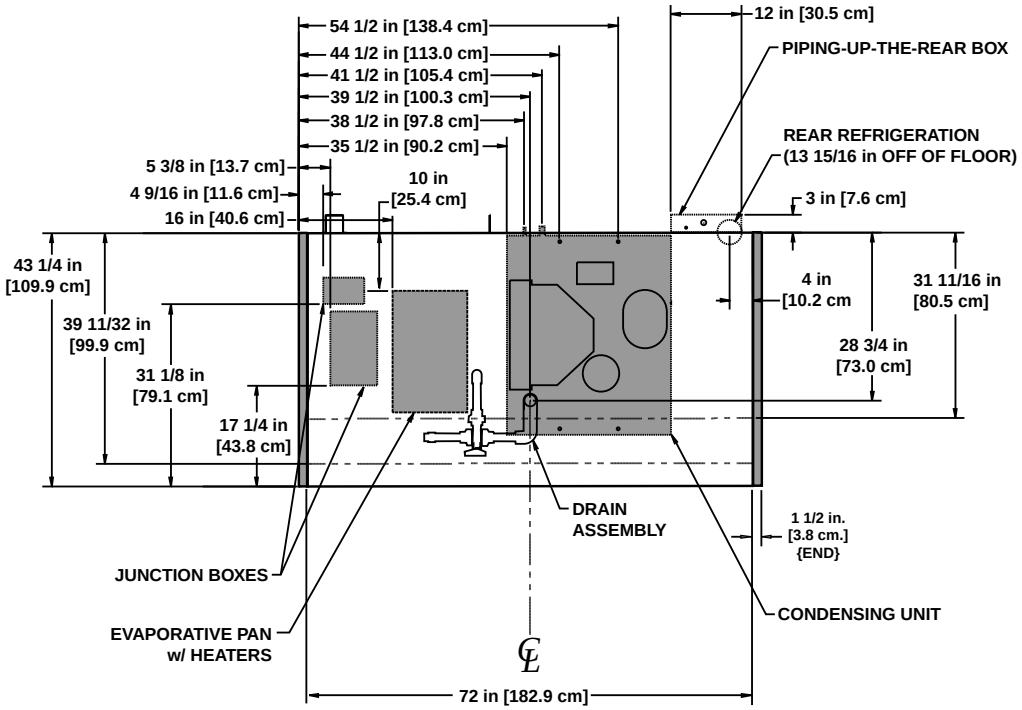

NOTES:

- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 5/8", LIQUID LINE - 3/8"

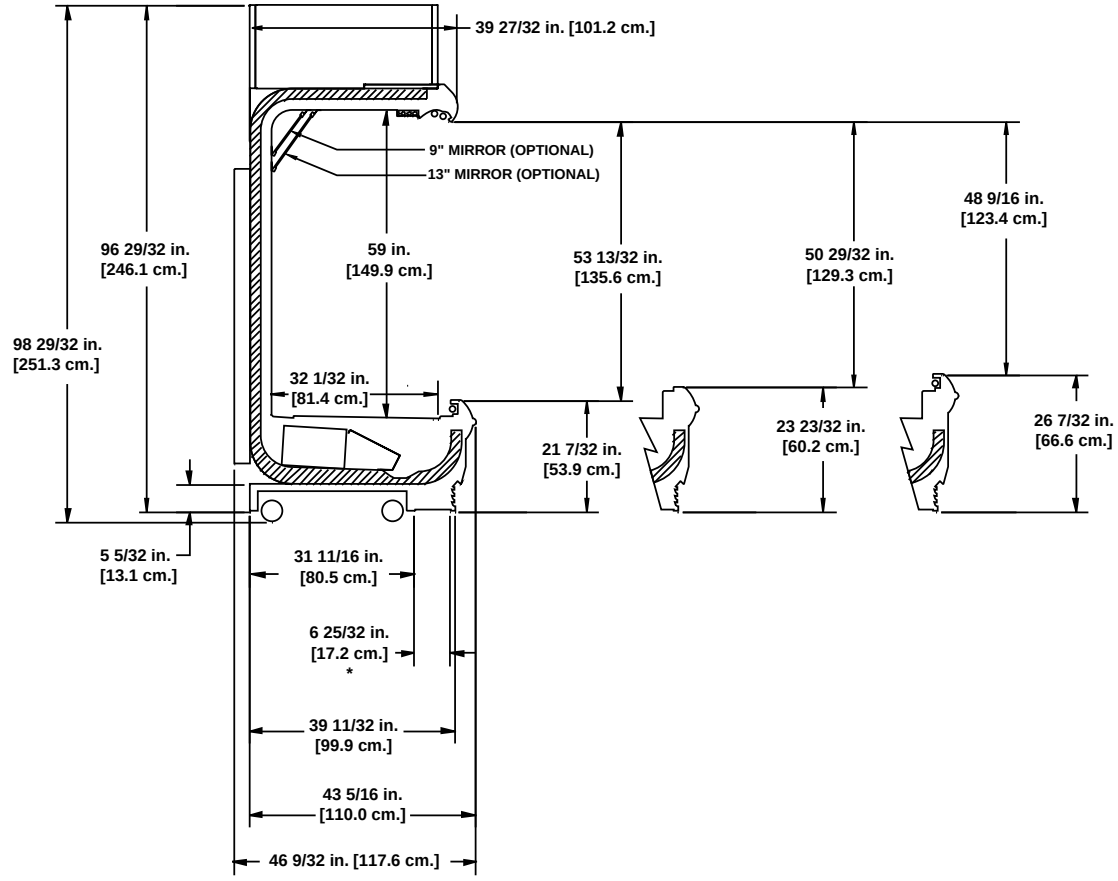

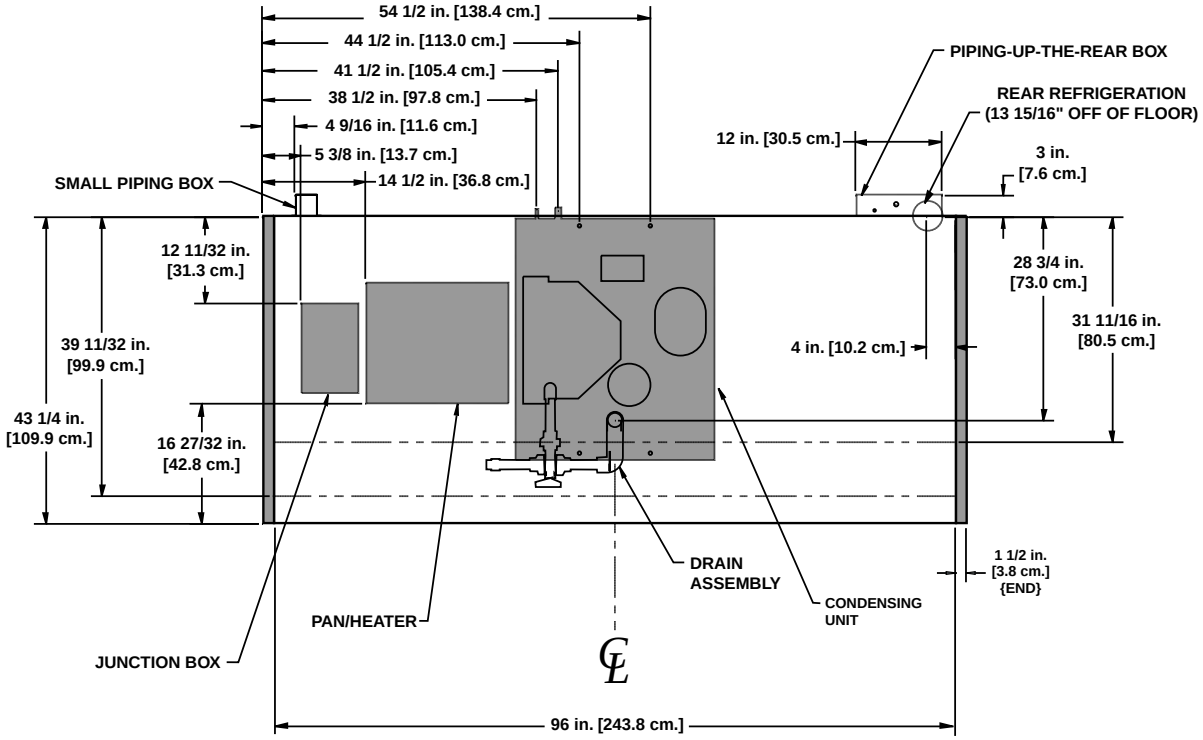

NOTES:

- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- SUCTION LINE 5/8", LIQUID LINE - 3/8"

Narrow Multi-Deck Self-Contained Dairy/Deli/Meat Merchandiser

ONUA - 4'/47" & 6'/71" multi-deck dairy/deli/meat

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONUA	4'/47"	208/230	1	60	3 wire + ground	19.91	25
	6'/71"	208/230	1	60	3 wire + ground	27.95	35

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Drain Pump 120 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONUA	4'/47"	2	1.00	60	1.00	34	0.90	108	6.28	1500	2.06	247
	6'/71"	3	1.50	90	1.50	51	1.10	132	6.28	1500	3.90	468

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
ONUA-4'/47"	43.9	33	6-8	27.5	34	39	310
ONUA-6'/71"		33	6-8	27.5	34	39	310

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[2] (amps)	LRA[3] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONUA-4'/47"	208-230	1	60	1	7.0	34.2	R-22	5.9	45	500	174
ONUA-6'/71"	208-230	1	60	1 1/2	10.4	48.2	R-22		45	500	174

[2] RLA - Running Load Amps.

[3] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
ONUA	4	- - - [4]	- - -	40	45	- - -	- - -	- - -	- - -

[4] Average discharge air velocity at peak of defrost.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

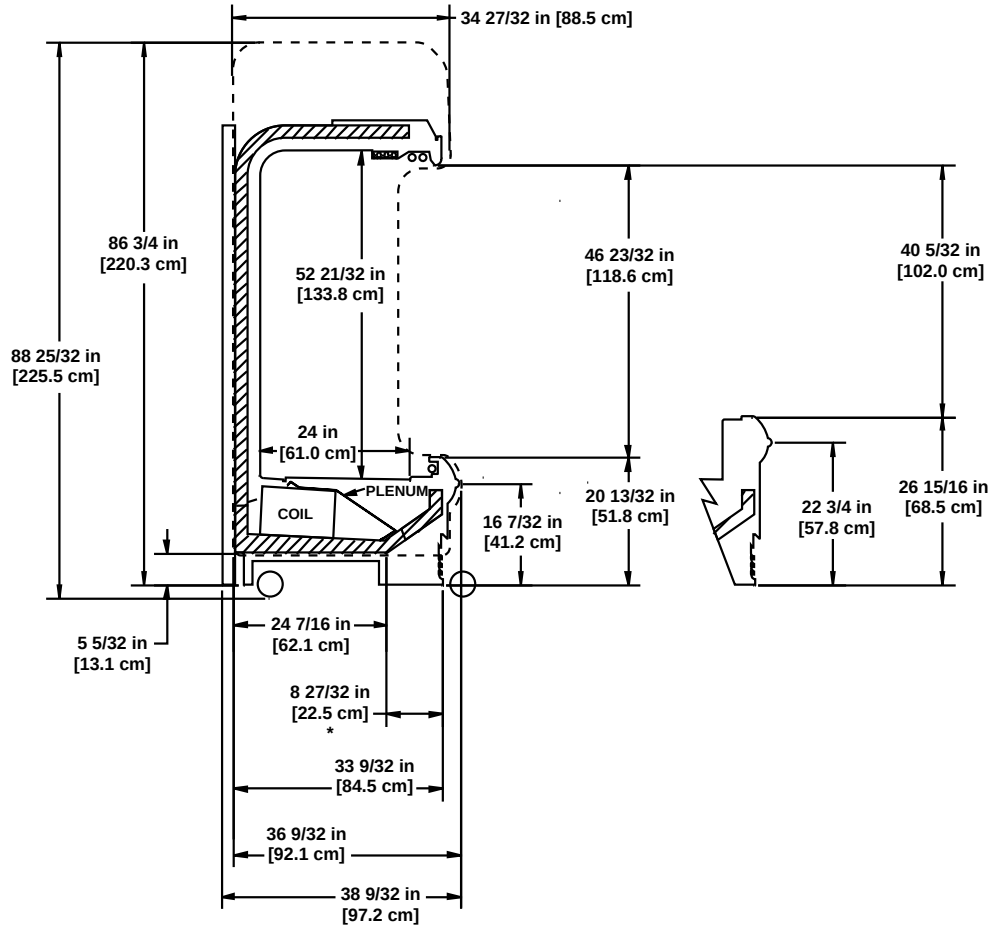

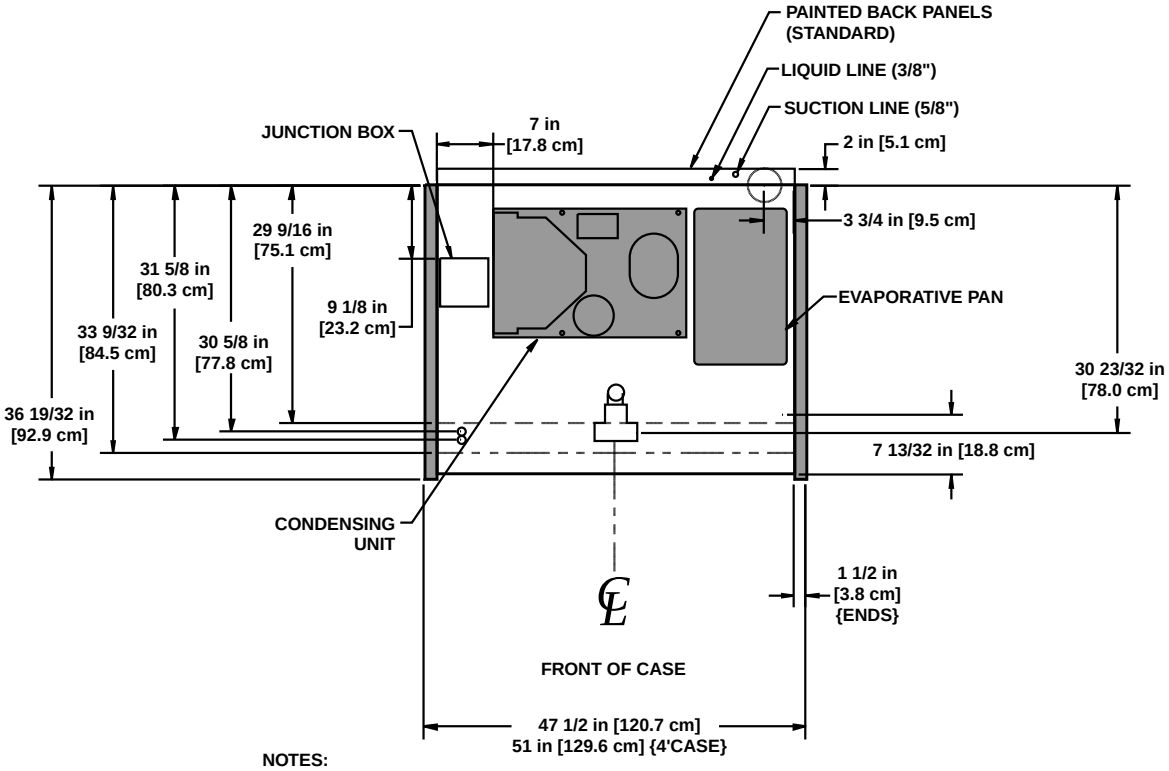

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL

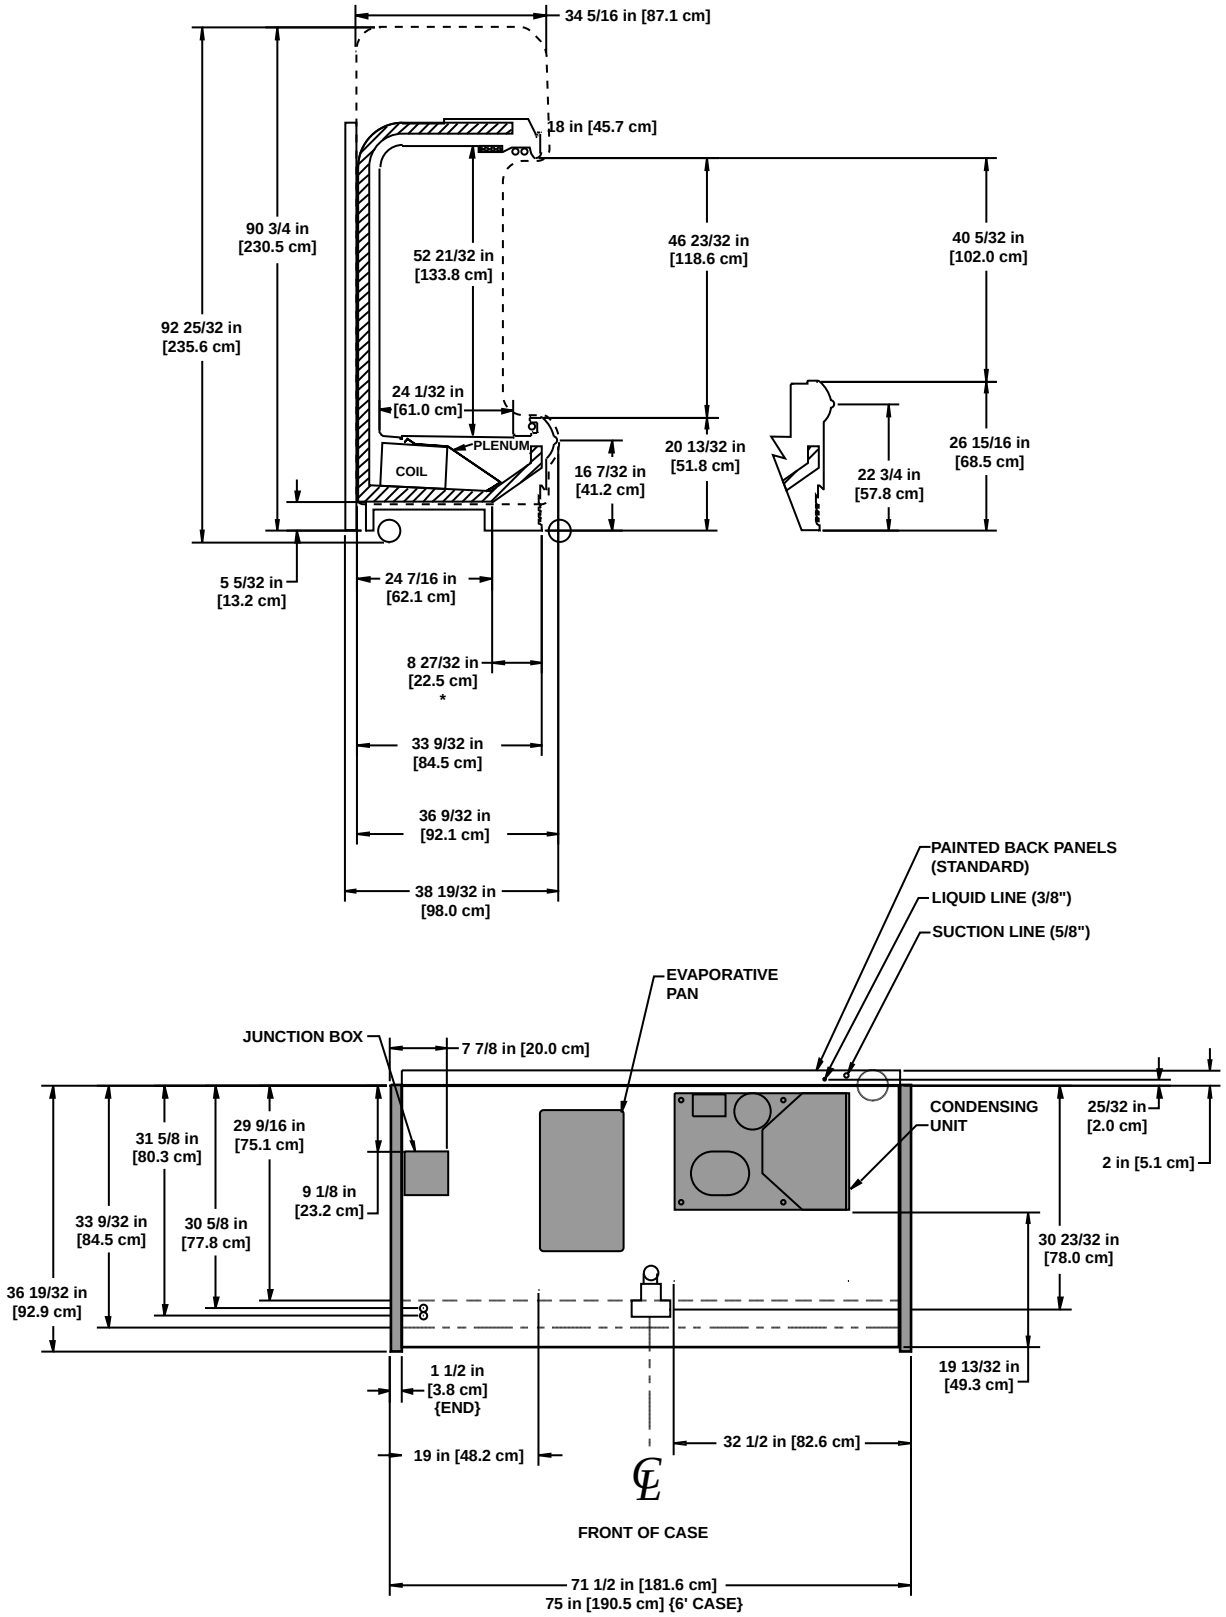

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS
• A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL

Wide Island Self-Contained Meat/Deli Merchandisers

OIMA - 8' & 12' self-contained wide island double wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIMA	8'	208/230	1	60	3 wire + ground	26.4	35
	12'	208/230	1	60	3 wire + ground	31.6	35

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIMA	8'	6	2.04	102	0.90	66	0.82	98	4.34	9.02	5.00	1200	5.55	1331	5.04	606
	12'	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000	5.55	1331	6.50	780

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
OIMA-8'		35	6-8	26	34	31	140
OIMA-12'		35	6-8	26	34	31	140

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIMA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
OIMA-12'[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIMA	3	40	42	- - -[5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™
A DOVER DIVERSIFIED COMPANY

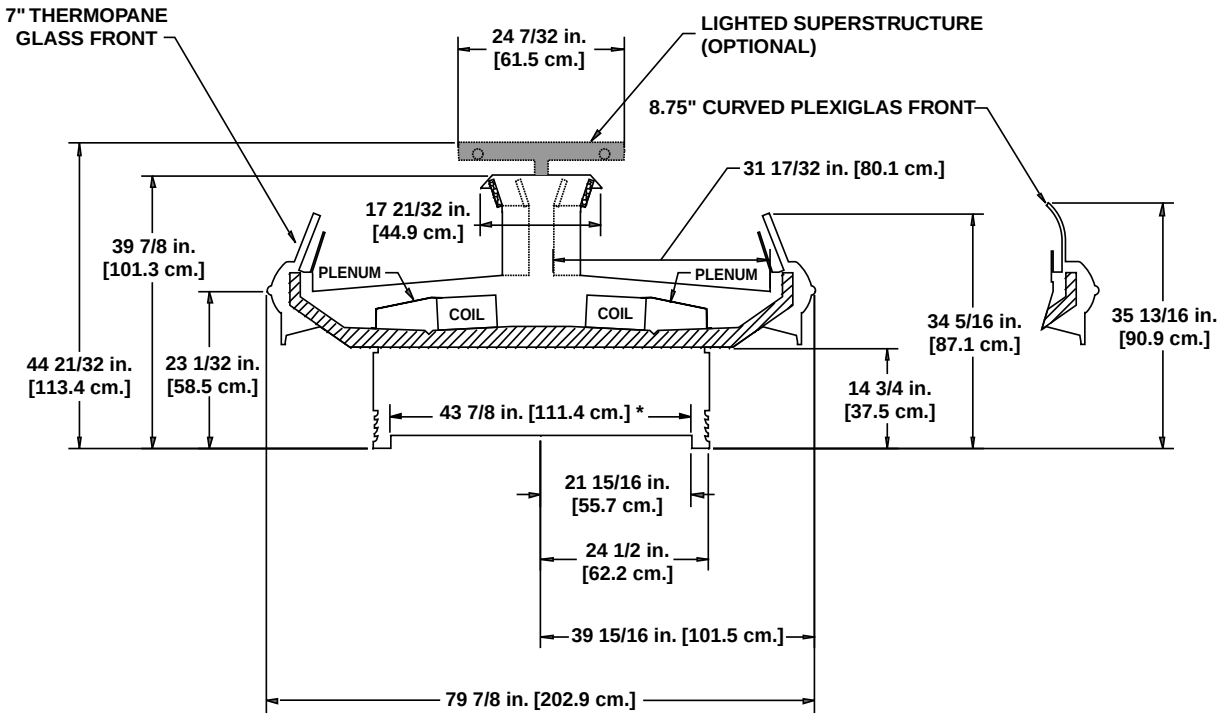

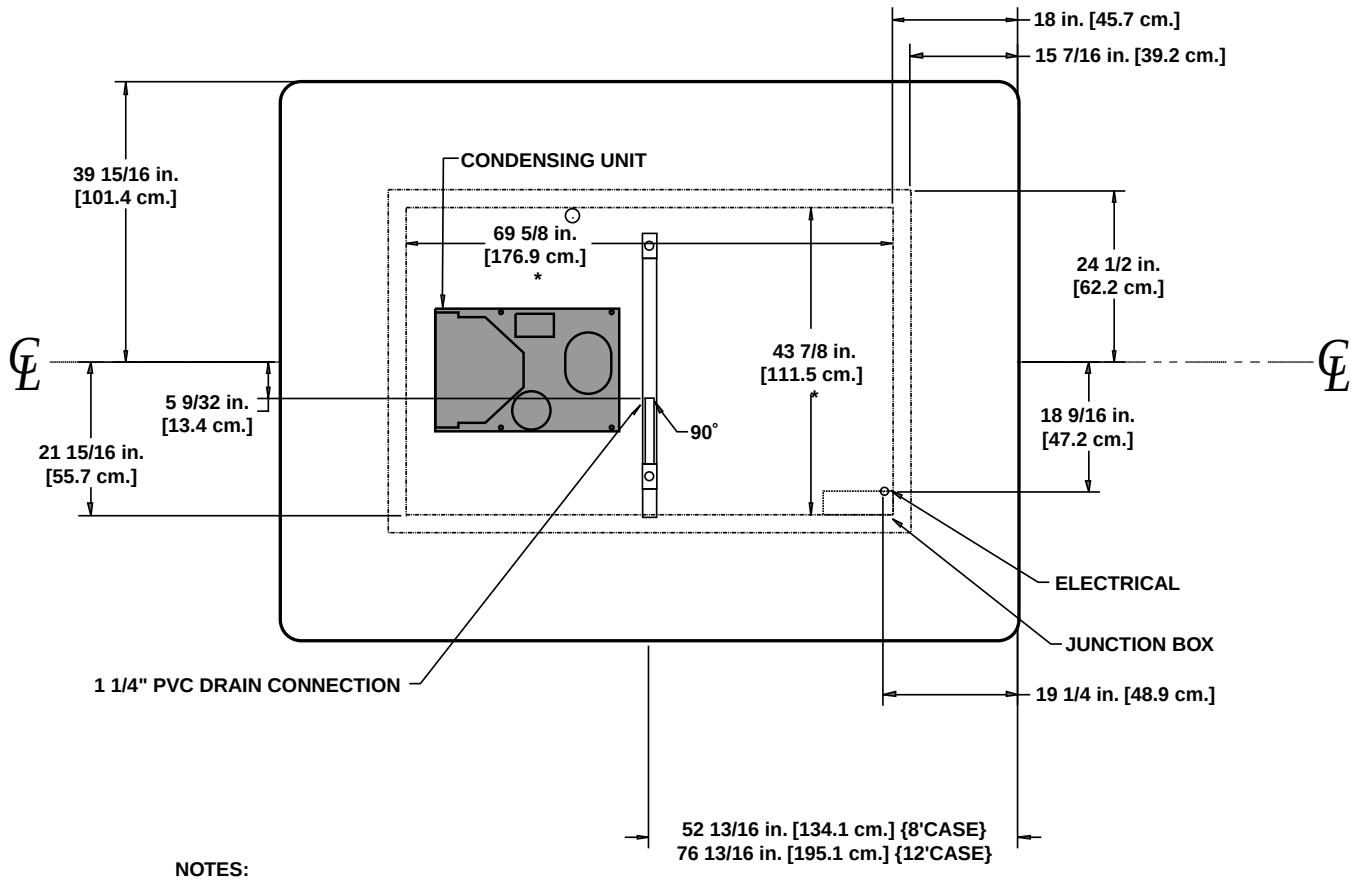

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Wide Island Self-Contained Meat/Deli Merchandisers

OIM(B)A - 6' & 12' self-contained wide island single wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIM(B)A	6'	208/230	1	60	3 wire + ground	19.4	25
	12'	208/230	1	60	3 wire + ground	31.1	35

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIM(B)A	6'	4	1.36	76	0.60	44	0.57	68	3.25	676	3.75	900	5.55	1331	3.15	378
	12'	8	2.72	136	1.20	88	1.17	140	7.22	1502	8.33	2000	5.55	1331	5.87	704

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
OIM(B)A-6'		35	6-8	26	34	31	140
OIM(B)A-12'		35	6-8	26	34	31	140

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIM(B)A-6'	208-230	1	60	1	7.0	34.2	R22	8.2	45	360	215
OIM(B)A-12'[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIM(B)A	3	40	42	- - - [5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

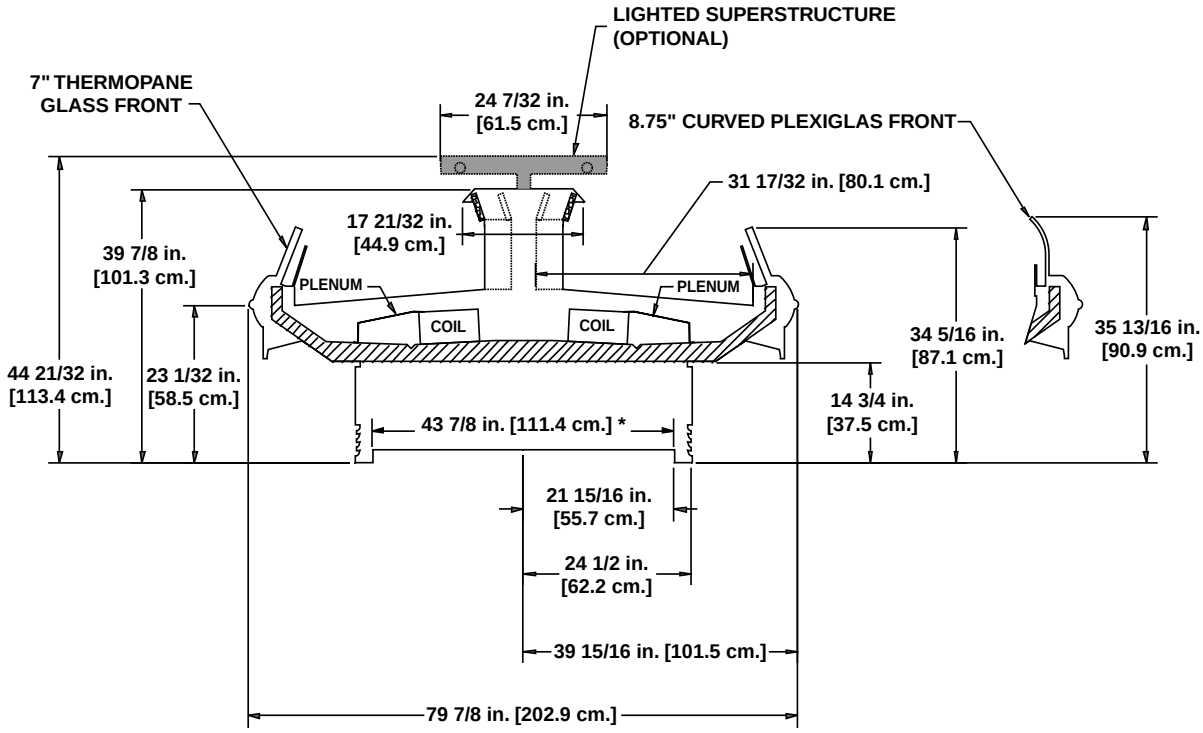

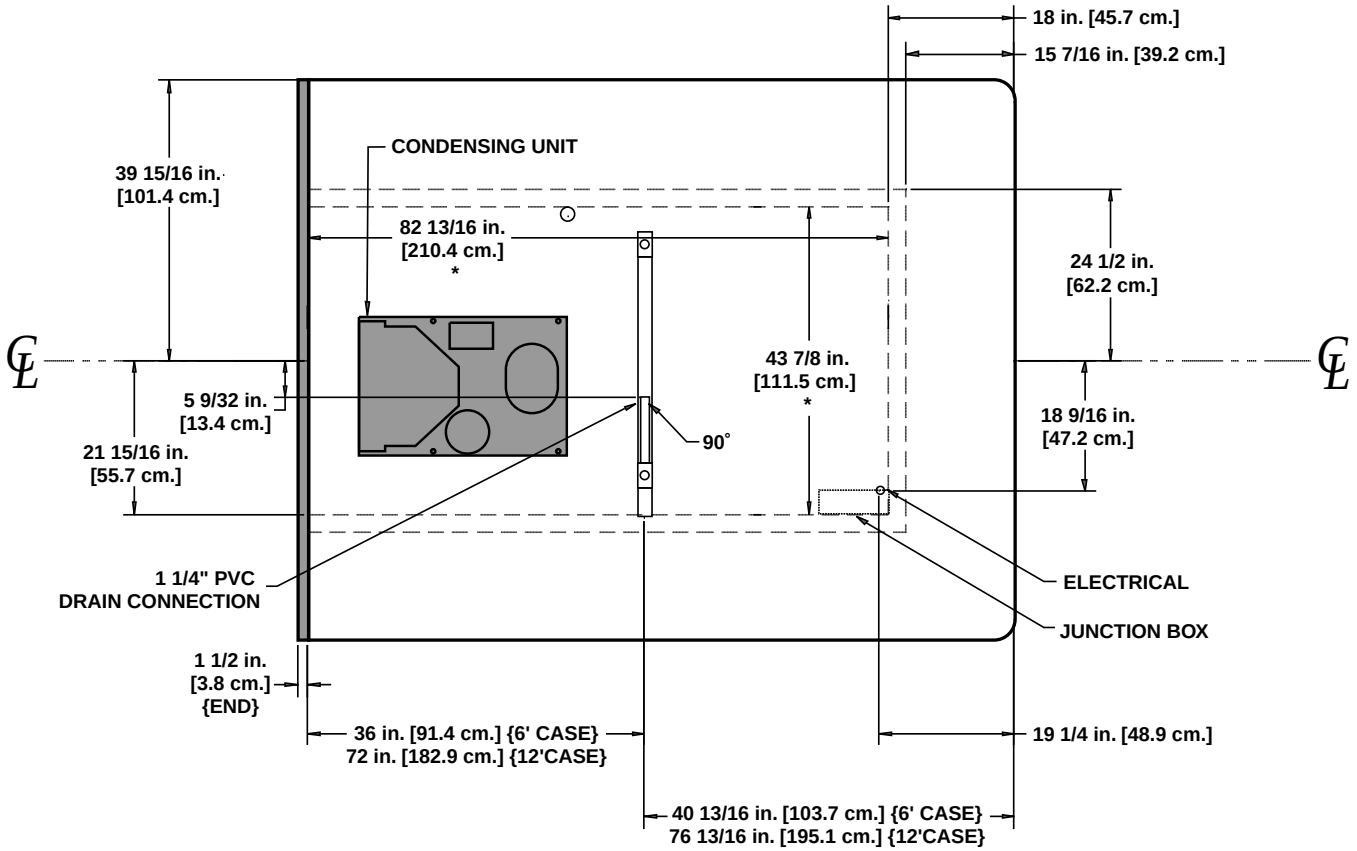

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Narrow Island Self-Contained Meat/Deli Merchandisers

ONIMA - 8' & 12' self-contained wide island double wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONIMA	8'	208/230	1	60	3 wire + ground	22.6	30
	12'	208/230	1	60	3 wire + ground	26.6	30

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		Fans per	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
Model		Case	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIMA	8'	6	2.04	102	0.90	66	0.82	98	4.34	902	5.00	1200	5.55	1331	1.26	151
	12'	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000	5.55	1331	1.46	175

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
ONIMA-8'		35	6-8	25	33	34	180
ONIMA-12'		35	6-8	25	33	34	180

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONIMA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
ONIMA-12'[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONIMA	3	35	47	- - -[5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

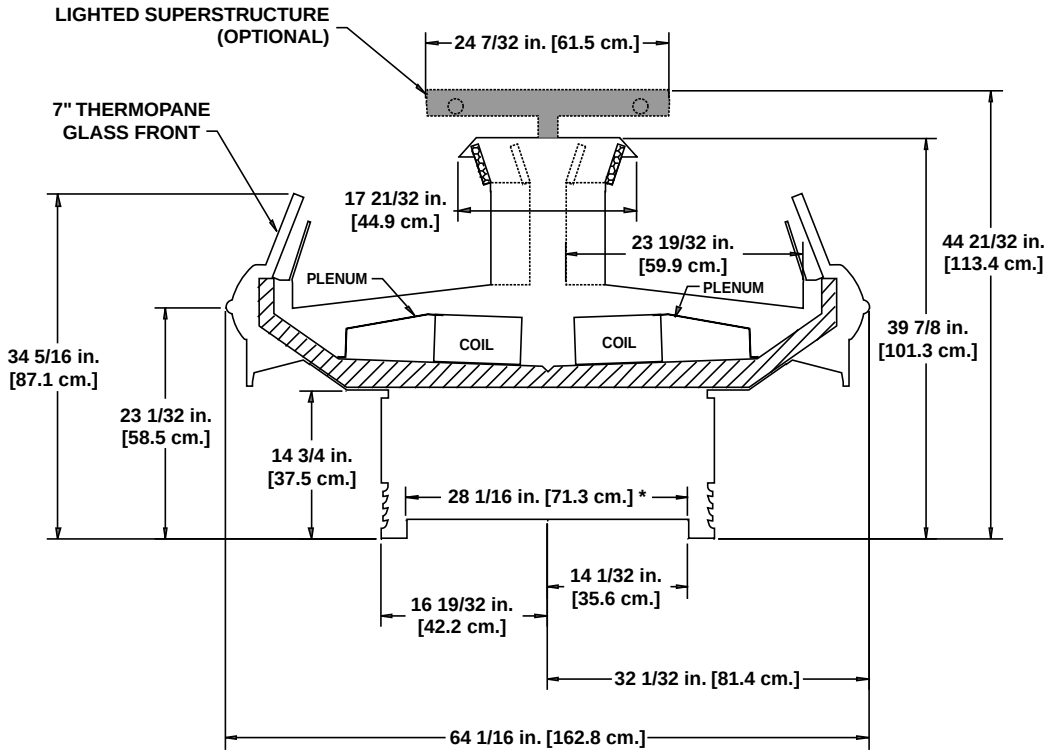

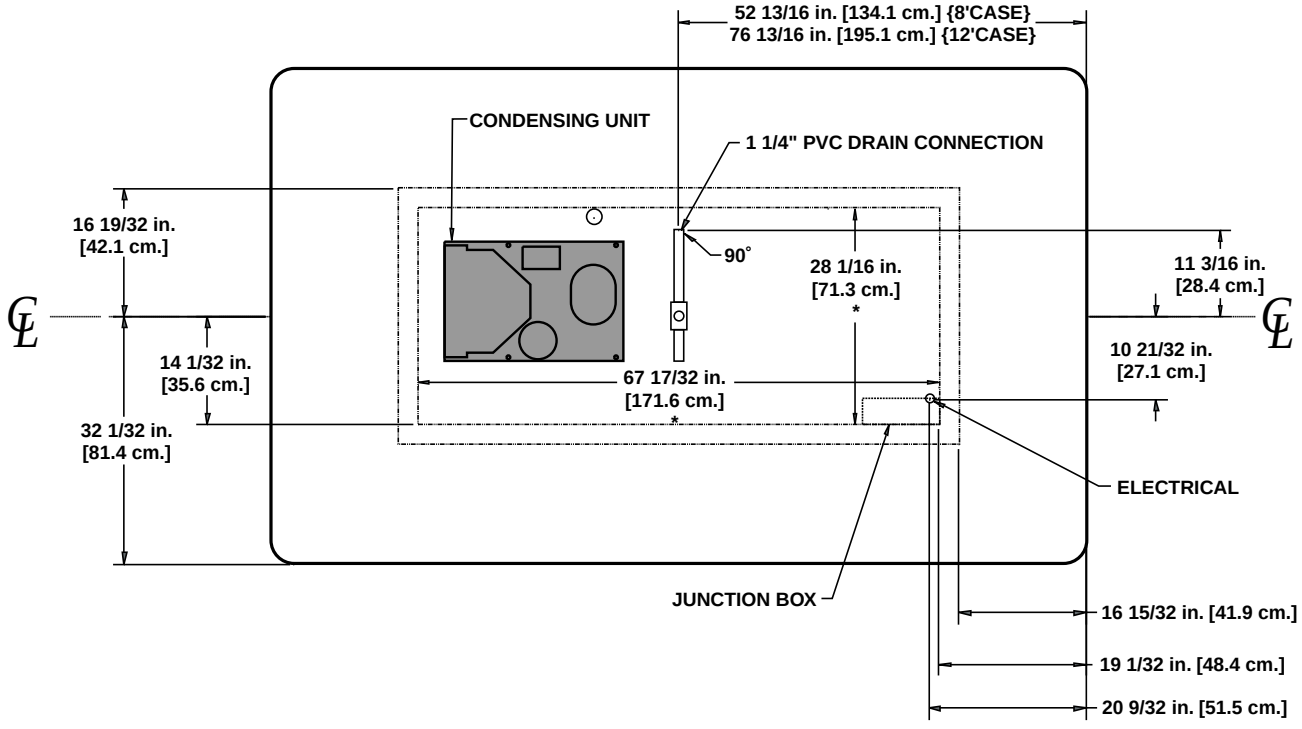

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Narrow Island Self-Contained Meat/Deli Merchandisers

ONIM(B)A - 8’ & 12’ self-contained wide island single wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONIM(B)A	8’	208/230	1	60	3 wire + ground	22.6	30
	12’	208/230	1	60	3 wire + ground	26.7	30

Electrical Data

			Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		Fans per Case	120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
Model			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIM(B)A	8’	6	2.04	102	0.90	66	0.75	90	4.34	902	5.00	1200	5.55	1331	1.26	151
	12’	8	2.72	136	1.20	88	1.17	140	7.22	1502	8.33	2000	5.55	1331	1.46	175

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
ONIM(B)A-8’		35	6-8	28	33	37	180
ONIM(B)A-12’		35	6-8	28	33	37	180

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONIM(B)A-8’	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
ONIM(B)A-12’[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONIM(B)A	3	35	47	- - -[5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

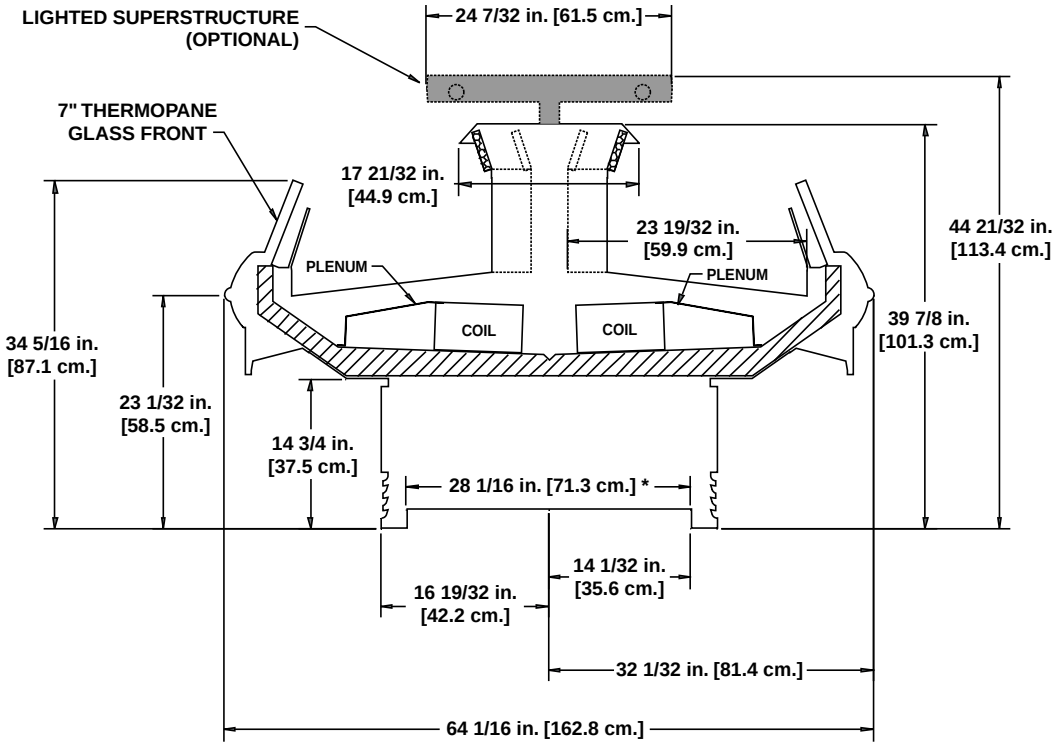

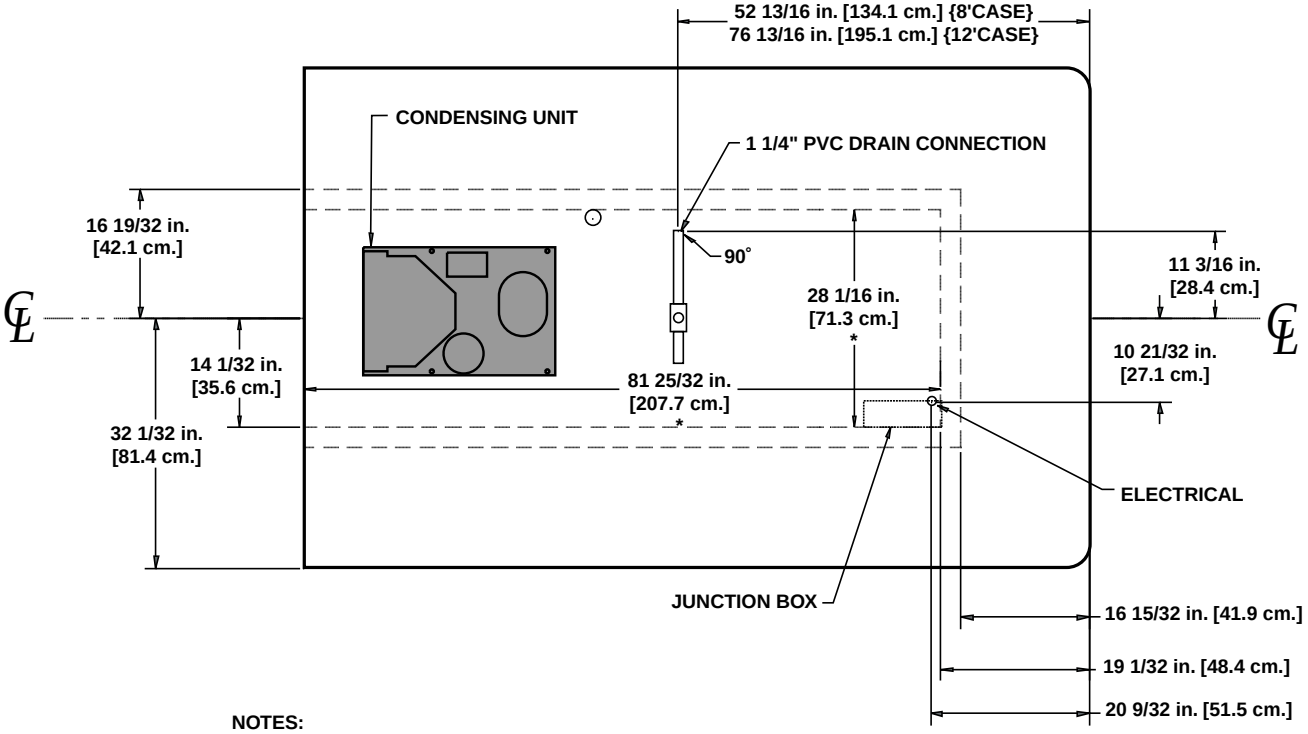

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Wide Island Self-Contained Produce Merchandisers

OIPA - 8’ & 12’ self-contained wide island double wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIPA	8’	208/230	1	60	3 wire + ground	20.0	25
	12’	208/230	1	60	3 wire + ground	35.0	40

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIPA	8’	6	2.04	102	0.90	66	0.23	28	- - - [1]	- - -	- - -	- - -	5.55	1331	3.78	454
	12’	8	2.72	136	1.20	88	0.55	66	- - -	- - -	- - -	- - -	5.55	1331	5.04	605

[1] NOTE: - - - not an option on this case model.

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[2] (FPM)
OIPA-8’		45	6-8	34	40	48	140
OIPA-12’		45	6-8	34	40	48	140

[2] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[4] (amps)	LRA[5] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIPA-8’	208-230	1	60	1	6.7	33.5	R22	7.8	45	360	215
OIPA-12’[3]	208-230	1	60	3/4	9.4	48.2	R22	11.9	45	360	215

[3] This case uses two of the condensing units listed above.

[4] RLA - Running Load Amps.

[5] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
OIPA	3	- - -	- - -	44	38	- - -	- - -	- - -	- - -

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

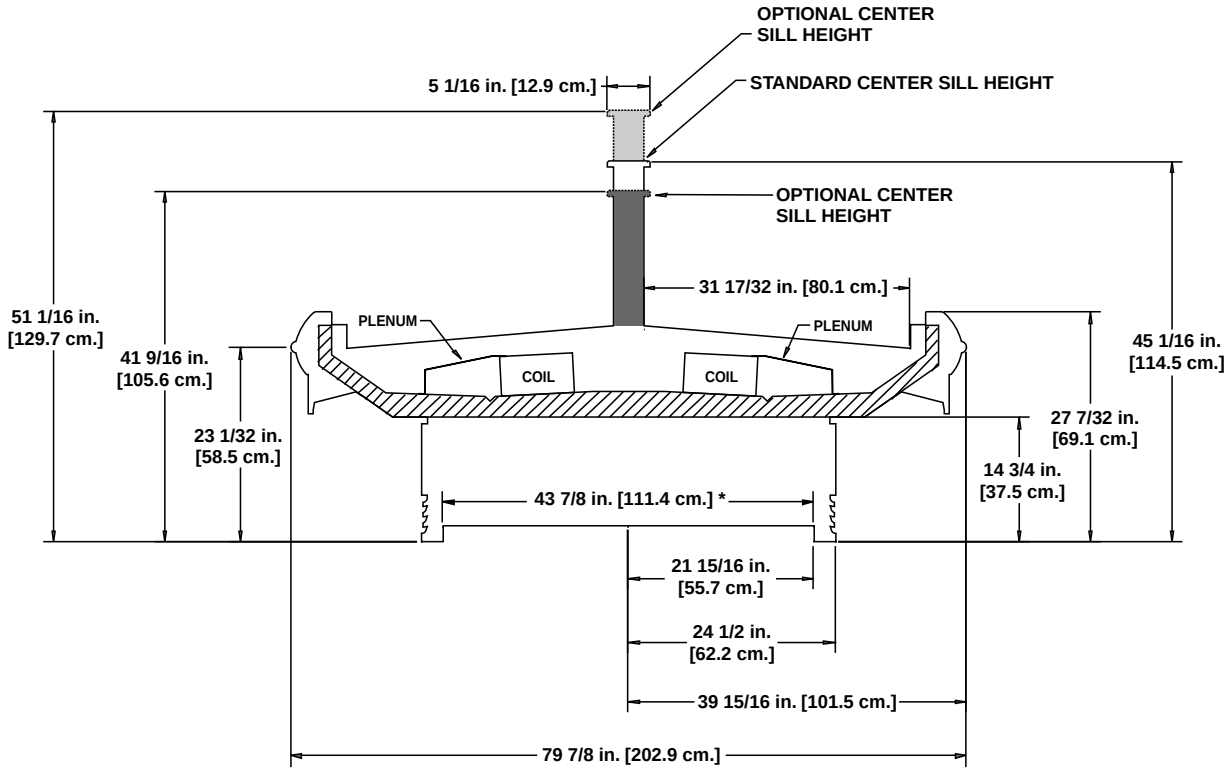

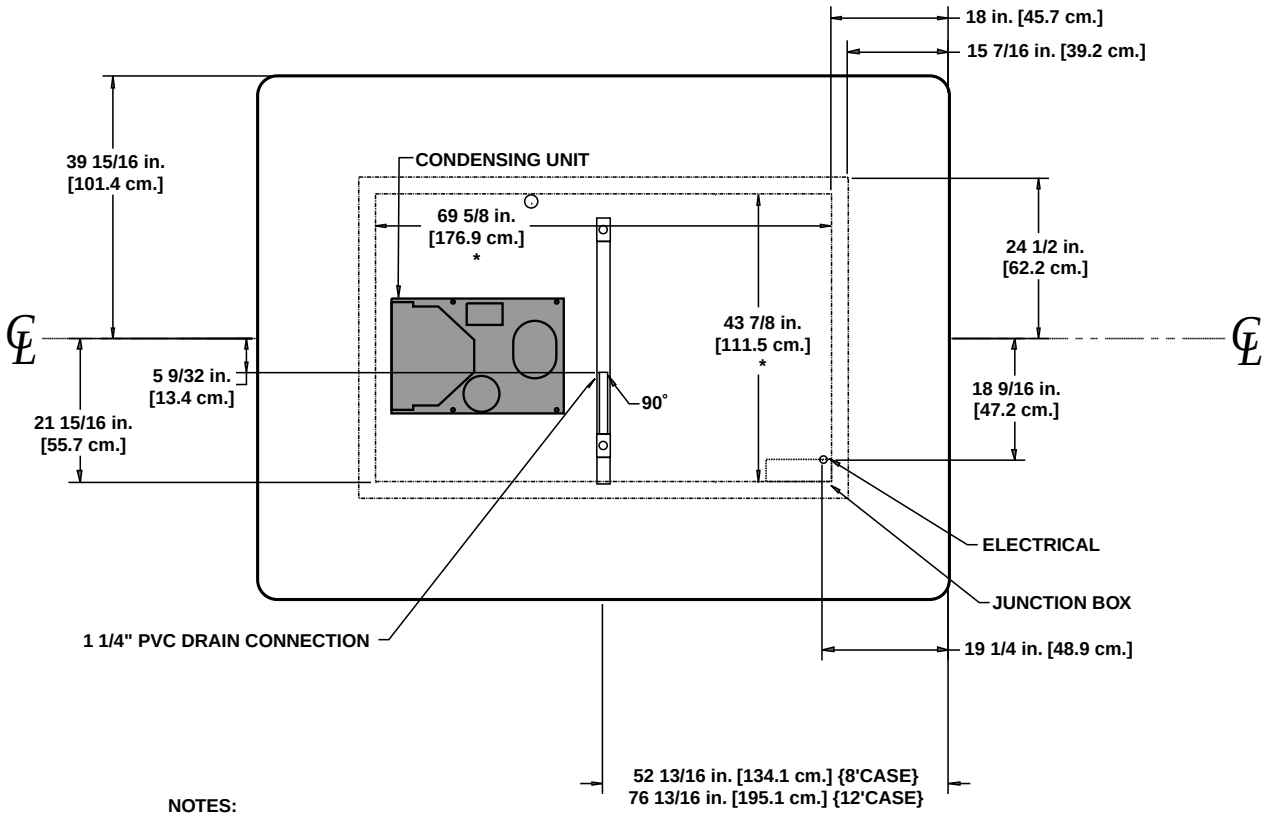

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Wide Island Self-Contained Multi-Deck Cheese Merchandisers

O3ICA - 8' & 12' self-contained wide island double wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O3ICA	8'	208/230	1	60	3 wire + ground	27.1	35
	12'	208/230	1	60	3 wire + ground	32.6	35

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3ICA	8'	6	2.04	102	0.90	66	0.82	98	4.34	902	5.00	1200	5.55	1331	5.71	546
	12'	8	2.72	136	1.20	88	1.08	130	7.22	1502	8.33	2000	5.55	1331	7.46	779

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
O3ICA-8'		37	6-8	29	37	48	160
O3ICA-12'		37	6-8	29	37	48	160

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3ICA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
O3ICA-12'[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O3ICA	6	30	55	- - - [5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

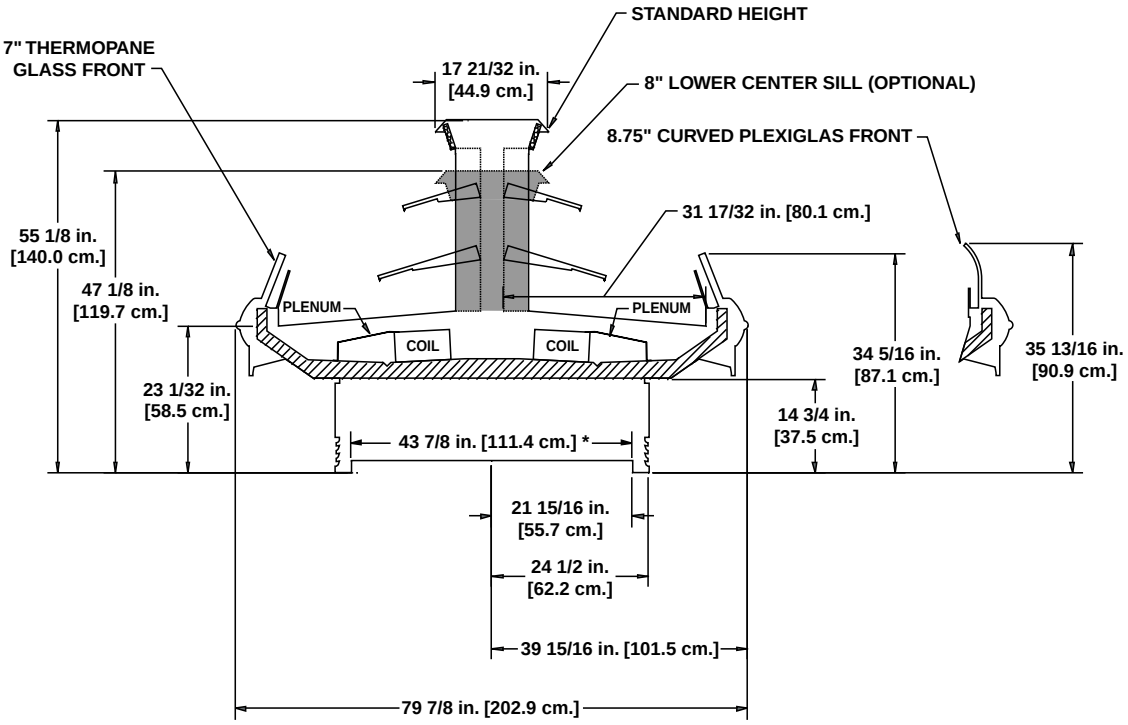

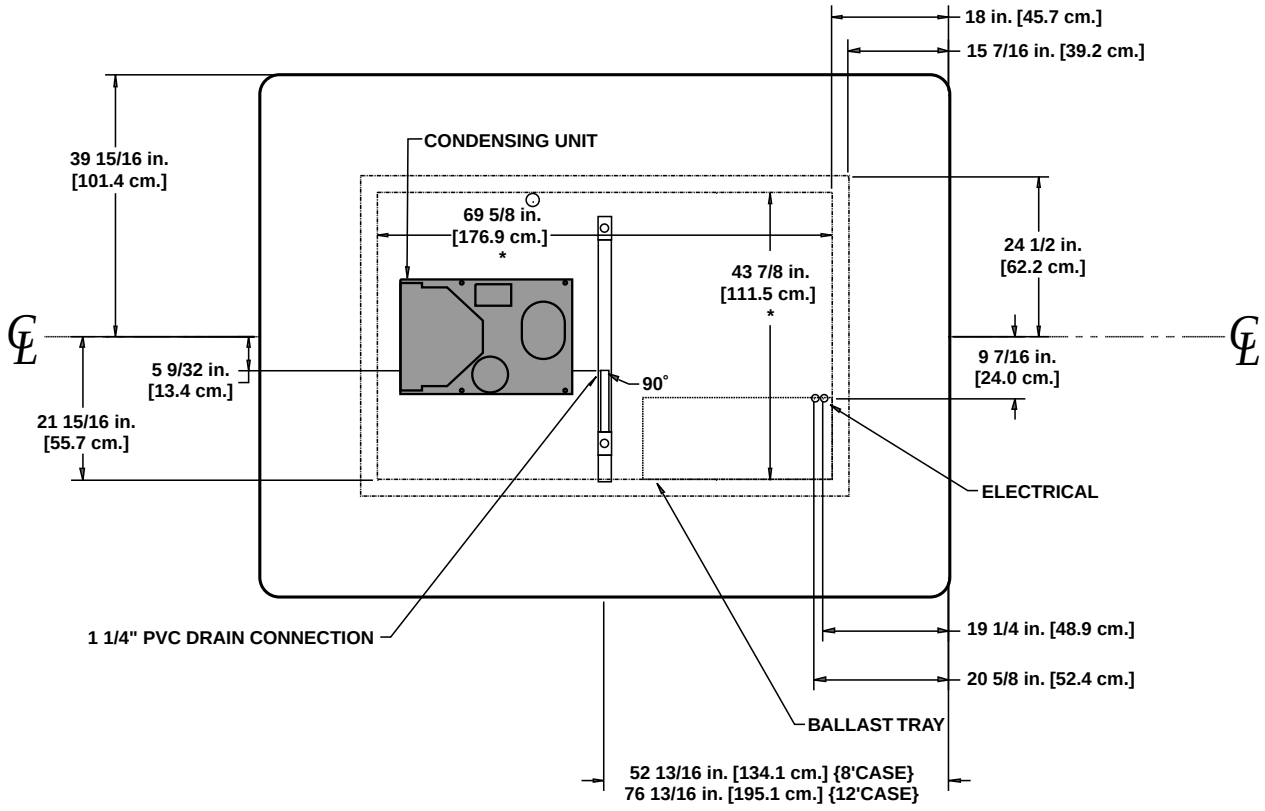

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

Wide Island Self-Contained Multi-Deck Cheese Merchandisers

O3IC(B)A - 8' & 12' self-contained wide island single wraparound end

System Requirements

Model		Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O3IC(B)A	8'	208/230	1	60	3 wire + ground	26.1	35
	12'	208/230	1	60	3 wire + ground	31.2	35

Electrical Data

Model		Fans per Case	Standard Fans 120 Volts		High Efficiency Fans 120 Volts		Anti-Condensate Heaters 120 Volts		Defrost Heaters 208 Volts		Defrost Heaters 240 Volts		Drain Heater 240 Volts		Maximum Lights 120 Volts	
			Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IC(B)A	8'	6	2.04	102	0.90	66	0.75	90	4.34	902	5.00	1200	5.55	1331	4.76	514
	12'	8	2.72	136	1.20	88	1.17	140	7.22	1502	8.33	2000	5.55	1331	6.02	665

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
O3IC(B)A-8'		37	6-8	29	37	48	160
O3IC(B)A-12'		37	6-8	29	37	48	160

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[3] (amps)	LRA[4] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3IC(B)A-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
O3IC(B)A-12'[2]	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

[2] This case uses two of the condensing units listed above.

[3] RLA - Running Load Amps.

[4] LRA - Locked Rotor Amps.

Defrost Controls

Model	Defrosts Per Day	Electric Defrost Fail-safe (min)	Electric Defrost Termination Temp. (°F)	Timed Off Defrost Fail-safe (min)	Timed Off Defrost Termination Temp. (°F)	Hot Gas Defrost Fail-safe (min)	Hot Gas Defrost Termination Temp. (°F)	Reverse Air Defrost Fail-safe (min)	Reverse Air Defrost Termination Temp. (°F)
O3IC(B)A	6	30	55	- - - [5]	- - -	- - -	- - -	- - -	- - -

[5] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

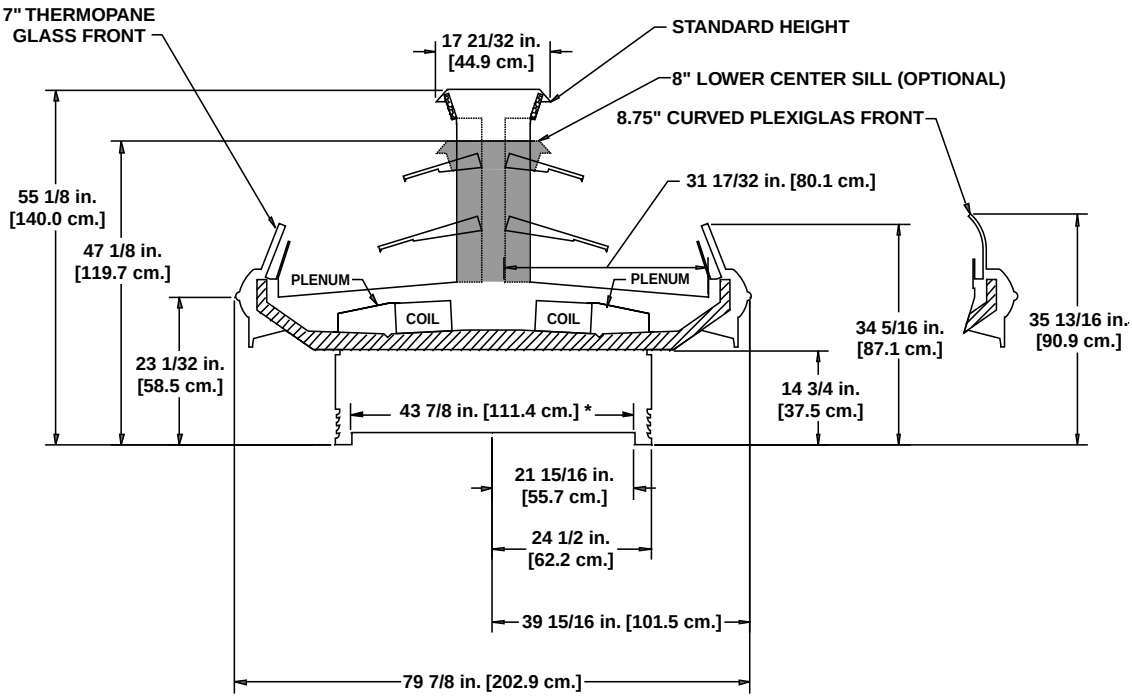

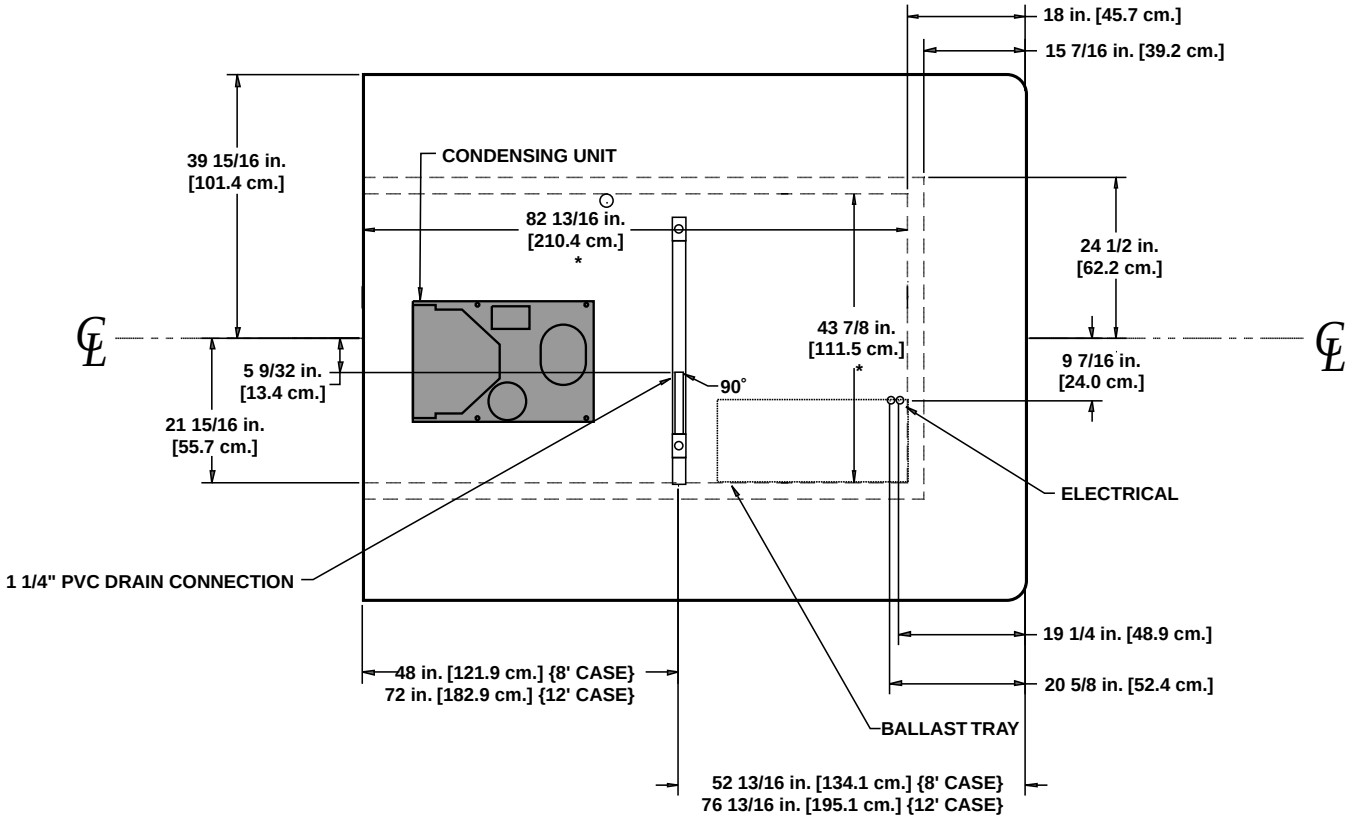

NOTES:

* STUB-UP AREA

• 12' CASES HAVE TWO CONDENSING UNITS

International Style Deli/Seafood Self-Contained Mobile Merchandisers

OSIA-4' - full service mobile self-contained deli/seafood

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity[1] (FPM)
OSIA-4'		12-14	6-8	26	33	34	

[1] Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA[2] (amps)	LRA[3] (amps)	Refrig.	lbs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIA-4'	115	1	60	1/3	8.9	48.0	R134A	2.25	45	440	162

[2] RLA - Running Load Amps.

[3] LRA - Locked Rotor Amps.

Defrost Controls

		Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
Model	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIA-4'	2	45	47	- - -[4]	- - -	- - -	- - -	- - -	- - -

[4] NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

Hill PHOENIX EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

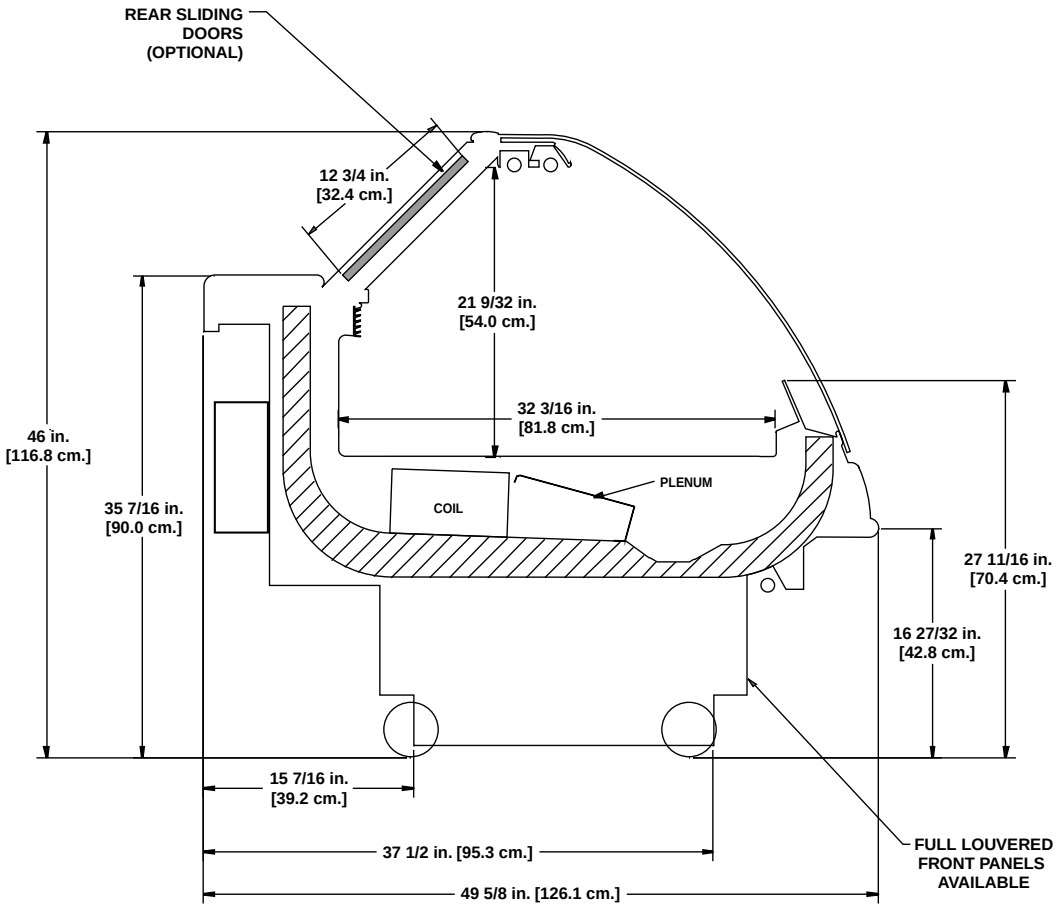

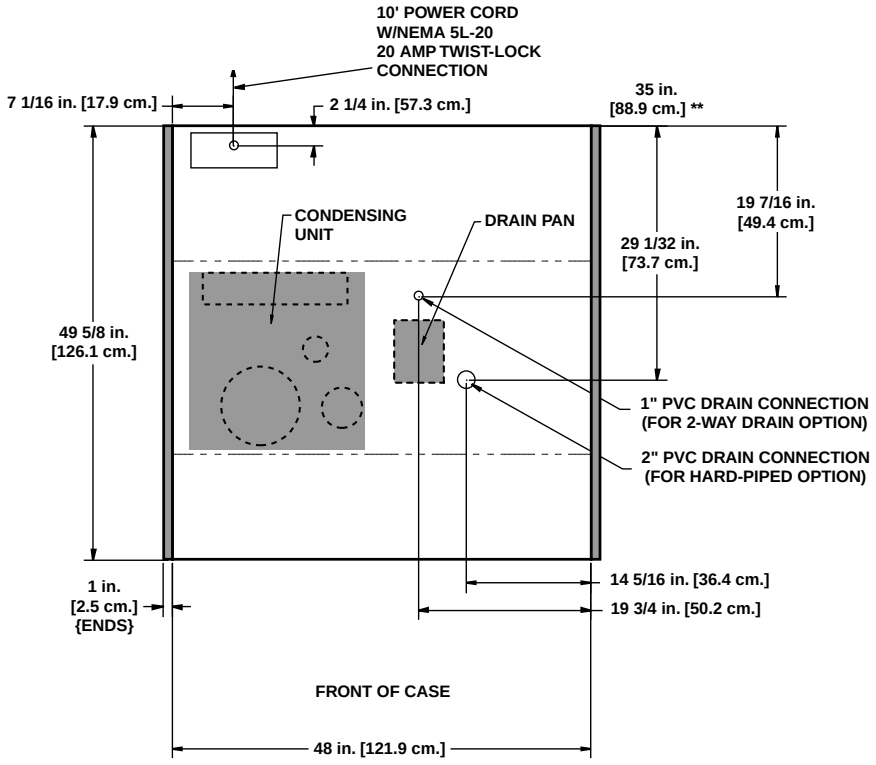

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Index

O2UM 20-23
O2.5UM 24-27
O2.5UMA-4’ 140-141
O3IC 100-102
O3ICA 162-163
O3IC(B) 100, 103-104
O3IC(B)A 164-165
O3IP 106-107
O3IP(B) 106, 108
O3UM 28-31
O3UMA-4’ 142-143
O3.5UM 32-35
O4UM 36-37
O5DM 44-49
O5DMA 144-147
O5DR 40-43
O5UM 38-39
O5Z 52-53
OC 2-3
OGM 122-124
OHM 54-55
OHMH 58-59
OHP 60-61
OHPH 62-63
OIM 78-79
OIMA 152-153
OIM(B) 78, 80
OIM(B)A 154-155
OIM(BB) 78, 81
OIP 86-87
OIPA 160-161
OIP(B) 86, 88
OIP(BB) 86, 89
OIZ 94-95
OM 4-5
OMZ 6-7
OMZD 8-9
ON5DM 50-51
ONHM 56-57
ONIM 82-83
ONIMA 156-157
ONIM(B) 82, 84
ONIM(B)A 158-159
ONIZ 96-97
ONIZ(G) 96, 98
ONRB 68-69
ONRZ 72-73
ONUA 148-150
OP 10-11
ORB 66-67
ORZ 70-71
ORZH 74-75
OSA 110-112
OSAG 118-120
OSI 126-128
OSIA-4’ 166-167
OSIH 130-131
OSIO 12-14
OSIOA-4’ 136-137
OSIOZA-4’ 138-139
OSM 114-116
OWEZ 92-93
OWEZ(G) 92-93
OWIZ 90-91
OWIZ(G) 90-91
OWSI 130-131
OWSIO 16-17

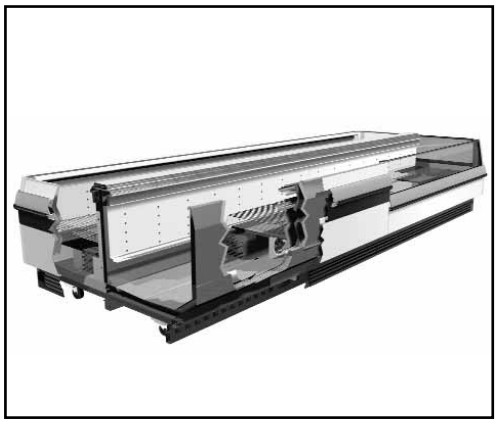

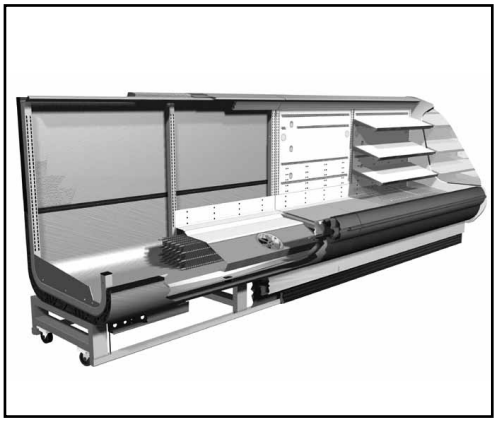

804-526-4455

Hill PHOENIX
EXCELLENCE™

A DOVER DIVERSIFIED COMPANY

1925 Ruffin Mill Road, Colonial Heights, VA 23834 • 709 Sigman Road, Conyers, GA 30013 • 1258 Quarry Lane, Suite G, Pleasanton, CA 94566 • 3601Walnut Avenue, Chino, CA 91710

Due to our commitment to continuous improvement all specifications are subject to change without notice.

Hill PHOENIX is a Sustaining Member of the American Society of Quality.

Visit our web site at www.hillphoenix.com