

HILL PHOENIX
EXCELENCE™

Merchandisers

Engineering

Reference

Manual

2000

OBSOLETE



Statement of Purpose

We will lead the markets we serve with innovative products, solutions and technological advances in a relentless pursuit to exceed customer expectations.

We will create a culture that promotes teamwork, integrity and respect for our customers, our suppliers and ourselves.

We are intolerant of mediocrity and dedicated to continuous improvement as a way of life.

As a result, **Hill PHOENIX** will enhance the success of our customers, the return to our shareholders, and the satisfaction of our employees.

Revisions From the 1999 Engineering Reference Manual

New Cases Added

ONZ	ONHP	MDCA-4'
ON2UM	BB	UPA-8'
ON2.5UM	ONRBH	O2SIA-4'
ON3UM	ORBH	OPA
ON3.5UM	ONRZH	ONNA
O3.5UD	OREZ	CURVED CASES
O6UM	O3IM	

Revisions

GLOBAL All Pages Added superheat set point and defrost run-off time to all models.
Hot gas defrost termination temperature for all medium temp. cases changed to 45°.
Hot gas defrost termination temperature for all low temp. cases changed to 60°.

OC	Page 2	Standard fan wattage changed. 12' defrost heater amperage changed for 208 volts. 27" front evaporator temperature changed to 17°, which changed the BTUH/ft and all other temperature data. Average product temperature changed. Timed-off defrost termination temperature changed. Reverse air defrost data added to model.
OM	Page 4	Timed-off defrost termination temperature changed. Reverse air defrost data added to model.
OMZD	Page 10	Standard fan amperage changed. Anti-condensate heater amperage and wattage changed. Defrost heater amperage and wattage changed from three phase to single phase.
OP	Page 14	39" rear cut produce BTUH/ft, discharge temperature, return temperature, and air velocity changed. 43" rear cut produce discharge temperature changed 39" rear bulk produce discharge temperature, average product temperature, return temperature, and air velocity changed. 43" rear bulk produce BTUH/ft, discharge temperature, and return temperature changed. All defrost termination temperatures changed.
OSIO	Page 18	Standard fan amperage changed. Electric and timed-off defrost termination temperature changed. Hot gas defrost data added to this model.
OWSIO	Page 22	Standard fan amperage changed. Hot gas defrost data added to this model. Timed-off defrost termination temperature changed.
O2UM	Page 30	4' defrost heater amperage changed.
O2.5UM	Page 38	4' defrost heater amperage changed.
O3UM	Page 48	4' defrost heater amperage changed.
O3.5UM	Page 56	4' Defrost heater amperage changed. Average product temperature changed.

Revisions From the 1999 Engineering Reference Manual

O4UM	Page 62	Average product temperature changed.
ON5DM	Page 72	Added performance data at 27° evaporator temperature. Timed-off and reverse air defrost termination temperatures changed.
O5DM	Page 74	12' defrost heater amperage changed at 208 volts. Discharge air velocity changed. Timed-off and reverse air defrost termination temperatures changed.
O5DMH	Page 80	12' defrost heater amperage changed at 208 volts. Timed-off and reverse air defrost termination temperatures changed.
O5DR	Page 84	High efficiency fan data changed. Defrost heaters added to model. Typical per row and maximum lighting changed. Electric, hot gas, and reverse air defrost data added to model. Cross-section was updated.
O5Z	Page 88	Defrost heater amps changed for 208 volt and 240 volt.
ONHM	Page 90	Standard and high efficiency fan data changed. BTUH/ft, average product temperature, return air temperature, and discharge air velocity changed. Timed-off and reverse air defrost termination temperature changed.
OHM	Page 92	27" front at 12° evaporator temperature the discharge temperature and return temperature changed. 27" front at 17° evaporator temperature the return temperature changed. 31" & 33" front at 17° evaporator temperature the return temperature changed. Timed-off and reverse air defrost termination temperature changed.
OHMH	Page 94	27" front at 12° evaporator temperature all data changed. Added 27" front and 31"/33" data at 17° evaporator temperature. Removed 31"/33" front data at 12° evaporator temperature. Electric, hot gas, and reverse air defrost fail-safe minutes changed. Timed-off and reverse air defrost termination temperature changed.
OHP	Page 98	Timed-off defrost fail-safe minutes changed. Electric, timed-off, and reverse air defrost termination temperatures changed.
OPH	Page 100	Timed-off defrost fail-safe minutes changed. Electric, timed-off, and reverse air defrost termination temperatures changed.
ONRB	Page 112	High efficiency fan motor amperage changed Electric and timed-off defrost fail-safe minutes changed. All defrost termination temperatures changed.
ORB	Page 116	High efficiency fan motor amperage changed Electric and timed-off defrost fail-safe minutes changed. All defrost termination temperatures changed.
ONRZ	Page 120	High efficiency fan motor wattage changed
ORZ	Page 124	High efficiency fan motor wattage changed Discharge air velocity changed.

Revisions From the 1999 Engineering Reference Manual

ORZH	Page 126	High efficiency fan motor wattage changed Anti-condensate heater data changed. Frozen food discharge temperature changed.
ONIM	Page 132	Standard fan amperage changed. Timed-off defrost data added to model.
OIM	Page 136	Standard fan amperage changed. OIMB-8' maximum lighting amperage changed. Timed-off defrost fail-safe minutes changed. Electric and timed-off defrost termination temperature changed.
OIP	Page 140	Standard fan amperage changed.
ONIZ	Page 144	Standard fan amperage changed.
OIZ	Page 148	Standard fan amperage changed. Electric defrost termination temperature changed.
OWIZ	Page 150	Standard fan amperage changed.
OWEZ	Page 152	Standard fan amperage changed. OWEZG for ice cream application defrost heater amperage changed.
O3IC	Page 156	Standard fan amperage changed. O3ICB-6' standard fan wattage changed. O3ICB-12' anti-condensate heater wattage changed. Electric defrost termination temperature changed.
O3IP	Page 168	Standard fan amperage changed.
OSA	Page 172	Standard fan amperage changed. Added hot gas defrost data to model.
OSM	Page 176	Standard fan amperage changed. Added hot gas defrost data to model.
OSAG	Page 180	Standard fan amperage changed.
OSI	Page 188	Standard fan amperage changed. Hot gas defrost data added to this model. Timed-off defrost fail-safe minutes changed. Electric and timed-off defrost termination temperature changed.
OWSI	Page 192	Standard fan amperage changed. Hot gas defrost data added to this model. Timed-off defrost fail-safe minutes changed. Electric and timed-off defrost termination temperature changed.
OSIF	Page 194	Standard fan amperage changed. Hot gas defrost data added to this model. Timed-off defrost fail-safe minutes changed. Electric and timed-off defrost termination temperature changed.

Revisions From the 1999 Engineering Reference Manual

OLF	Page 198	12' defrost heater amperage at 208 volts changed.
OLFG	Page 202	Anti-condensate heater data changed. 12' defrost heater amperage at 208 volts changed. Timed-off defrost fail-safe minutes changed.
OSAH	Page 206	Added electrical data for European configurations. Added OSAH 12' data to both domestic and European electrical data. Added cross-section of an OSAH on an 11" baseframe.
MMCA-4'	Page 216	Plug style changed.
OSIOPA-4'	Page 222	Updated cross-section.
O2.5UMA	Page 228	Electric defrost termination temperature changed.
O3UMA	Page 230	24 hour energy usage changed. Electric defrost termination temperature changed.
O5DMA	Page 232	Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data. Drain heater amperage changed. O5DMA-4' compressor RLA changed. Timed-off defrost termination temperature. Updated cross-sections.
ONUA	Page 238	Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data.
ONIMA	Page 242	Standard fan amperage changed. Maximum fuse size on the ONIMA-12' changed. Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data.
ONIMBA	Page 244	Standard fan amperage changed. Maximum fuse size on the ONIMBA-12' changed. Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data.
OIMA	Page 246	Standard fan amperage changed. Maximum fuse size changed. Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data. Electric defrost termination temperature changed.
OIMBA	Page 248	Standard fan amperage changed. Maximum fuse size changed. Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data. Electric defrost termination temperature changed.
OIPA	Page 250	Standard fan amperage changed. Maximum fuse size changed. Minimum circuit ampacity changed. Removed high efficiency fans and added condenser fan information to electrical data.

Revisions From the 1999 Engineering Reference Manual

- O3ICA Page 252 Standard fan amperage changed.
 Maximum fuse size changed.
 Minimum circuit ampacity changed.
 Removed high efficiency fans and added condenser fan information to electrical data.
 Electric defrost termination temperature changed.
- O3ICBA Page 254 Standard fan amperage changed.
 Maximum fuse size changed.
 Minimum circuit ampacity changed.
 Removed high efficiency fans and added condenser fan information to electrical data.
 Electric defrost termination temperature changed.
- OSIA-4' Page 256 Compressor RLA and LRA data changed.

OBSOLETE

OBSOLETE

Table of Contents

Merchandisers by Design Application

Single Deck Merchandisers	1
Single Deck Deli/Cheese Merchandiser (OC)	2
Single Deck Deli/Meat/Seafood Merchandiser (OM)	4
Single Deck Frozen Meat Merchandiser (OMZ)	8
Single Deck Frozen Food/Ice Cream Merchandiser (OMZD)	10
Single Deck Frozen Food/Ice Cream Merchandiser (ONZ)	12
Single Deck Produce Merchandiser (OP)	14
International Style Single Deck Deli/Meat/Seafood Merchandiser (OSIO)	18
Wide International Style Single Deck Deli/Meat/Seafood Merchandiser (OWSIO)	22
 Multi-Deck Merchandisers	 25
Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (ON2UM)	26
Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (O2UM)	30
Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (ON2.5UM)	34
Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (O2.5UM)	38
Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (ON3UM)	44
Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (O3UM)	48
Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (ON3.5UM)	52
Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser (O3.5UM)	56
Multi-Deck Produce/Dairy/Deli Merchandiser (O3.5UD)	60
Multi-Deck Produce/Dairy/Deli Merchandiser (O4UM)	62
Multi-Deck Produce/Dairy/Deli Merchandiser (O5UM)	66
Multi-Deck Produce/Dairy/Deli Merchandiser (O6UM)	70
Narrow Multi-Deck Produce/Dairy Merchandiser (ON5DM)	72
Multi-Deck Produce/Dairy/Deli Merchandiser (O5DM)	74
High Multi-Deck Produce/Dairy/Deli Merchandiser (O5DMH)	80
Multi-Deck Rear Load Dairy Merchandiser (O5DR)	84
Multi-Deck Frozen Food Merchandiser (O5Z)	88
Narrow Multi-Deck Deli/Meat Merchandiser (ONHM)	90
Multi-Deck Meat Merchandiser (OHM)	92
High Multi-Deck Deli/Meat Merchandiser (OHMH)	94
Narrow Multi-Deck Produce Merchandiser (ONHP)	96
Multi-Deck Produce Merchandiser (OHP)	98
High Multi-Deck Produce Merchandiser (OHPH)	100
Multi-Deck Narrow Produce/Dairy/Deli/Meat Merchandiser (ONU)	102
Roll-In Rear Load Dairy Merchandiser (ORDR)	104
Multi-Deck Deli Back Bar Merchandiser (BB)	108

Table of Contents

Merchandisers by Design Application

Reach-In Door Merchandisers	111
Narrow Glass Door Reach-In Beverage Merchandiser (ONRB)	112
High Narrow Glass Door Reach-In Beverage Merchandiser (ONRBH)	114
Glass Door Reach-In Beverage Merchandiser (ORB)	116
High Glass Door Reach-In Beverage Merchandiser (ORBH)	118
Narrow Glass Door Reach-In Frozen Food/Ice Cream Merchandiser (ONRZ)	120
High Narrow Glass Door Reach-In Frozen Food/Ice Cream Merchandiser (ONRZH)	122
Glass Door Reach-In Frozen Food/Ice Cream Merchandiser (ORZ)	124
High Glass Door Reach-In Frozen Food/Ice Cream Merchandiser (ORZH)	126
Glass Door Reach-In End Cap Frozen Food/Ice Cream Merchandiser (OREZ)	128
Single Deck Island Merchandisers	131
Narrow Island Deli/Meat Merchandiser (ONIM)	132
Wide Island Deli/Meat Merchandiser (OIM)	136
Wide Island Bulk Produce Merchandiser (OIP)	140
Narrow Island Frozen Food/Ice Cream Merchandiser (ONIZ / ONIZG)	144
Island Frozen Food Merchandiser (OIZ)	148
Wide Island Frozen Food/Ice Cream Merchandiser (OWIZ / OWIZG)	150
Wide Island Frozen Food/Ice Cream Merchandiser (OWEZ / OWEZG)	152
Multi-Deck Island Merchandisers	155
Wide Island Multi-Deck Cheese Merchandiser (O3IC)	156
Wide Island Multi-Deck Deli/Meat Merchandiser (O3IM)	162
Wide Island Multi-Deck Produce Merchandiser (O3IP)	168
Service Merchandisers	171
American Style Curved Glass Service Deli Merchandiser (OSA)	172
American Style Verticle Glass Service Deli Merchandiser (OSM)	176
American Style Curved Glass Service Meat/Deli/Seafood Gravity Coil Merchandiser (OSAG)	180
American Style Verticle Glass Service Meat/Deli/Seafood Gravity Coil Merchandiser (OGM)	184
International Style Service Deli/Meat/Seafood Merchandiser (OSI)	188
Wide International Style Service Deli/Meat/Seafood Merchandiser (OWSI)	192
International Style Flat Glass Service Deli/Meat/Seafood Merchandiser (OSIF)	194
Flat Glass Service Deli Merchandiser (OLF)	198
Flat Glass Service Deli Gravity Coil Merchandiser (OLFG)	202
American Style Curved Glass Service Hot Foods Merchandiser (OSAH)	206
International Style Service Hot Foods Merchandiser (OSIH)	210

Table of Contents

Merchandisers by Design Application

Self-Contained Merchandisers	213
Single Deck Self-Contained Mobile Deli Merchandiser (MDCA-4')214
Single Deck Self-Contained Mobile Deli/Meat Merchandiser (MMCA-4')216
Single Deck Self-Contained Produce Merchandiser (OPA)218
International Style Self-Contained Mobile Deli/Meat/Seafood Merchandiser (OSIOA-4')220
International Style Self-Contained Mobile Deli/Meat/Seafood Prep. Merchandiser (OSIOPA-4')222
International Style Self-Contained Mobile Dual-Temp Merchandiser (OSIOZA-4')224
Single Deck Self-Contained Mobile Boxed Produce Merchandiser (UPA-8')226
Multi-Deck Self-Contained Mobile Produce/Dairy/Deli/Meat Merchandiser (O2.5UMA-4')228
Multi-Deck Self-Contained Mobile Produce/Dairy/Deli/Meat Merchandiser (O3UMA-4')230
Multi-Deck Self-Contained Produce/Dairy/Deli Merchandiser (O5DMA)232
Narrow Multi-Deck Self-Contained Dairy Merchandiser (ONNA)236
Narrow Multi-Deck Self-Contained Dairy/Deli/Meat Merchandiser (ONUA)238
Narrow Island Self-Contained Deli/Meat Merchandiser (ONIMA)242
Narrow Island Self-Contained Deli/Meat Merchandiser (ONIMBA)244
Wide Island Self-Contained Deli/Meat Merchandiser (OIMA)246
Wide Island Self-Contained Deli/Meat Merchandiser (OIMBA)248
Wide Island Self-Contained Bulk Produce Merchandiser (OIPA)250
Wide Island Multi-Deck Self-Contained Cheese Merchandiser (O3ICA)252
Wide Island Multi-Deck Self-Contained Cheese Merchandiser (O3ICBA)254
International Style Self-Contained Mobile Deli/Meat/Seafood Merchandiser (OSIA-4')256
International Style Self-Contained Mobile Deli/Meat/Seafood Merchandiser (O2SIA-4')258
Curved Case Merchandisers	261
Curved Case Electrical and Refrigeration Data262
30° Inside & Outside Curved Case266
45° Inside & Outside Curved Case267
60° Inside & Outside Curved Case267
90° Inside & Outside Curved Case269
Index	270

OBSOLETE

Table of Contents

Merchandisers by Departmental Application

Produce

Single Deck Merchandisers	1
OP	14

Multi-Deck Merchandisers	25
---------------------------------------	-----------

ON2UM	26
O2UM	30
ON2.5UM.....	34
O2.5UM.....	38
ON3UM.....	44
O3UM	48
ON3.5UM.....	52
O3.5UM.....	56
O3.5UD	60
O4UM	62
O5UM	66
O6UM	70
ON5DM	72
O5DM	74
O5DMH	80
ONHP	96
OHP	98
OPHP	100

Single Deck Island Merchandisers	131
OIP / OIPB / OIPBB	140

Multi-Deck Island Merchandisers	155
O3IP / O3IPB	168

Self-Contained Merchandisers.	213
OPA	218
UPA	226
O2.5UMA-4'	228
O3UMA-4'	230
O5DMA	232
OIPA.....	250

Dairy/Beverage

Multi-Deck Merchandisers	25
ON2UM	26
O2UM	30
ON2.5UM.....	34
O2.5UM.....	38
ON3UM	44
O3UM	48
ON3.5UM.....	52
O3.5UM.....	56
O3.5UD	60
O4UM	62
O5UM	66
O6UM	70
ON5DM	72
O5DM	74
O5DMH	80
O5DR	84
ONU	102
ORDR	104

Reach-In Door Merchandisers.	111
ONRB	112
ONRBH	114
ORB.....	116
ORBH	118

Dairy/Beverage (Continued)

Self-Contained Merchandisers.	213
O2.5UMA-4'	228
O3UMA-4'	230
O5DMA	232
ONNA-47"	236
ONUA.....	238

Deli

Single Deck Merchandisers	1
OC	2
OM	4
OSIO	18
OWSIO	22

Multi-Deck Merchandisers	25
ON2UM	26
O2UM	30
ON2.5UM.....	34
O2.5UM	38
ON3UM	44
O3UM	48
ON3.5UM.....	52
O3.5UM	56
O3.5UD	60
O4UM	62
O5UM	66
O6UM	70
O5DM	74
O5DMH	80
ONHM	90
OHM	92
OHMH	94
ONU	102
BB	108

Single Deck Island Merchandisers	131
ONIM / ONIMB.....	132
OIM / OIMB / OIMBB.....	136

Multi-Deck Island Merchandisers	155
O3IC / O3ICB.....	156
O3IM / O3IMB	162

Service Merchandisers	171
OSA	172
OSM.....	176
OSAG	180
OGM	184
OSI	188
OWSI	192
OSIF	194
OLF	198
OLFG	202
OSAH (Hot Foods)	206
OSIH (Hot Foods)	210

Self-Contained Merchandisers.	213
MDCA-4'	214
MMCA-4'	216
OSIOA-4'	220
OSIOPA-4'	222
OSIOZA-4'	224

Table of Contents

Merchandisers by Departmental Application

Deli (Continued)

Self-Contained Merchandisers	213
O2.5UMA-4'	228
O3UMA-4'	230
O5DMA	232
ONUA	238
ONIMA	242
ONIM(B)A	244
OIMA	246
OIM(B)A	248
O3ICA	252
O3IC(B)A	254
OSIA-4'	256
O2SIA-4'	258

Meat

Single Deck Merchandisers	1
OM	4
OSIO	18
OWSIO	22
Multi-Deck Merchandisers	25
ON2UM	26
O2UM	30
ON2.5UM	34
O2.5UM	38
ON3UM	44
O3UM	48
ON3.5UM	52
O3.5UM	56
ONHM	90
OHM	92
OHMH	94
ONU	102
Single Deck Island Merchandisers	131
ONIM / ONIM(B)	132
OIM / OIM(B) / OIM(BB)	136
Multi-Deck Island Merchandisers	155
O3IM / O3IM(B)	162
Service Merchandisers	171
OSAG	180
OGM	184
OSI	188
OWSI	192
OSIF	194
Self-Contained Merchandisers	213
MMCA-4'	216
OSIOA-4'	220
OSIOPA-4'	222
OSIOZA-4'	224
O2.5UMA-4'	228
O3UMA-4'	230
ONUA	238
ONIMA	242
ONIM(B)A	244
OIMA	246
OIM(B)A	248
OSIA-4'	256
O2SIA-4'	258

Seafood

Single Deck Merchandisers	1
OM	4
OSIO	18
OWSIO	22
Multi-Deck Merchandisers	25
ON2UM	26
O2UM	30
ON2.5UM	34
O2.5UM	38
ON3UM	44
O3UM	48
ON3.5UM	52
O3.5UM	56

Service Merchandisers	171
OSAG	180
OGM	184
OSI	188
OWSI	192
OSIF	194

Self-Contained Merchandisers	213
OSIOA-4'	220
OSIOPA-4'	222
OSIOZA-4'	224
O2.5UMA-4'	228
O3UMA-4'	230
OSIA-4'	256
O2SIA-4'	258

Frozen Food

Single Deck Merchandisers	1
OMZ (Frozen Meat)	.8
OMZD	10
ONZ	12

Multi-Deck Merchandisers	25
O5Z	.88

Reach-In Door Merchandisers	111
ONRZ	120
ONRZH	122
ORZ	124
ORZH	126
OREZ	128

Single Deck Island Merchandisers	131
ONIZ / ONIZG	144
OIZ	148
OWIZ / OWIZG	150
OWEZ / OWEZG	152

Self-Contained Merchandisers	213
OSIOZA-4'	224

Ice Cream

Single Deck Merchandisers	1
OMZD	10
ONZ	12

Table of Contents

Merchandisers by Departmental Application

Ice Cream (Continued)

Reach-In Door Merchandisers 111

ONRZ	120
ONRZH	122
ORZ	124
ORZH	126
OREZ	128

Single Deck Island Merchandisers 131

ONIZ / ONIZG	144
OWIZ / OWIZG	150
OWEZ / OWEZG	152

Self-Contained Merchandisers 213

OSIOZA-4'	224
---------------------	-----

OBSOLETE



**Single Deck
Merchandisers**

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

Single Deck Deli/Cheese Merchandiser

OC - 6', 8', & 12

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OC	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33
	8'	2	1.00	60	0.60	40	0.25	30	3.85	800	4.44
	12'	3	1.50	90	0.90	60	0.38	46	5.77	1200	6.67
											1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OC	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OC	27"	480	17	6-8	26	35	39	305
	31" & 33"	415	17	6-8	26	34	35	305

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OC	2	6 - 8	40	49	70	47	26	45	40	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

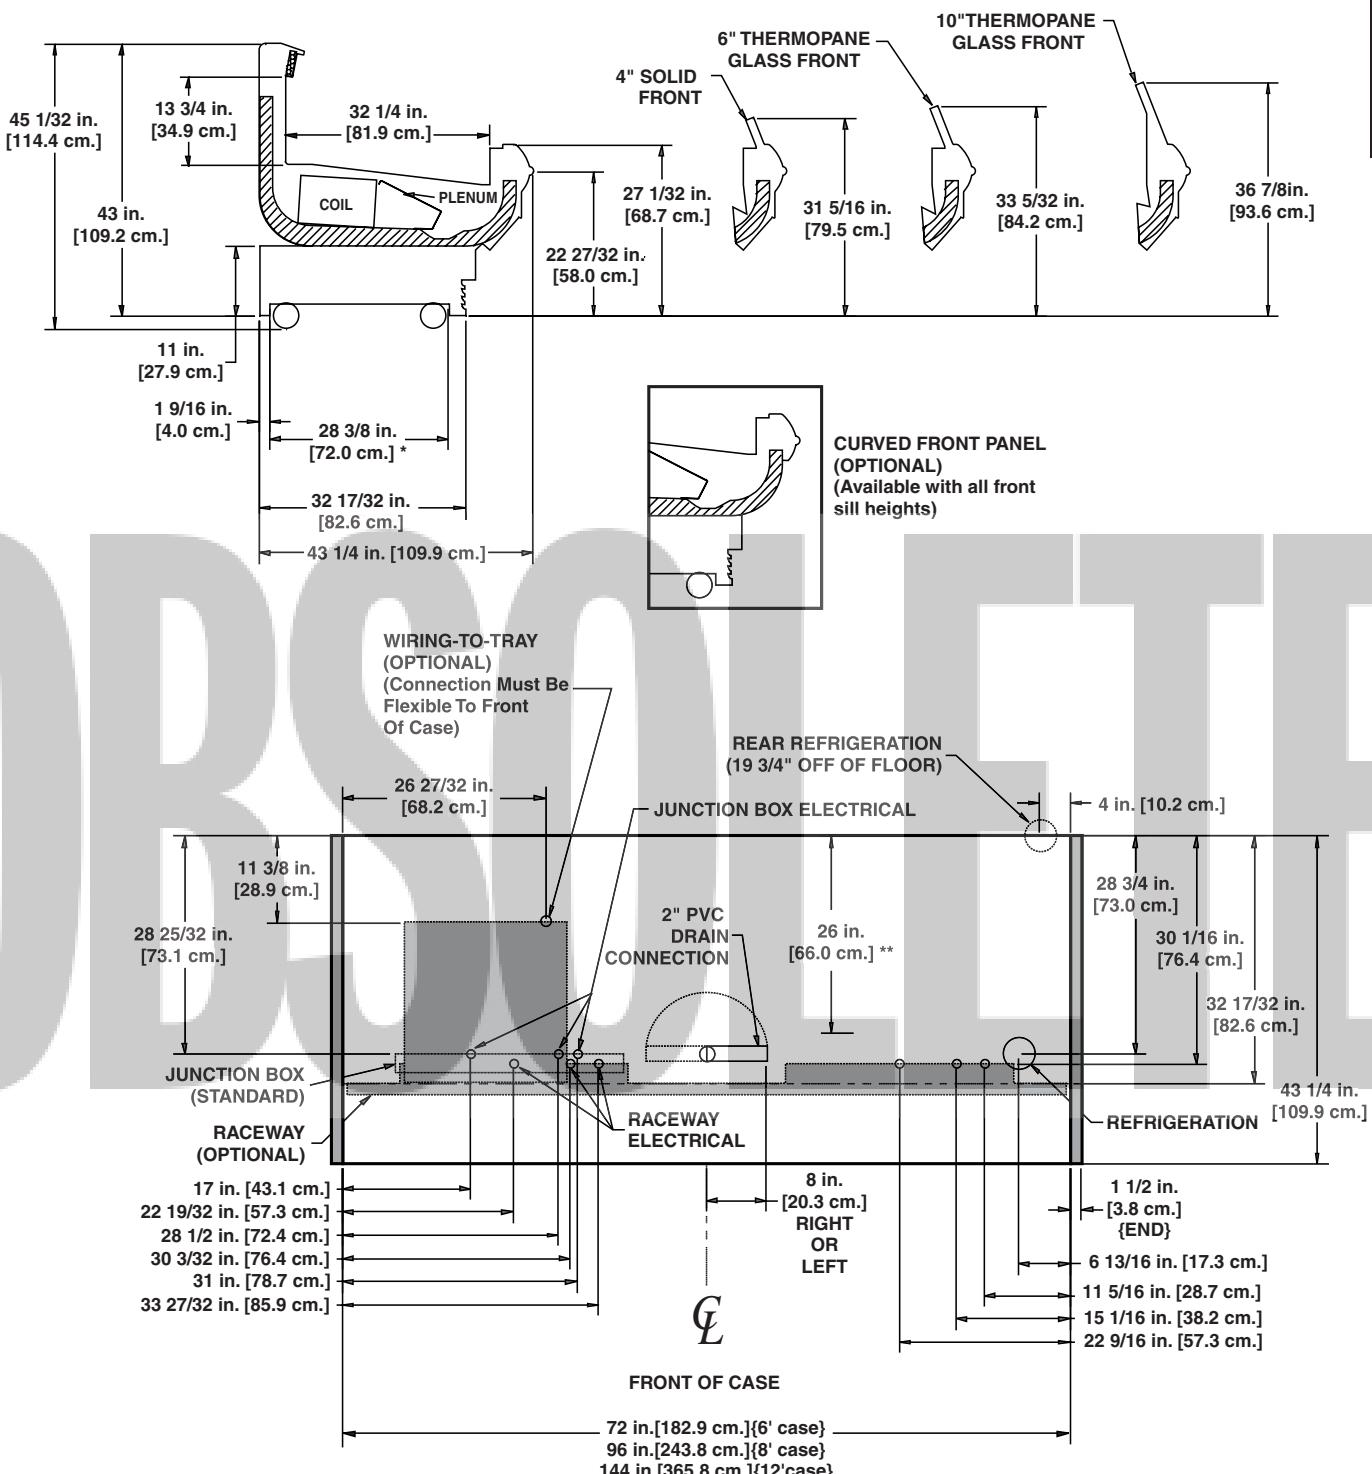

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS


- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"


Single Deck Deli/Meat/Seafood Merchandiser

OM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters ¹		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OM	4'	2	1.00	60	0.60	40	0.14	17	1.92	400	2.22
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33
	8'	2	1.00	60	0.60	40	0.25	30	3.85	800	4.44
	12'	3	1.50	90	0.90	60	0.38	46	5.77	1200	6.67

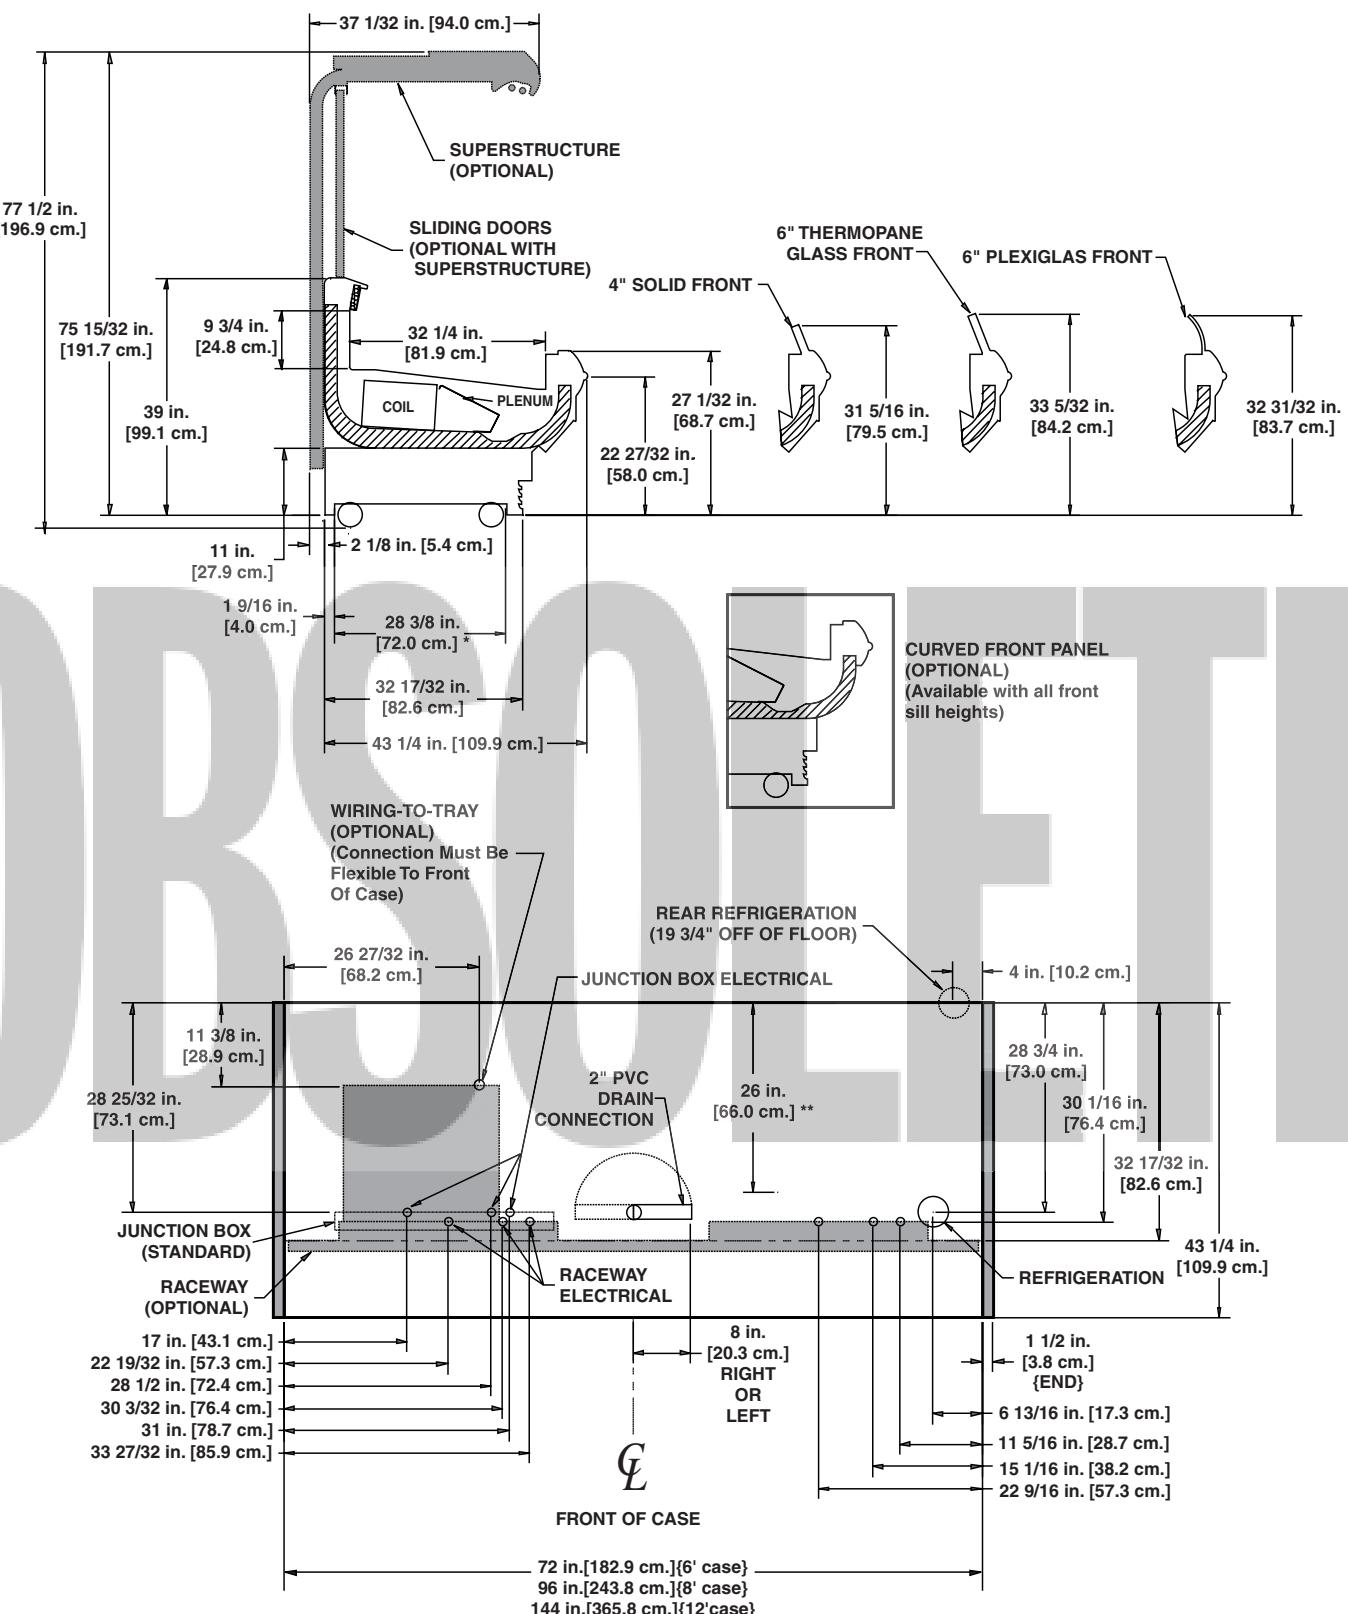

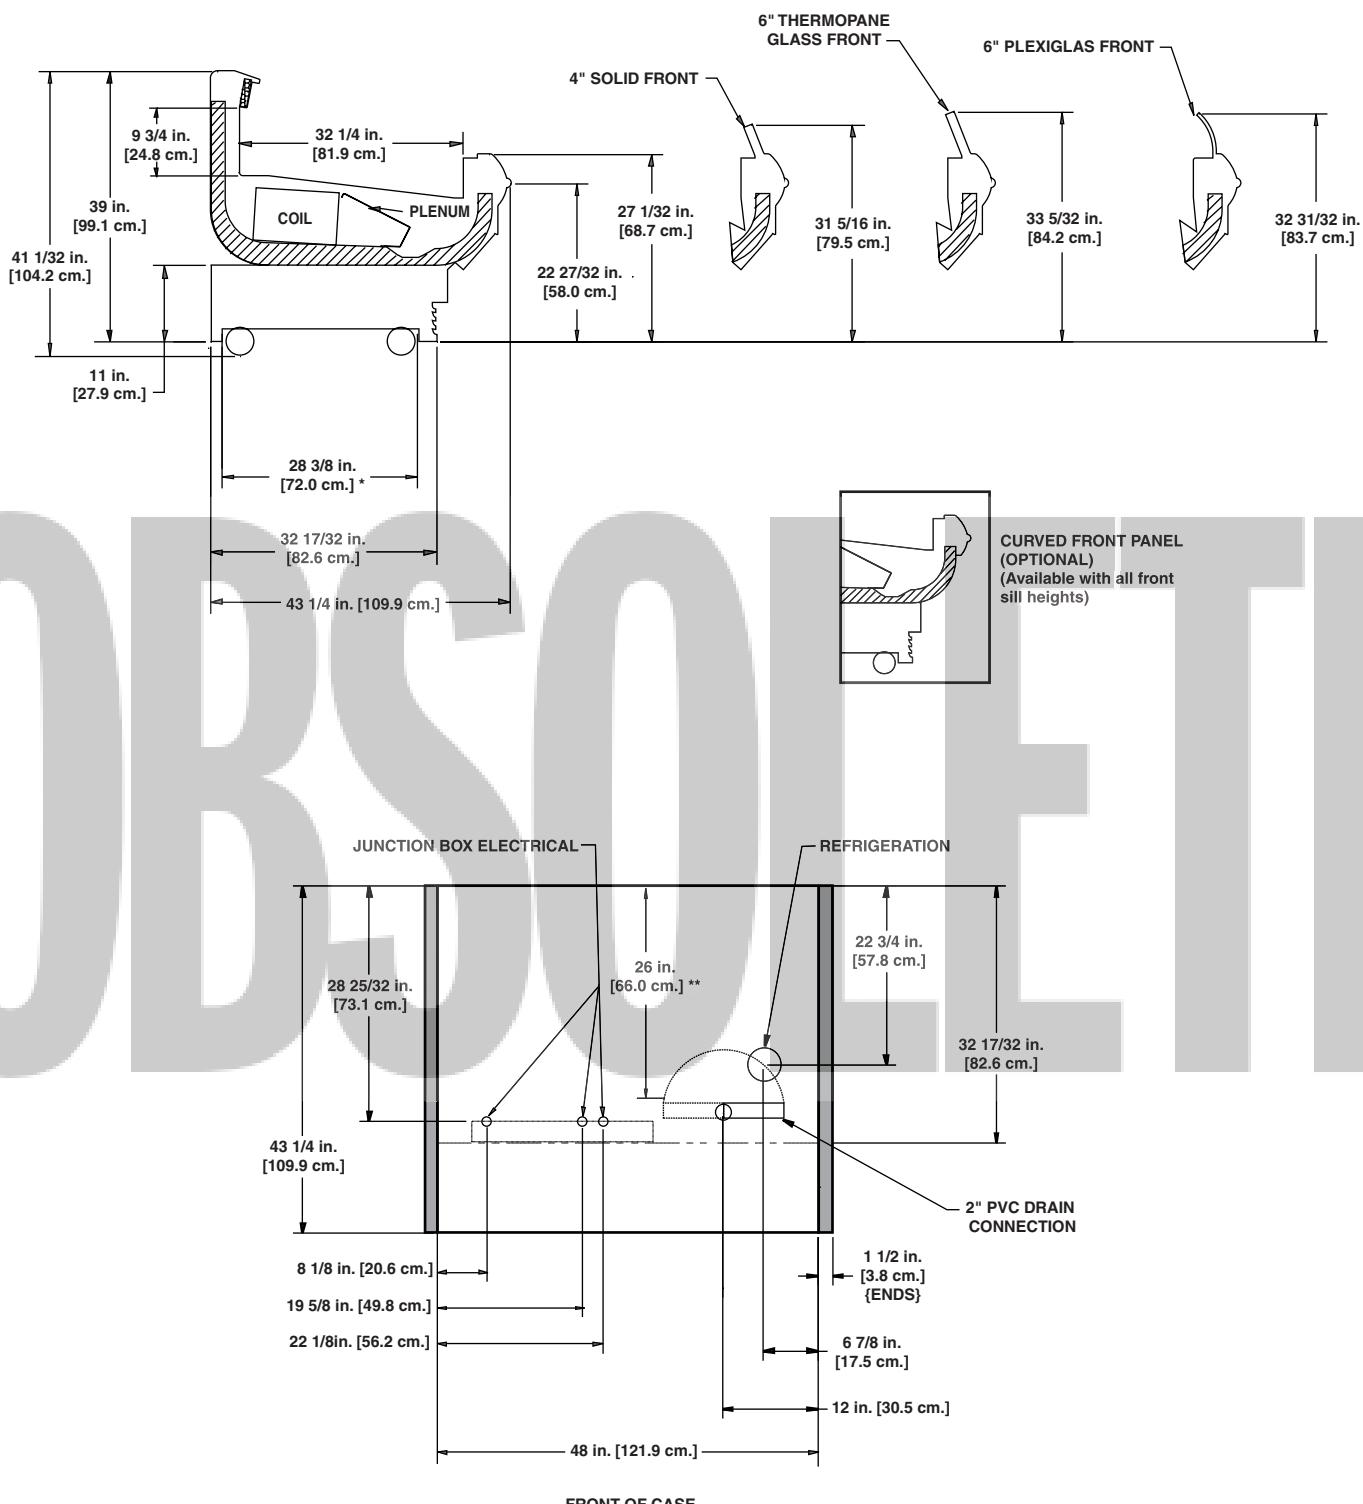

OBSCOLTE

Single Deck Frozen Meat Merchandiser

OMZ - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OMZ	6'	2	1.00	60	0.64	34	0.90	108	5.00 ¹	1800	5.76 ¹
	8'	3	1.50	90	0.96	51	0.96	115	6.66 ¹	2400	7.69 ¹
	12'	4	2.00	120	1.28	69	1.83	220	7.99 ¹	2880	9.24 ¹

¹ NOTE: 3 phase load. Figures given in maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OMZ	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OMZ	33"	550	-23	3-5	-10	4	0	120

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OMZ	4	13 - 15	45	47	---	---	20	60	---	---

⁴ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN FROZEN FOODS

A  DOVER DIVERSIFIED COMPANY

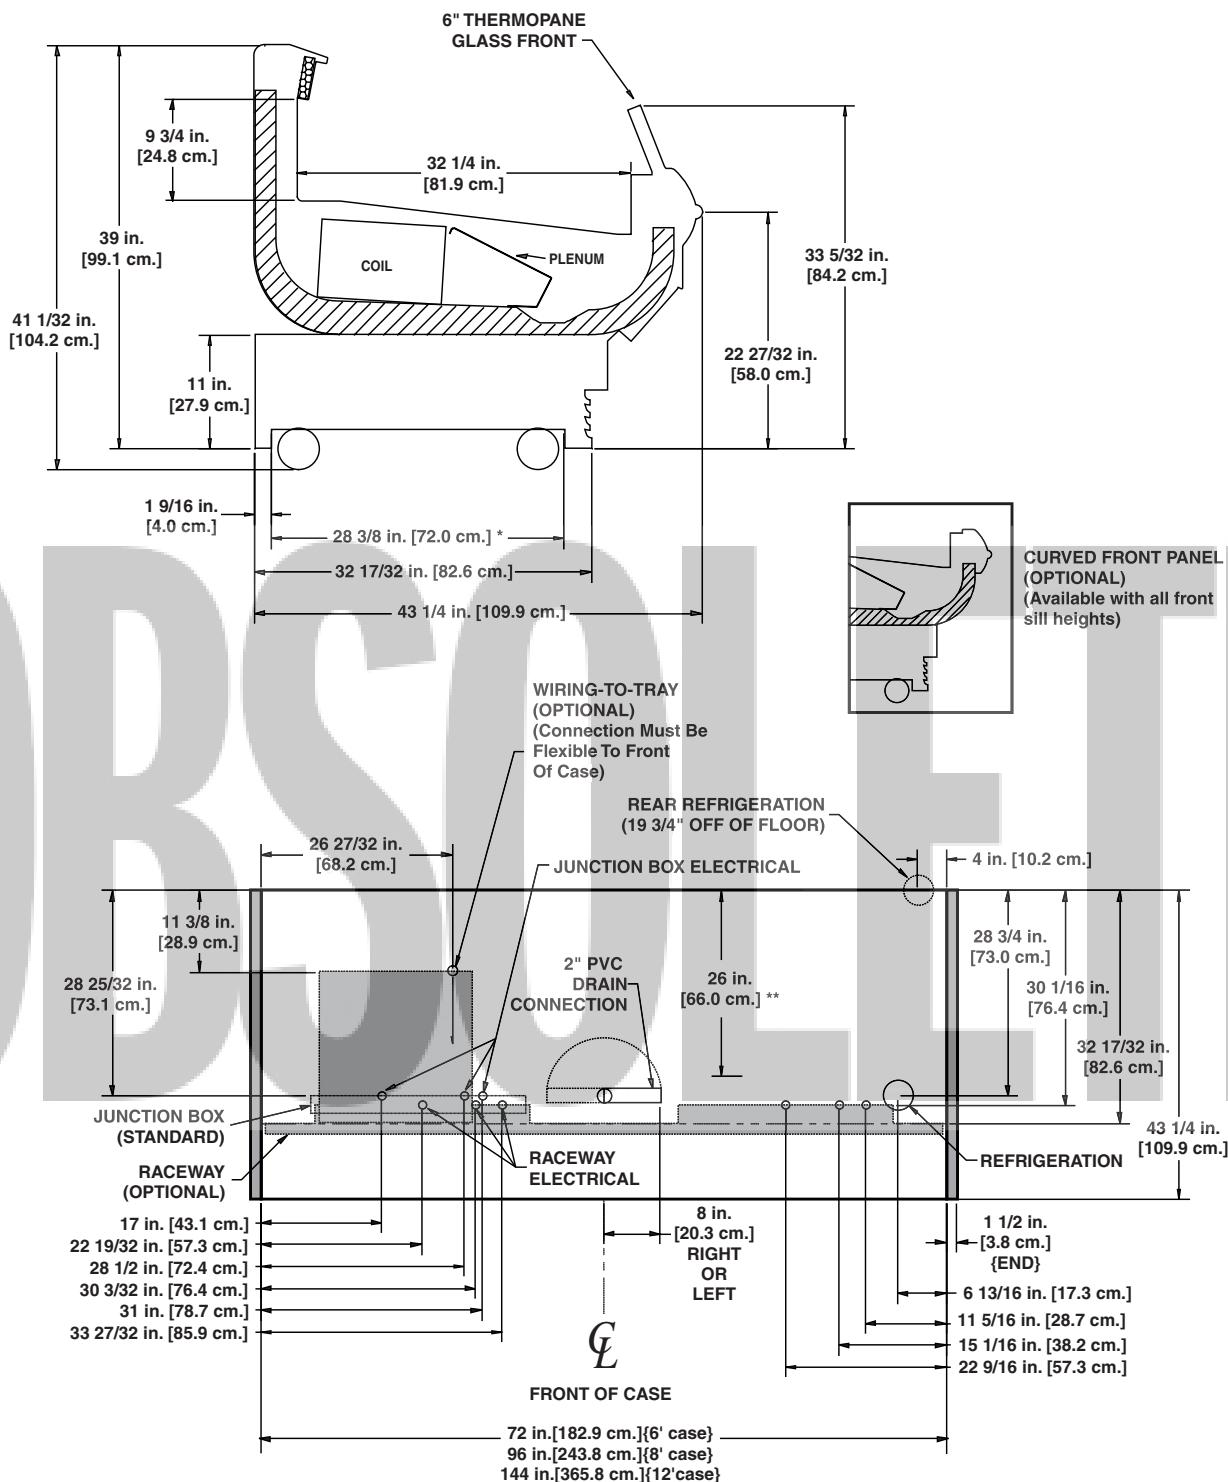

Single Deck Frozen Food/Ice Cream Merchandiser

OMZD - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OMZD	6'	2	0.90	34	0.30	22	1.28	154	11.54	2400	13.31
	8'	3	1.35	51	0.45	33	1.45	174	15.38	3200	17.75
	12'	4	1.80	68	0.60	44	2.59	311	23.08	4800	26.63
											6390

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OMZD	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OMZD-F ³	35 19/32"	456	-18	3-5	-8	1	2	240
OMZD-C ³	35 19/32"	476	-28	3-5	-18	-8	-8	240

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ F=frozen food, C=ice cream.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OMZD	1	13 - 15	45	48	---	---	20	60	---	---


⁴ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

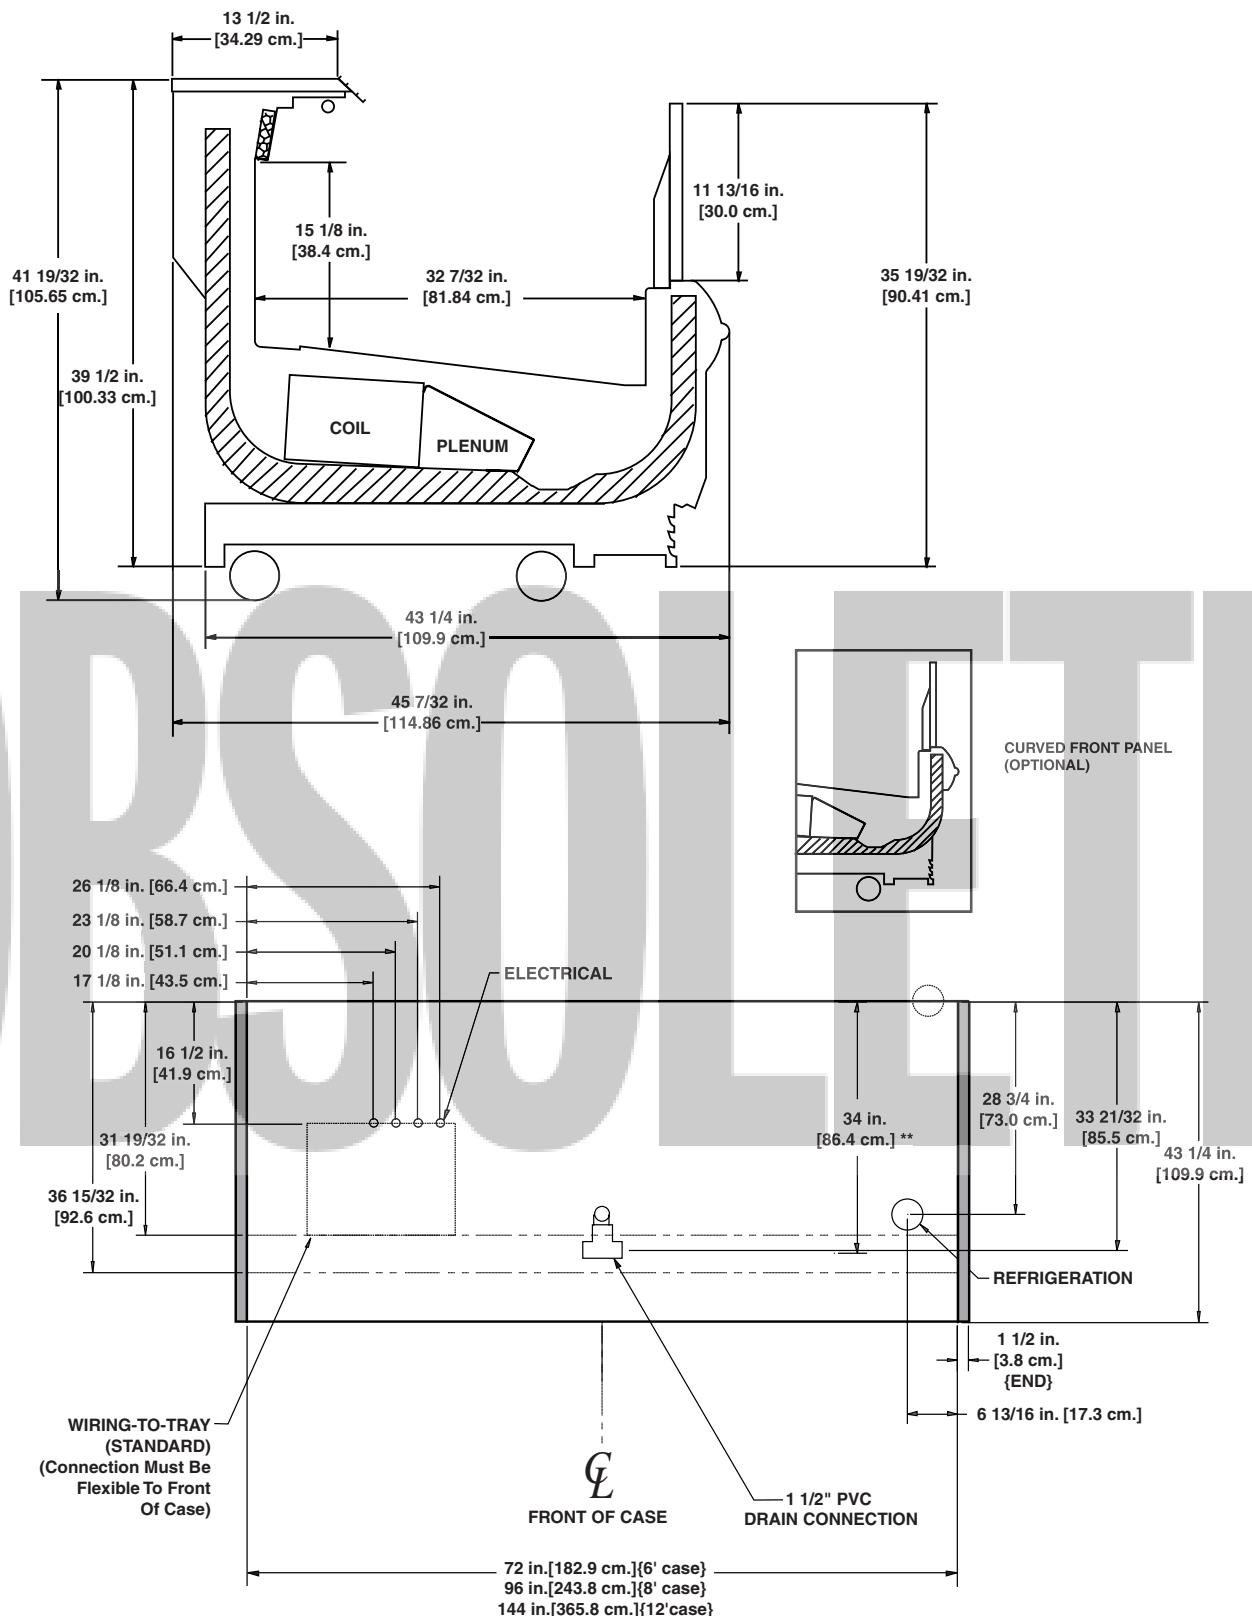

NOTES:-

* STUB-UP AREA

**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE - 7/8", LIQUID LINE - 3/8"

A DOVER DIVERSIFIED COMPANY

Single Deck Frozen Food/Ice Cream Merchandiser

ONZ - 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heaters		
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		120 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ONZ	F-8'	2	0.90	34	0.30	22	1.93	232	7.69	1600	8.88	2130	0.13	15
	F-12'	3	1.35	51	0.45	33	2.70	324	11.54	2400	13.31	3195	0.13	15
	C-8'	2	0.90	34	0.30	22	1.93	232	15.38	3200	17.75	4260	0.13	15
	C-12'	3	1.35	51	0.45	33	2.70	324	23.08	4800	26.63	6390	0.13	15

¹ F = frozen food, C = ice cream.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ONZ	8'	---	---	---
	12'	---	---	---

² NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ONZ - F	369	-23	3-5	-12	-1	0	180
ONZ - C	412	-33	3-5	-22	-11	-9	180

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONZ	1	13 - 15	48	47	---	---	20	60

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN
COLD

A  DOVER DIVERSIFIED COMPANY

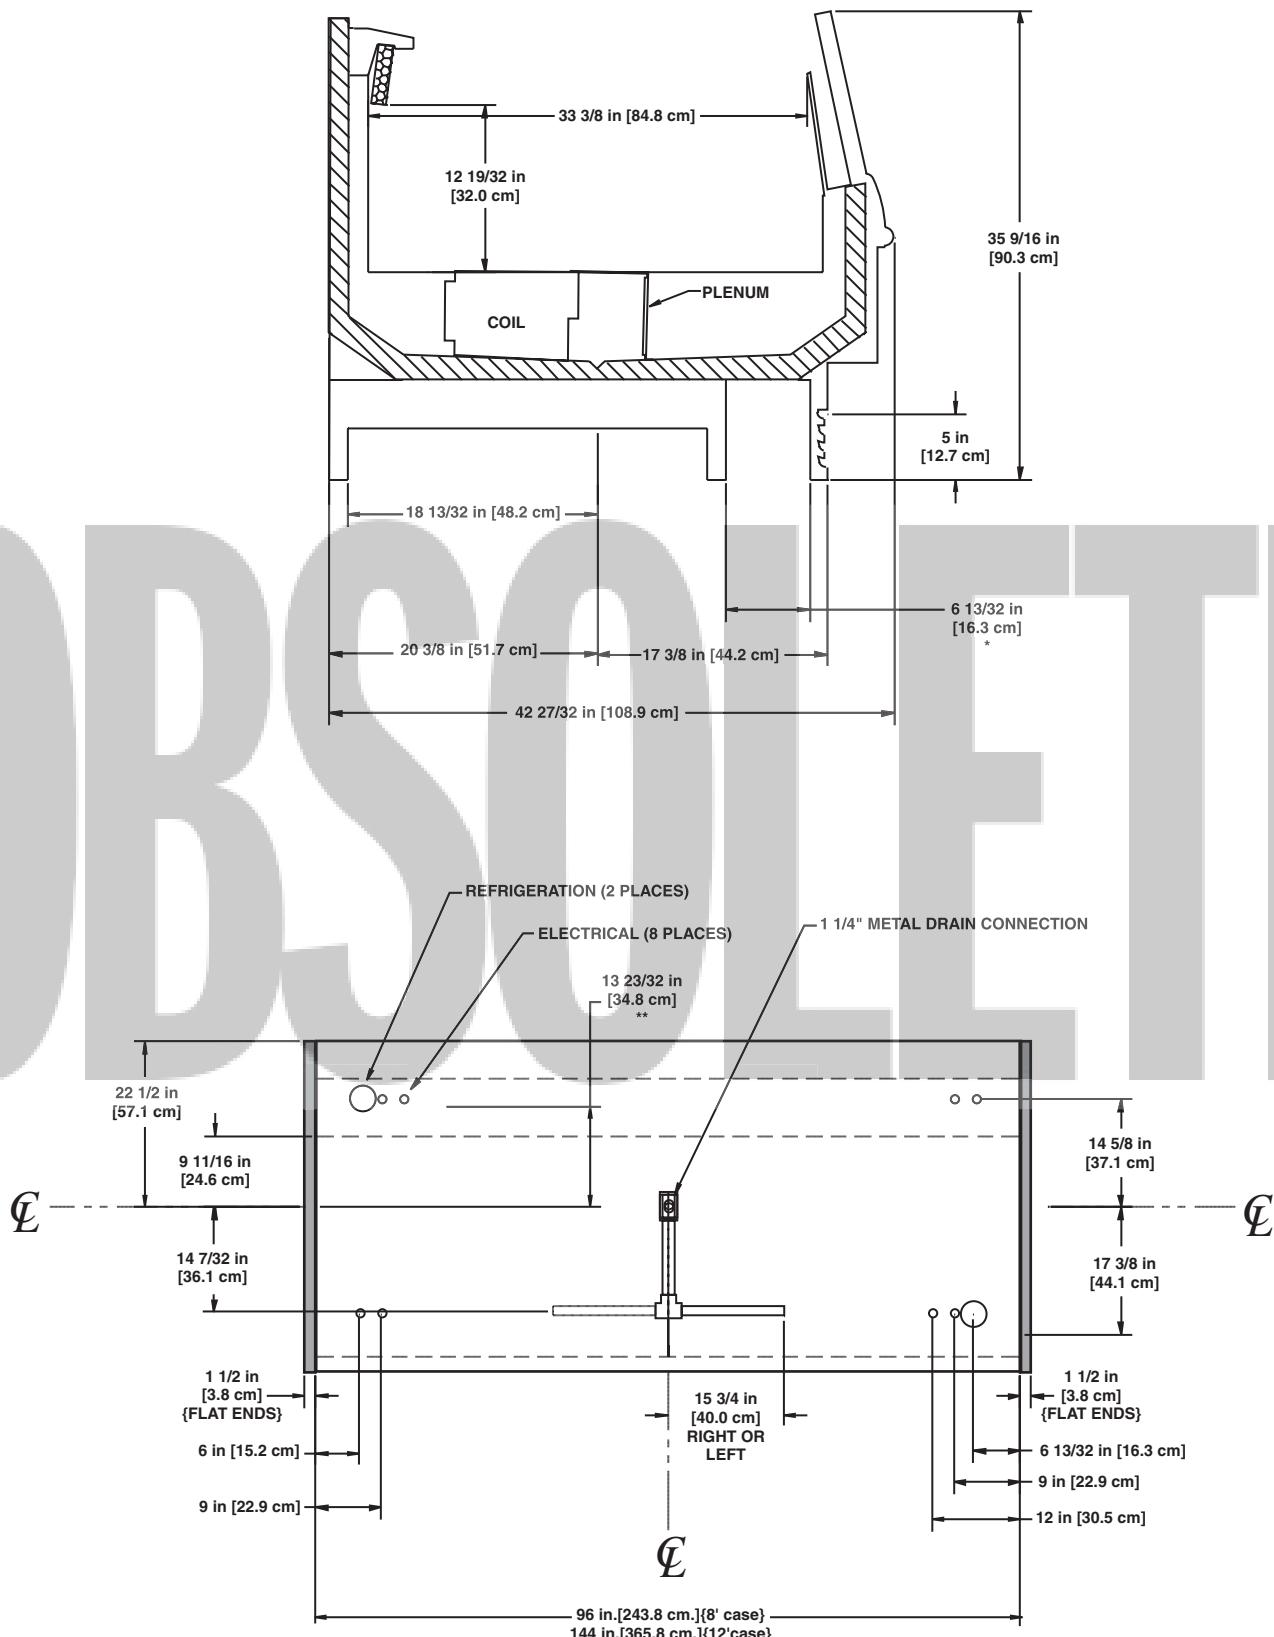

Single Deck Produce Merchandiser

OP - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters ¹		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OP	4'	2	1.00	60	0.60	40	---	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	---	2.88	600	3.33	798
	8'	2	1.00	60	0.60	40	---	3.85	800	4.44	1065
	12'	3	1.50	90	0.90	60	---	5.77	1200	6.67	1600

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OP	4'	0.57	68	0.57	68
	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Rear Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OP Cut Produce	39"	288	22	6-8	31	37	42	180
	43"	401	22	6-8	30	36	45	210
OP Bulk Produce	39"	230	27	6-8	26	40	44	180
	43"	374	27	6-8	35	40	47	210

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OP	2	6 - 8	40	49	60	47	26	45
							40	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
COLD


A  DOVER DIVERSIFIED COMPANY

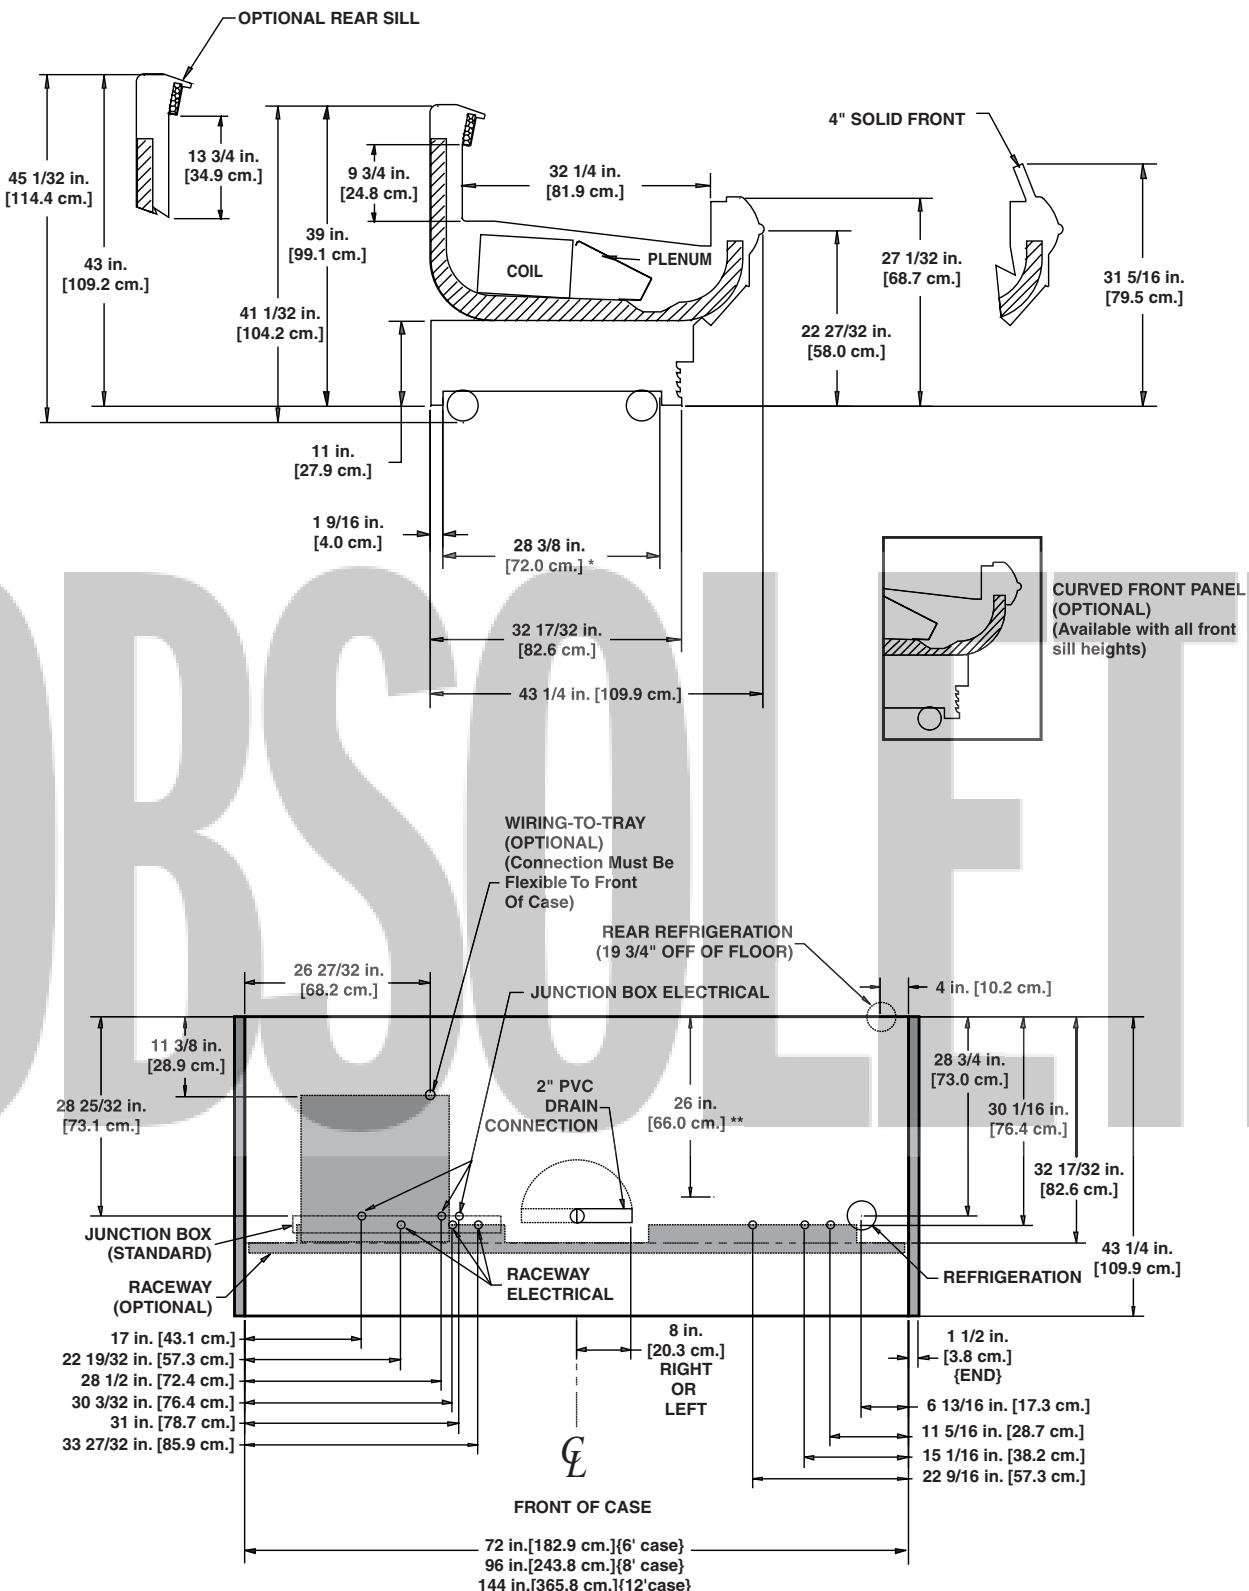**NOTES:**

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"

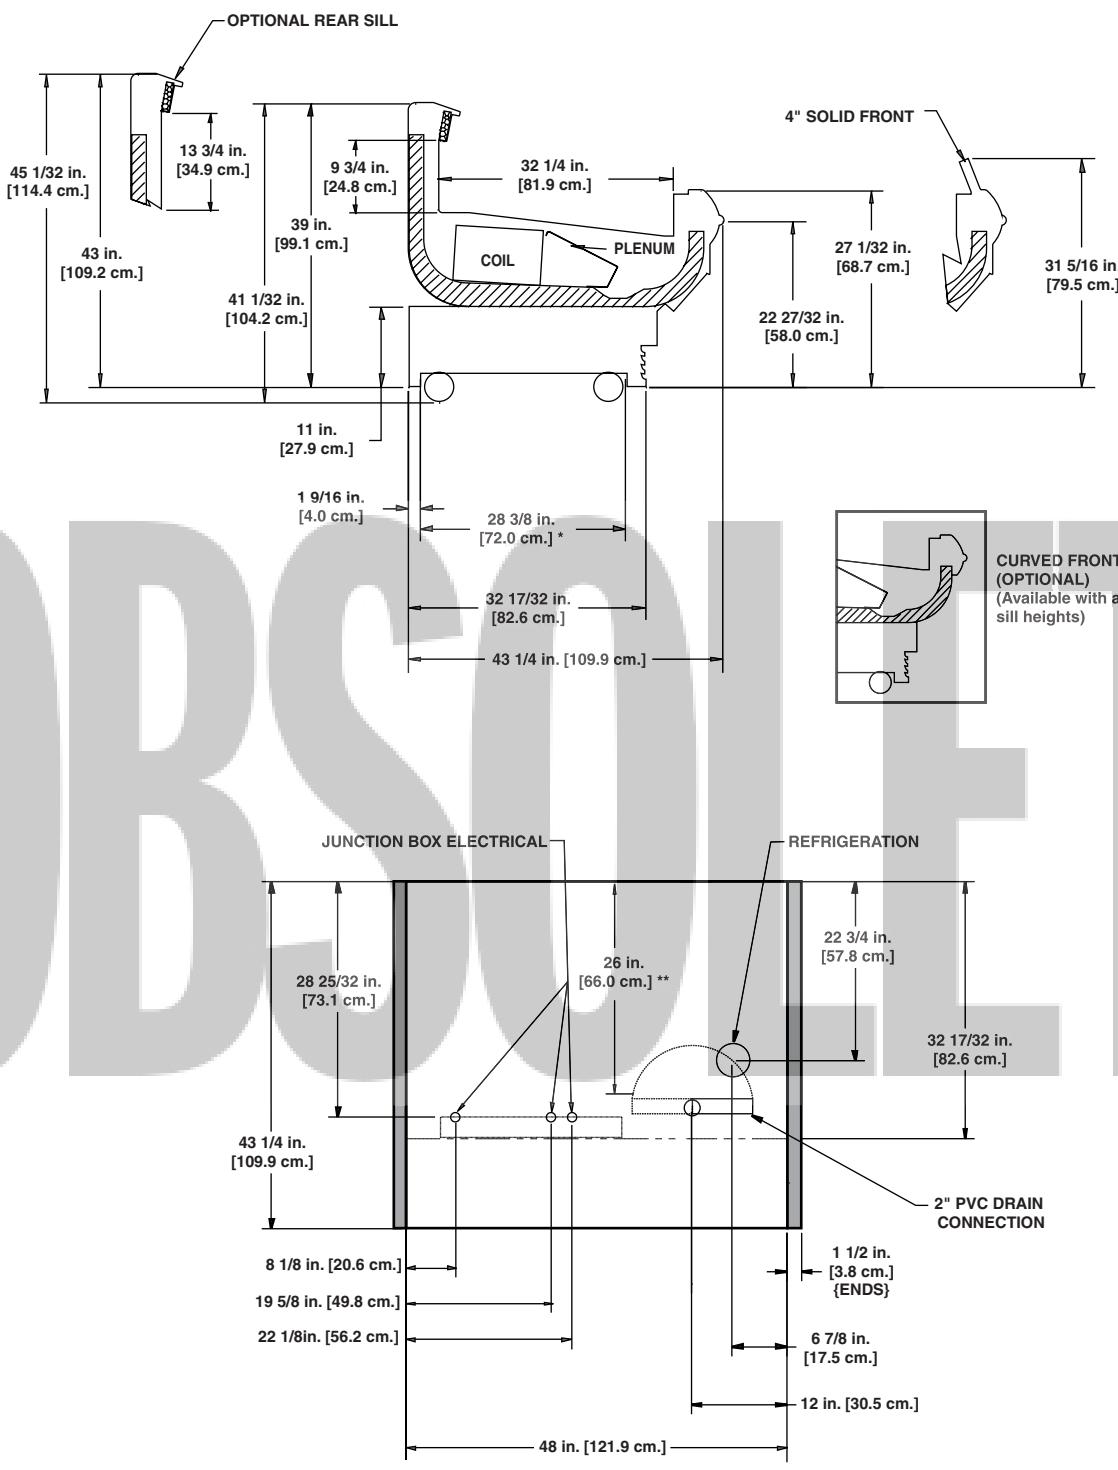

OBSCULTE

International Style Single Deck Deli/Meat/Seafood Merchandiser

OSIO - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OSIO	4'	2	0.90	34	0.30	22	0.55	66	1.92	400	2.22	532
	6'	2	0.90	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.35	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSIO	4'	0.57	68	0.57	68
	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OSIO	31 27/32"	695 ³	12	6-8	24	33	33	180

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ Calculated from OSIO data compressor tables.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIO	3	6 - 8	35	47	55	47	26	45	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

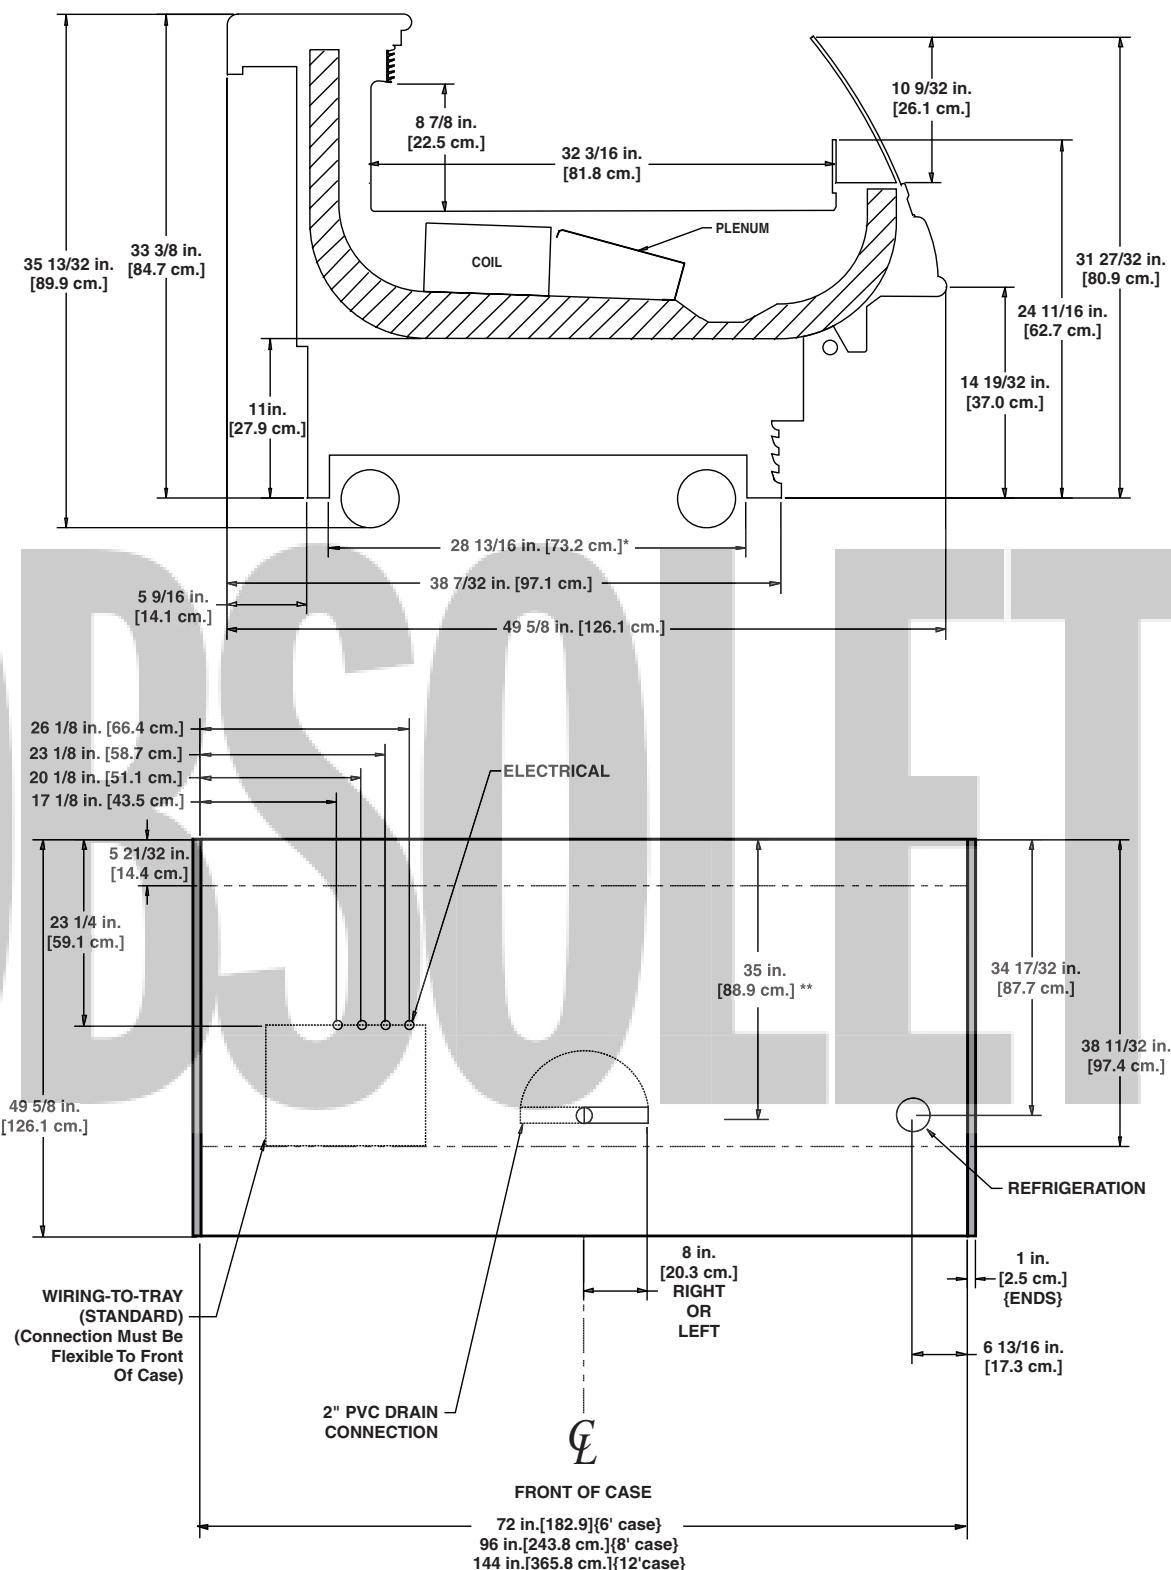

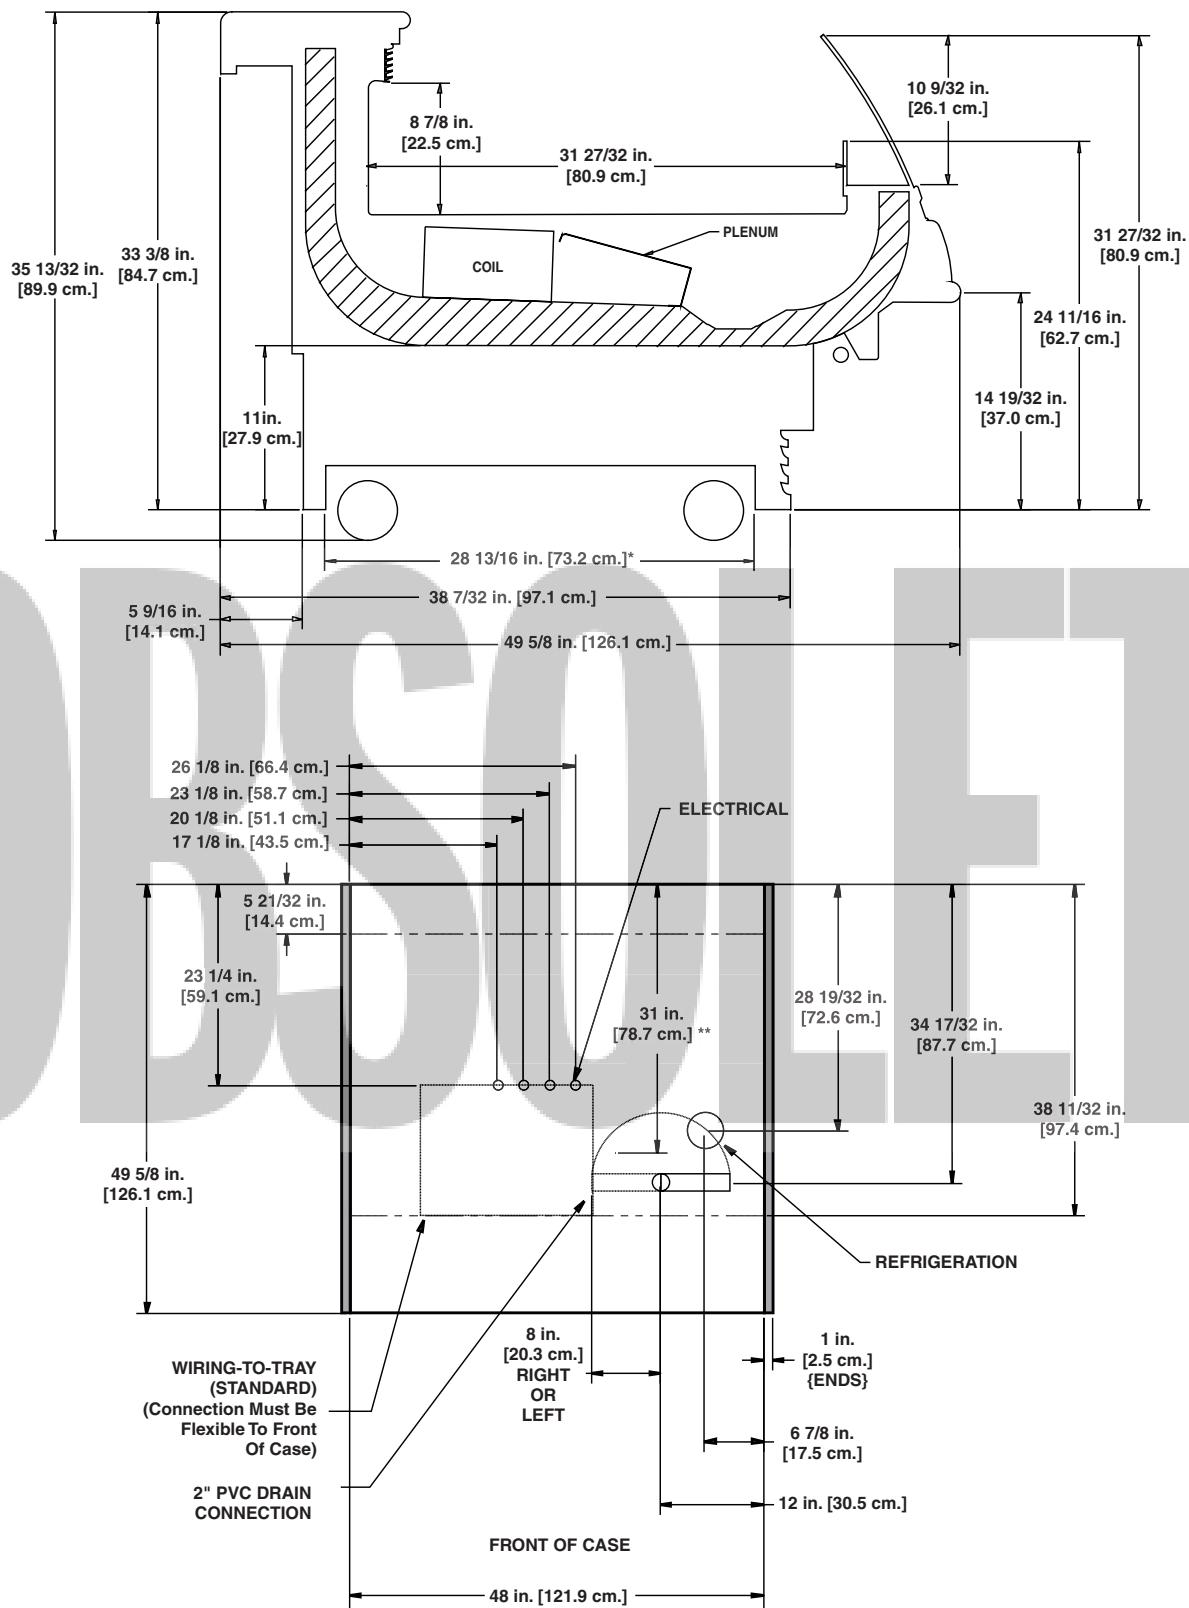

OBSCOLTE

Wide International Style Single Deck Deli/Meat/Seafood Merchandiser

OWSIO - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OWSIO	6'	2	0.90	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.35	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OWSIO	6'	0.57	68	0.57	68
	8'	0.57	68	0.57	68
	12'	0.77	92	0.77	92

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OWSIO	31 27/32"	795 ³	12	6-8	24	34	33	180

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ Calculated from OSIOA data compressor tables.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OWSIO	3	6 - 8	35	47	55	47	26	45

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

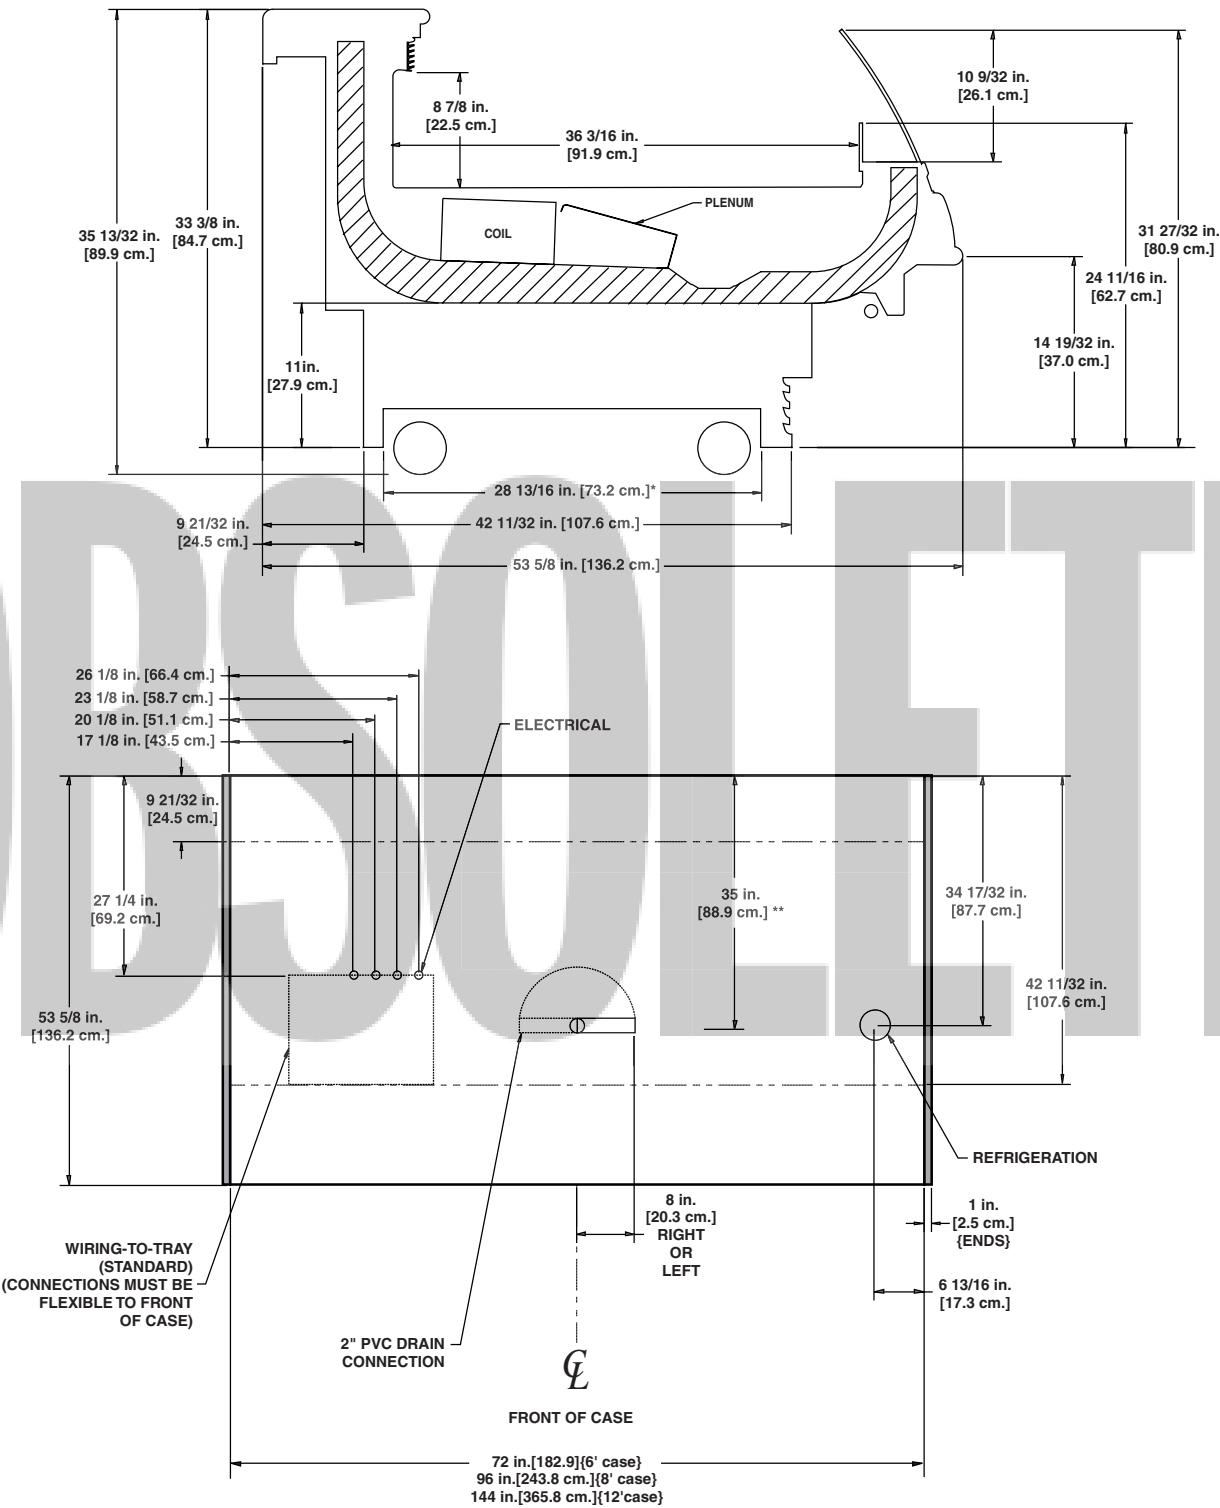

OBSOLETE

OBSOLETE

Multi-Deck
Merchandisers

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

ON2UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters ¹		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ON2UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ON2UM	4'	0.57	68	1.14	137
	6'	0.57	68	2.06	247
	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³ ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ON2UM	27", 31", 33"	657	17	6-8	28	32	35	280

² Model ON2UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ON2UM	2	6 - 8	40	47	45	45	26	45	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELENCE

A  DOVER DIVERSIFIED COMPANY

ON2UM
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

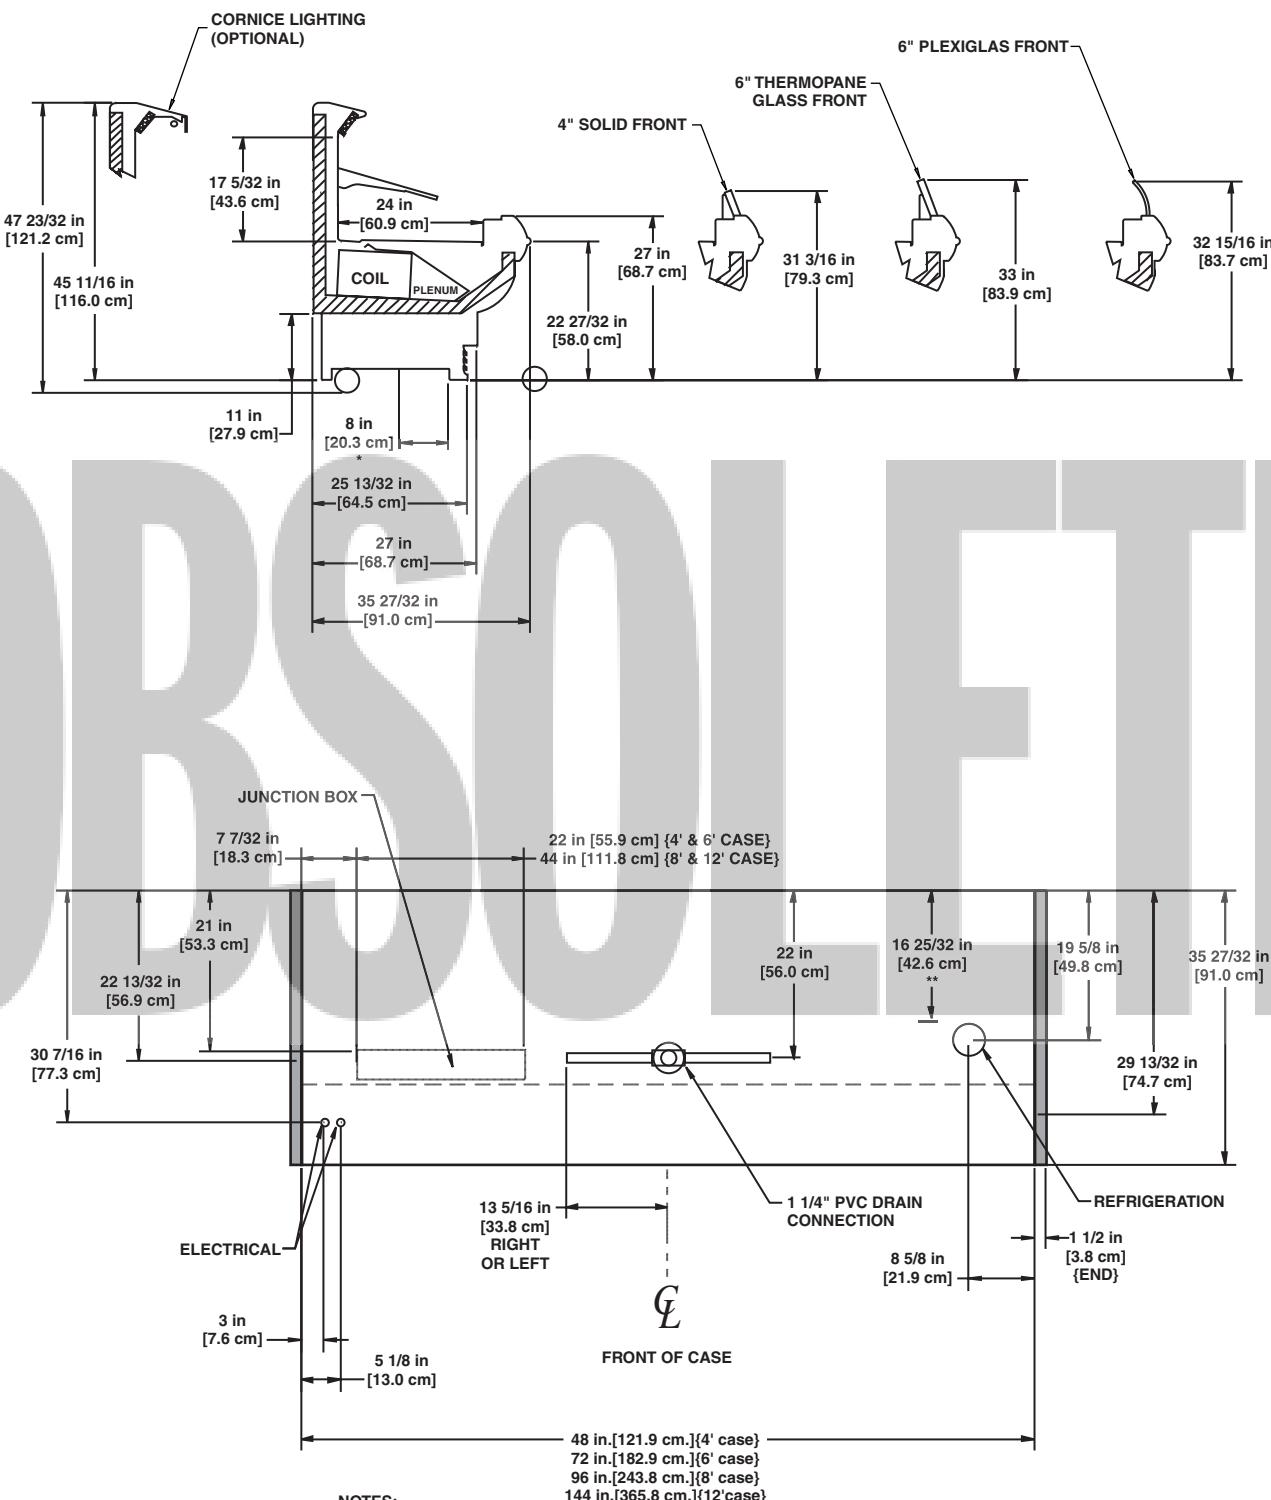

MULTI-DECK


Produce/Dairy/Deli/Meat/Seafood

ON2UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM

E X C E L L E N C E

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

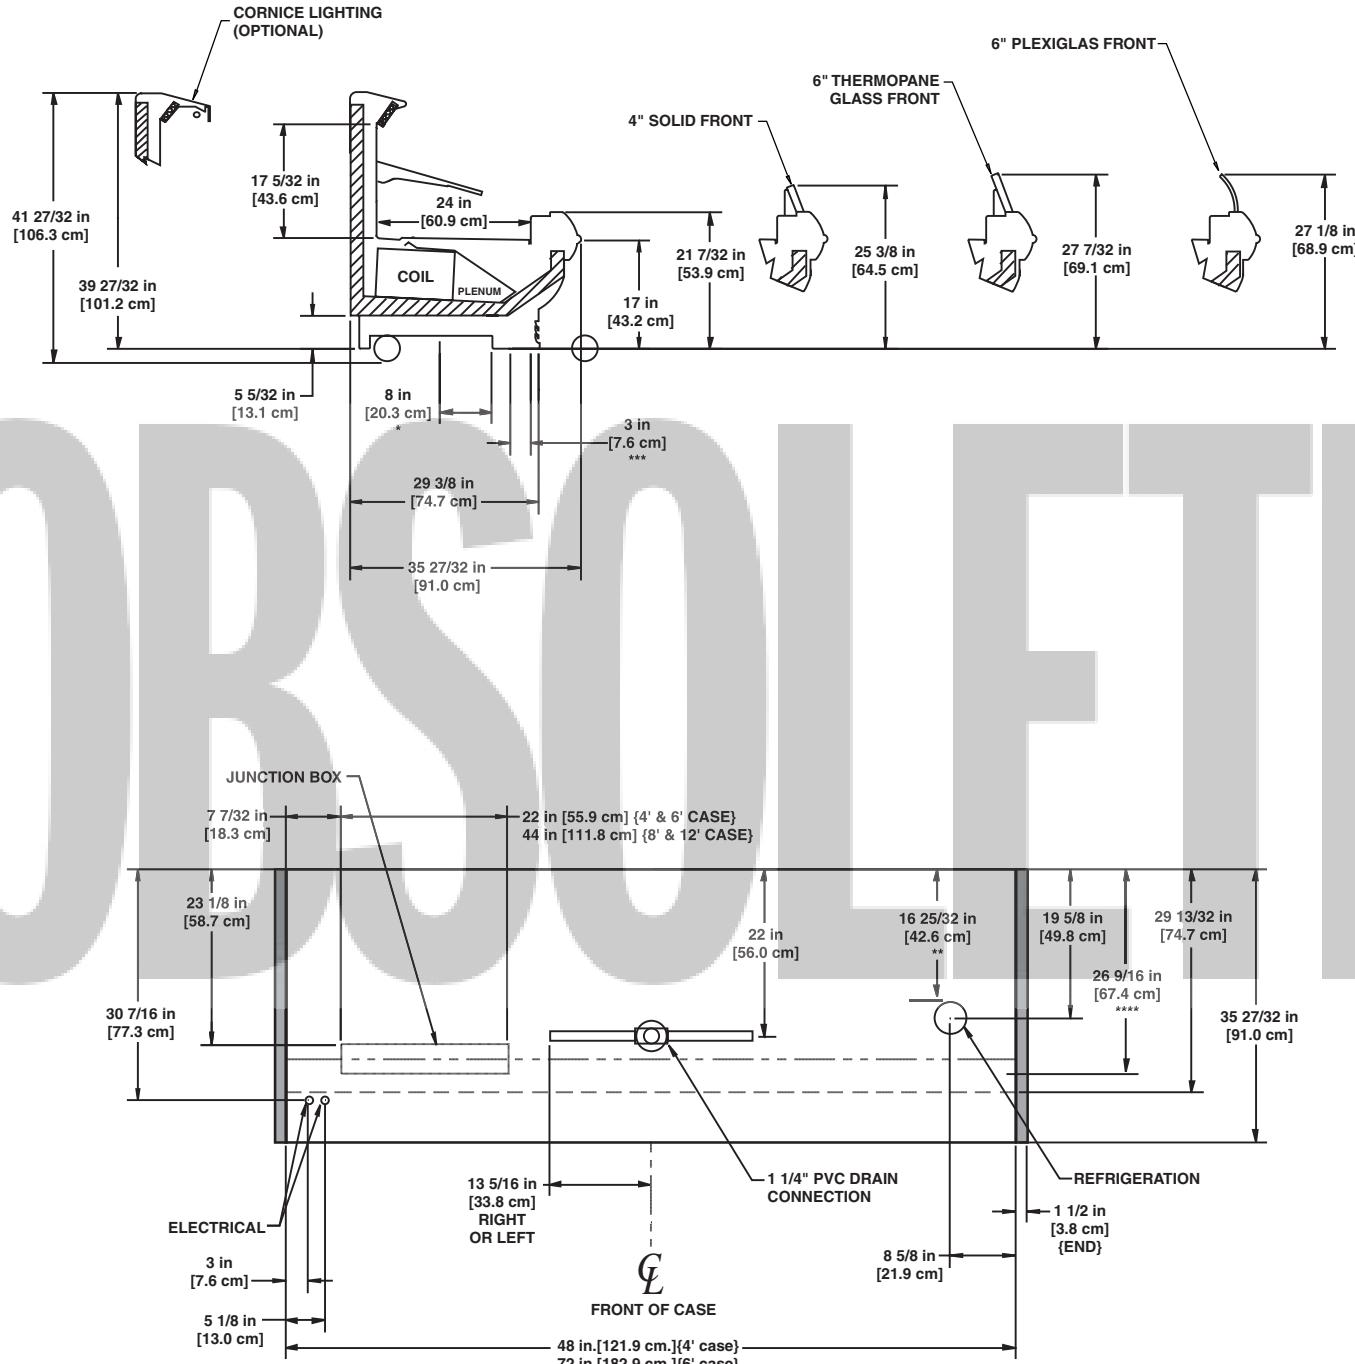

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

OBSCOLTE

Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

O2UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O2UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O2UM	4'	0.57	68	1.14	137
	6'	0.57	68	2.06	247
	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
O2UM	27", 31", 33"	1000	17	6-8	27	31	40	340

² Model O2UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O2UM	3	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COLD

A  DOVER DIVERSIFIED COMPANY

****(For additional rear sill options refer to the Merchandisers Accessories Guide)***

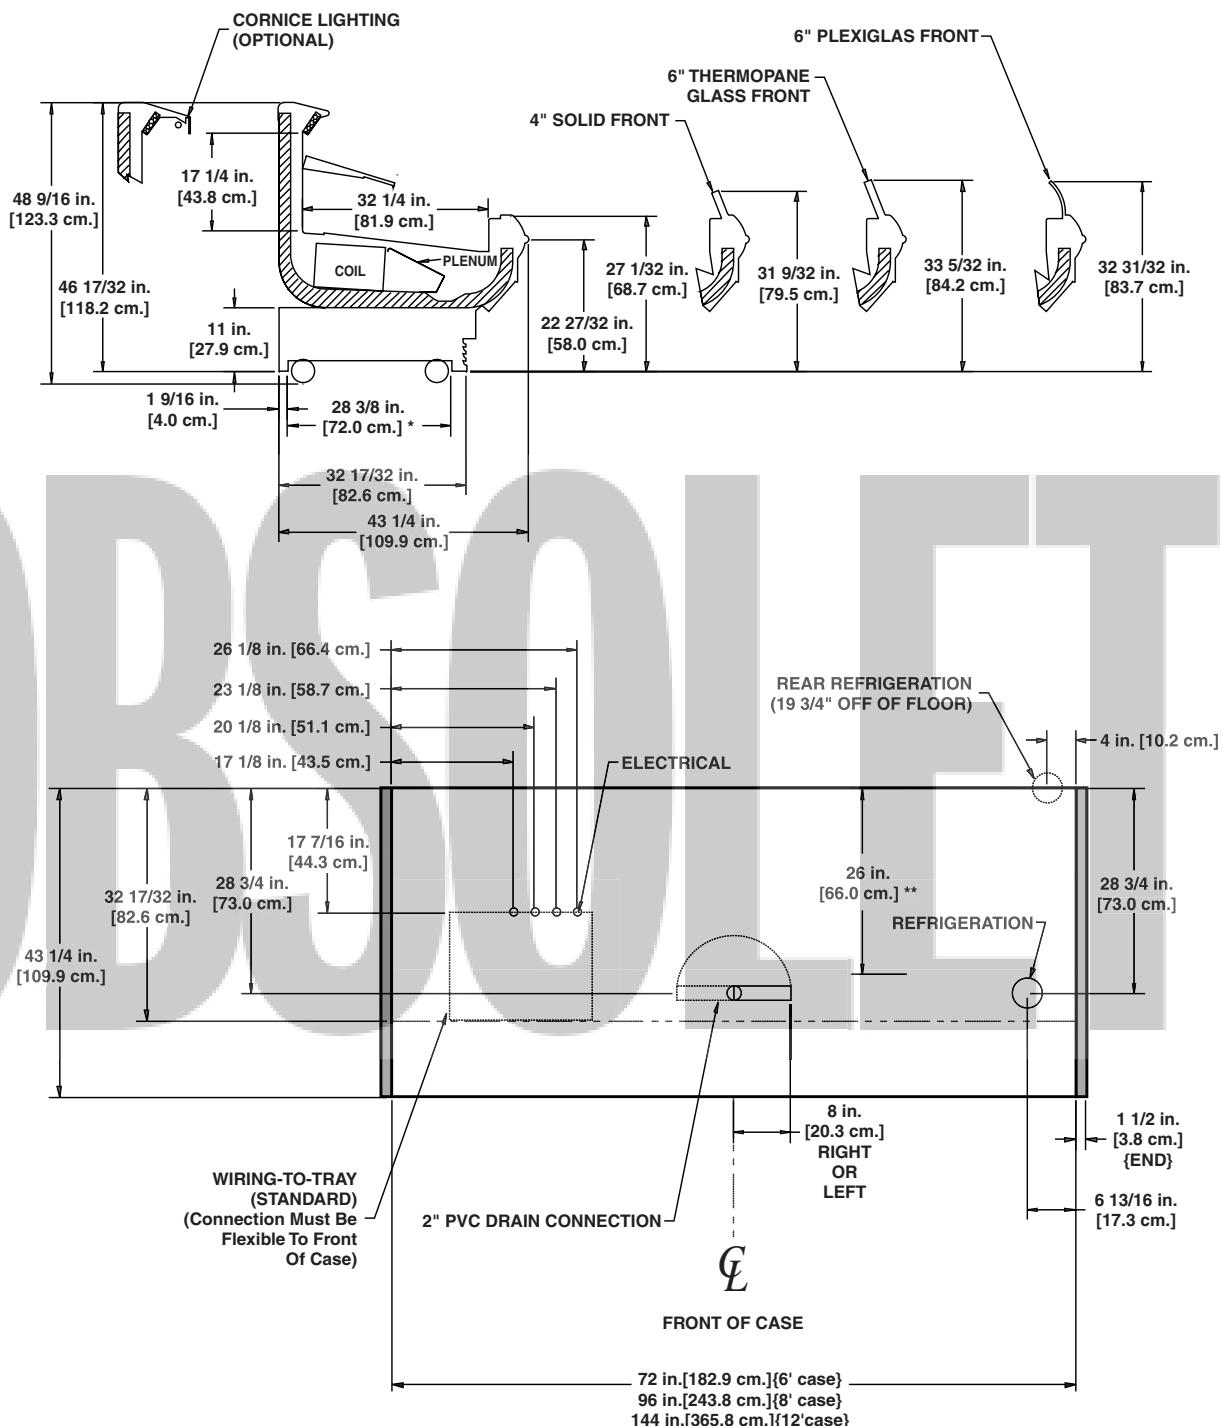

NOTES:-

* STUB-UP AREA


* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE - 7/8", LIQUID LINE - 3/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

O2UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM
EXCELENE

*****(For additional rear sill options refer to the
Merchandisers Accessories Guide)

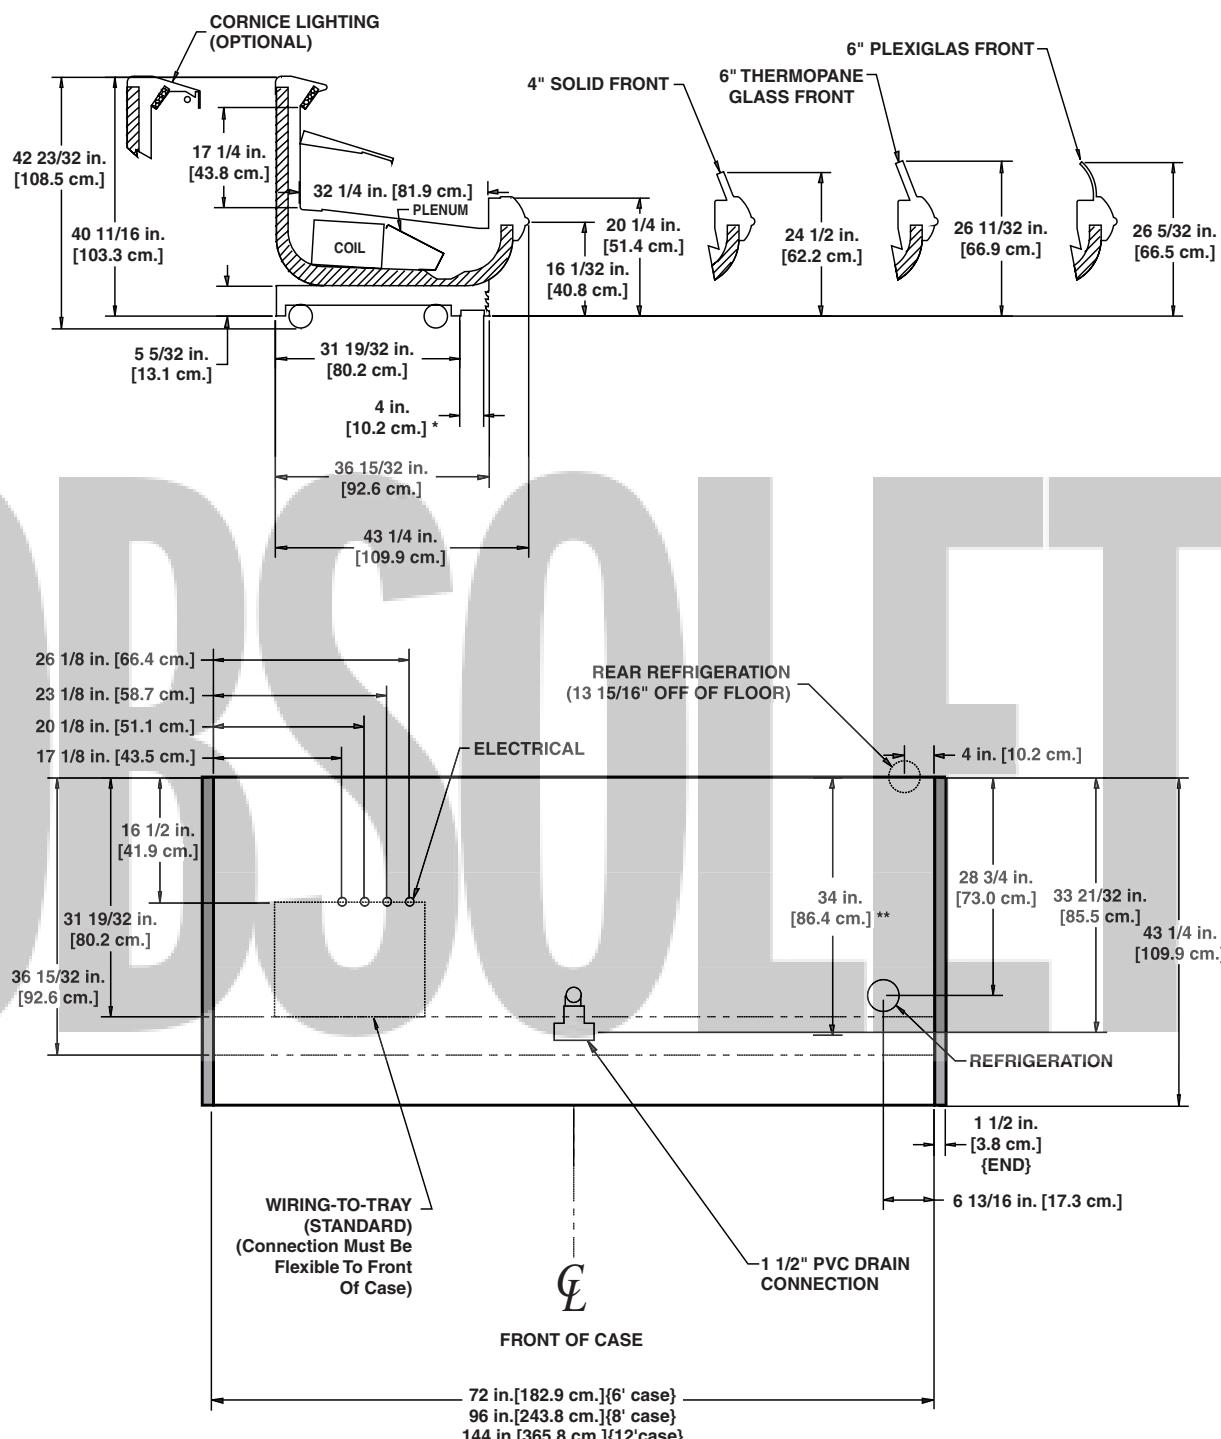


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

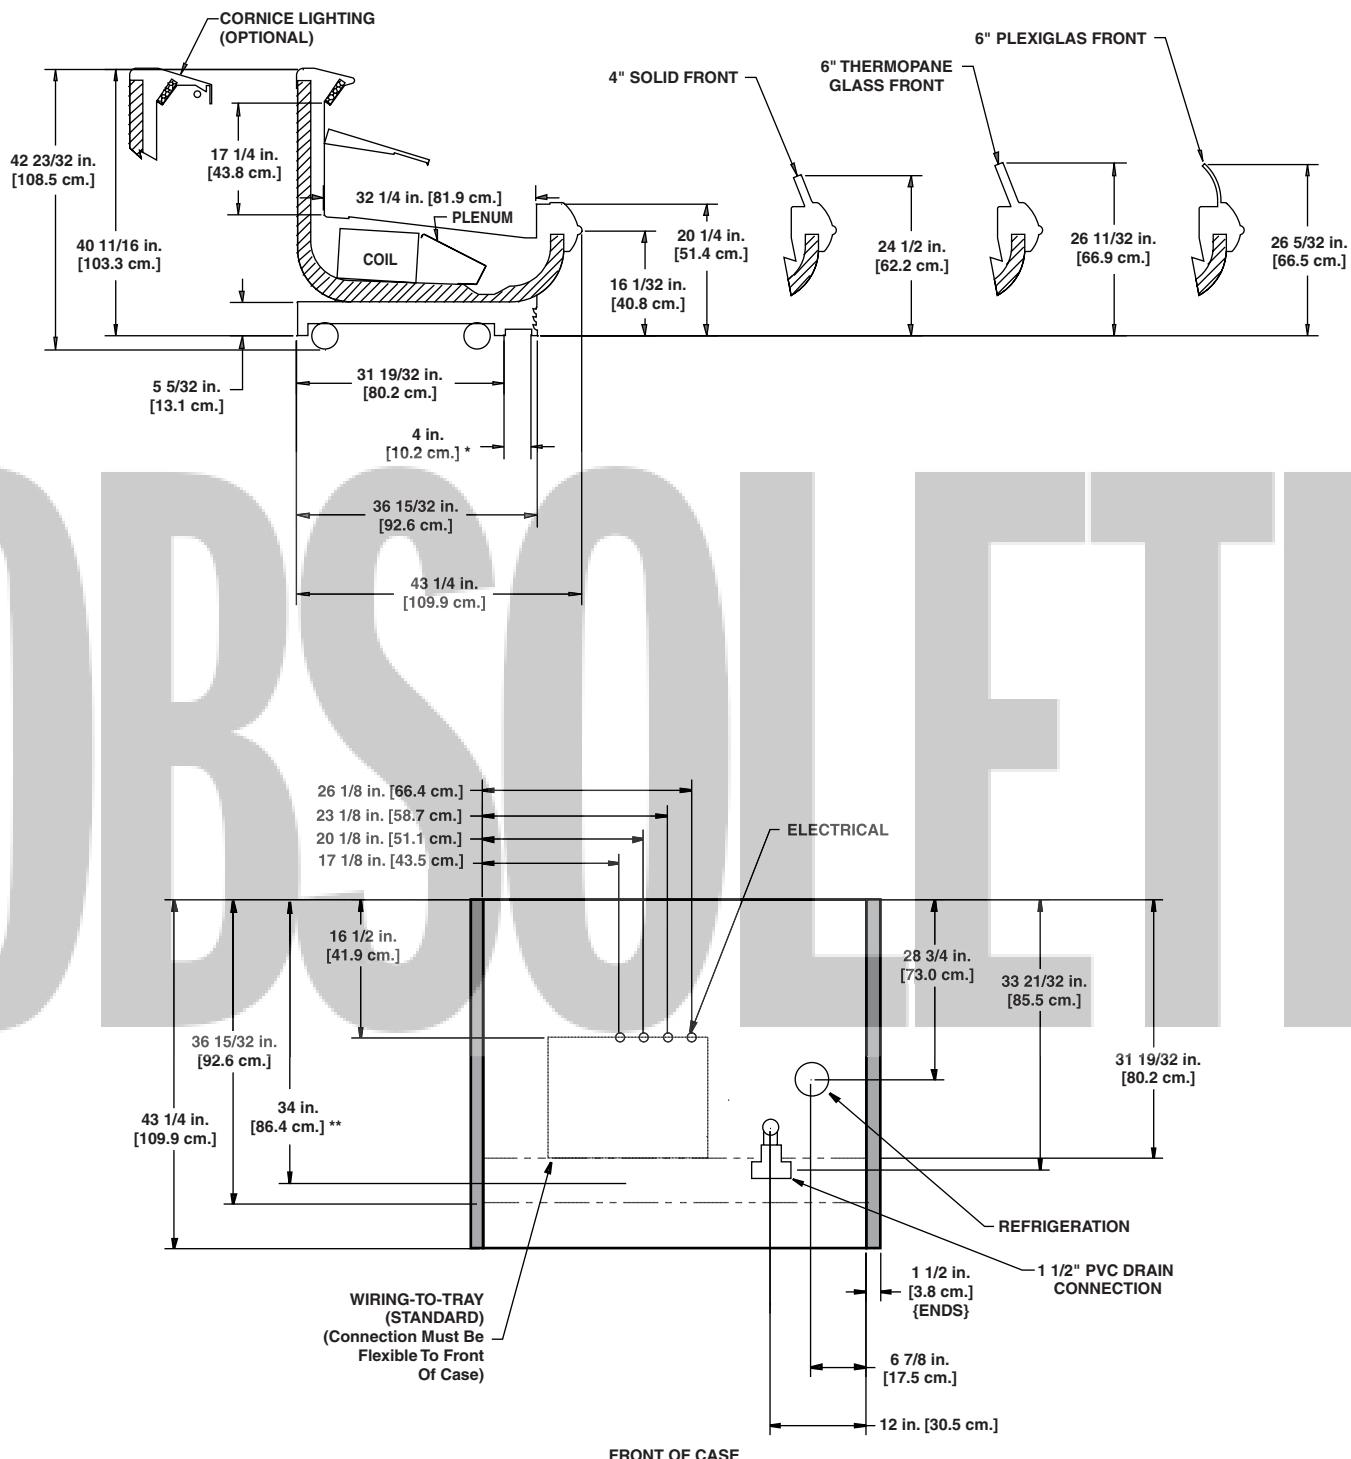

Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

ON2.5UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ON2.5UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ON2.5UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ON2.5UM	27", 31", 33"	811	17	6-8	28	32	35	284

² Model ON2.5UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ON2.5UM	2	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.



HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

ON2.5UM
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

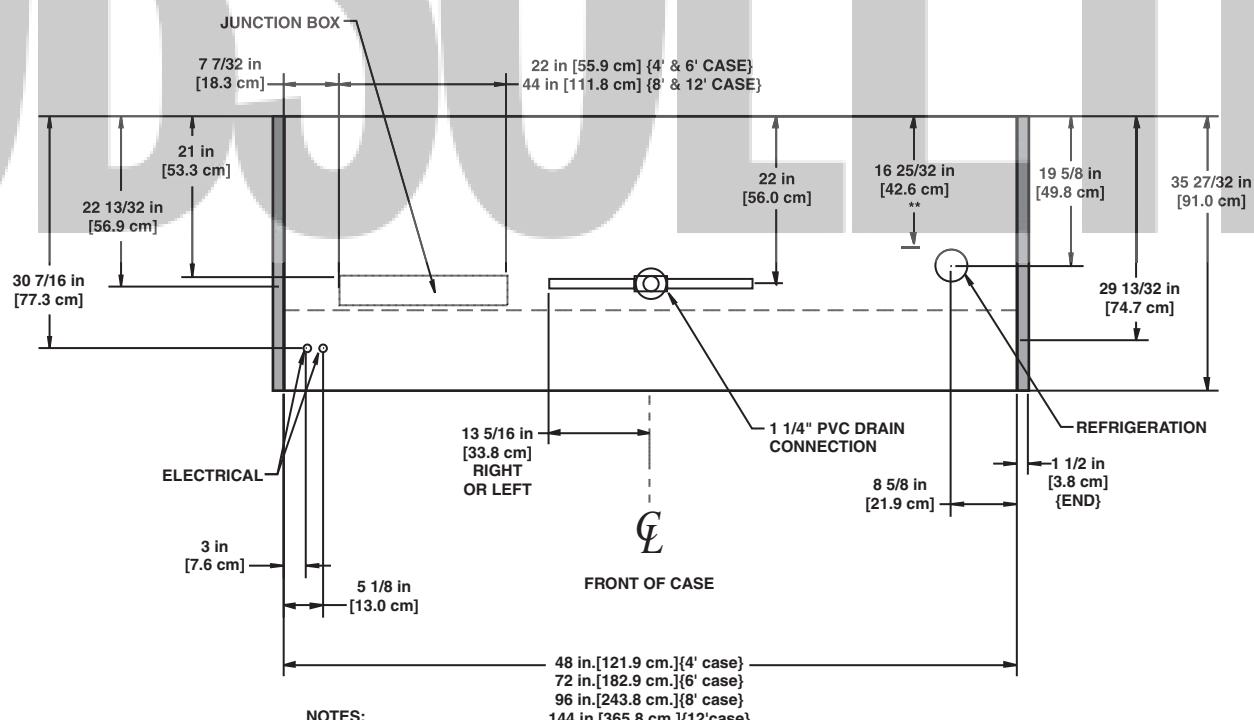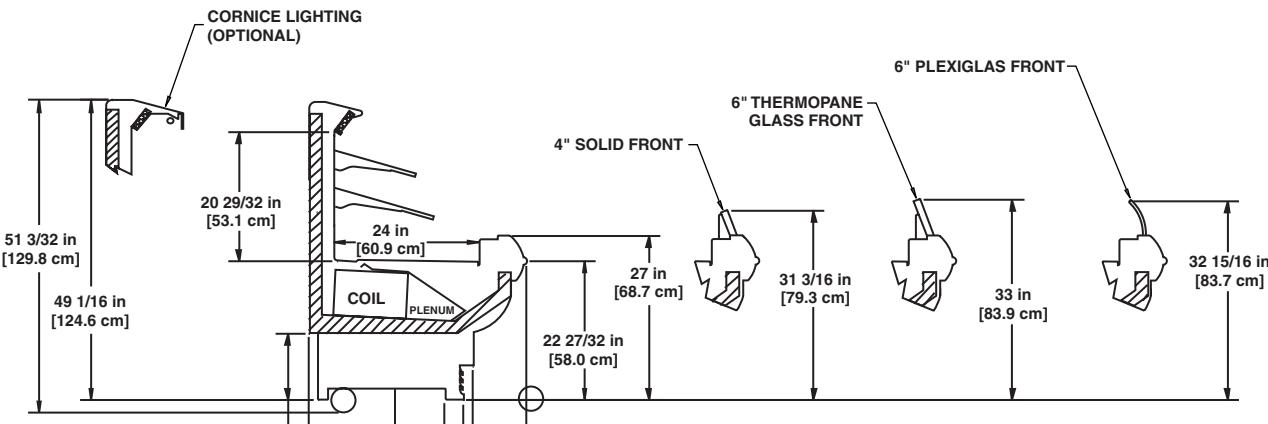

NOTES:

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

A DOVER DIVERSIFIED COMPANY


MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

ON2.5UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

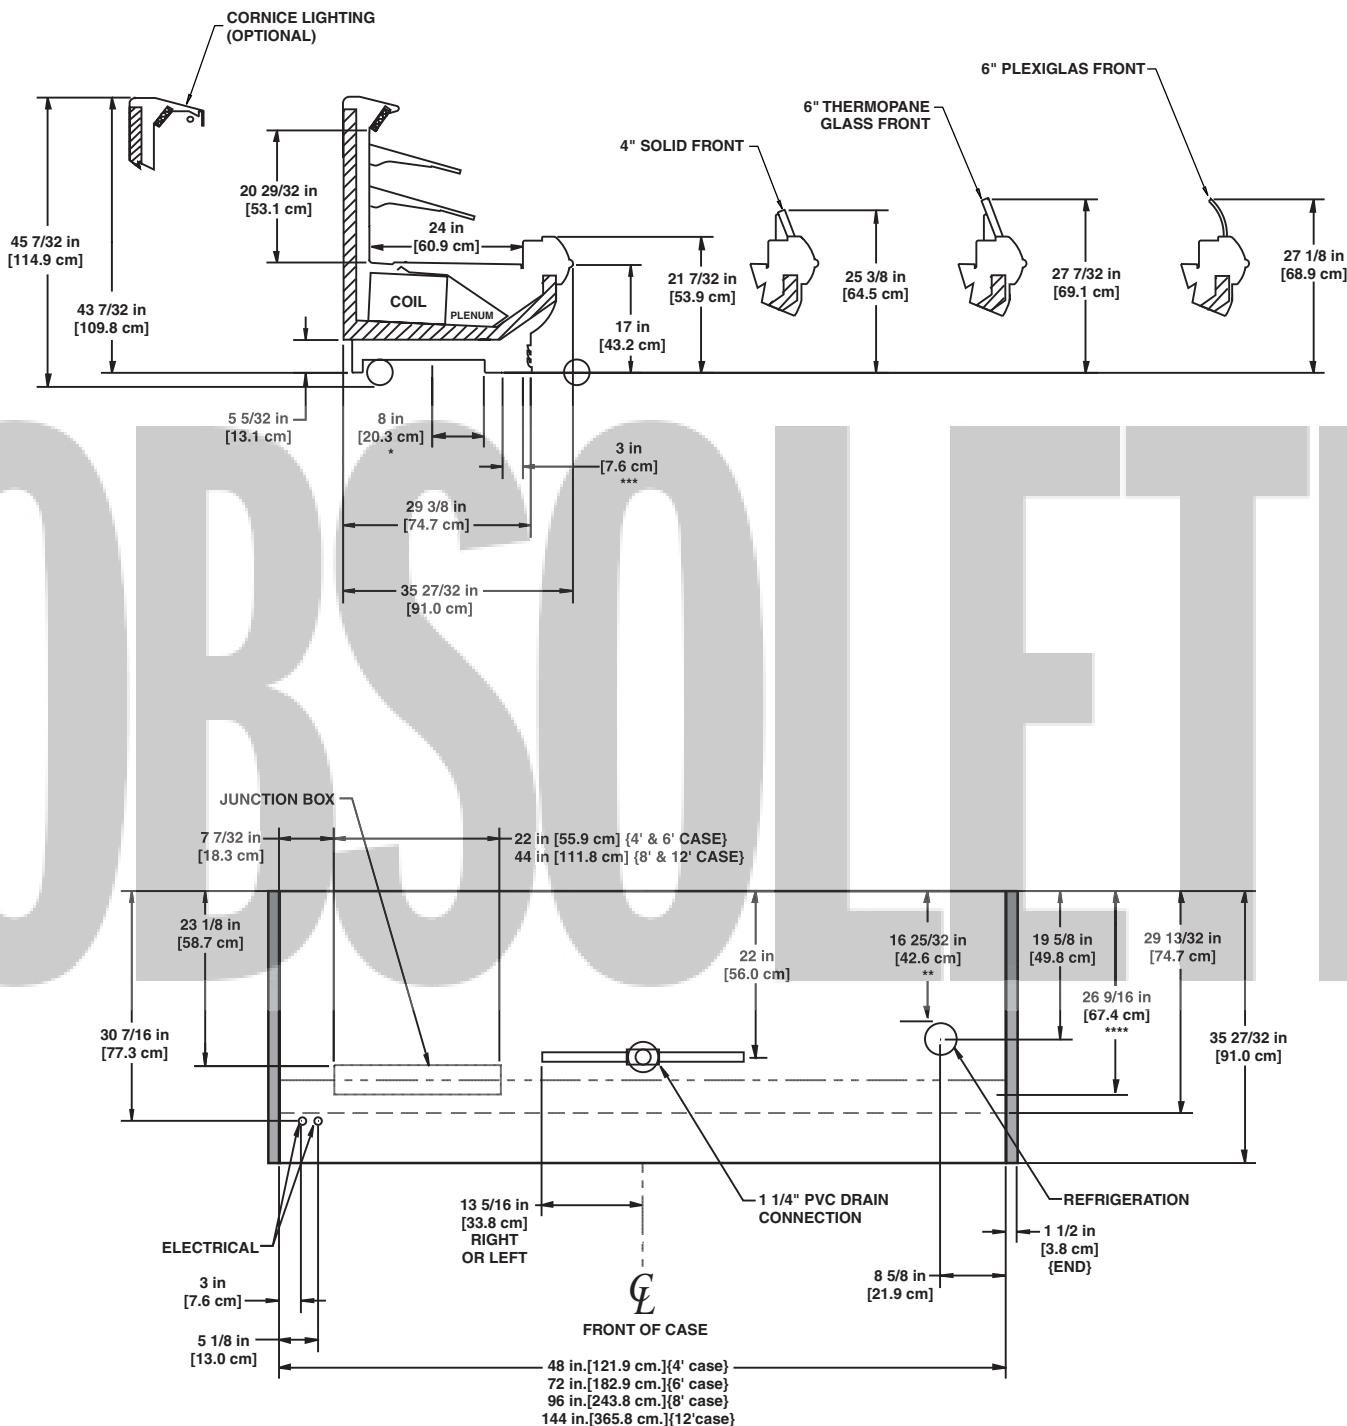

NOTES:

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

OBSCULTE

Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

O2.5UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O2.5UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O2.5UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
O2.5UM ⁵	27", 31", 33"	1020	17	6-8	27	33	45	225
O2.5UM w/Plexi Dome	27", 31", 33"	1380	17	6-8	32	36	46	305

² Model O2.5UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

⁵ For cases with rear refrigerated storage boxes add 110 BTUH/ft

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O2.5UM	3	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

O2.5UM
(11" BASEFRAME)

Hill PHOENIX™

****(For additional rear sill options refer to the Merchandisers Accessories Guide)***

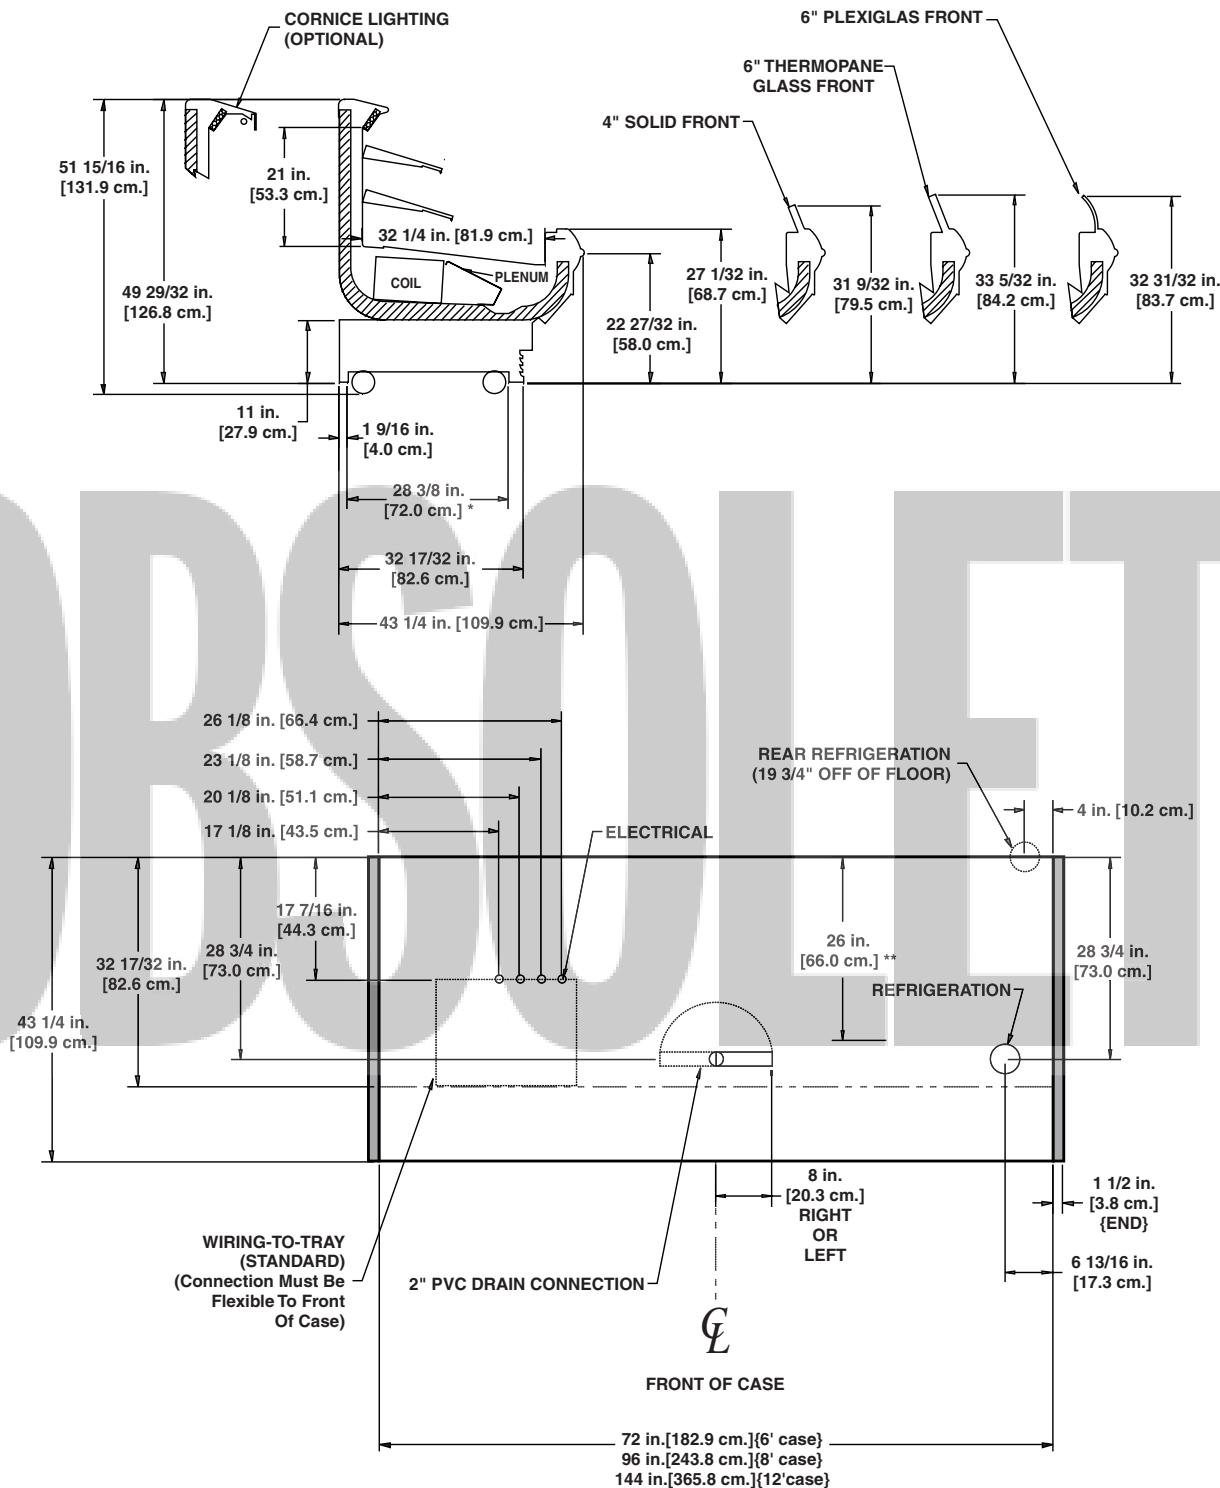


NOTES:-

- * STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE - 7/8", LIQUID LINE - 3/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", & 16"


A DOVER DIVERSIFIED COMPANY

***(For additional rear sill options refer to the
Merchandisers Accessories Guide)**

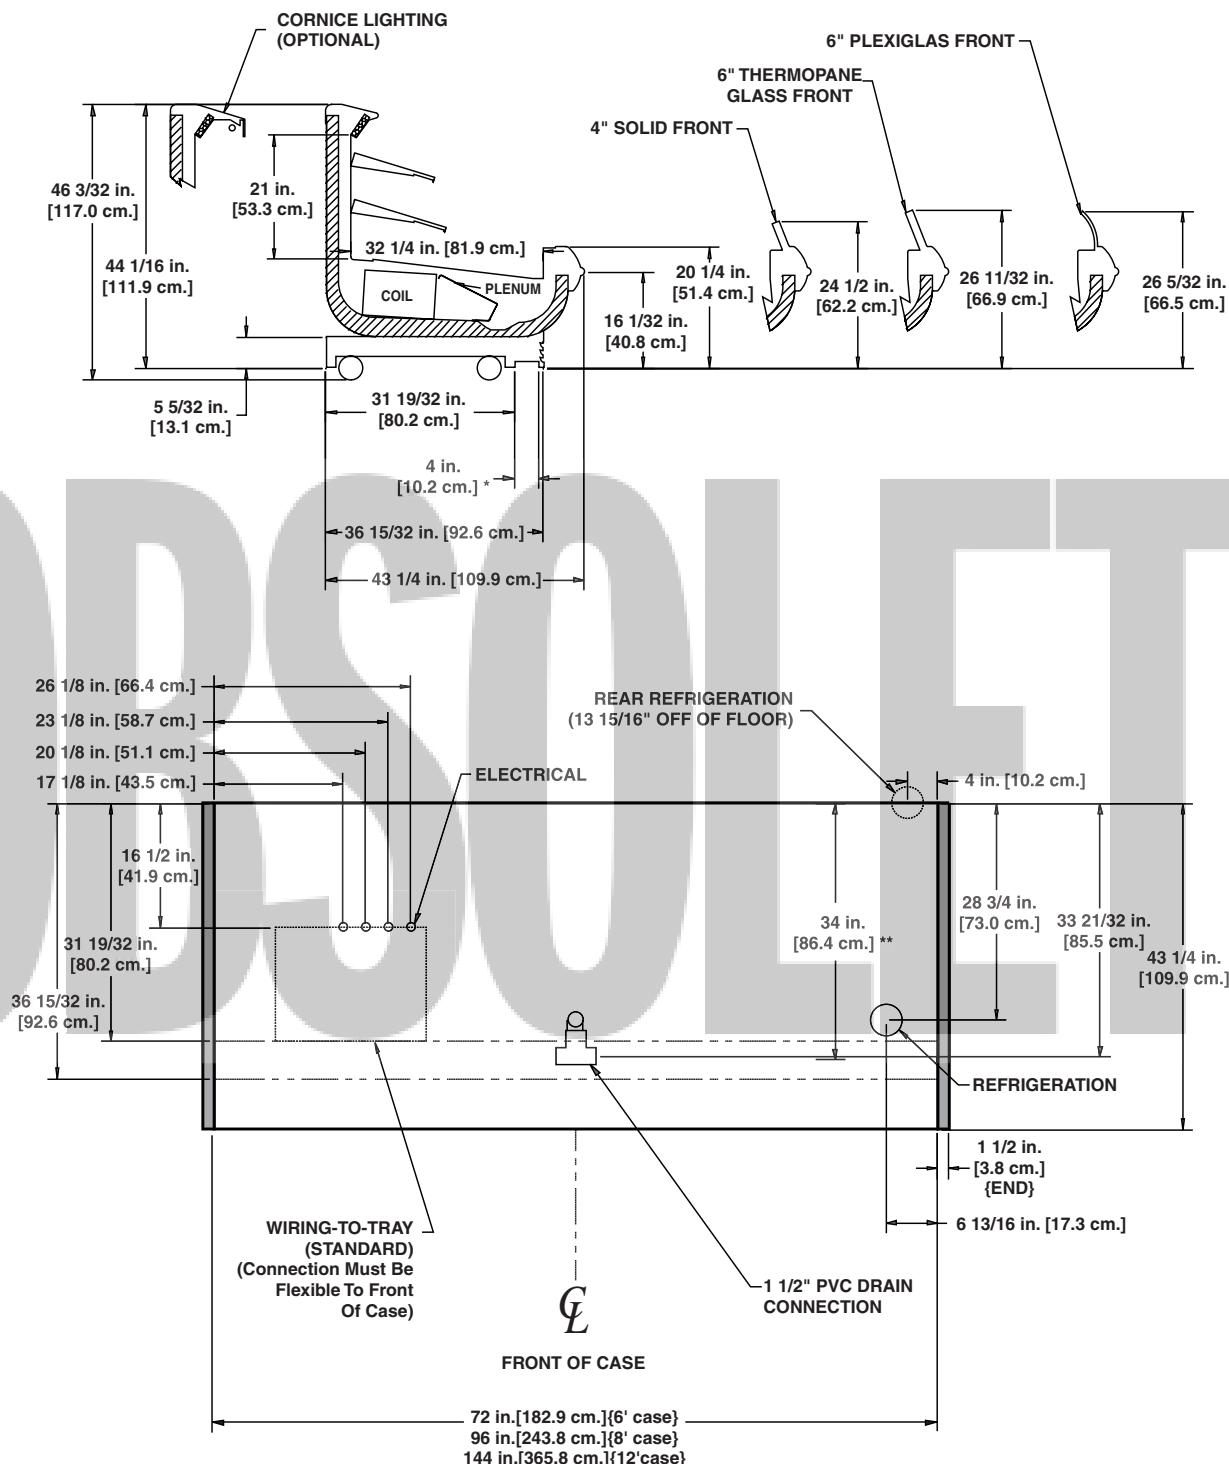


- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

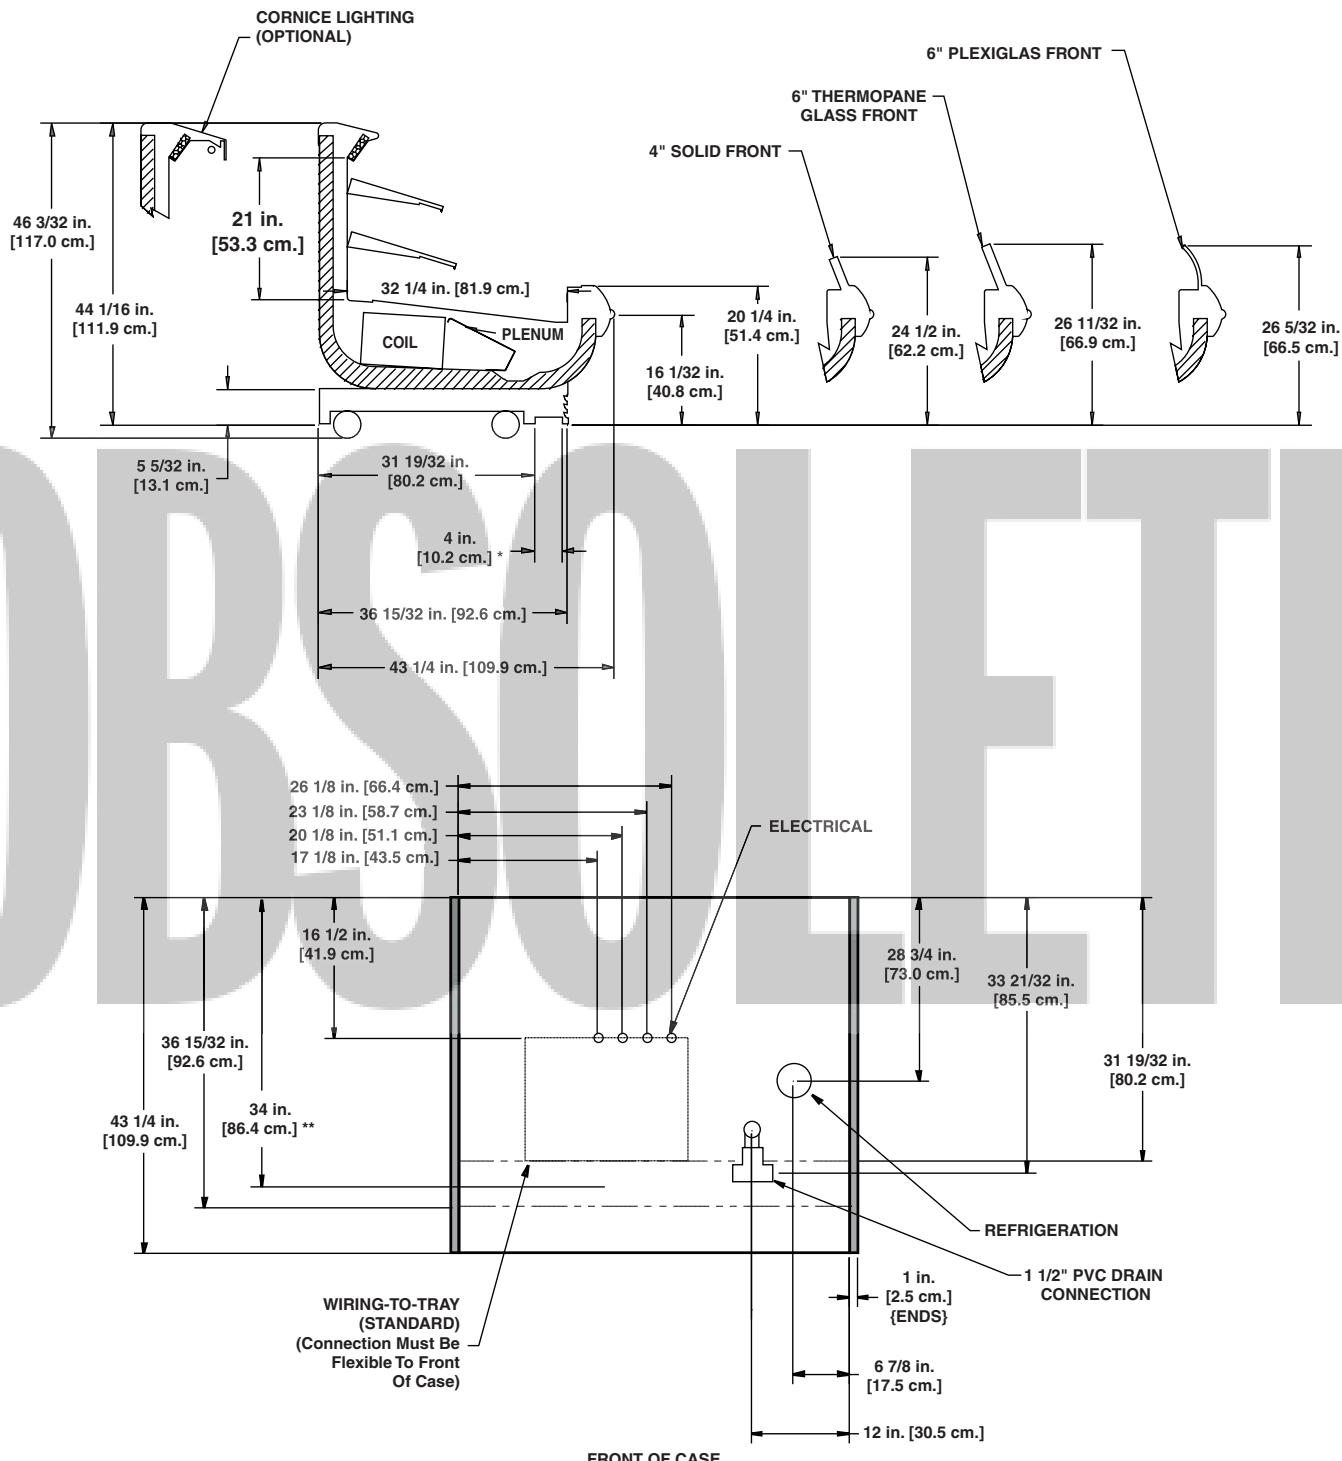

REAR REFRIGERATED BOX APPLICATION

HILL PHOENIX™

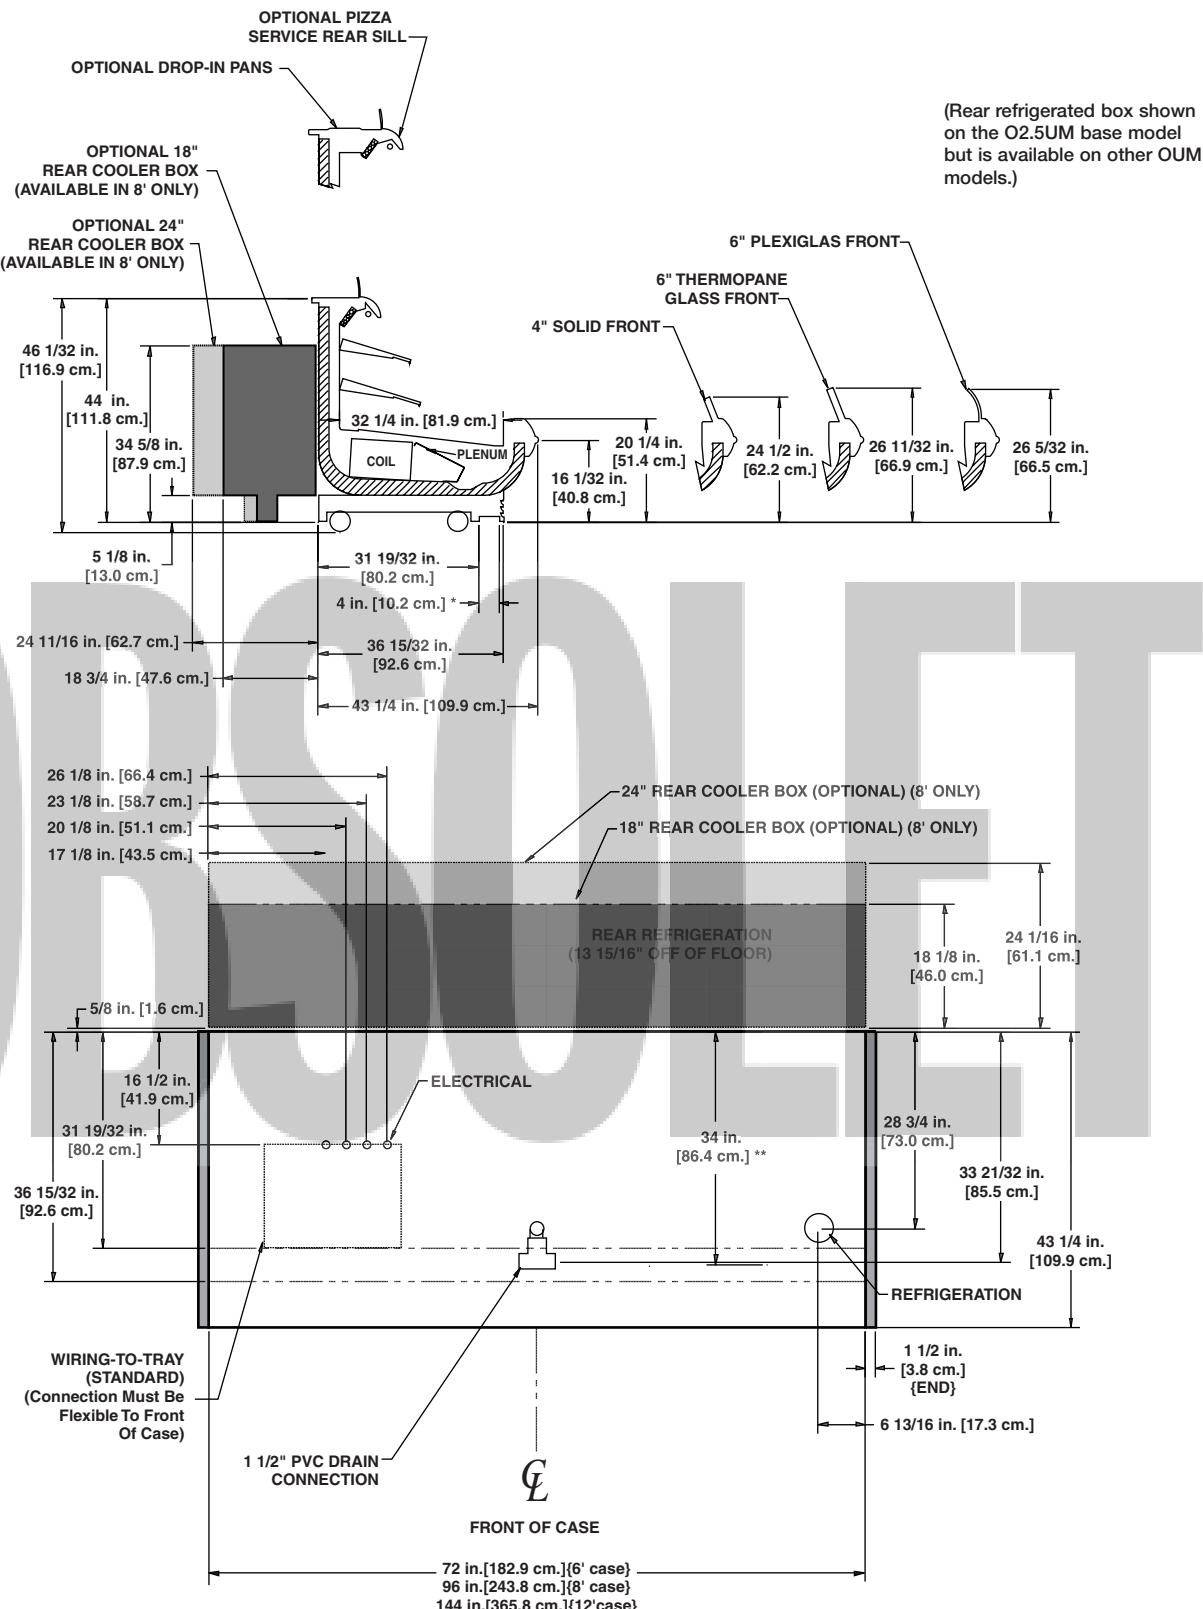

NOTES.

- * STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE - 7/8", LIQUID LINE - 3/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", & 16"


A DOVER DIVERSIFIED COMPANY

O2.5UM

w/ Plexiglas Dome

HILL PHOENIX
EXCELLENCE™

*****(For additional rear sill options refer to the
Merchandisers Accessories Guide)

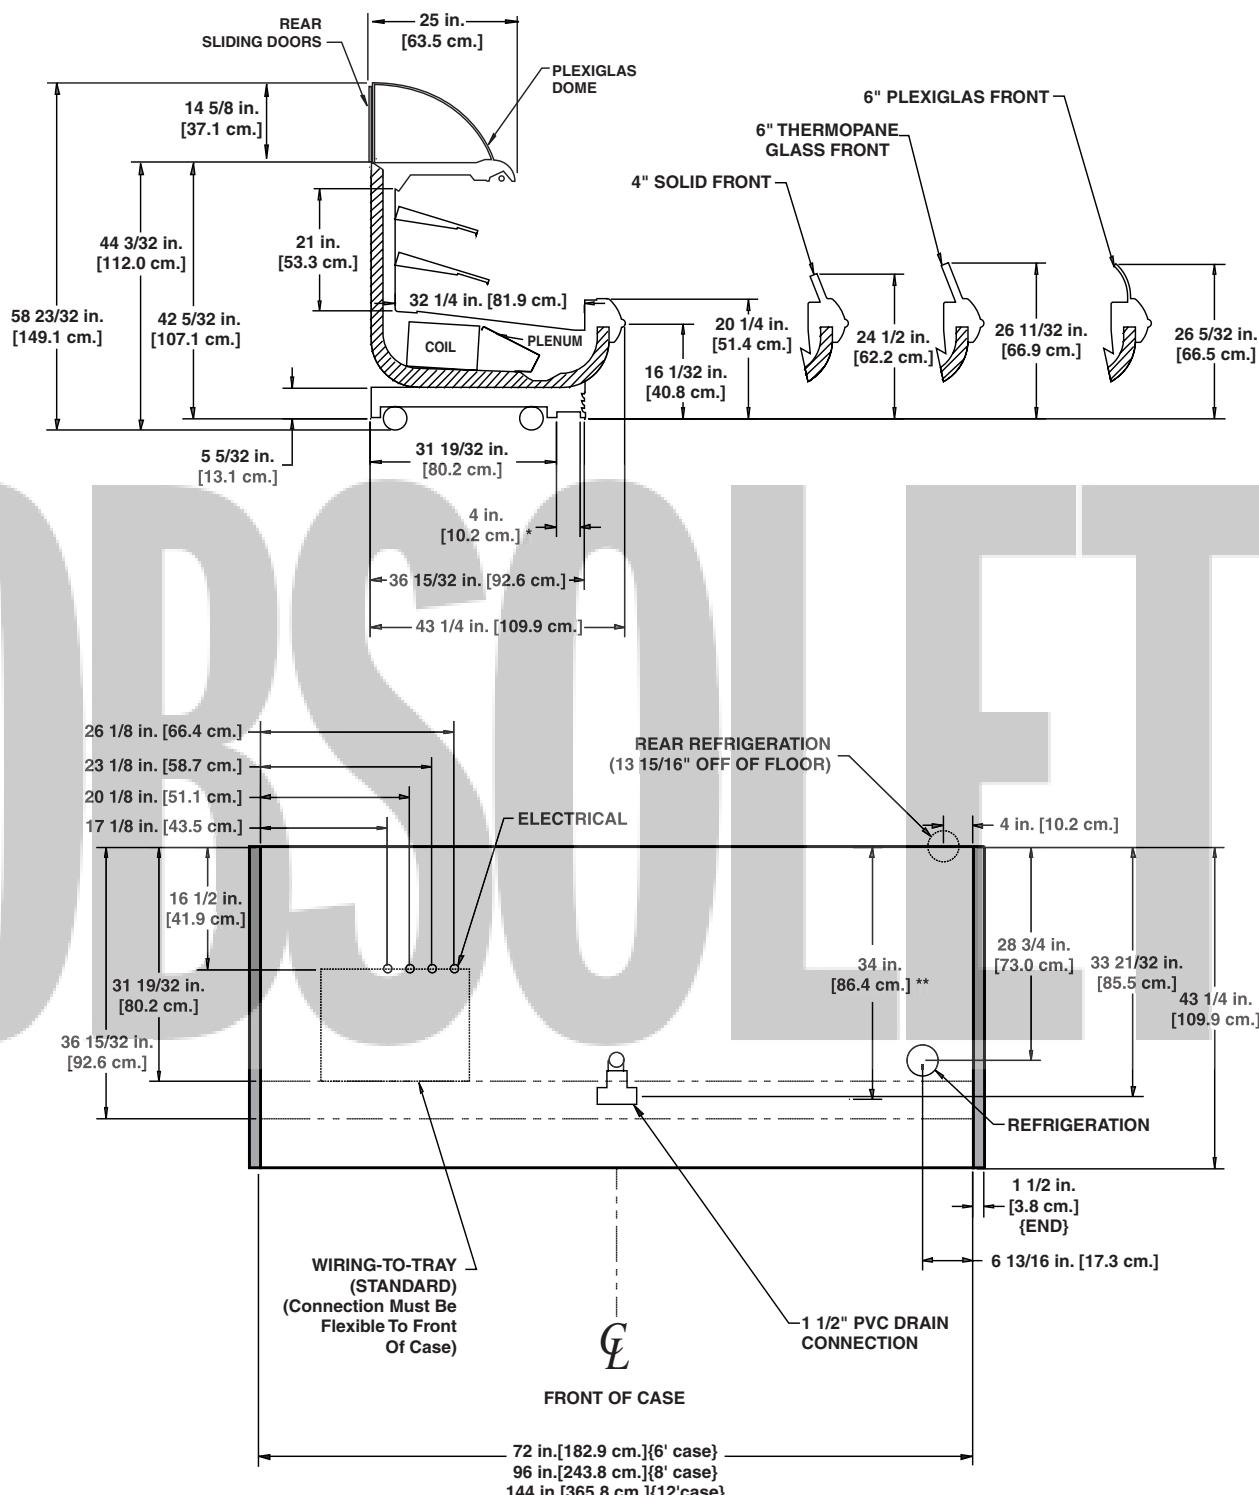

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

ON3UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ON3UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ON3UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ON3UM	27", 31", 33"	824	17	6-8	28	32	35	230

² Model ON3UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ON3UM	2	6 - 8	40	47	45	45	26	45	45	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

ON3UM
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

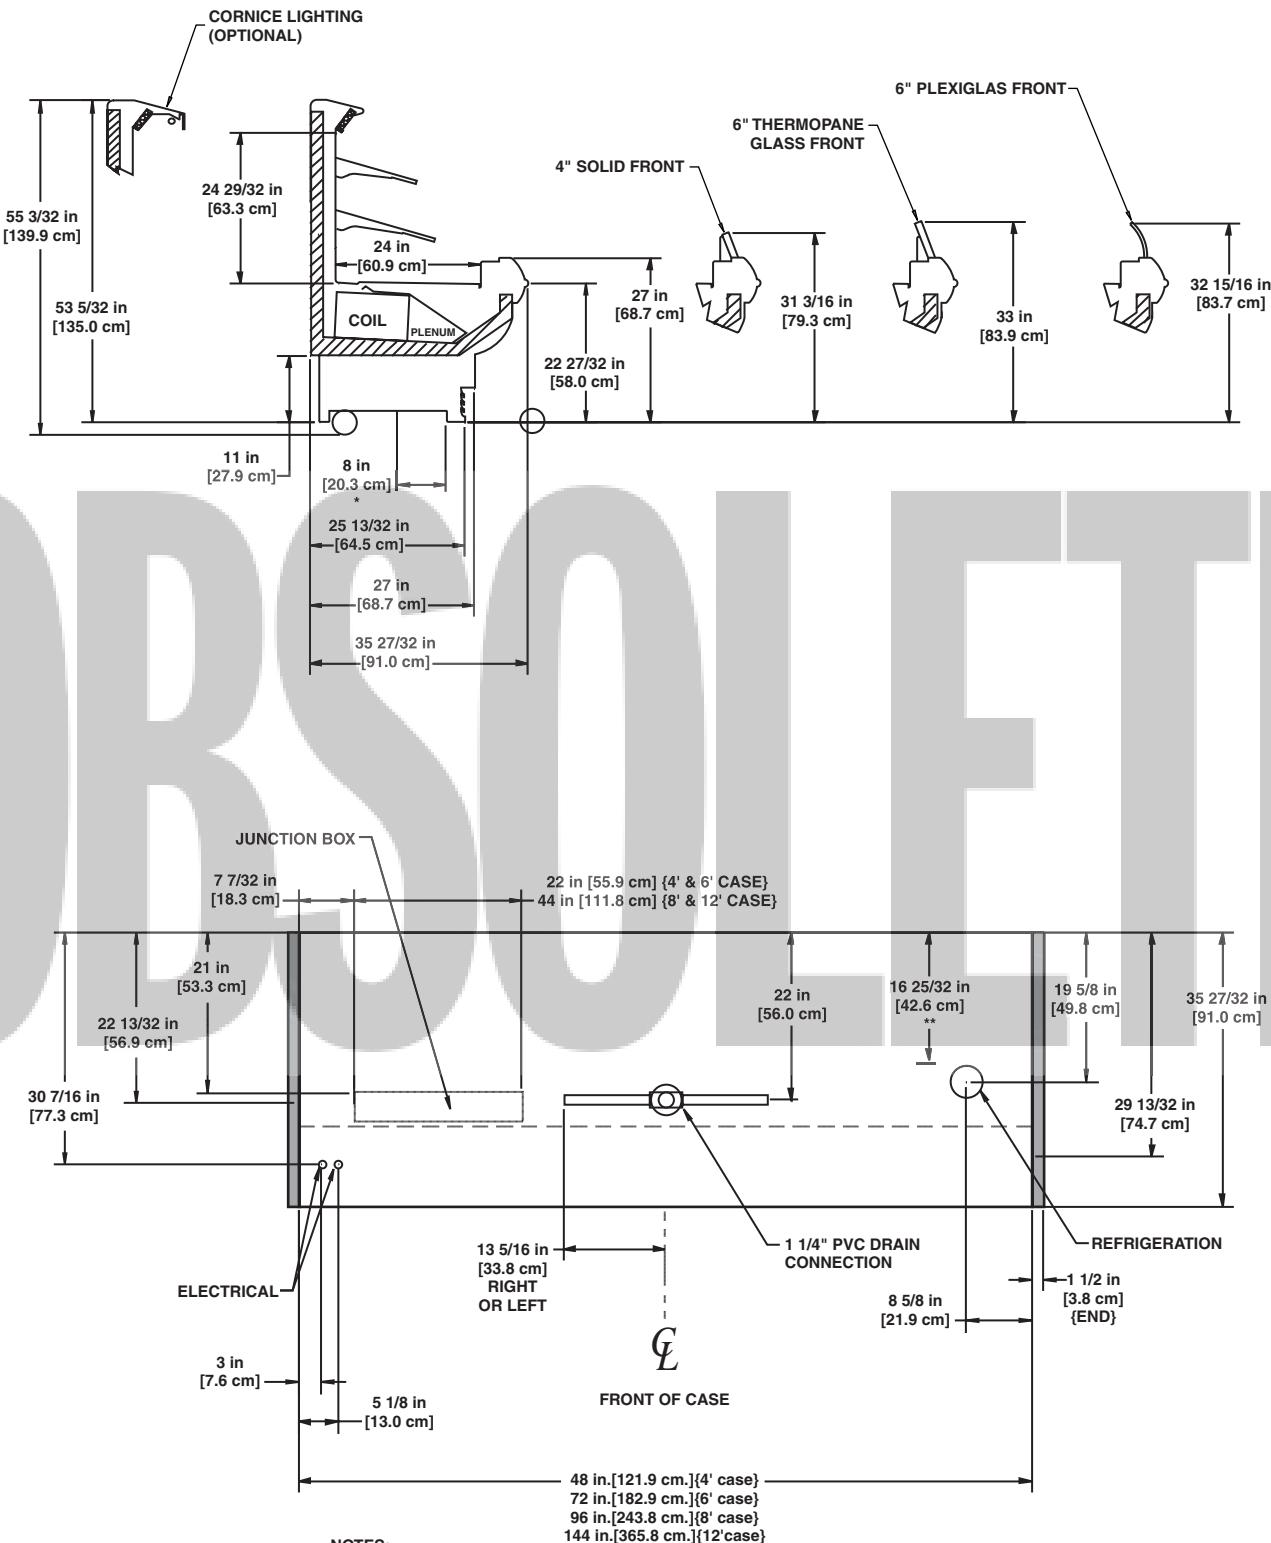

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL

• BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE

• SUCTION LINE - 7/8", LIQUID LINE - 3/8"

• AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

A DOVER DIVERSIFIED COMPANY



MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

ON3UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

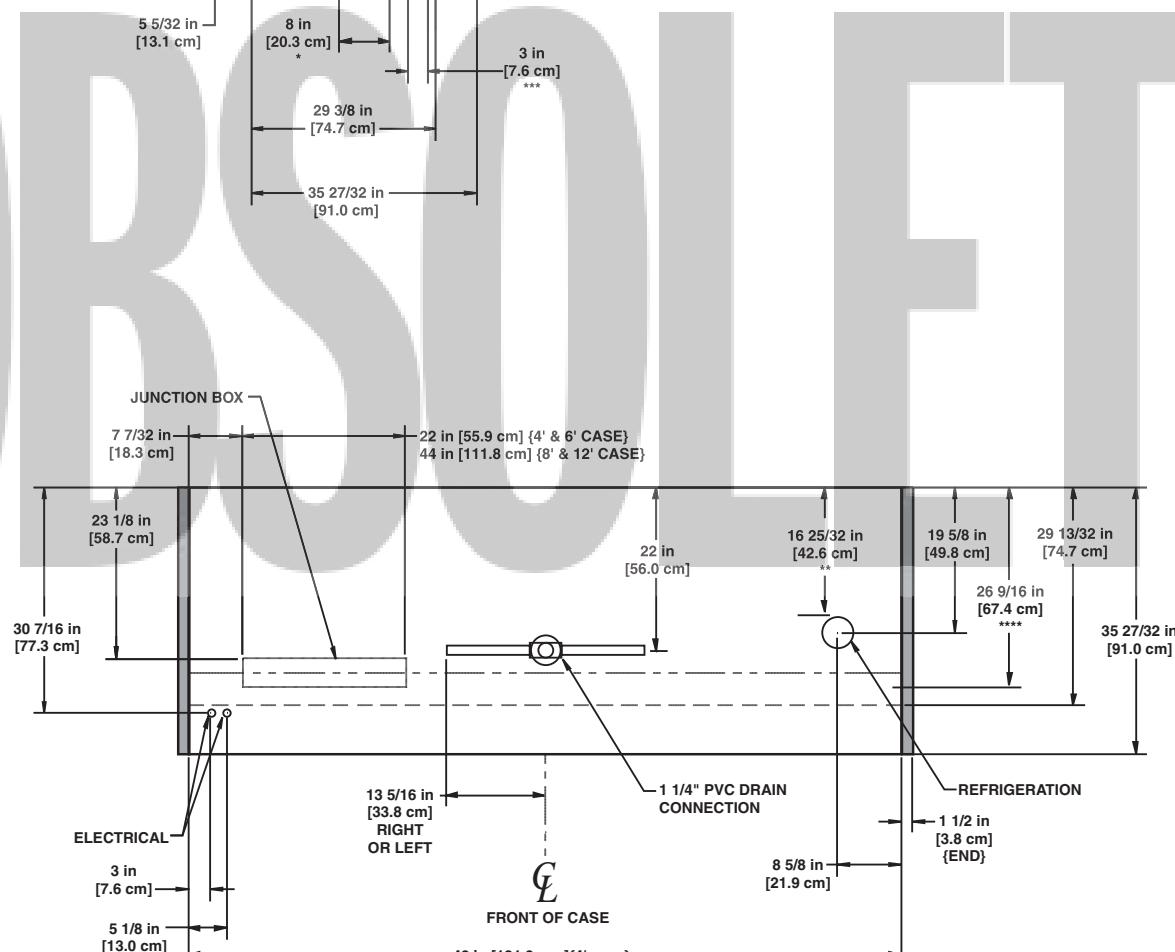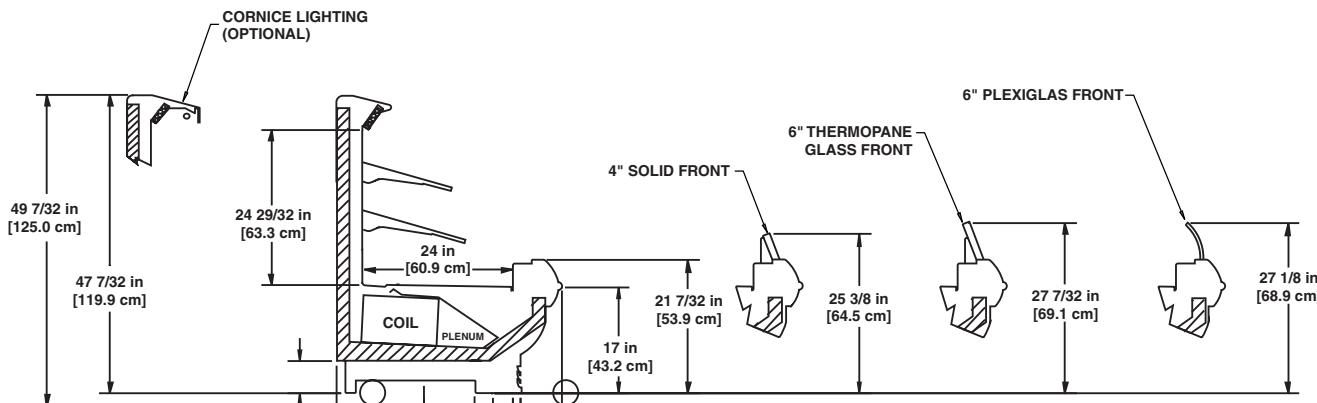

NOTES:

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

OBSCULTE

Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

O3UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O3UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O3UM	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	4.02	482

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
O3UM	27", 31", 33"	1030	17	6-8	27	32	45	225

² Model O3UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
O3UM	3	6 - 8	40	47	45	45	26	45	45

Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

O3UM
(11" BASEFRAME)

HILL PHOENIX™
EXCELSIOR

****(For additional rear sill options refer to the Merchandisers Accessories Guide)***

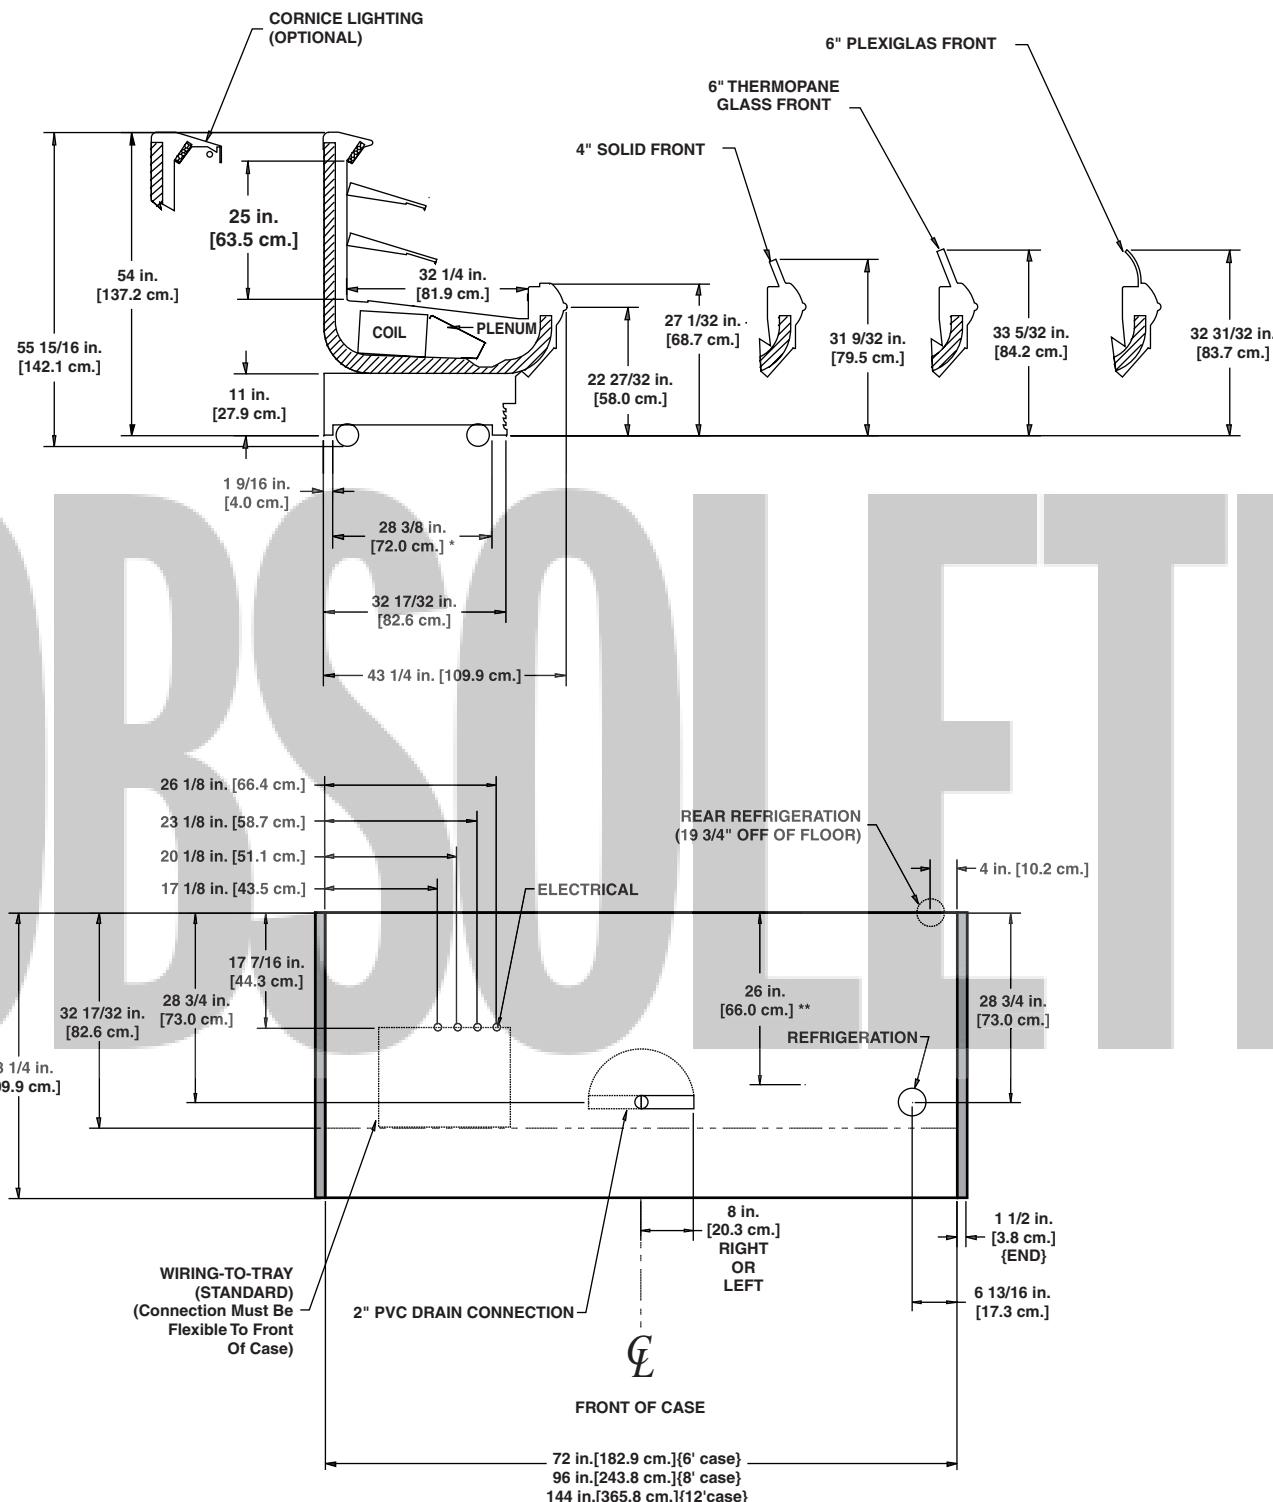

MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

NOTES:-


* STUB-UP AREA

* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE - 7/8", LIQUID LINE - 3/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

A  DOVER DIVERSIFIED COMPANY

***(For additional rear sill options refer to the
Merchandisers Accessories Guide)**

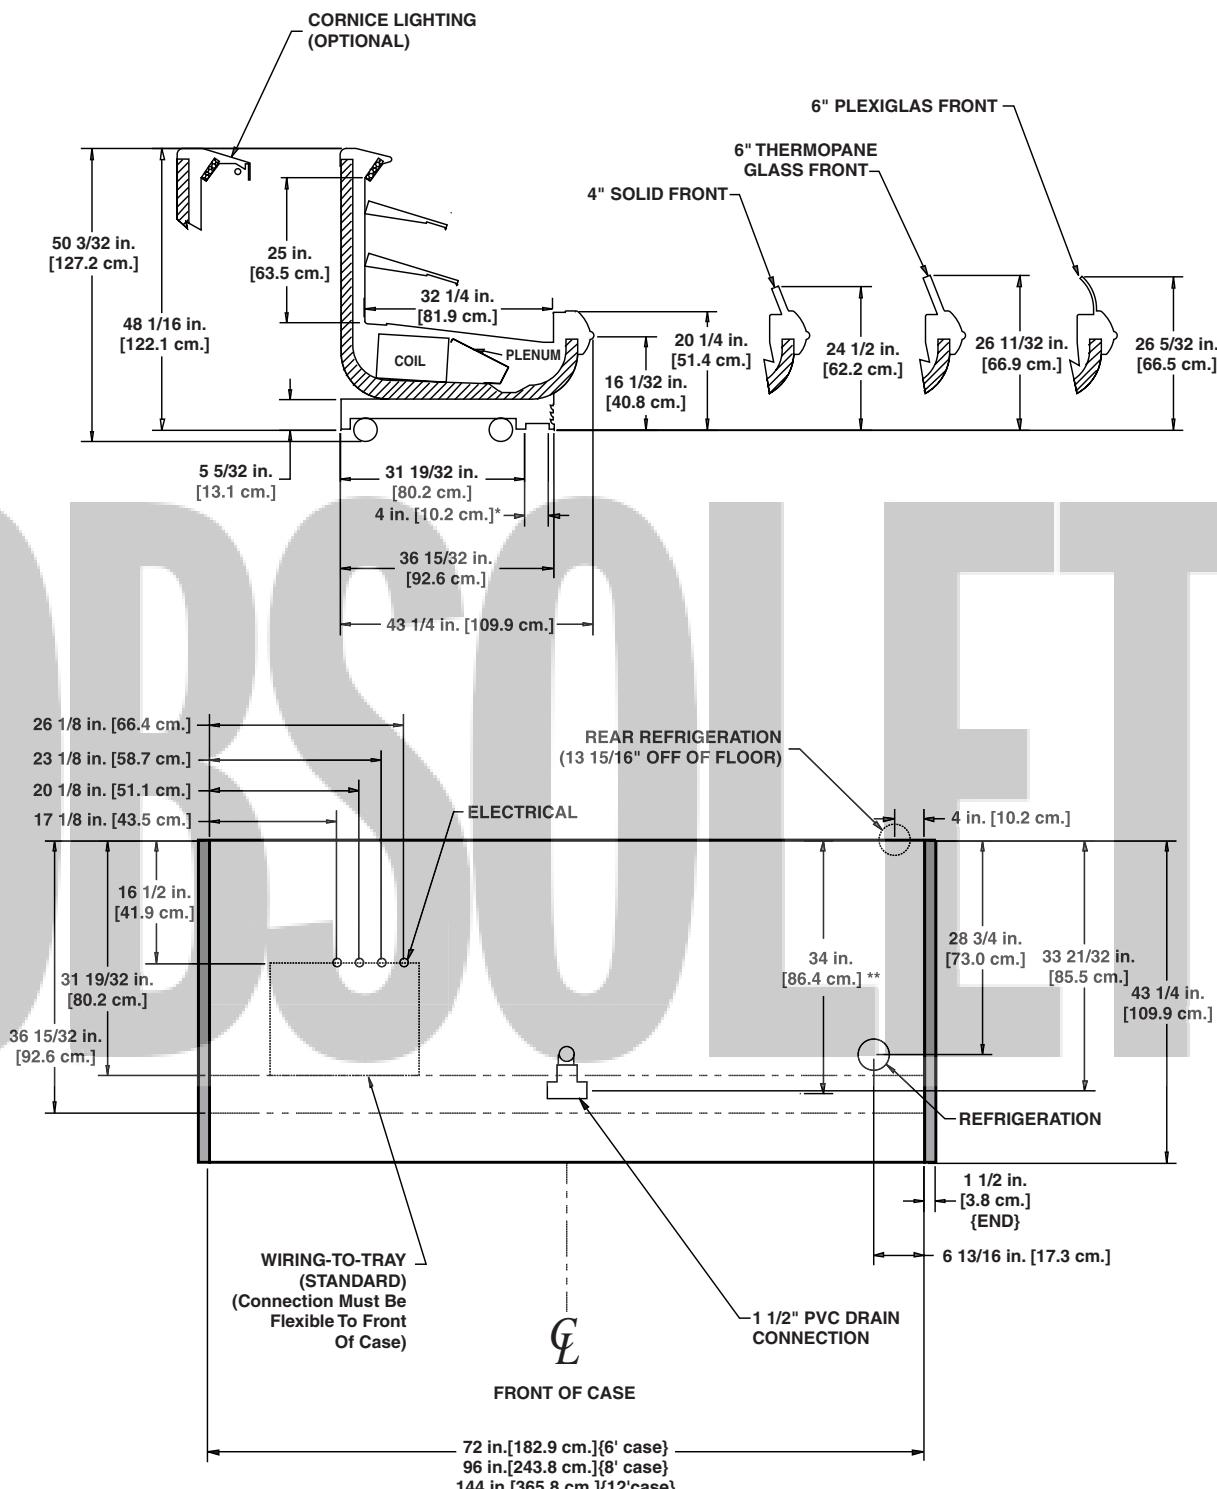


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

***(For additional rear sill options refer to the Merchandisers Accessories Guide)**

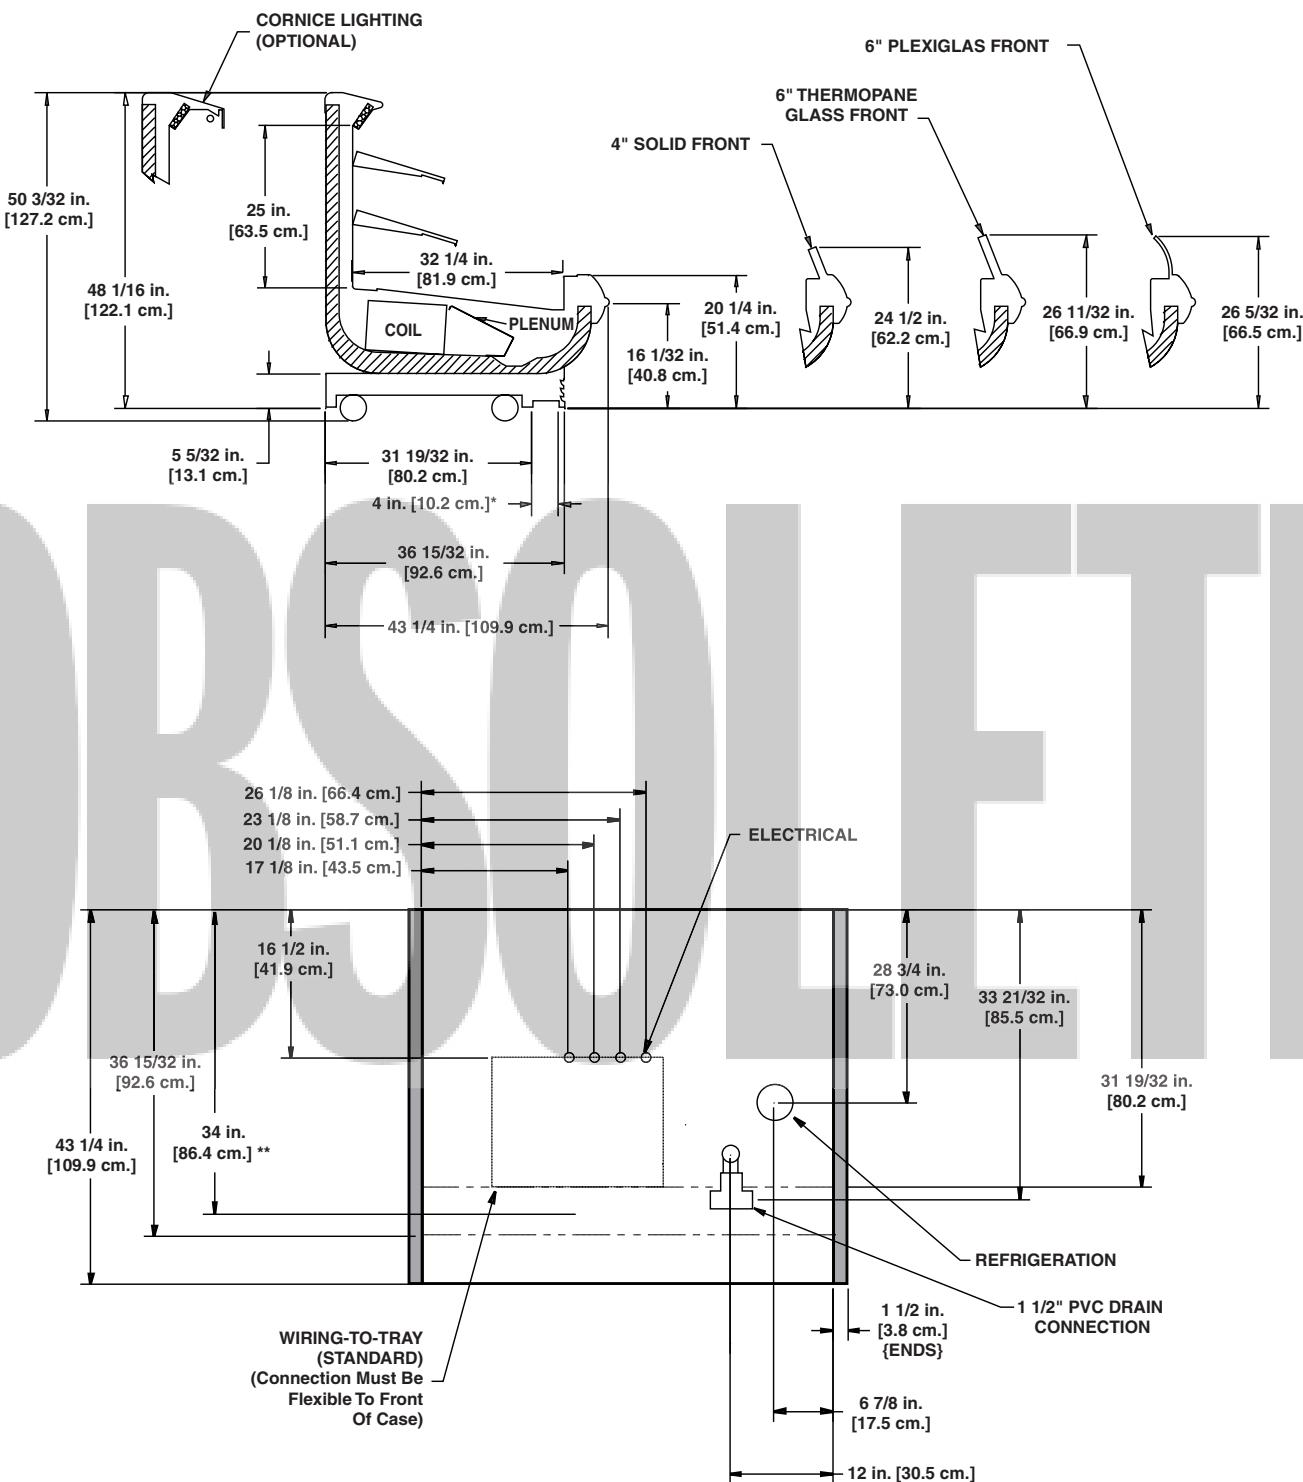

NOTES:

FRONT OF CASE

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

Narrow Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

ON3.5UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ON3.5UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ON3.5UM	4'	0.57	68	1.91	229
	6'	0.57	68	3.03	364
	8'	0.57	68	3.03	364
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ON3.5UM	27", 31", 33"	1019	17	6-8	28	32	35	204

² Model ON3.5UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ON3.5UM	3	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLLENCE IN
ENGINEERING

A  DOVER DIVERSIFIED COMPANY

ON3.5UM
(11" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

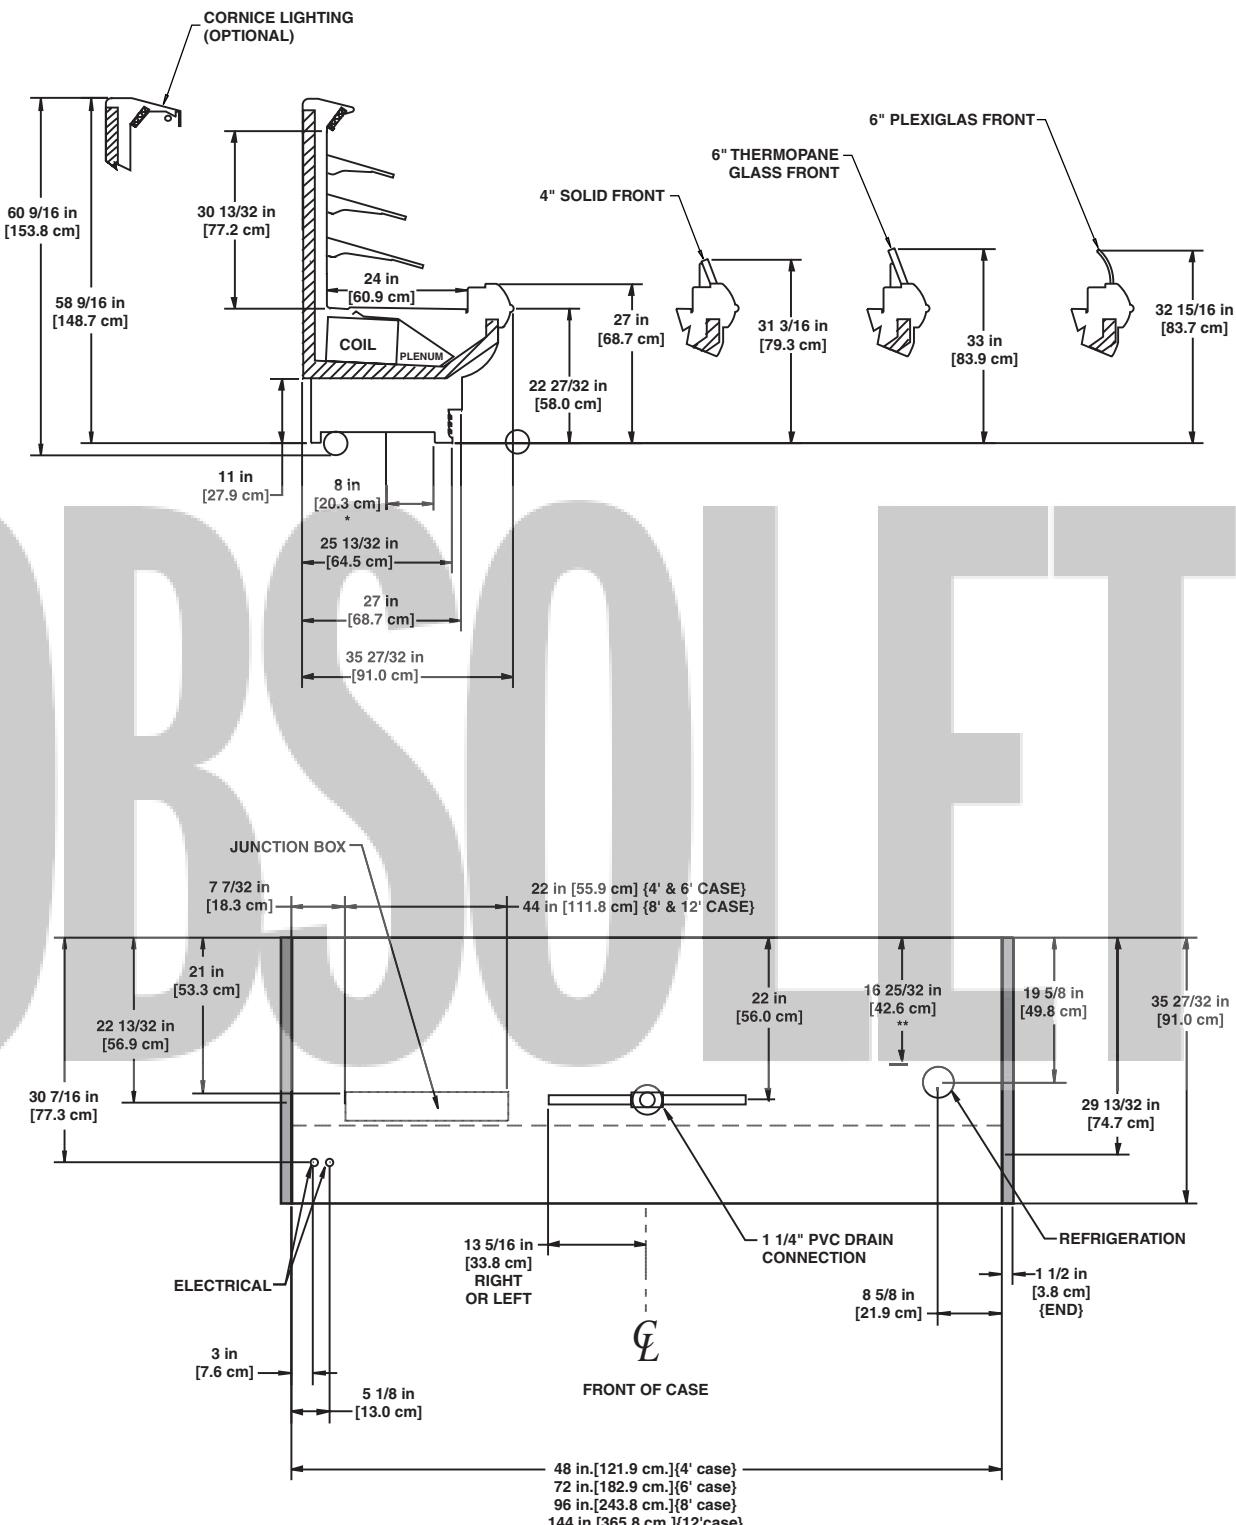


MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

ON3.5UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM
 EXCELENE

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

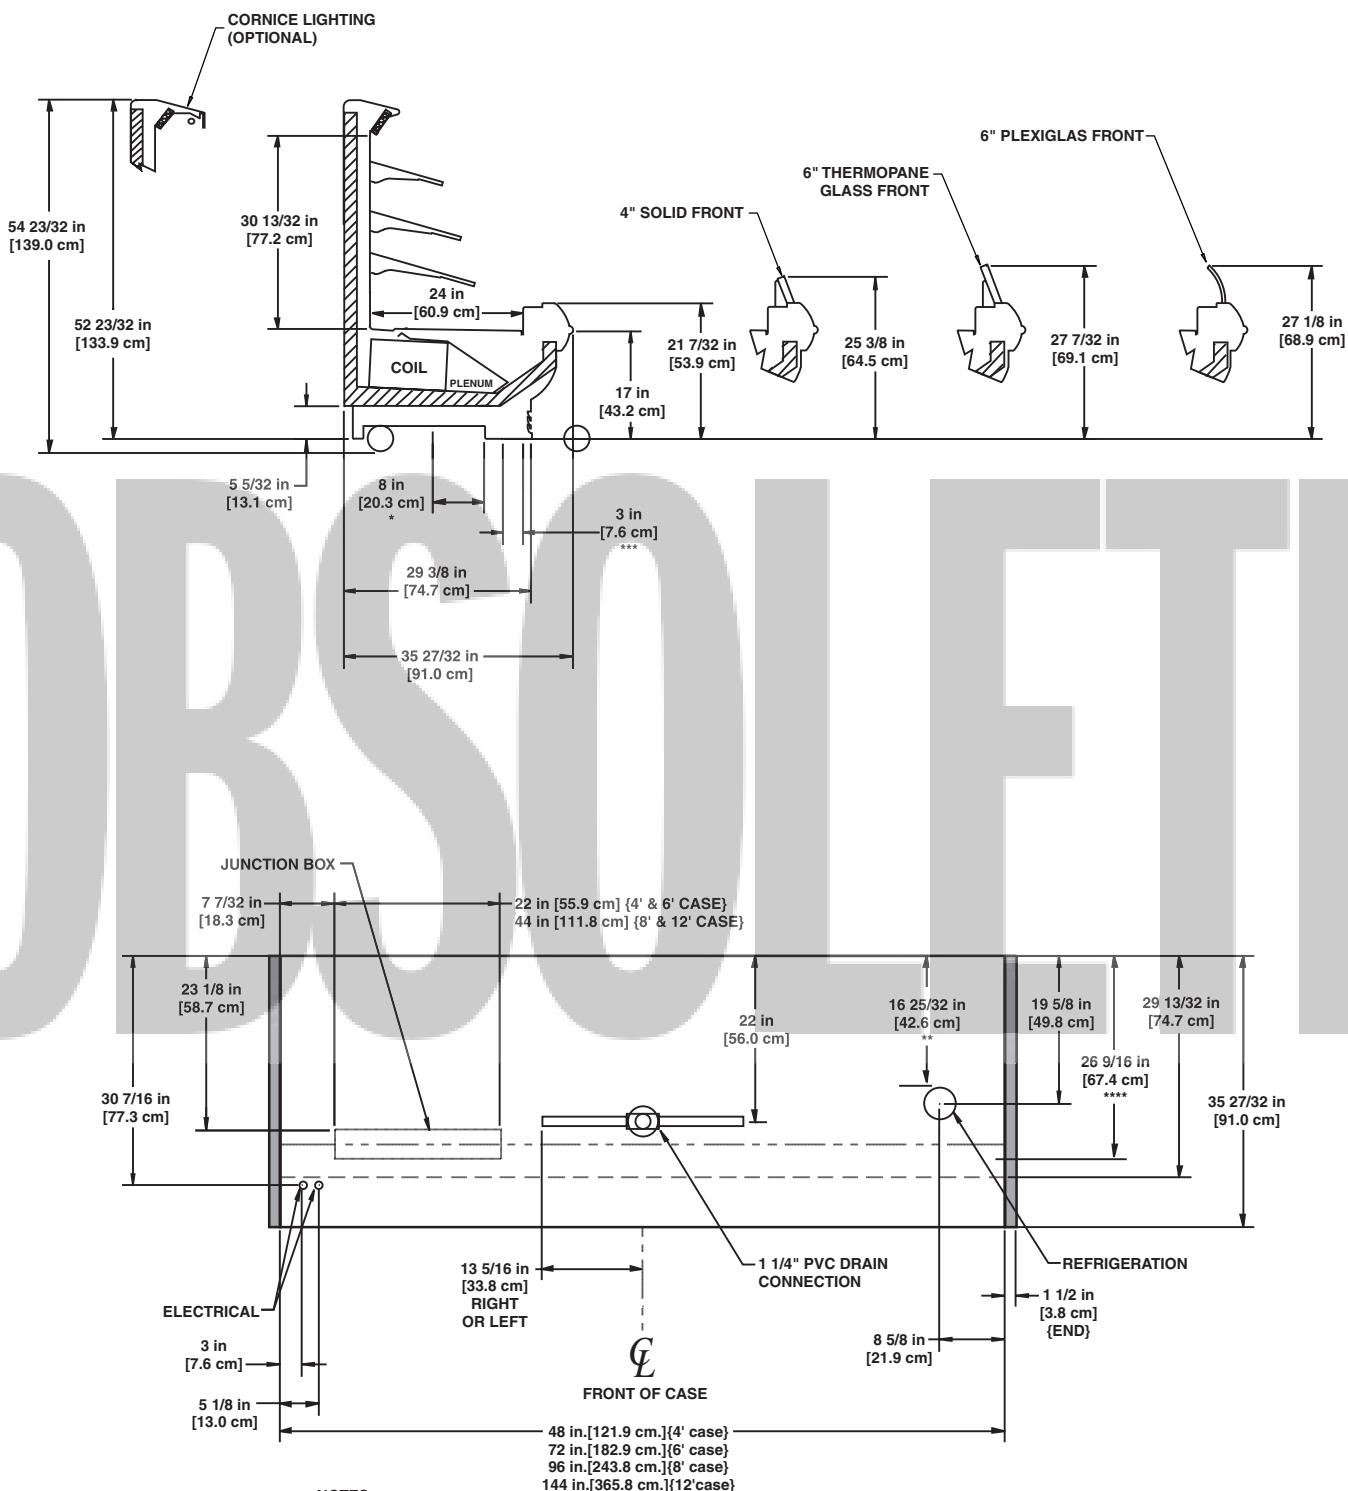

MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

OBSCULTE

Multi-Deck Produce/Dairy/Deli/Meat/Seafood Merchandiser

O3.5UM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O3.5UM	4'	2	1.00	60	0.60	40	0.14 ¹	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O3.5UM	4'	0.57	68	1.91	229
	6'	0.57	68	3.03	364
	8'	0.57	68	3.03	364
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model ²	Front Sill Heights	BTUH/ft ³ ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
O3.5UM	27", 31", 33"	1300	17	6-8	30	35	45	300

² Model O3.5UM only available for meat application with 33" front.

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3.5UM	3	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING


A DOVER DIVERSIFIED COMPANY

03.5UM

(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

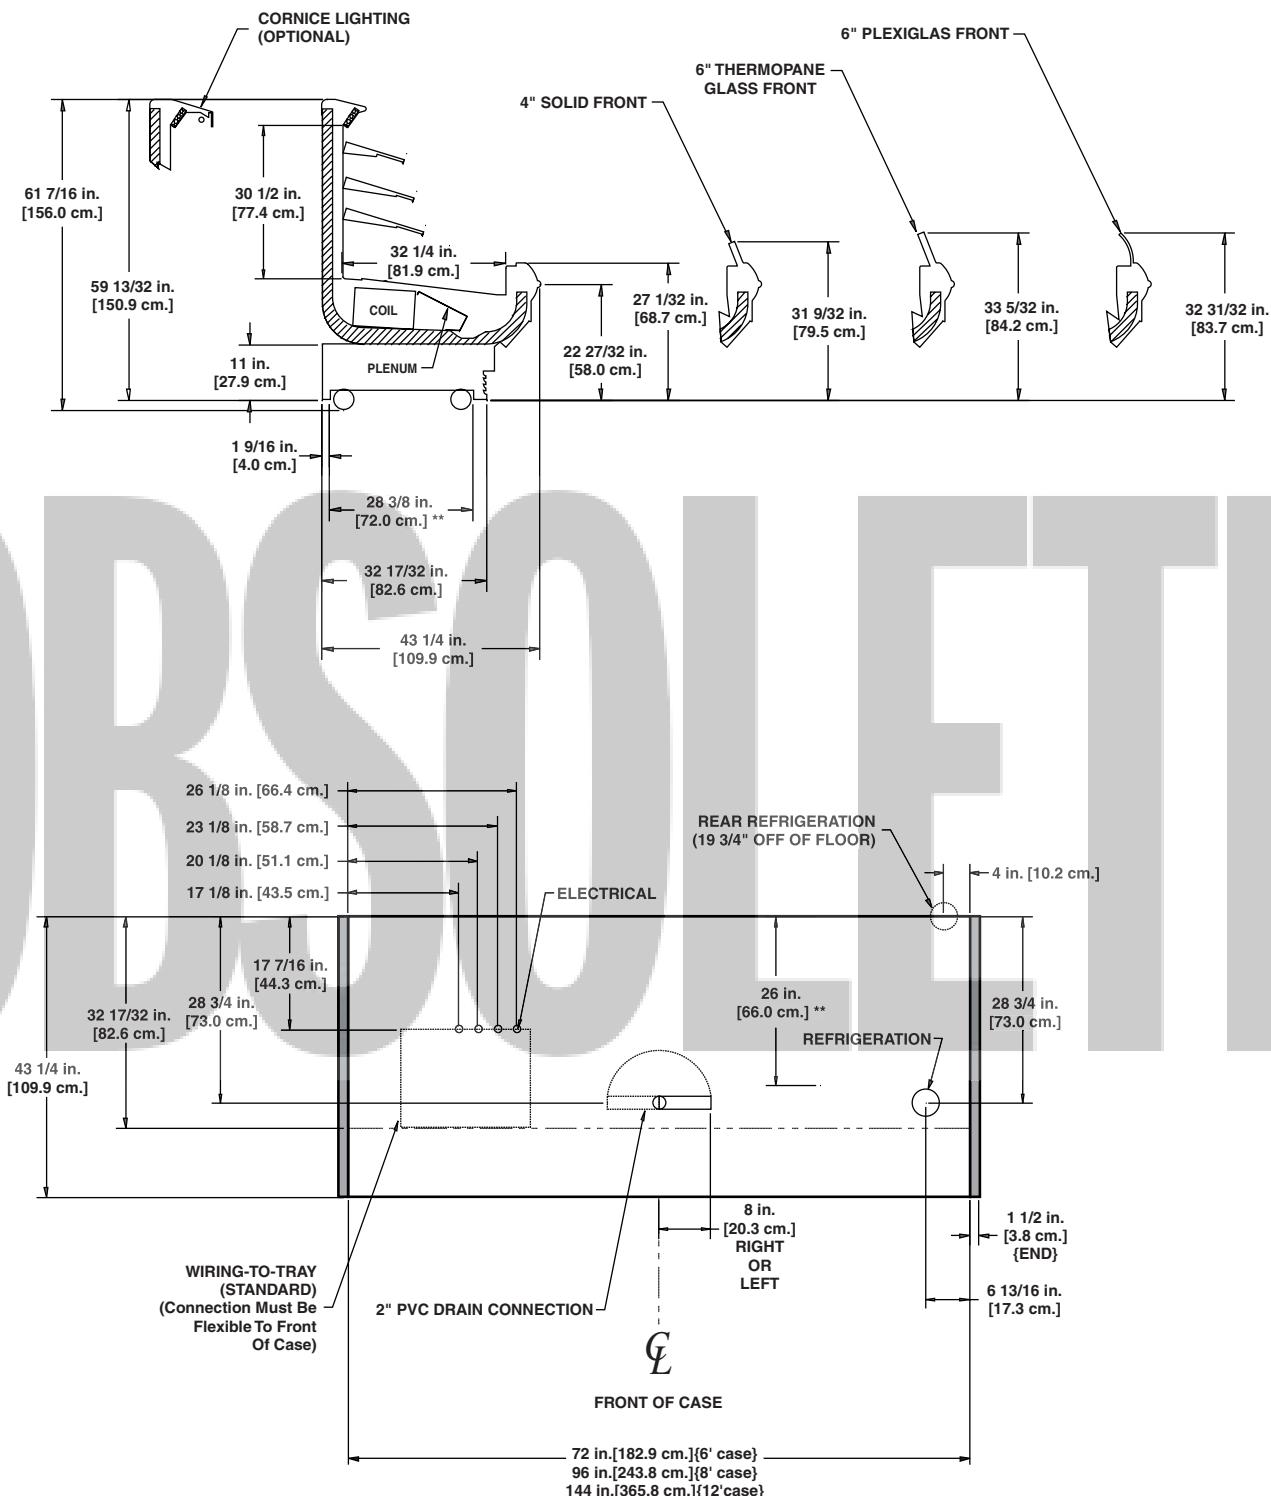


MULTI-DECK

Produce/Dairy/Deli/Meat/Seafood

O3.5UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM
EXCELENE

*****(For additional rear sill options refer to the
Merchandisers Accessories Guide)

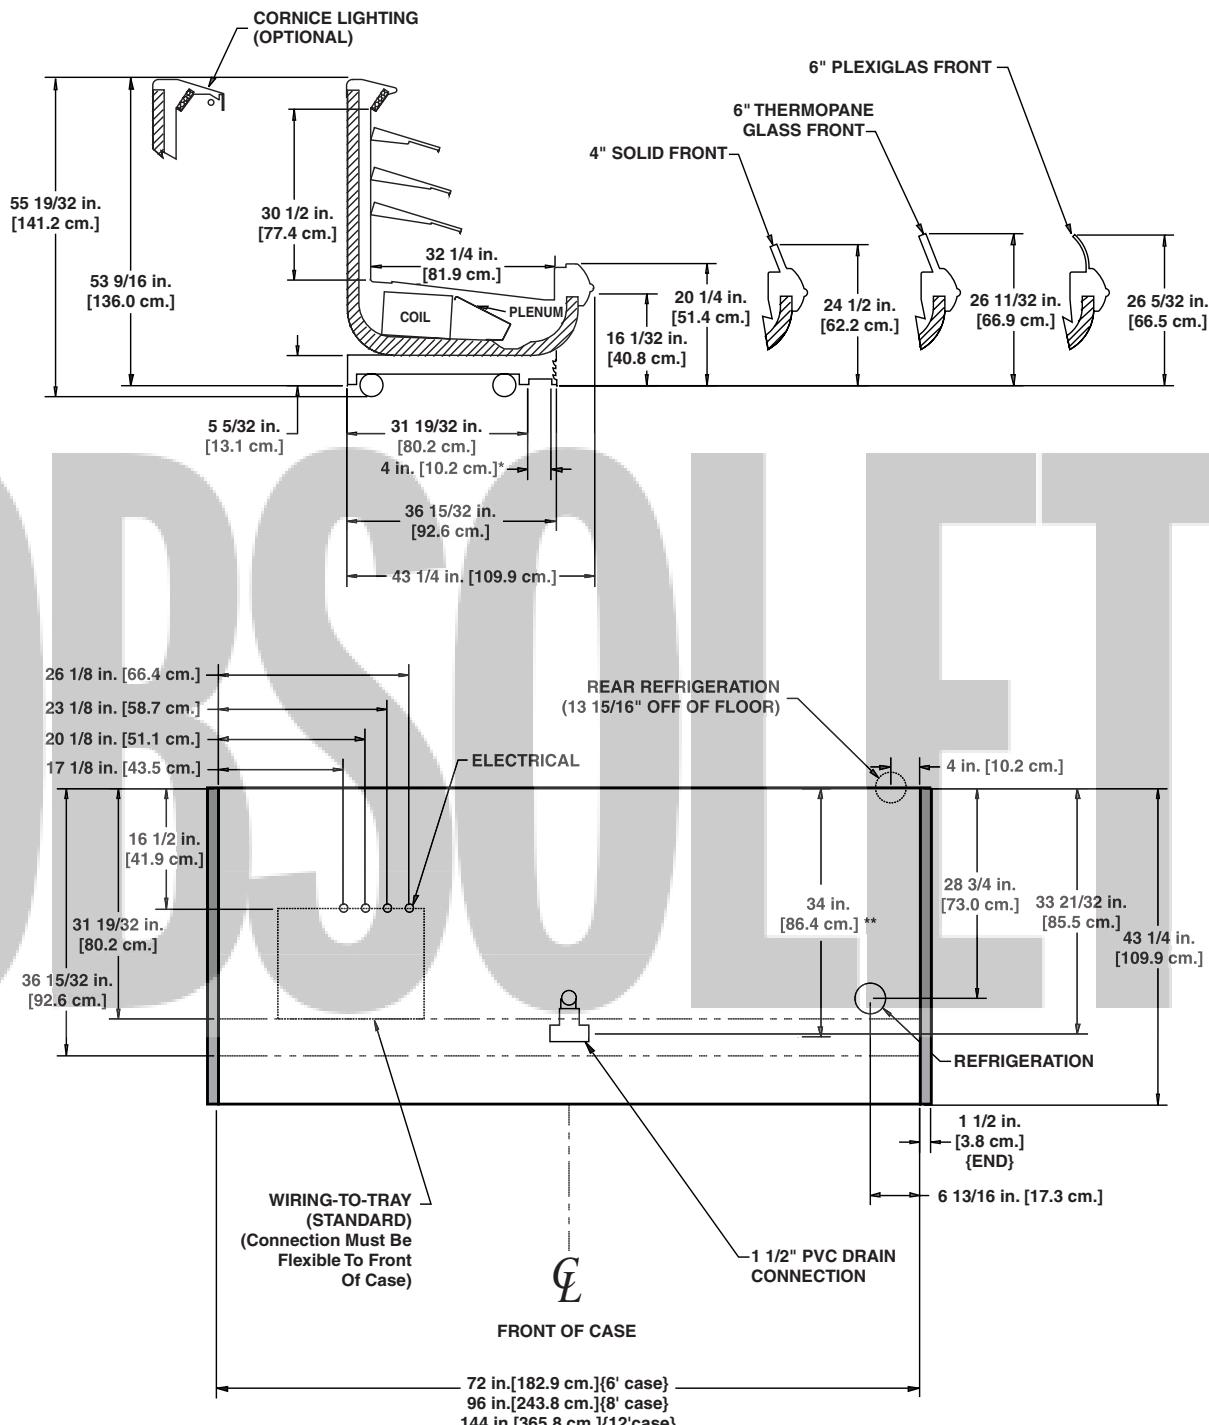


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

***(For additional rear sill options refer to the Merchandisers Accessories Guide)**

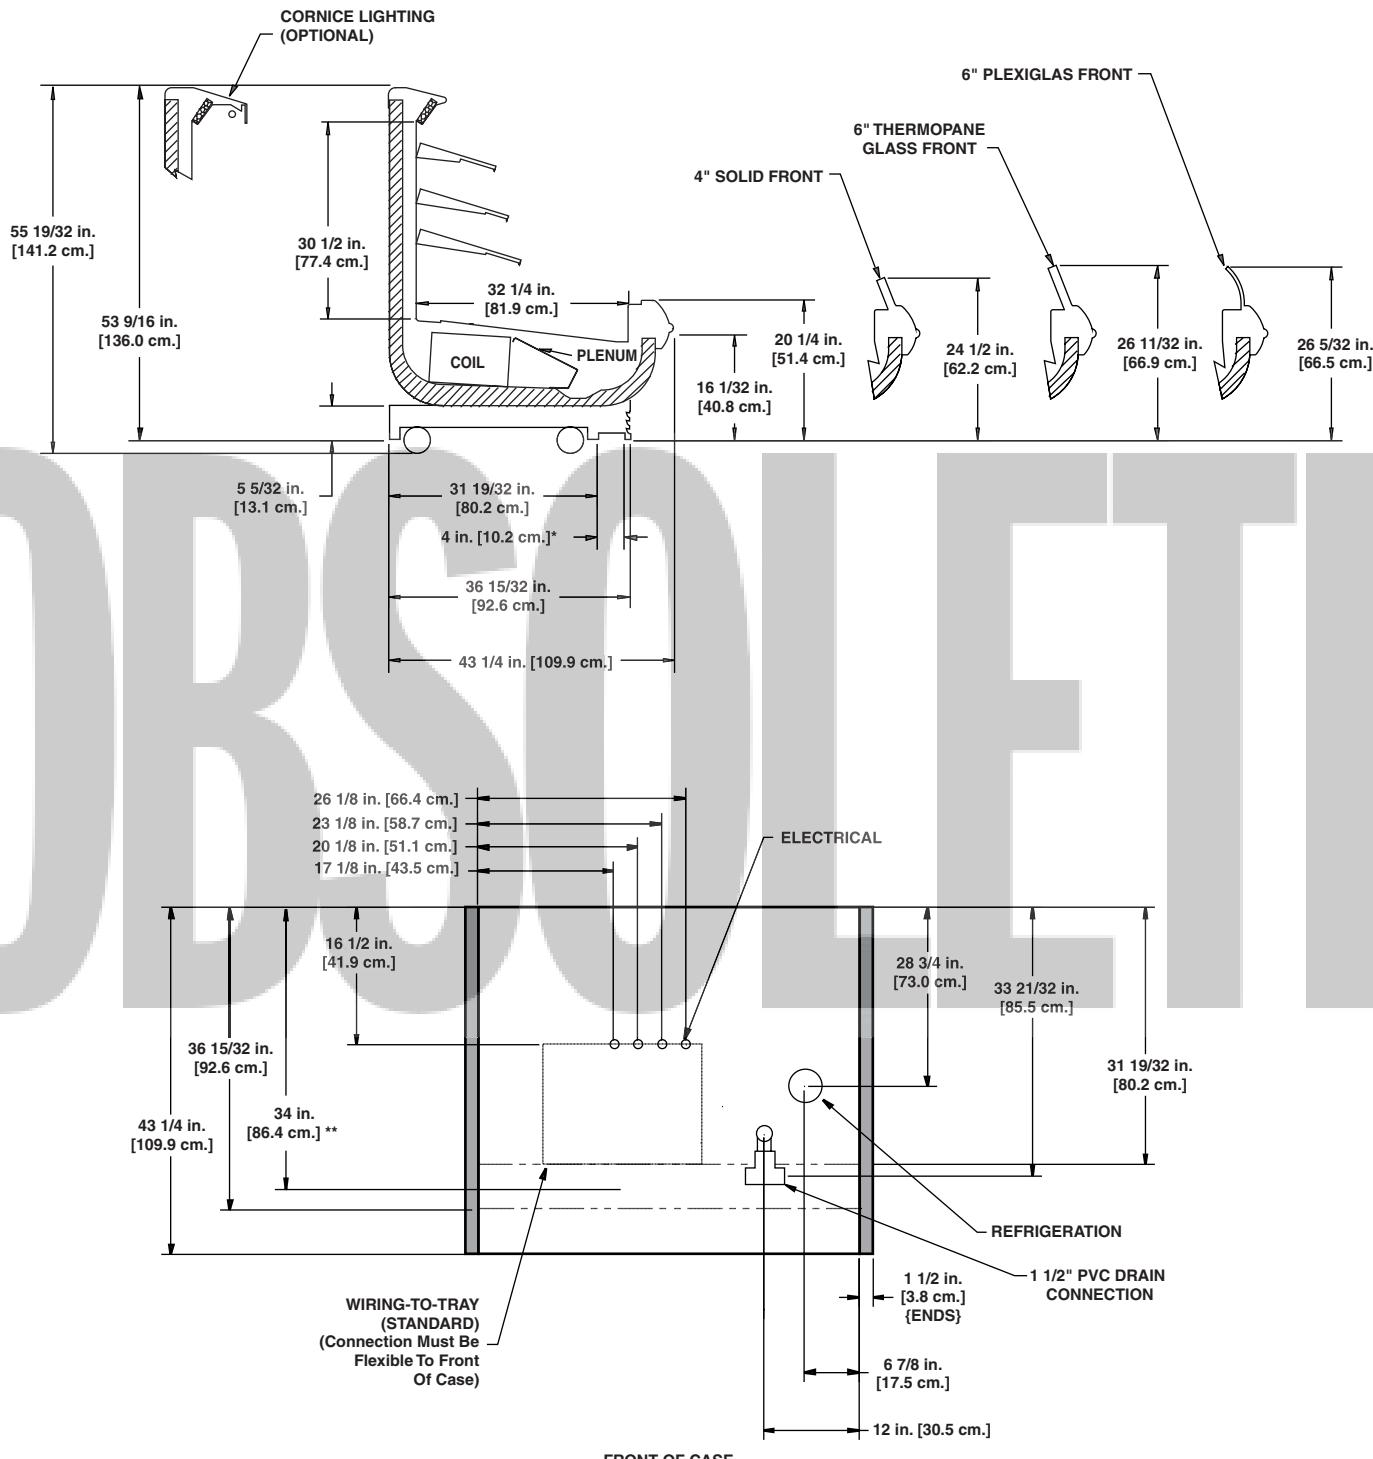

Multi-Deck Produce/Dairy/Deli Merchandiser

O3.5UD - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O3.5UD	4'	2	1.00	60	0.60	40	0.14	17	1.92	400	2.22	532
	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O3.5UD	4'	0.57	68	1.34	161
	6'	0.57	68	2.11	253
	8'	0.57	68	2.11	253
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
O3.5UD	18"	1300	17	6-8	30	36	45	300

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
O3.5UD	3	6 - 8	40	47	45	45	26	45	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

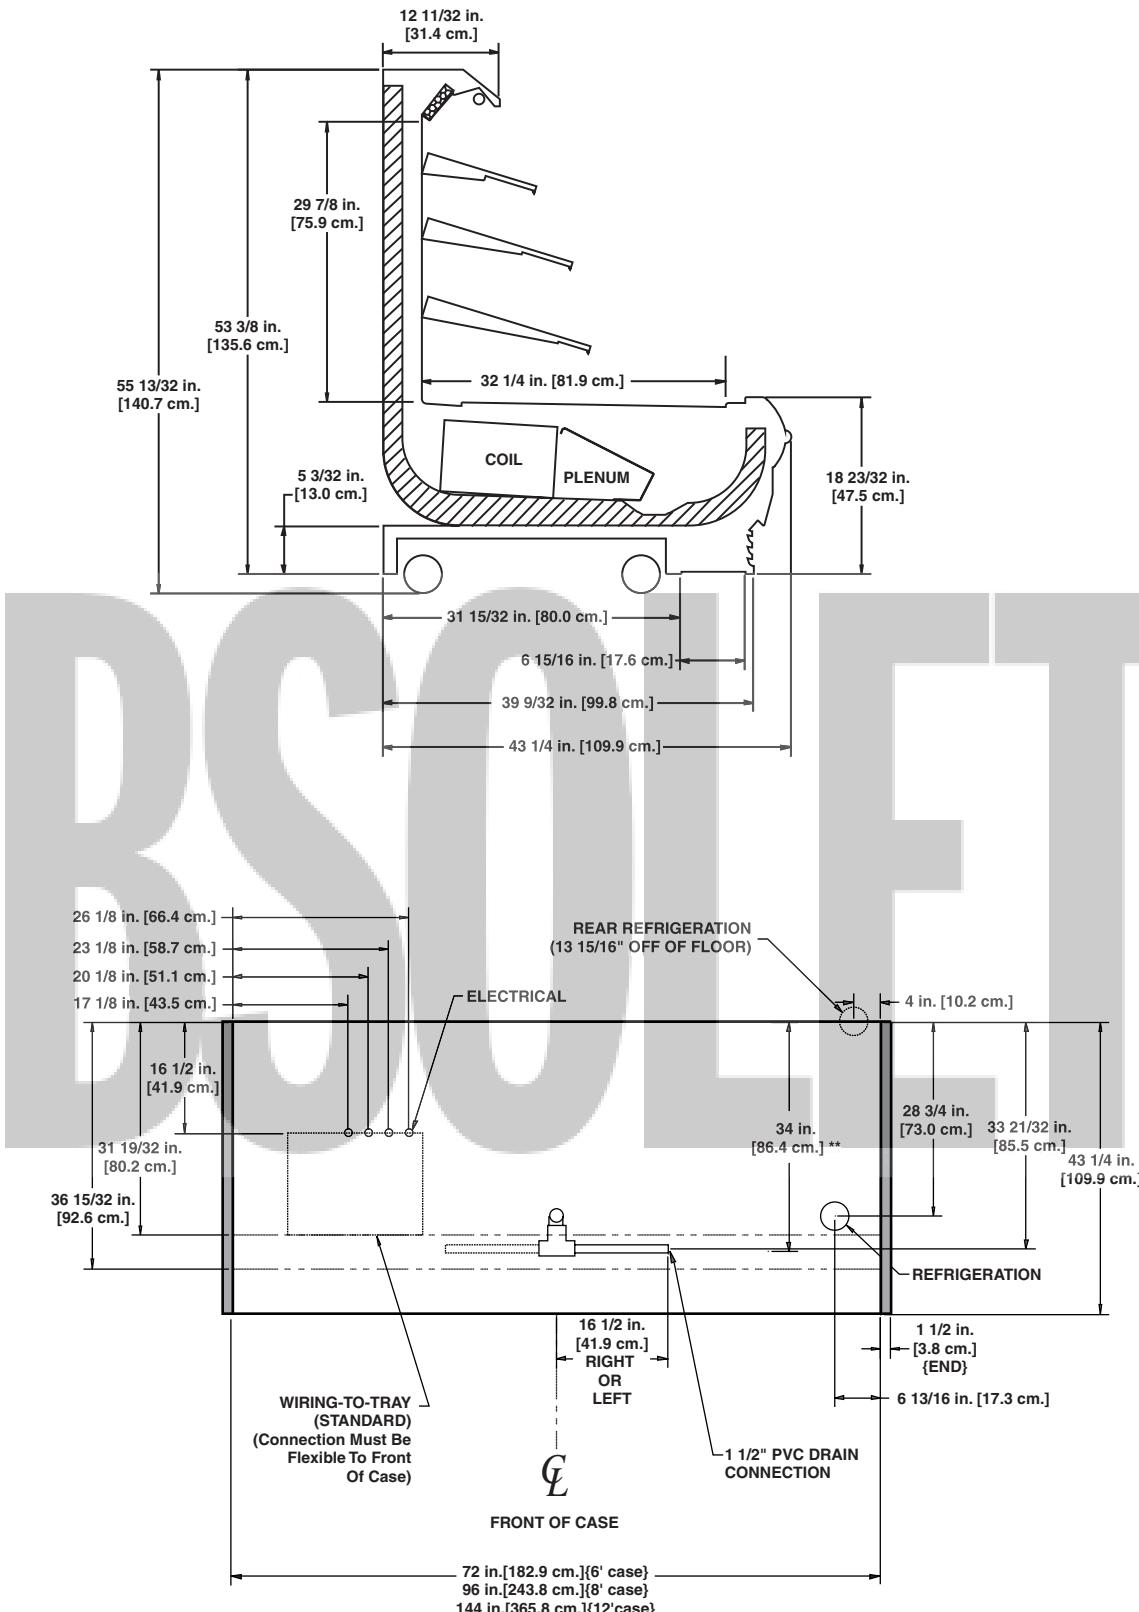

Multi-Deck Produce/Dairy/Deli Merchandiser

O4UM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O4UM	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O4UM	6'	0.57	68	3.03	364
	8'	0.57	68	3.03	364
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O4UM	33"	1460	17	6-8	30	36	43	300

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O4UM	4	6 - 8	40	47	45	45	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLLENCE IN
REFRIGERATION

A  DOVER DIVERSIFIED COMPANY

O4UM
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™


*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

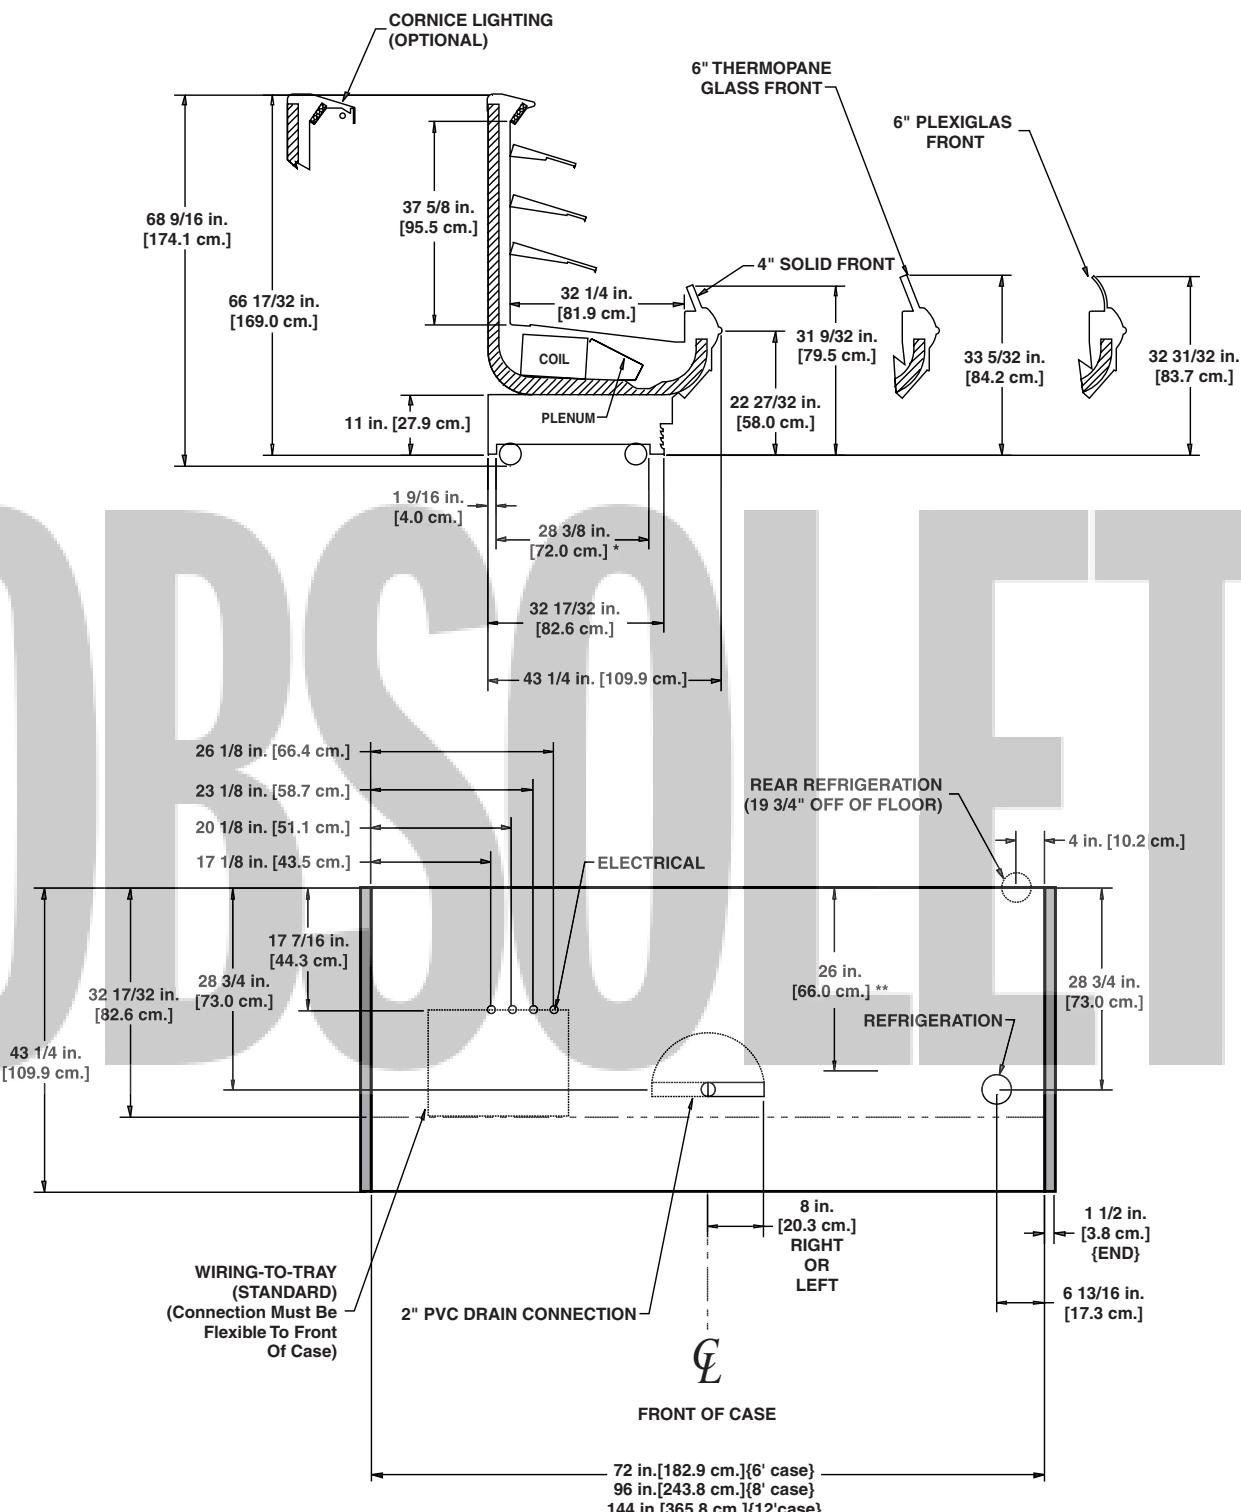

MULTI-DECK

Produce/Dairy/Deli

*** (For additional rear sill options refer to the Merchandisers Accessories Guide)**

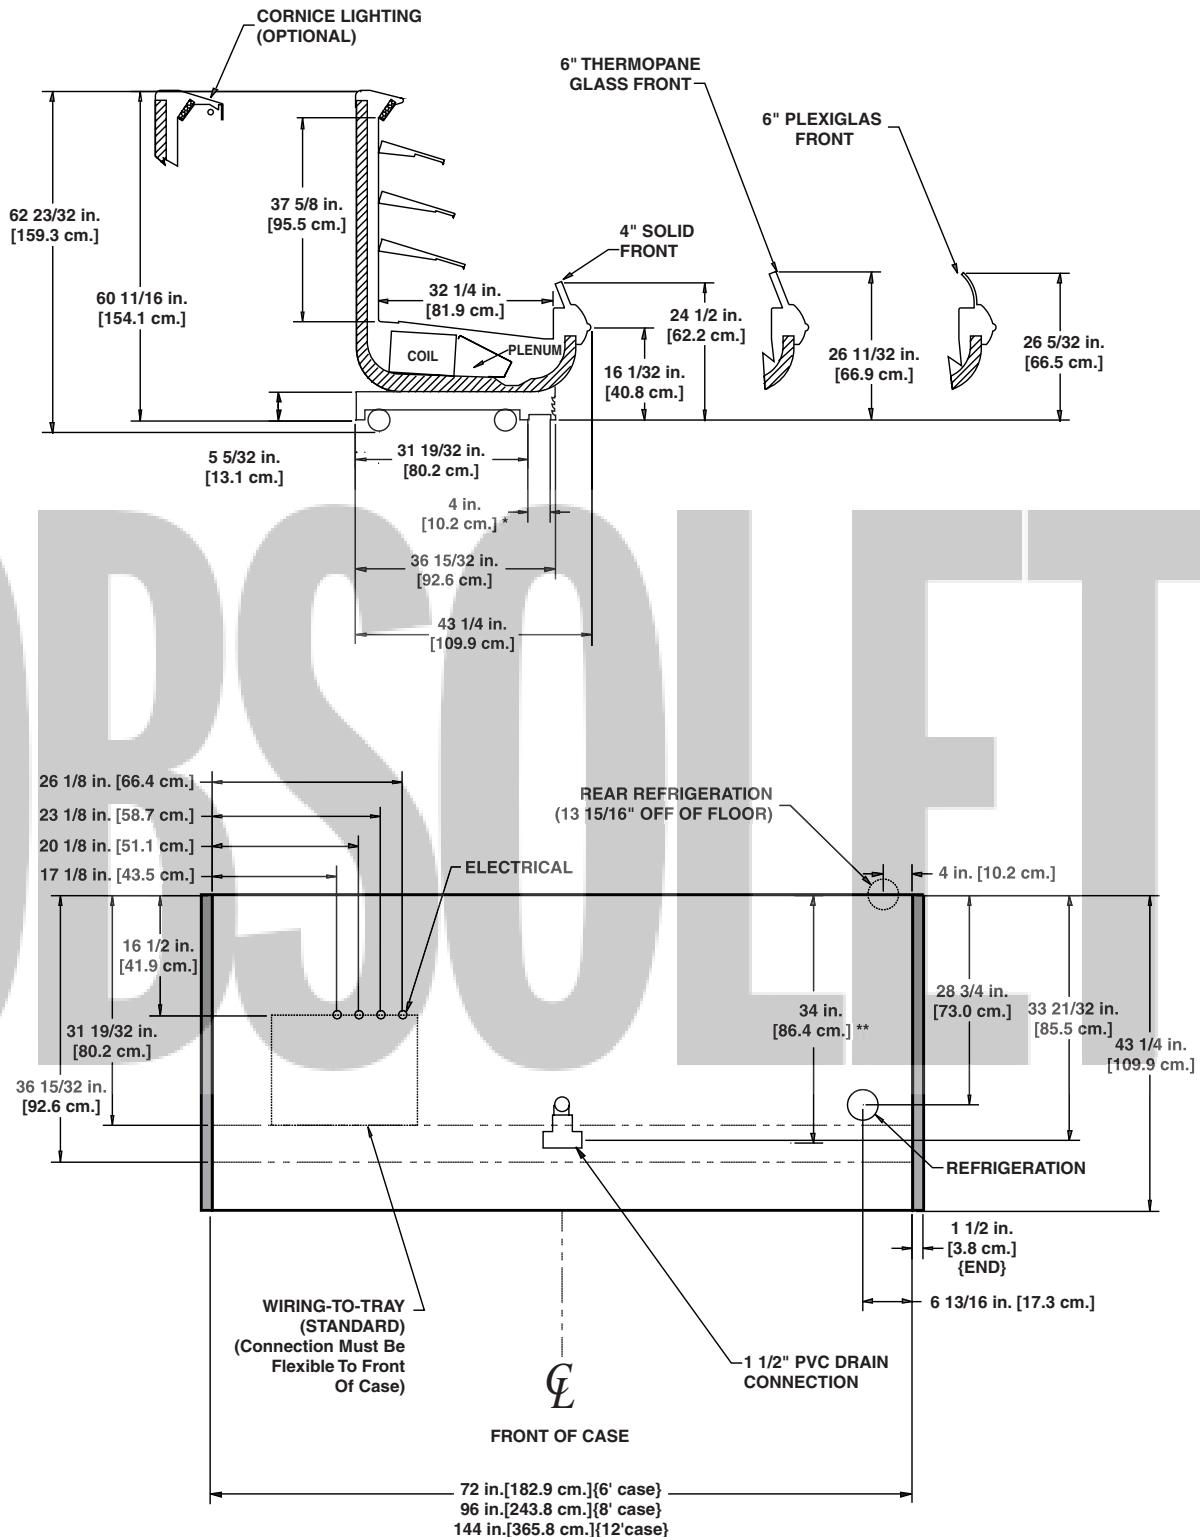

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

OBSCOLTE

Multi-Deck Produce/Dairy/Deli Merchandiser

O5UM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O5UM	6'	2	1.00	60	0.60	40	0.20 ¹	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25 ¹	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38 ¹	46	5.77	1200	6.67	1600

¹ Anti-condensate heater data for unlighted rear sill. For lighted rear sill, double the values.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O5UM	6'	0.57	68	3.33	400
	8'	0.57	68	3.33	400
	12'	0.77	92	5.07	608

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O5UM	33"	1490	17	6-8	30	35	42	300

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5UM	4	6 - 8	40	47	---	---	26	45	45	45

⁴ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

O5UM
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

*(For additional rear sill options refer to the
Merchandisers Accessories Guide)

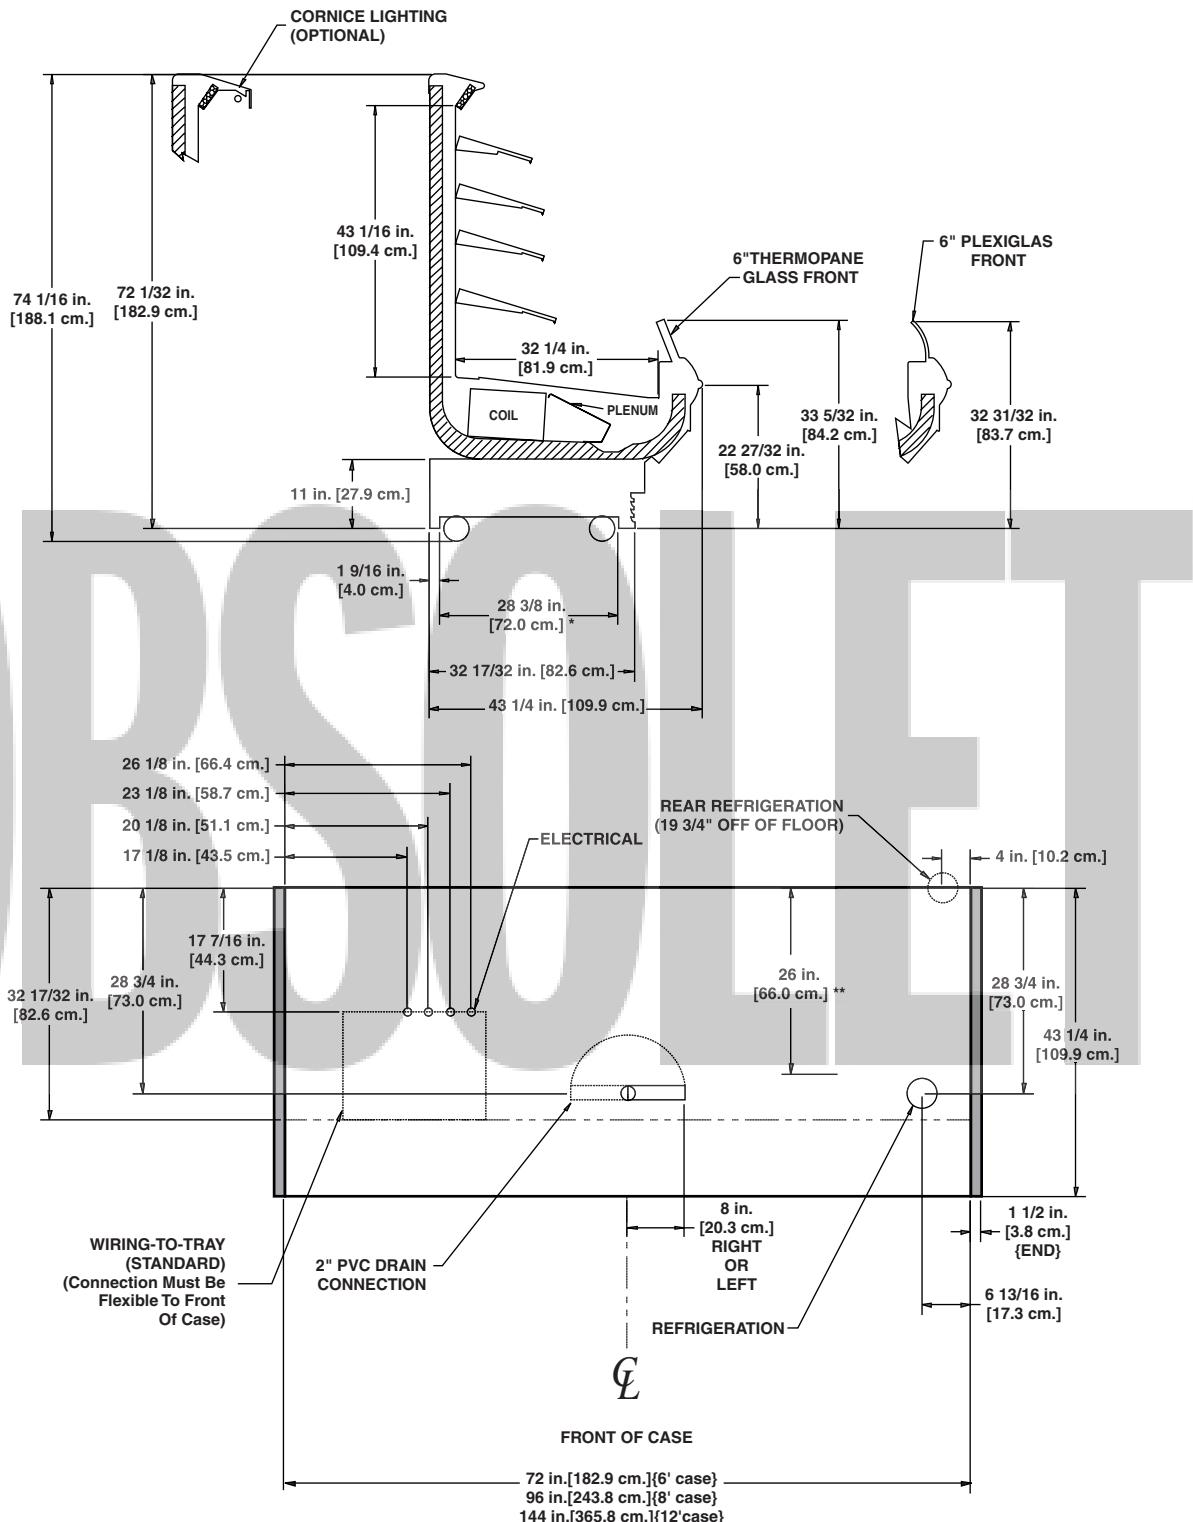

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

A DOVER DIVERSIFIED COMPANY

MULTI-DECK


Produce/Dairy/Deli

O5UM
(5 5/32" BASEFRAME)

HILL PHOENIXTM

E X C E L L E N C E

*****(For additional rear sill options refer to the
Merchandisers Accessories Guide)

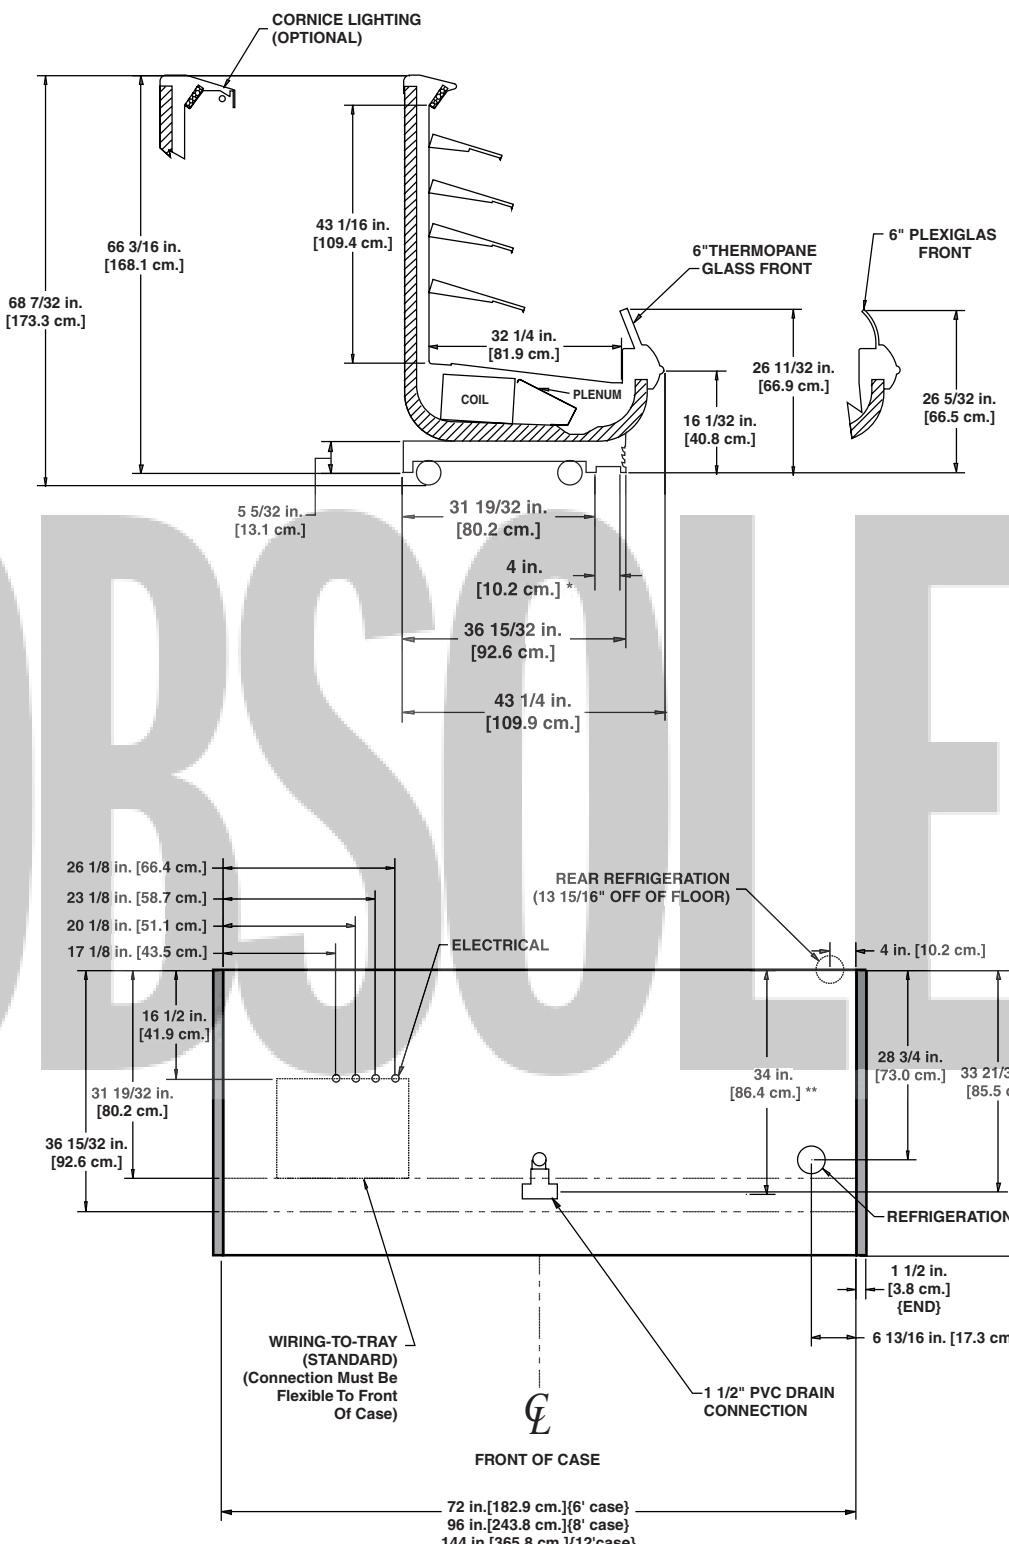

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE - 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

A DOVER DIVERSIFIED COMPANY

MULTI-DECK

Produce/Dairy/Deli

OBSCOLTE

Multi-Deck Produce/Dairy/Deli Merchandiser

O6UM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O6UM	6'	2	1.00	60	0.60	40	0.20	24	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	0.25	30	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	0.38	46	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O6UM	6'	0.57	68	3.33	400
	8'	0.57	68	3.33	400
	12'	0.77	92	5.07	608

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
O6UM	33"	1405	17	6-8	29	35	41	300

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O6UM	4	6 - 8	35	48	---	---	26	45	---	---

³ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

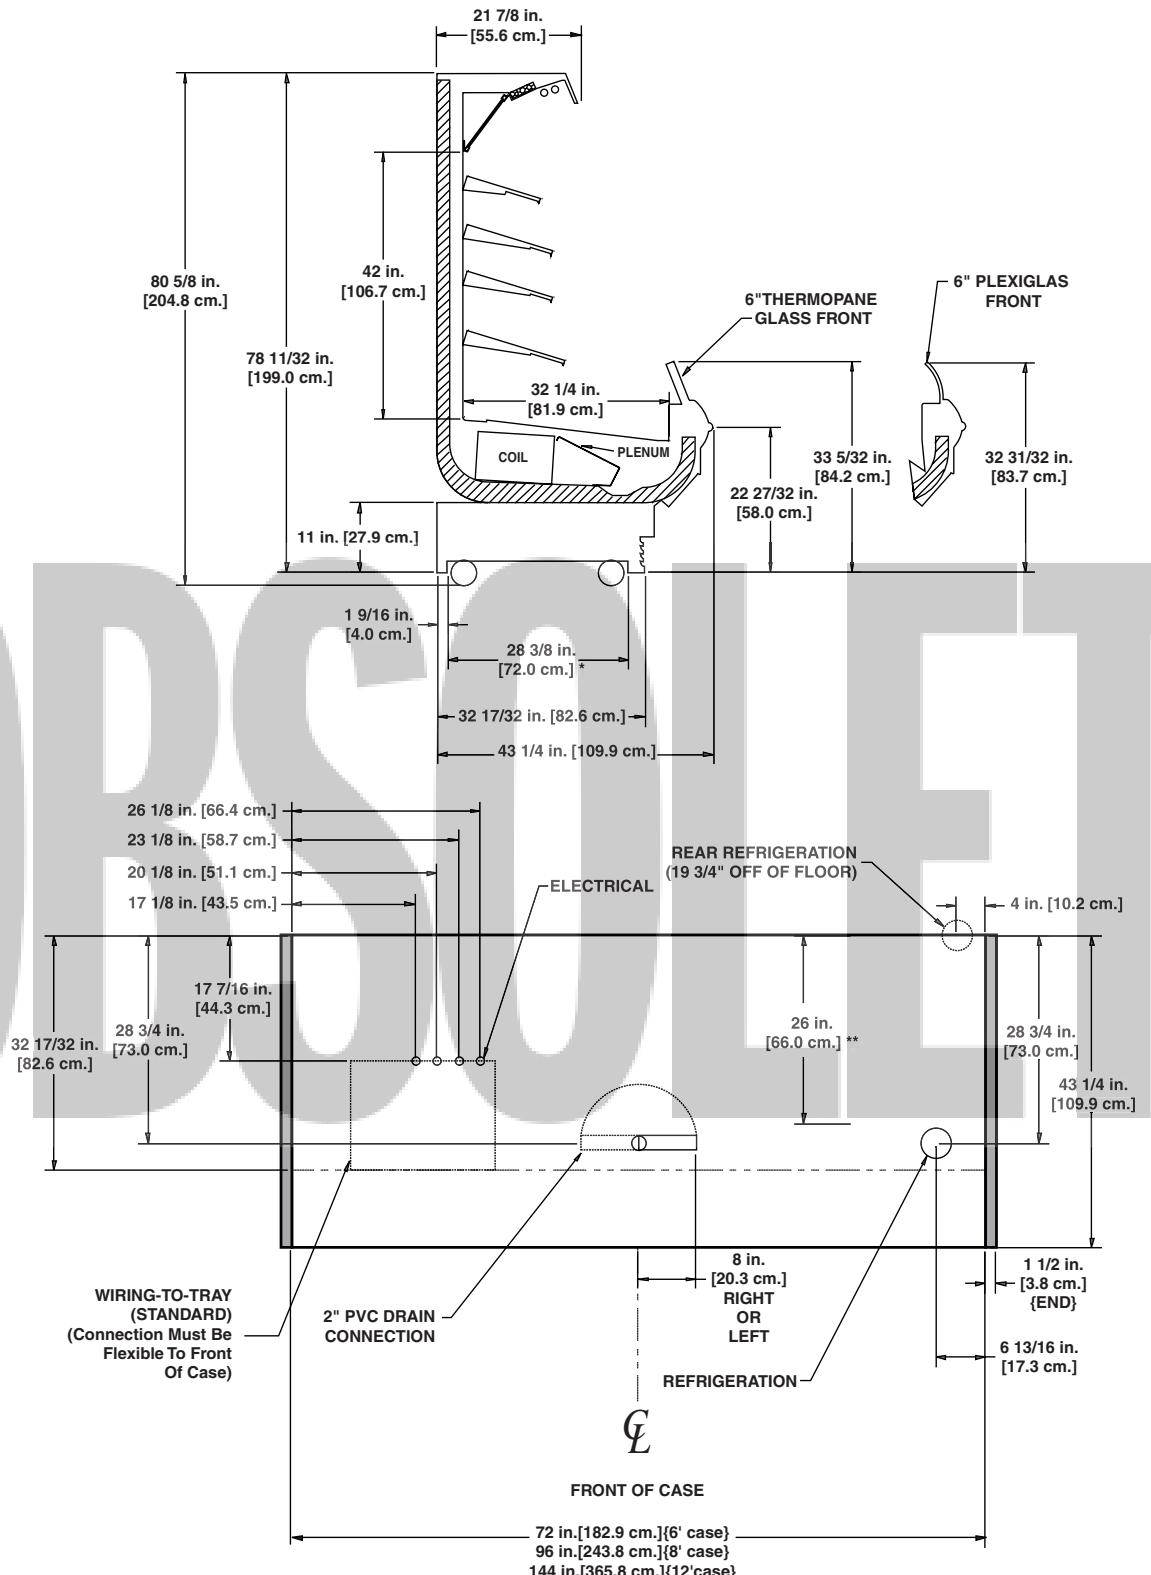

Narrow Multi-Deck Produce/Dairy Merchandiser

ON5DM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ON5DM	6'	3	1.50	90	1.50	51	- - - ¹	- - -	2.88	600	3.33	798
	8'	4	2.00	120	2.00	69	- - -	- - -	3.85	800	4.44	1065
	12'	5	2.50	150	2.50	85	- - -	- - -	5.77	1200	6.67	1600

¹ NOTE: - - - not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ON5DM	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ON5DM Dairy	18"	1815	17	6-8	32	35	47	215
	21"	1770	17	6-8	31	34	44	215
	27"	1685	17	6-8	31	33	40	215
ON5DM Produce Beverage	18"	1670	27	6-8	37	39	53	215
	21"	1628	27	6-8	36	38	52	215
	27"	1550	27	6-8	36	37	52	215

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.


Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ON5DM	4	6 - 8	32	47	42	47	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

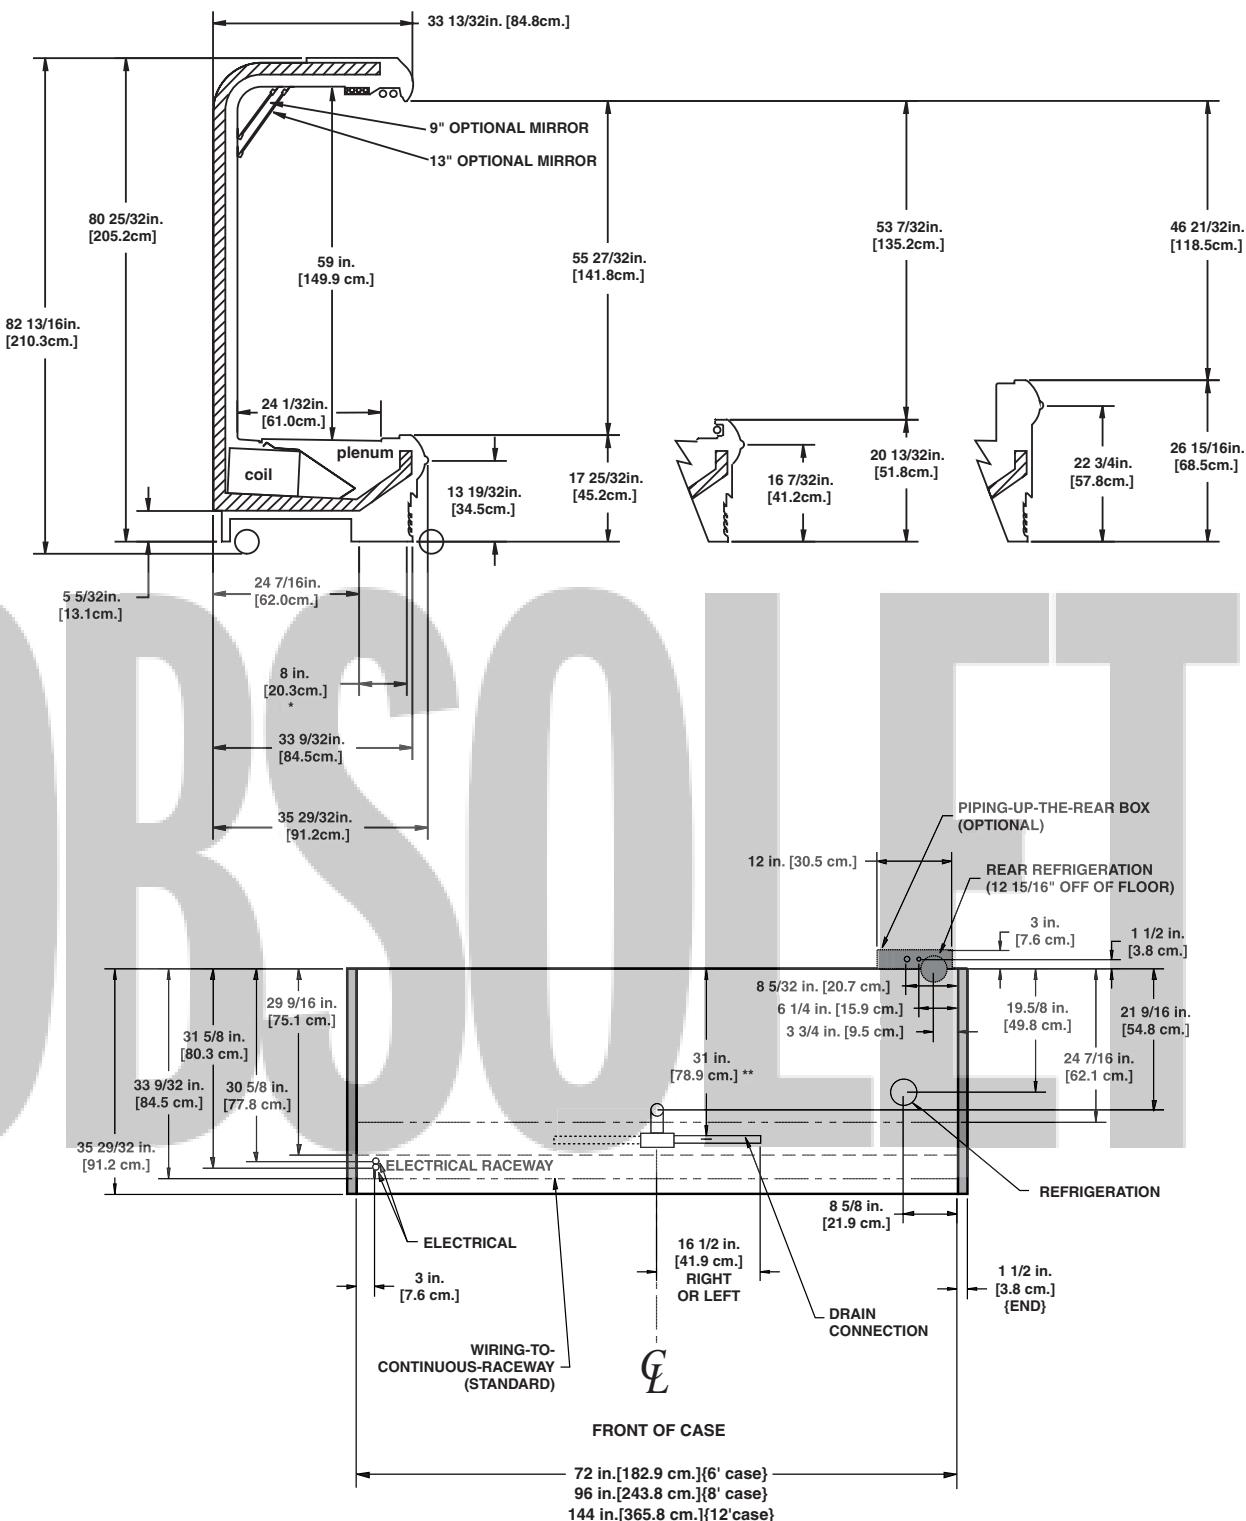

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
(WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", & 18"

Multi-Deck Produce/Dairy/Deli Merchandiser

O5DM - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5DM	4'	2	1.00	60	1.00	34	---	1.92	400	2.22	532
	6'	2	1.00	60	1.00	34	---	2.88	600	3.33	798
	8'	3	1.50	90	1.50	51	---	3.85	800	4.44	1065
	12'	4	2.00	120	2.00	69	---	5.77	1200	6.67	1600

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O5DM	4'	0.57	68	3.55	426
	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O5DM Deli w/ Shelf Lights	21"	1570	17	6-8	30	35	44	270
	23"	1530	17	6-8	30	34	44	270
	26"	1500	17	6-8	30	33	44	270
O5DM Dairy/Cut Produce w/ Shelf Lights	18"	1500	22	6-8	34	37	47	270
	21"	1460	22	6-8	34	36	47	270
	23"	1430	22	6-8	34	36	47	270
	26"	1400	22	6-8	34	36	47	270
O5DM Beverage/Bulk Produce w/o Shelf Lights	18"	1490	27	6-8	36	39	52	270
	21"	1450	27	6-8	36	38	52	270
	23"	1420	27	6-8	36	38	52	270
	26"	1390	27	6-8	36	38	52	270

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5DM	3	6 - 8	32	47	42	47	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENE

A DOVER DIVERSIFIED COMPANY

MULTI-DECK

Produce/Dairy/Deli

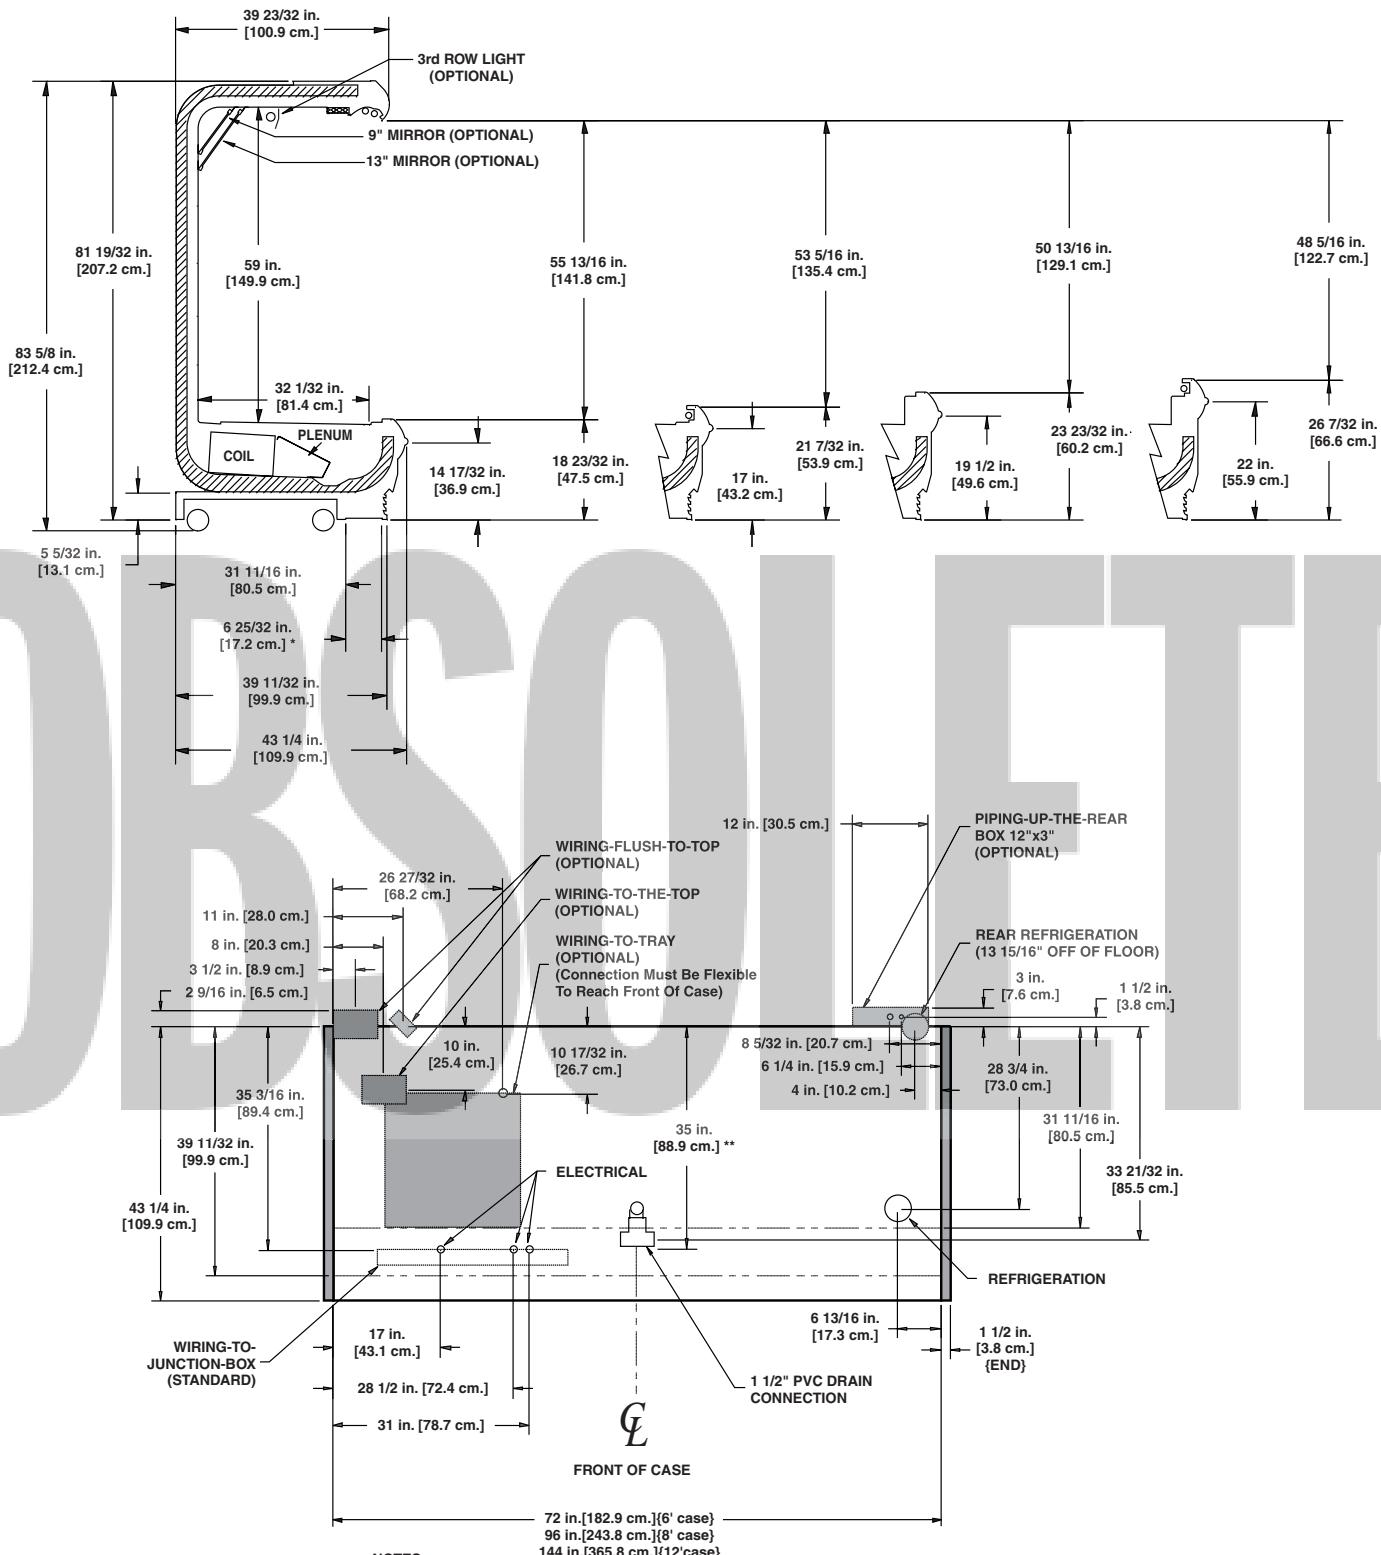

NOTES.


* STUB-UP AREA
** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

A DOVER DIVERSIFIED COMPANY

O5DM
(CURVED FRONT PANEL)


HILL PHOENIXTM

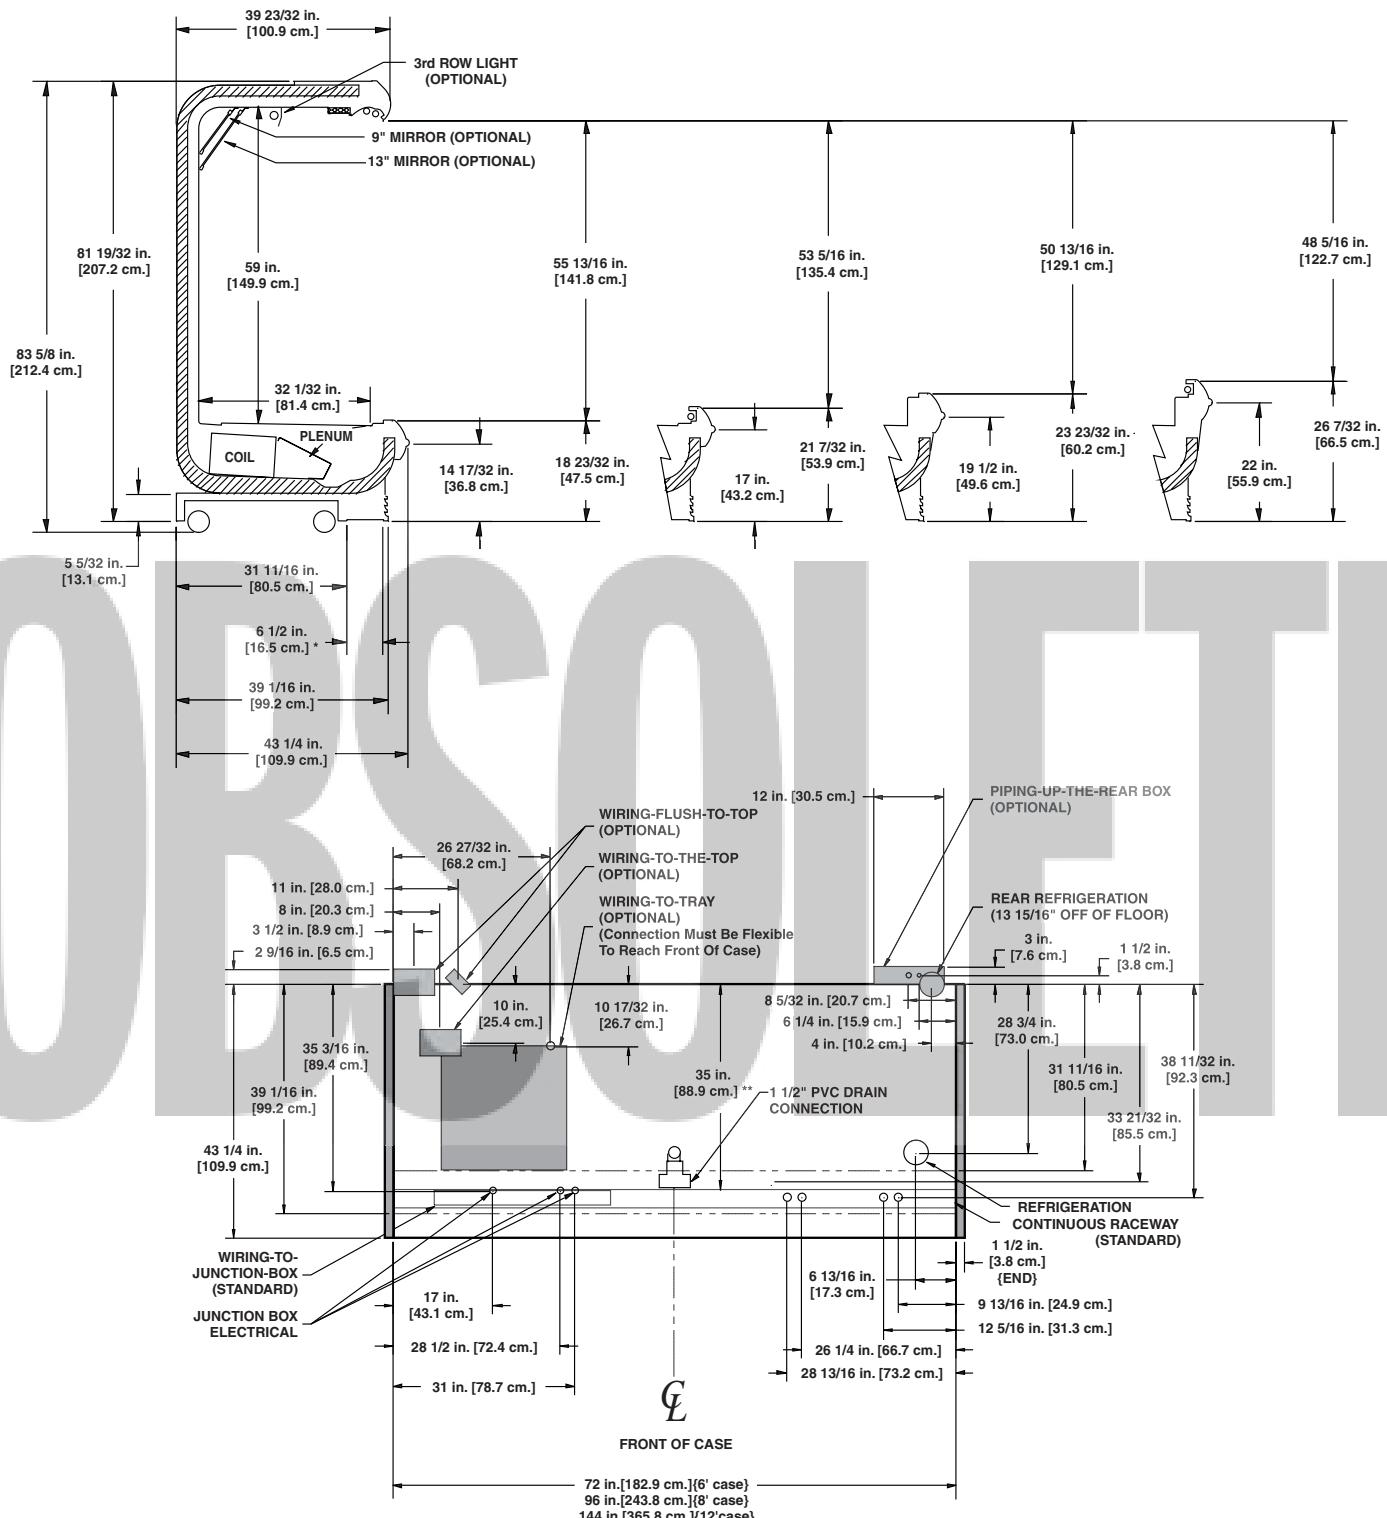

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS
- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

MULTI-DECK

Produce/Dairy/Deli

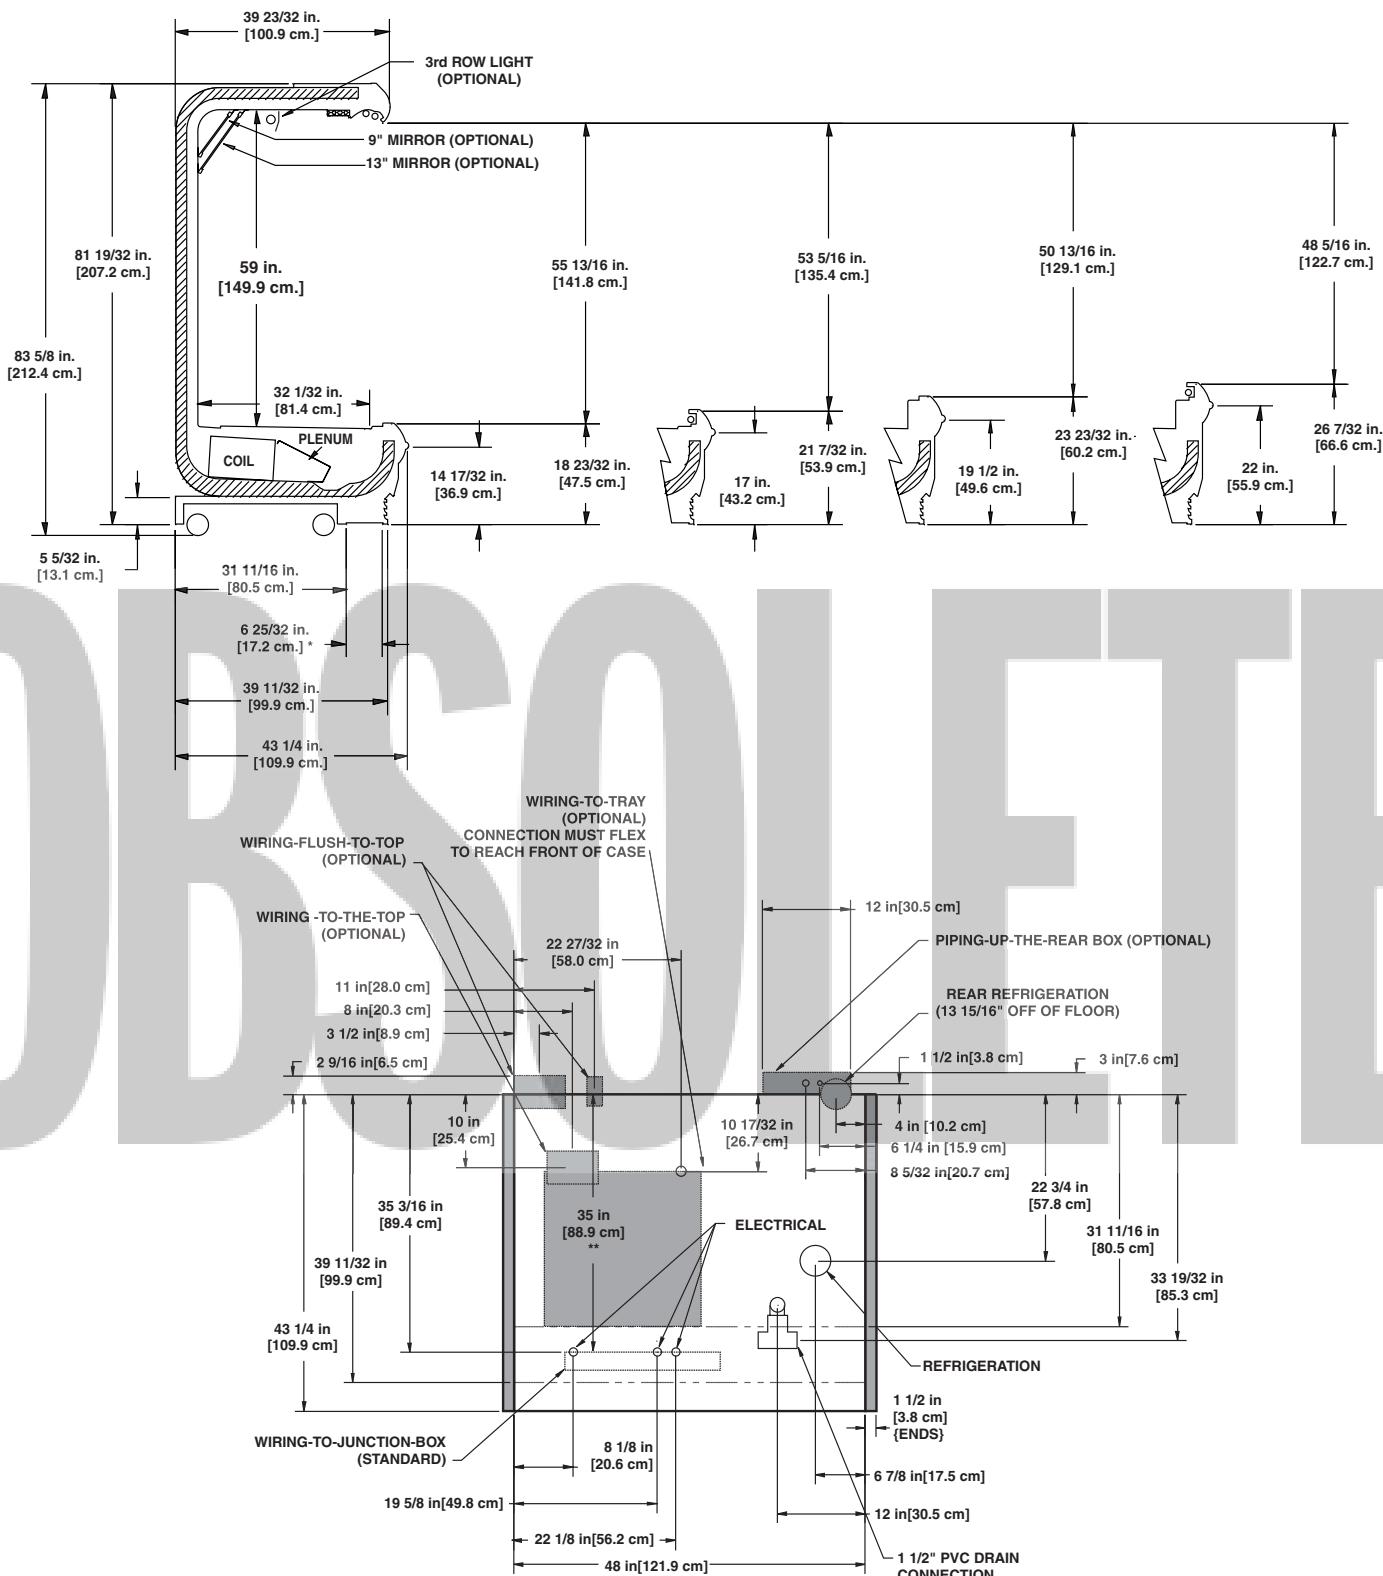

NOTES: **FRONT OF CASE**

* STUB-UP AREA


**** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS**

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - WIRING-TO-THE-TOP - ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
(WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

A  DOVER DIVERSIFIED COMPANY

O5DM-4'
(CURVED FRONT PANEL)

HILL PHOENIXTM
 EXCELENE

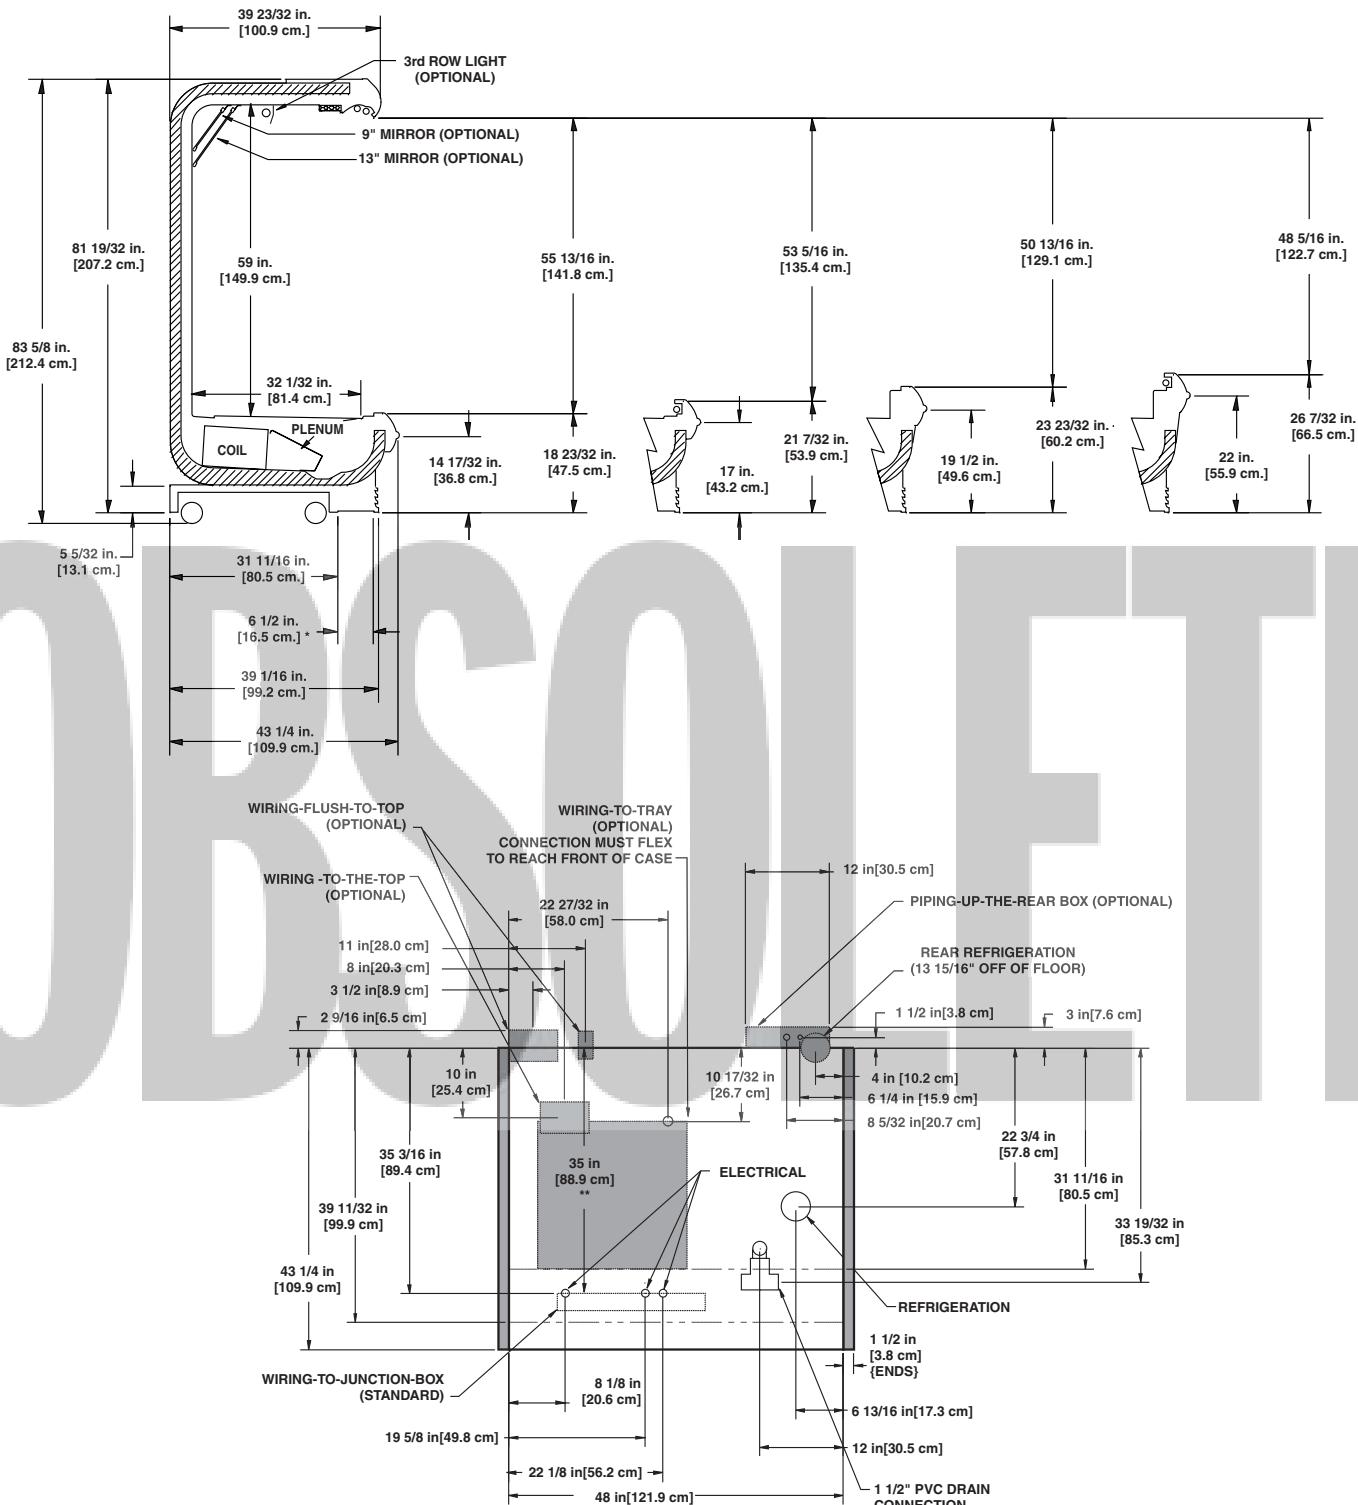

NOTES:

FRONT OF CASE

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS


- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

O5DM
(PRODUCE CONVERSION)

HILL PHOENIX
EXCELLENCE™

MULTI-DECK

Produce/Dairy/Deli

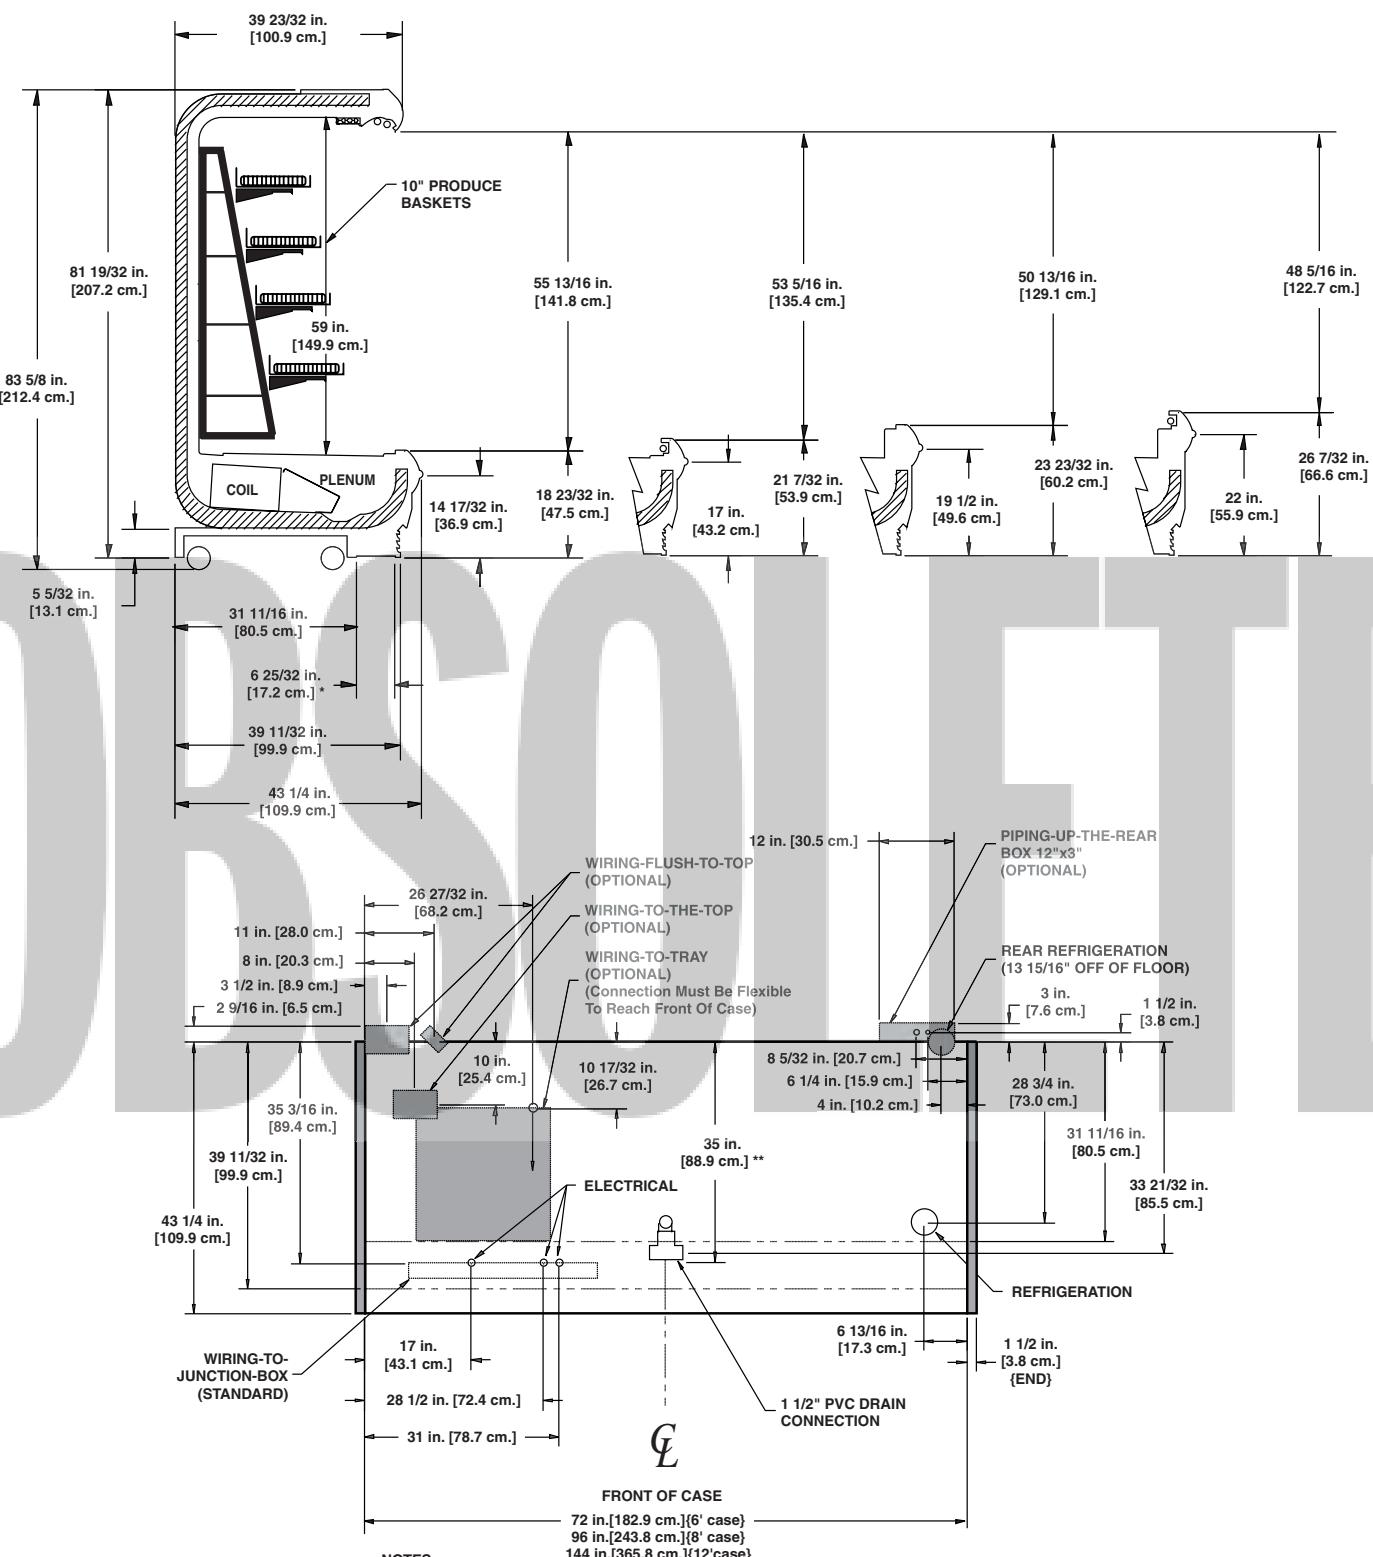

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO PORT 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

High Multi-Deck Produce/Dairy/Deli Merchandiser

O5DMH - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5DMH	4'	2	1.00	60	1.00	34	---	1.92	400	2.22	532
	6'	3	1.50	90	1.50	51	---	2.88	600	3.33	798
	8'	4	2.00	120	2.00	69	---	3.85	800	4.44	1065
	12'	5	2.50	150	2.50	85	---	5.77	1200	6.67	1600

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O5DMH	4'	0.57	68	3.55	426
	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O5DMH Deli	21"	1620	17	6-8	31	35	43	250
	23"	1570	17	6-8	31	34	43	250
	26"	1540	17	6-8	31	34	43	250
O5DMH Dairy Cut Produce	18"	1555	22	6-8	35	37	47	265
	21"	1500	22	6-8	35	37	47	265
	23"	1470	22	6-8	35	37	47	265
	26"	1440	22	6-8	35	37	47	265

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5DMH	3	6 - 8	32	47	42	47	26	45

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

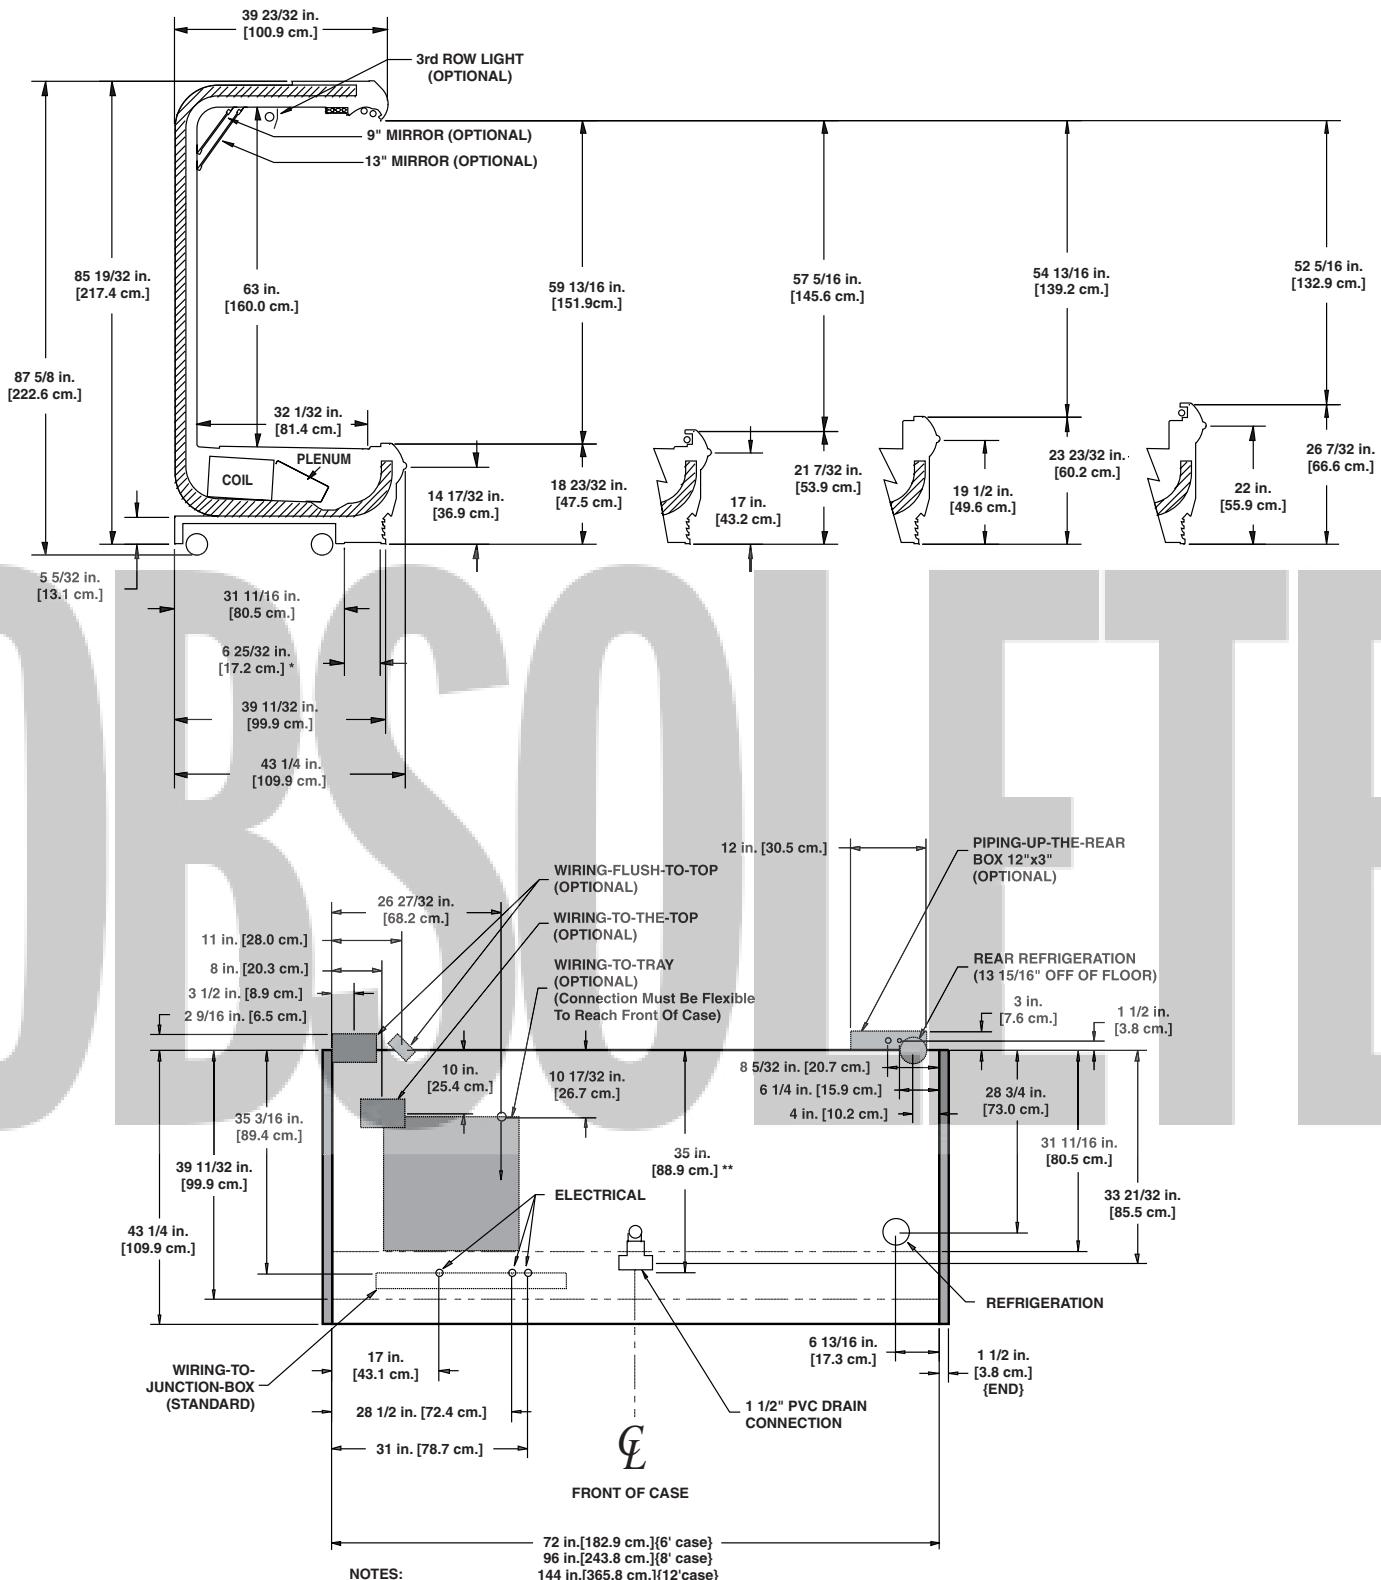


- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

O5DMH
(CURVED FRONT PANEL)

Hill PHOENIX™


E X C E L L E N C E

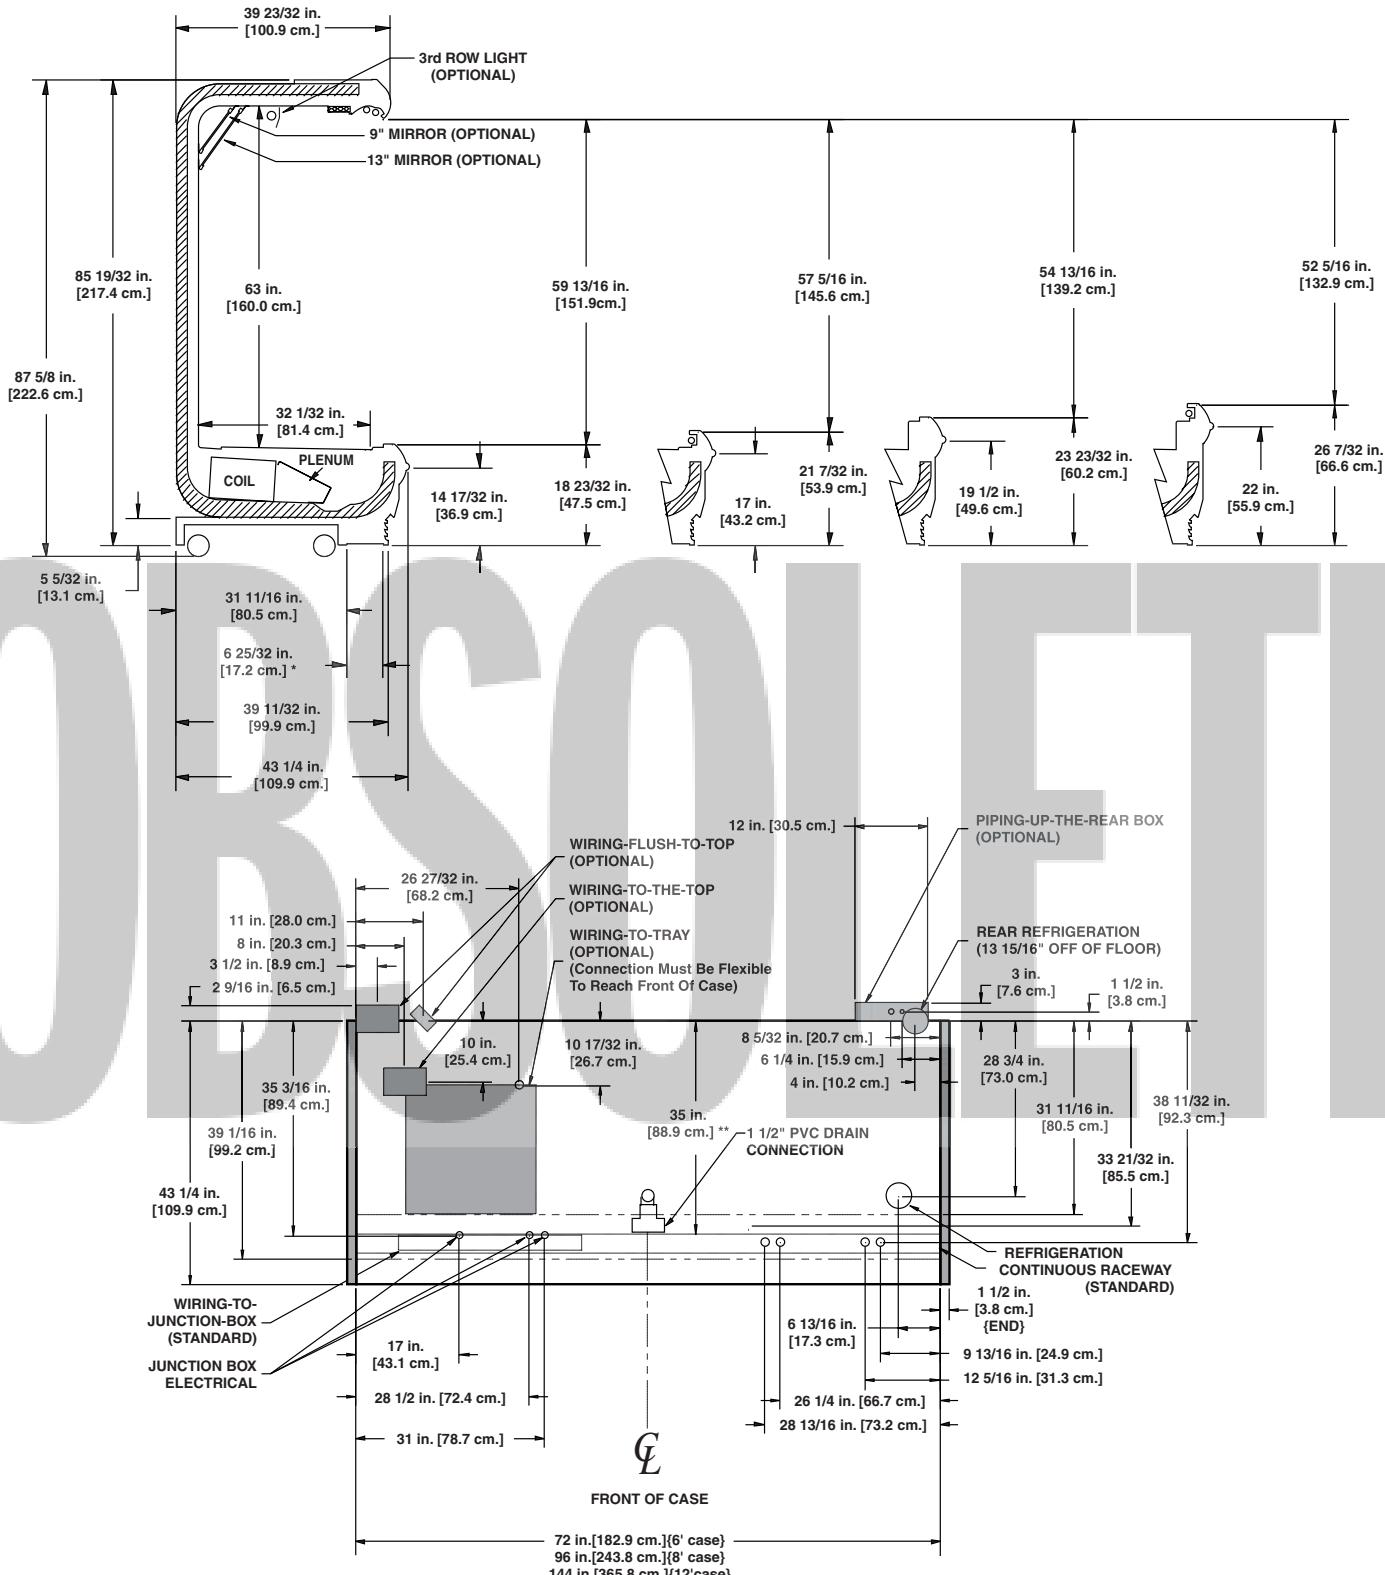

NOTES:

- * STUB-UP AREA
 - ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS
 - ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
 - WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
 - A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL. (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
 - BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
 - SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
 - AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

A DOVER DIVERSIFIED COMPANY

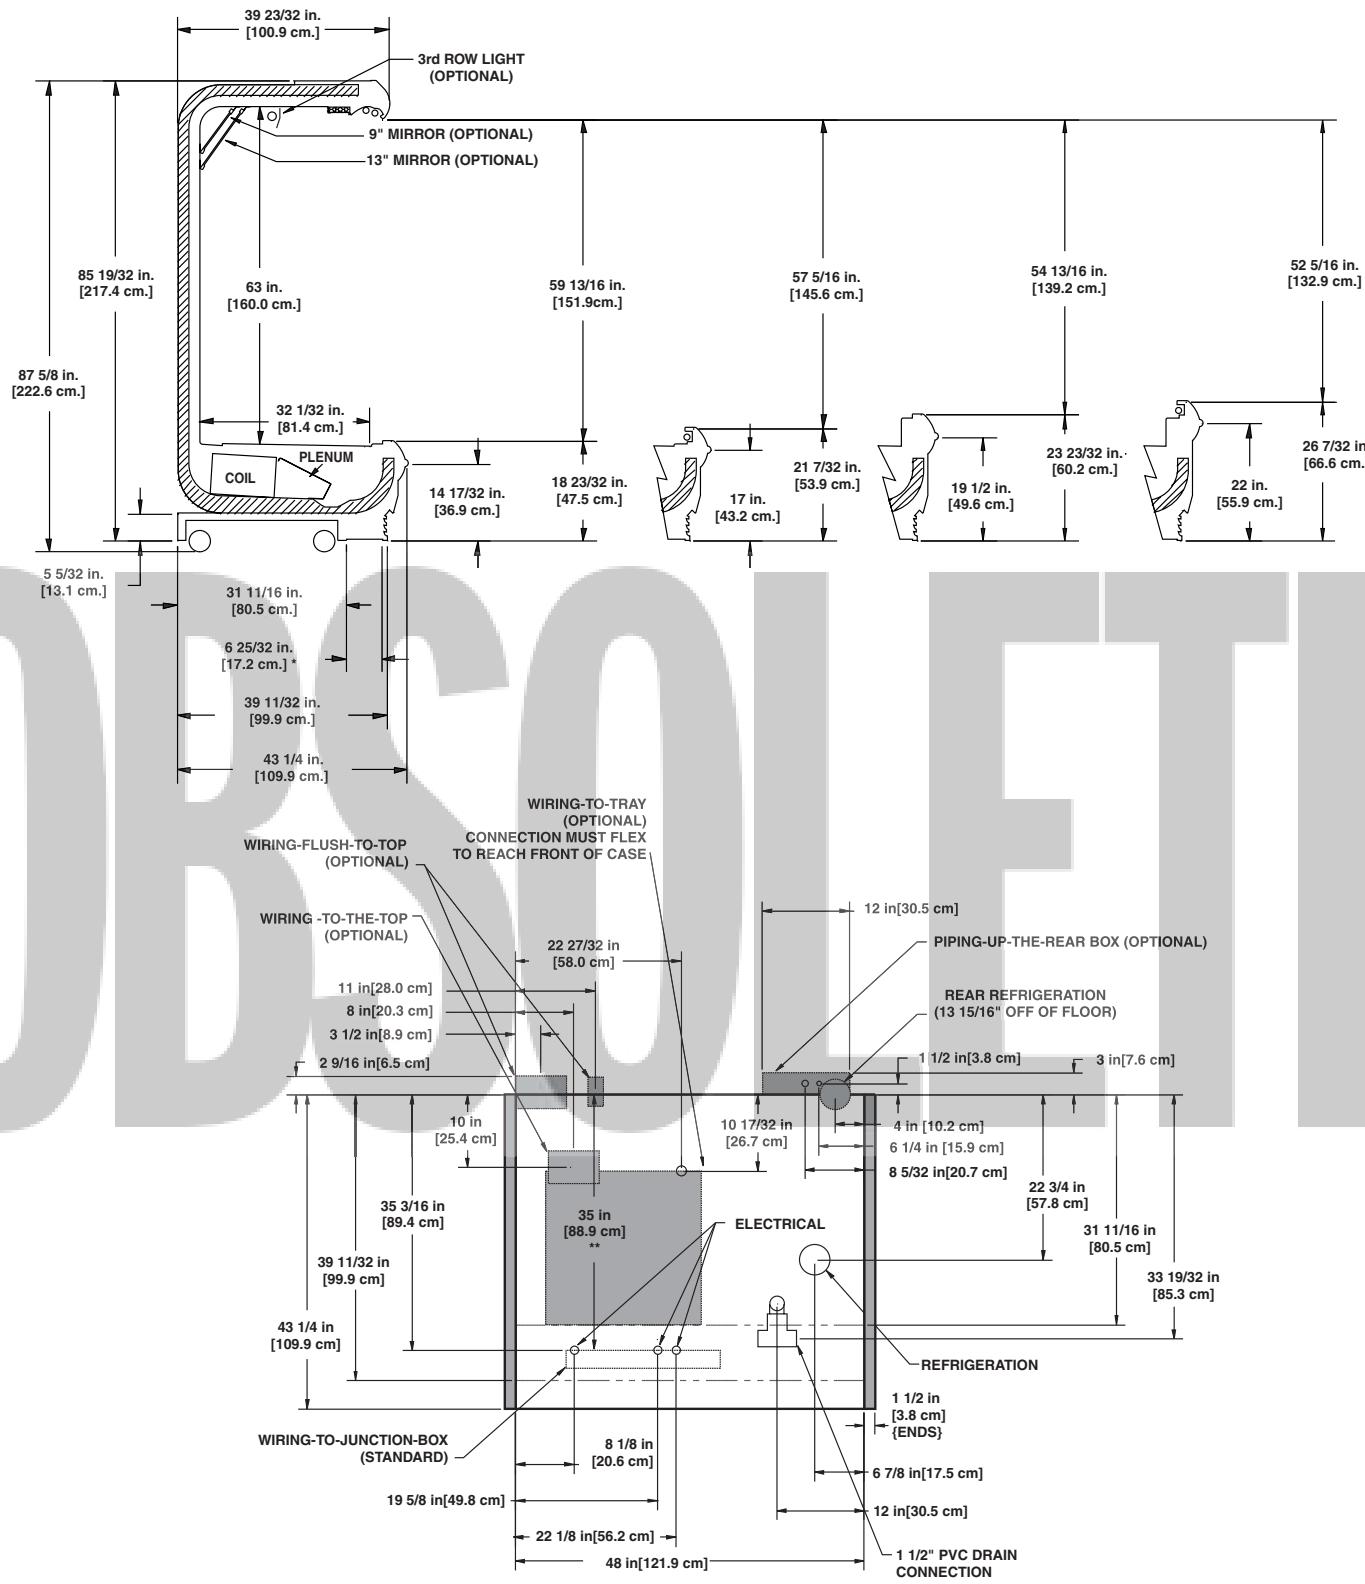

NOTES:

FRONT OF CASE

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

Multi-Deck Rear Load Dairy Merchandiser

O5DR - 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O5DR	8'	4	2.00	120	2.00	69	- - - ¹	- - -	3.85	800	4.44	1065
	12'	5	2.50	150	2.50	85	- - -	- - -	5.78	1200	6.67	1600

¹ NOTE: - - - not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O5DR	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O5DR Dairy	18"	1502	17	6-8	32	36	47	275
	21"	1502	17	6-8	32	36	46	275
	23"	1453	17	6-8	32	35	42	275
	26"	1425	17	6-8	32	35	42	275
O5DR Dairy	21"	1389	22	6-8	35	37	48	275
	23"	1422	22	6-8	35	37	47	275

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost		
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	
O5DR	4	6 - 8	32	47	45	47	26	45	42	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
REFRIGERATION

A  DOVER DIVERSIFIED COMPANY

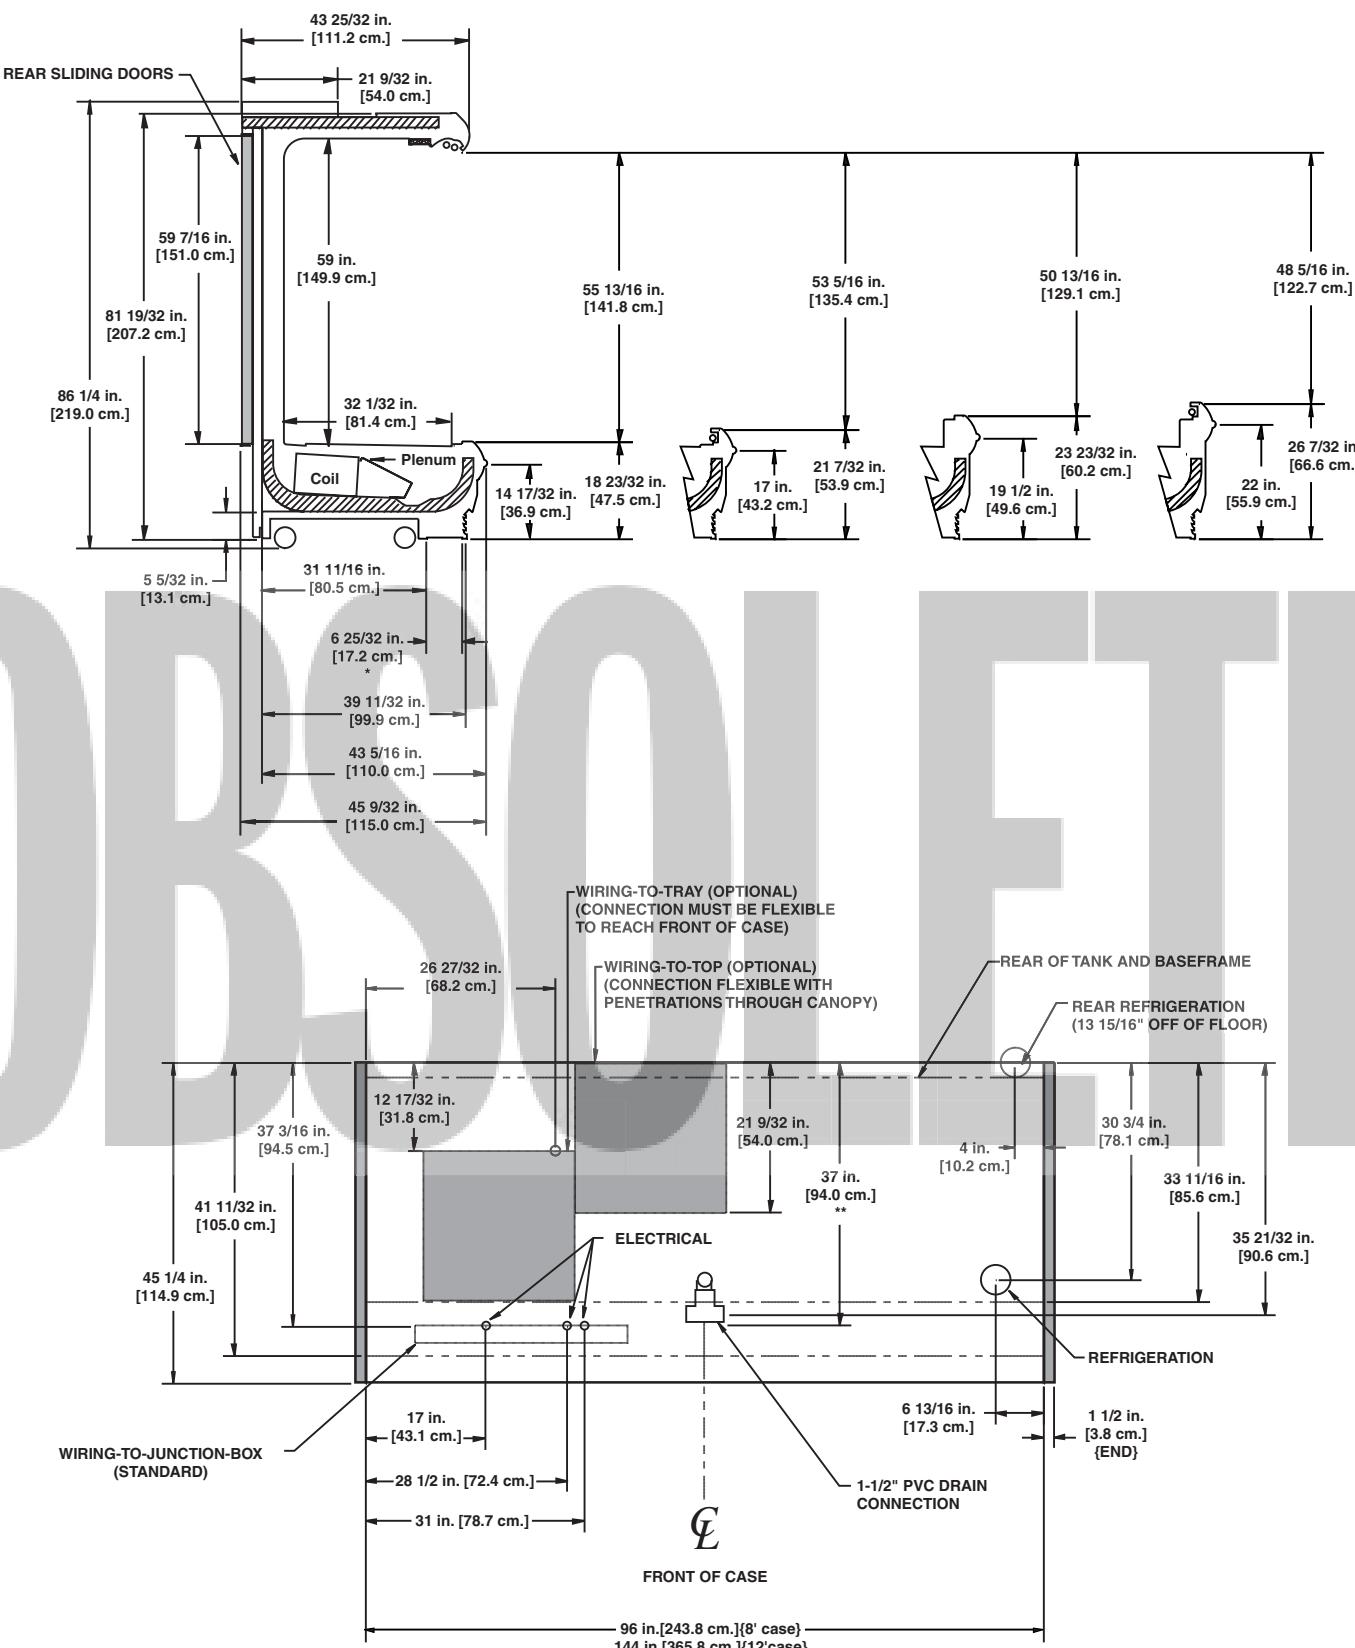


NOTES:

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SUCTION LINE 7/8", LIQUID LINE - 3/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

O5DR
(CURVED FRONT PANEL)

HILL PHOENIX™
EXCELLERON

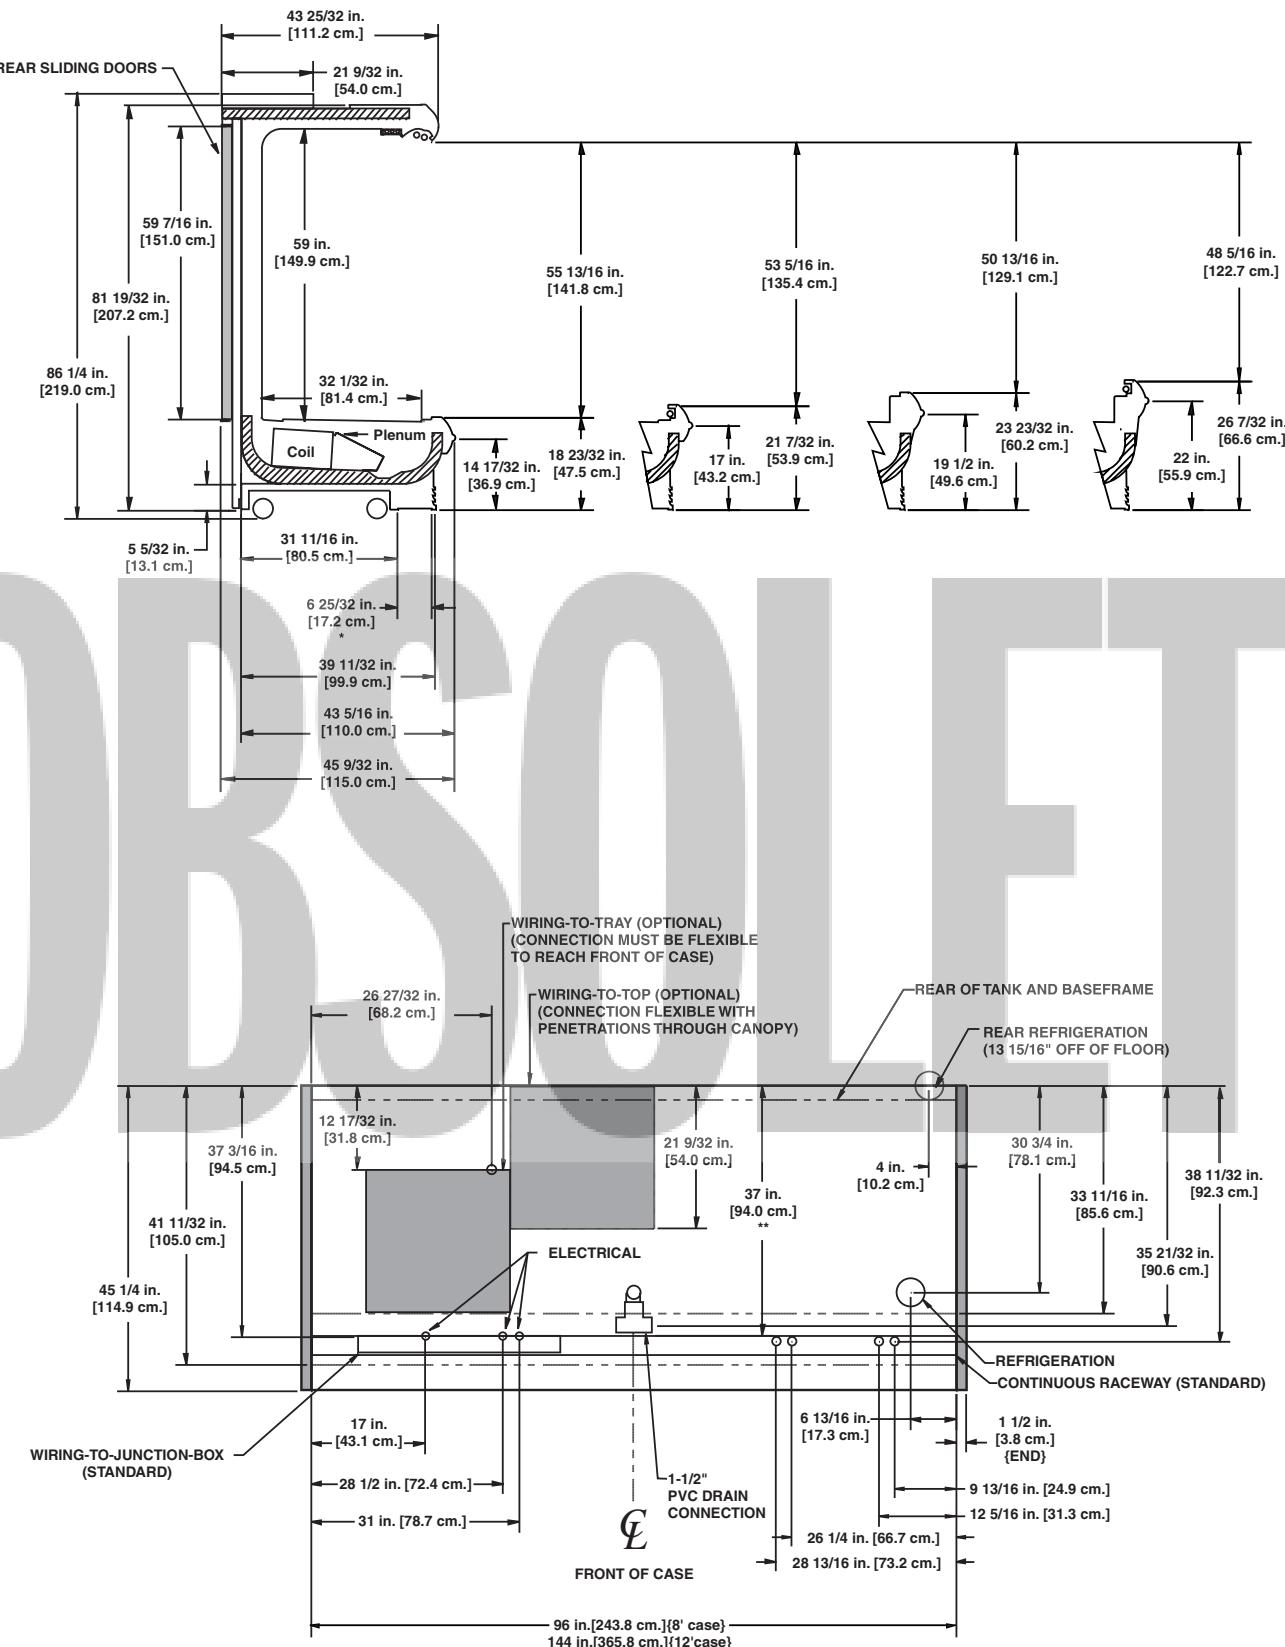

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• SUCTION LINE 7/8", LIQUID LINE - 3/8"

• AVAILABLE SHELF SIZES: 10', 12', 14', 16', 18', 20", 22", & 24"

A DOVER DIVERSIFIED COMPANY

OBSCOLTE

Multi-Deck Frozen Food Merchandiser

O5Z - 6', 8', & 12'

Electrical Data

Model	Fans per Case				Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
					120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
	Pri. ¹	Sec.	Amb.	Total	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5Z	6'	4	2	2	8	4.56	280	2.04	187	2.25 ²	270	9.99 ³	3600	11.53 ³
	8'	5	3	2	10	5.70	352	2.55	233	3.10 ²	344	13.32 ³	4800	15.37 ³
	12'	7	4	3	14	7.98	490	3.57	327	4.68 ²	562	20.00 ³	7200	23.06 ³

¹ Pri.=Primary, Sec.=Secondary, Amb.=Ambient

² Cases equipped with windowed ends add 1.85 amps per end.

³ 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O5Z	6'	0.57	68	1.71	205
	8'	0.57	68	1.71	205
	12'	0.77	92	2.31	277

Air Defrost Option

Model	Defrost Heaters		
	120 Volts		
	Amps	Watts	
O5Z	6'	---	---
	8'	6.69	803
	12'	9.20	1104

⁴ NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft ⁵	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁶ (FPM)		
							Pri.	Sec.	Amb.
O5Z	1840	-18	3-5	-5	0	0	650	425	275

⁵ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁶ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5Z	2	13 - 15	34	50	---	---	24	60

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COLD

A DOVER DIVERSIFIED COMPANY

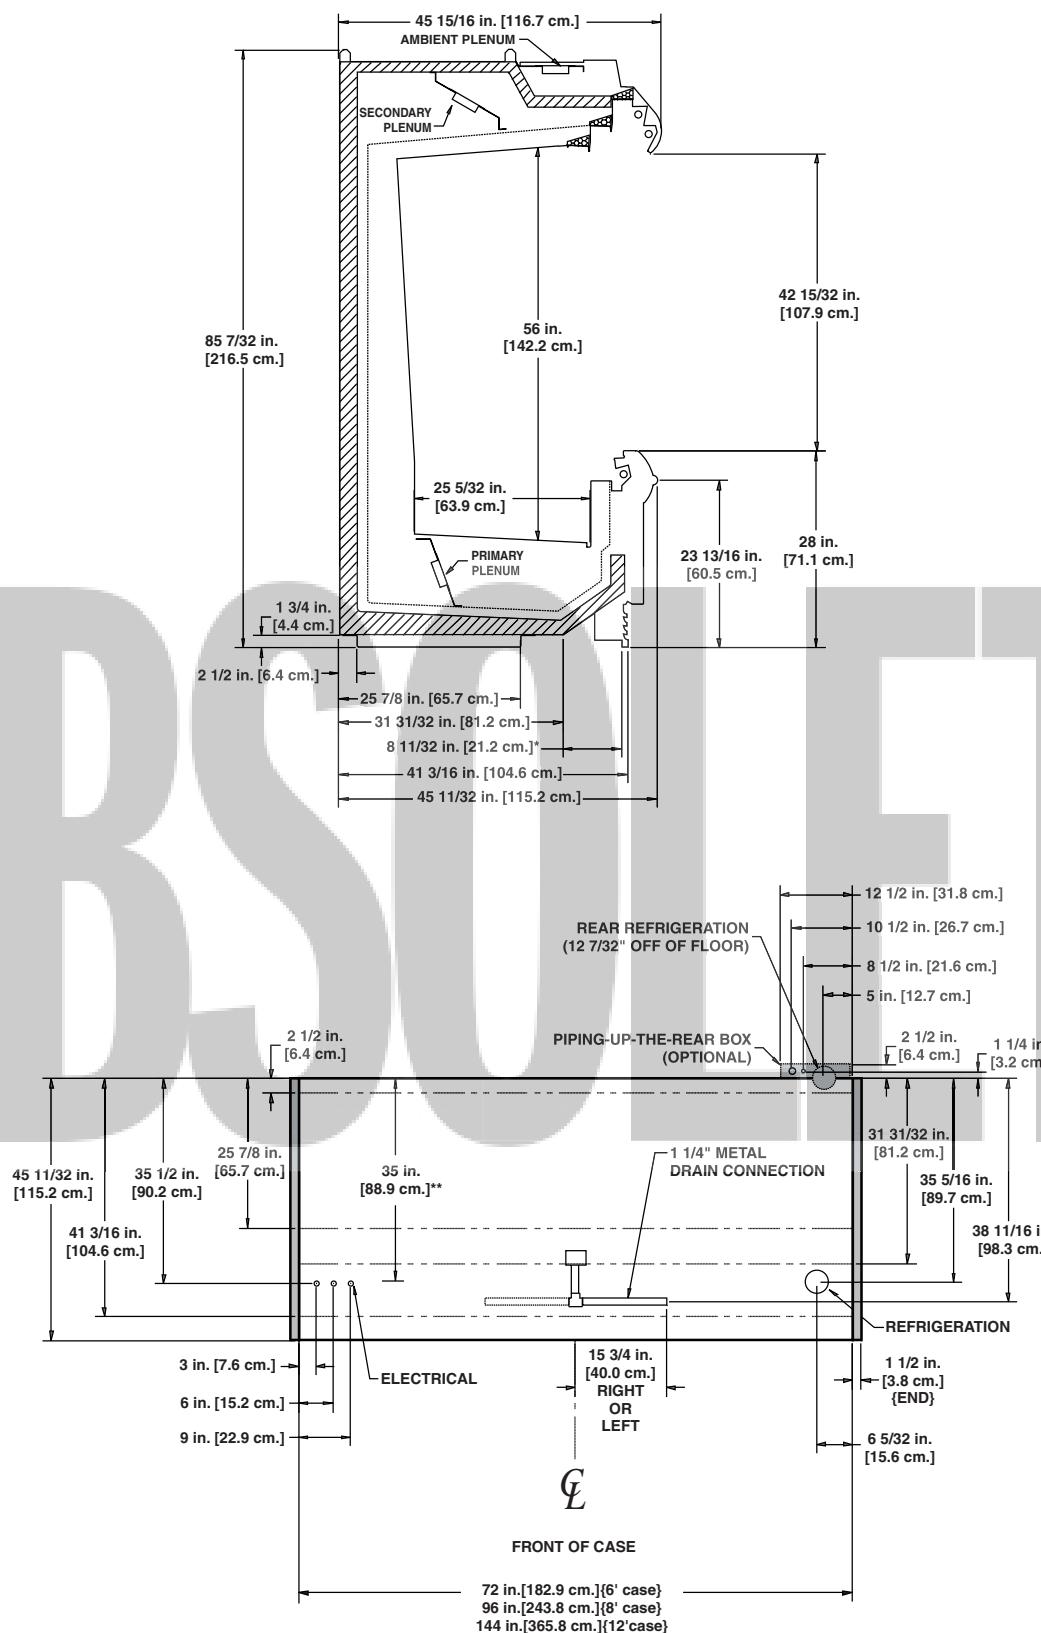

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• A 4" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL

• SUCTION LINE - 1 1/8", LIQUID LINE - 5/8"

• AVAILABLE SHELF SIZES: 18" & 22"

Narrow Multi-Deck Deli/Meat Merchandiser

ONHM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONHM	6'	2	1.00	60	0.60	40	---	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	---	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	---	5.77	1200	6.67	1600

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONHM	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ONHM	27"	1440	17	6-8	30	34	41	340
	31" & 33"	1340	17	6-8	30	34	41	340

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONHM	4	6 - 8	35	47	45	47	26	45	45	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

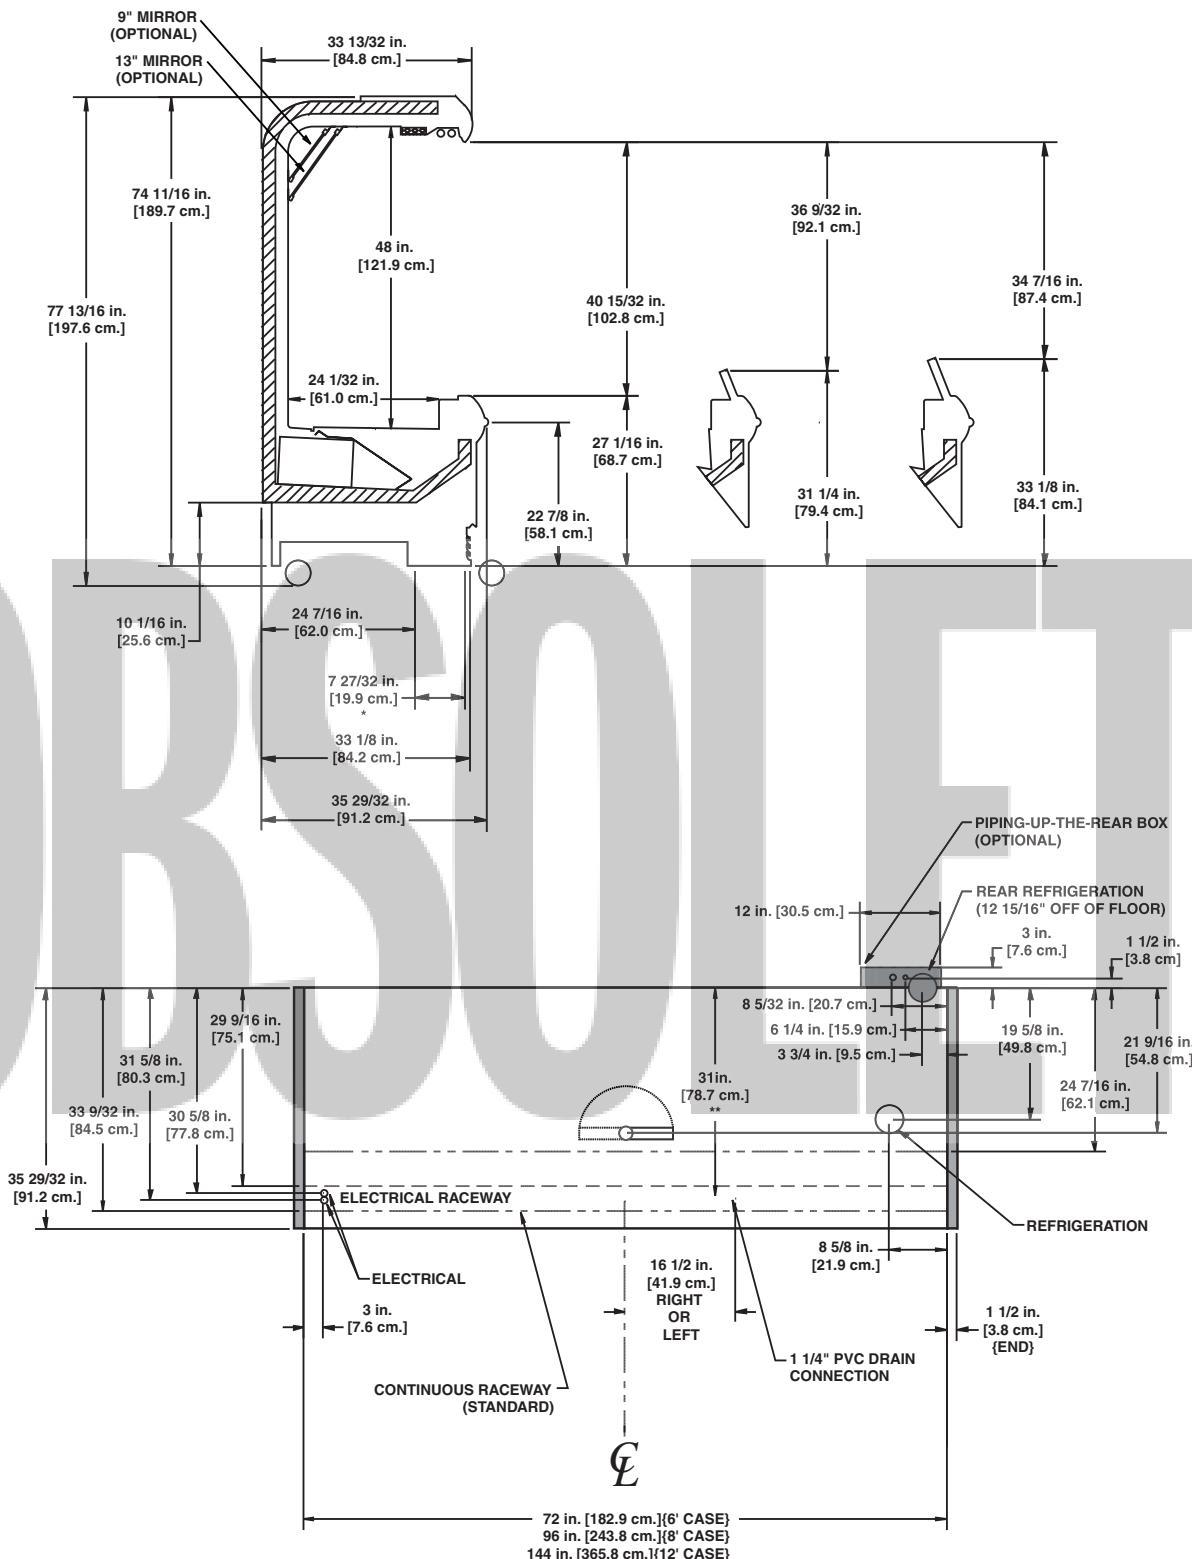

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", & 20"

Multi-Deck Deli/Meat Merchandiser

OHM - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OHM	6'	2	1.00	60	1.00	34	0.40	48	2.88	600	3.33
	8'	3	1.50	90	1.50	51	0.58	70	3.85	800	4.44
	12'	4	2.00	120	2.00	69	0.83	100	5.77	1200	6.67
											1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OHM	6'	0.57	68	3.90
	8'	0.57	68	3.90
	12'	0.77	92	5.84
				701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OHM	27"	1475	12	6-8	25	33	35	350
	27"	1448	17	6-8	28	35	38	350
	31" & 33"	1341	17	6-8	28	34	37	350

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OHM	3	6 - 8	35	47	45	47	26	45	45	45

Medium Temperature Defrost Schedule


No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm

HILL PHOENIX
EXCELLLENCE™

All measurements are taken per CRMA specifications.

A  DOVER DIVERSIFIED COMPANY

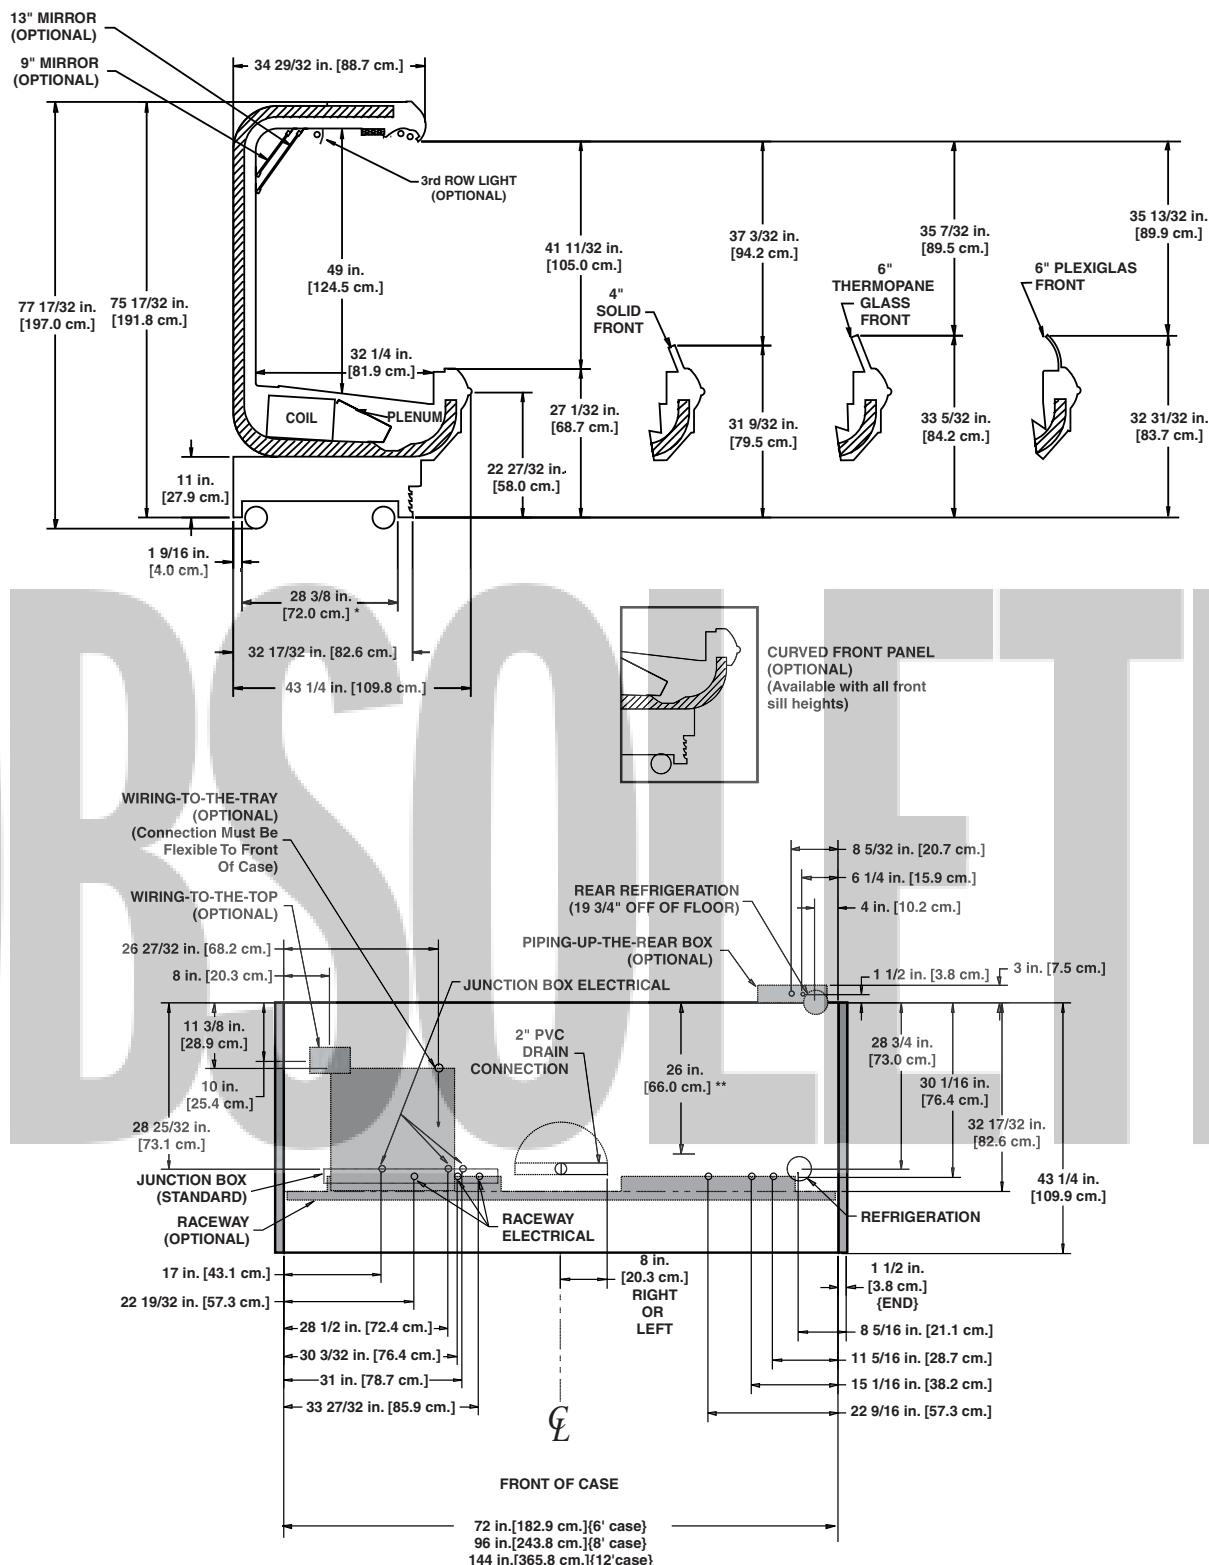

High Multi-Deck Deli/Meat Merchandiser

OHMH- 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OHMH	6'	3	1.50	90	0.90	60	0.80	96	2.88	600	3.33	798
	8'	4	2.00	120	1.20	80	1.15	138	3.85	800	4.44	1065
	12'	5	2.50	150	1.50	100	1.67	200	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OHMH	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OHMH	27"	1550	12	6-8	26	33	37	330
	27"	1435	17	6-8	29	36	41	330
	31" & 33"	1340	17	6-8	29	34	38	330

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls


Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OHMH	4	6 - 8	35	47	45	47	26	45

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

HILL PHOENIX
EXCELLLENCE IN COOLING

All measurements are taken per CRMA specifications.

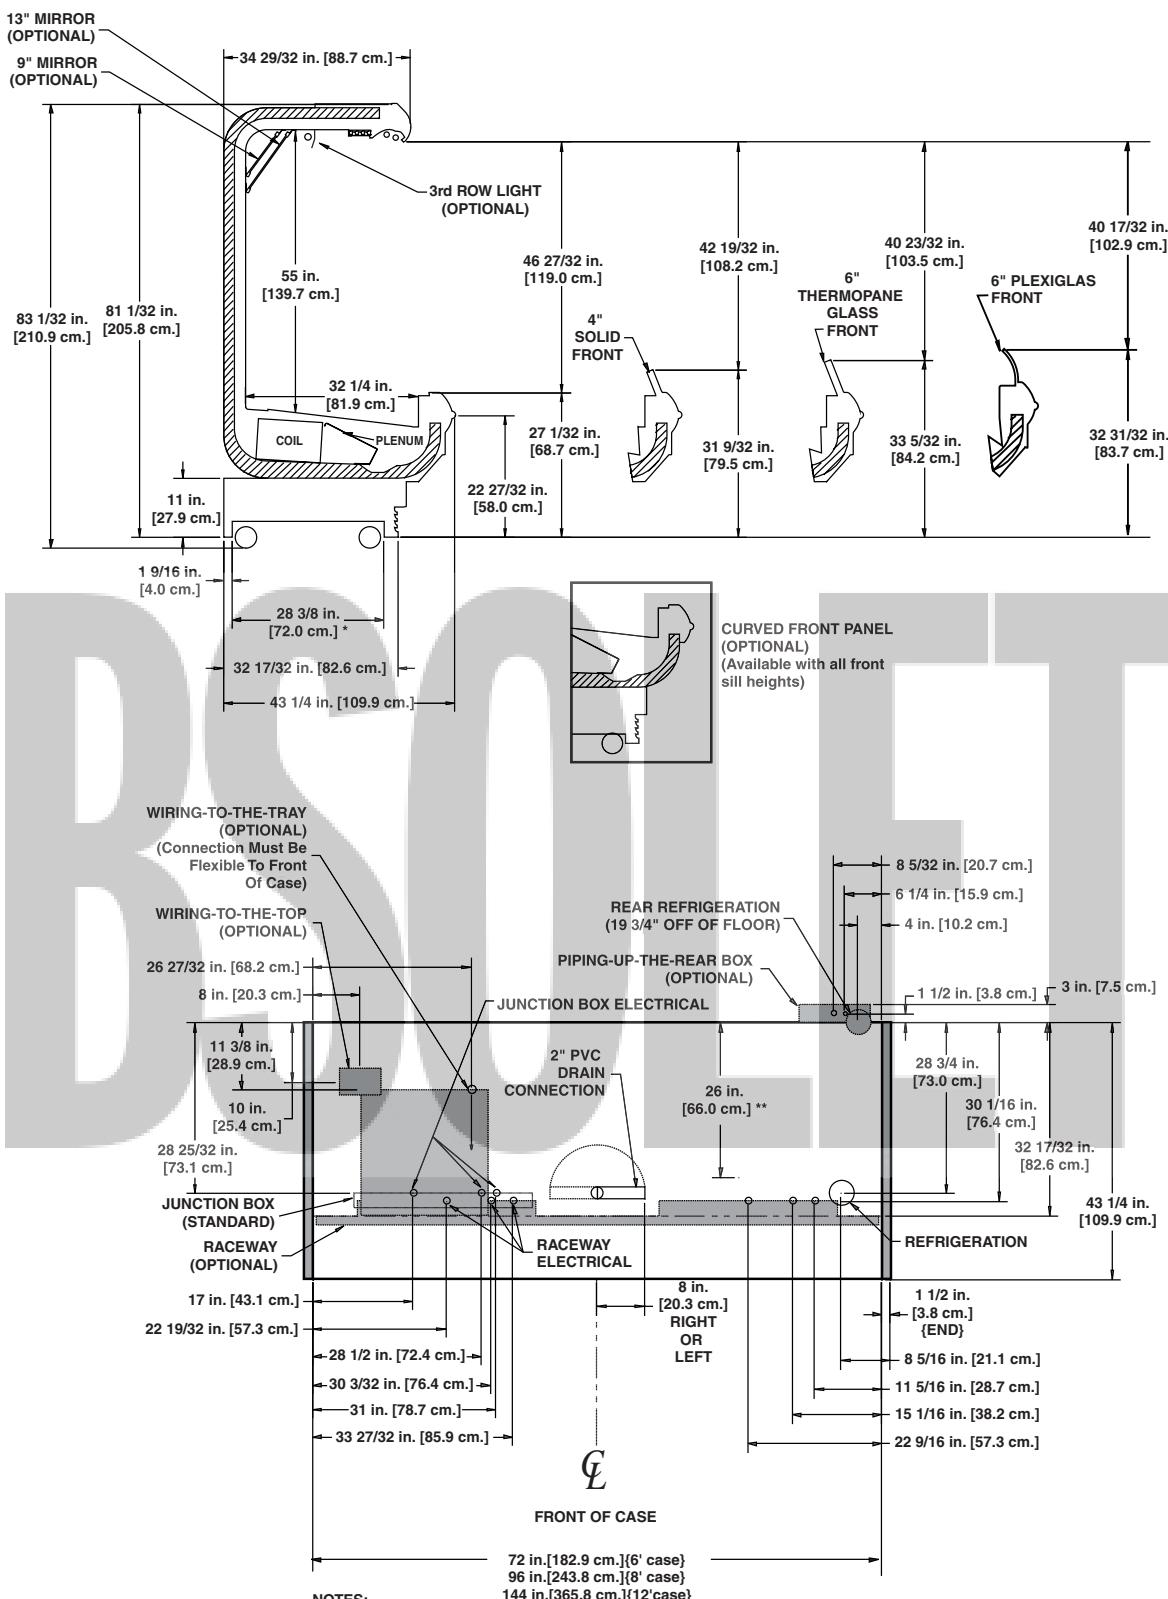

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
(WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", & 20"

Narrow Multi-Deck Produce Merchandiser

ONHP - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONHP	6'	2	1.00	60	0.60	40	---	2.88	600	3.33	798
	8'	3	1.50	90	0.90	60	---	3.85	800	4.44	1065
	12'	4	2.00	120	1.20	80	---	5.77	1200	6.67	1600

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONHP	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ONHP Cut Produce	27"	1310	22	6-8	32	38	45	360
ONHP Bulk Produce	27"	930	27	6-8	36	42	48	360

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONHP	3	6 - 8	35	47	45	47	---	---	45	45

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

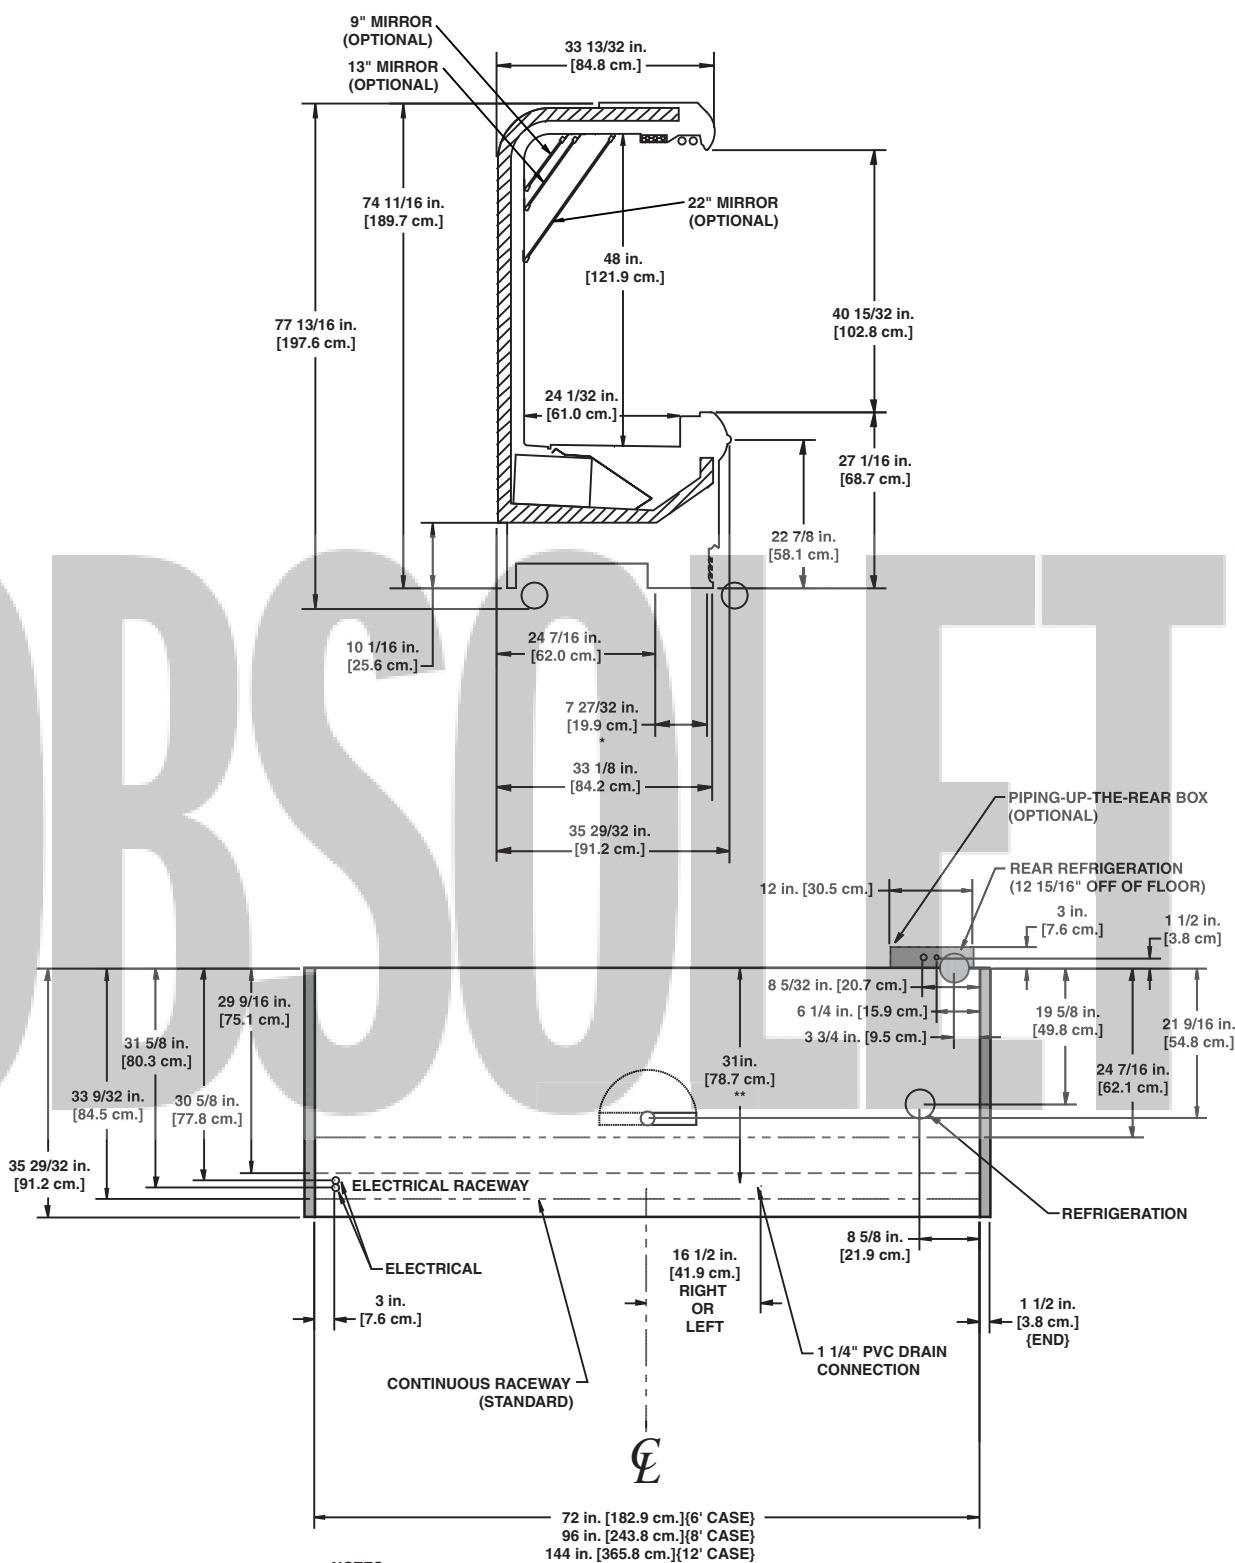

Multi-Deck Produce Merchandiser

OHP - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans				High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts			
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OHP	6'	2	1.00	60	0.64	34	0.40 ¹	48	2.88	600	3.33	798	
	8'	3	1.50	90	0.96	51	0.58 ¹	70	3.85	800	4.44	1065	
	12'	4	2.00	120	1.28	69	0.83 ¹	100	5.77	1200	6.67	1600	

¹ Anti-condensate heater data for reduced (cut produce) temperature option only.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OHP	6'	0.57	68	3.90	468
	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OHP Cut Produce	27"	1215	22	6-8	31	38	45	440
OHP Bulk Produce	27"	855	27	6-8	36	46	48	250

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls


Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OHP Cut Produce	3	6 - 8	24	47	45	47	20	45	30	45
OHP Bulk Produce	2	6 - 8	---	---	45	47	---	---	56	40

⁴ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

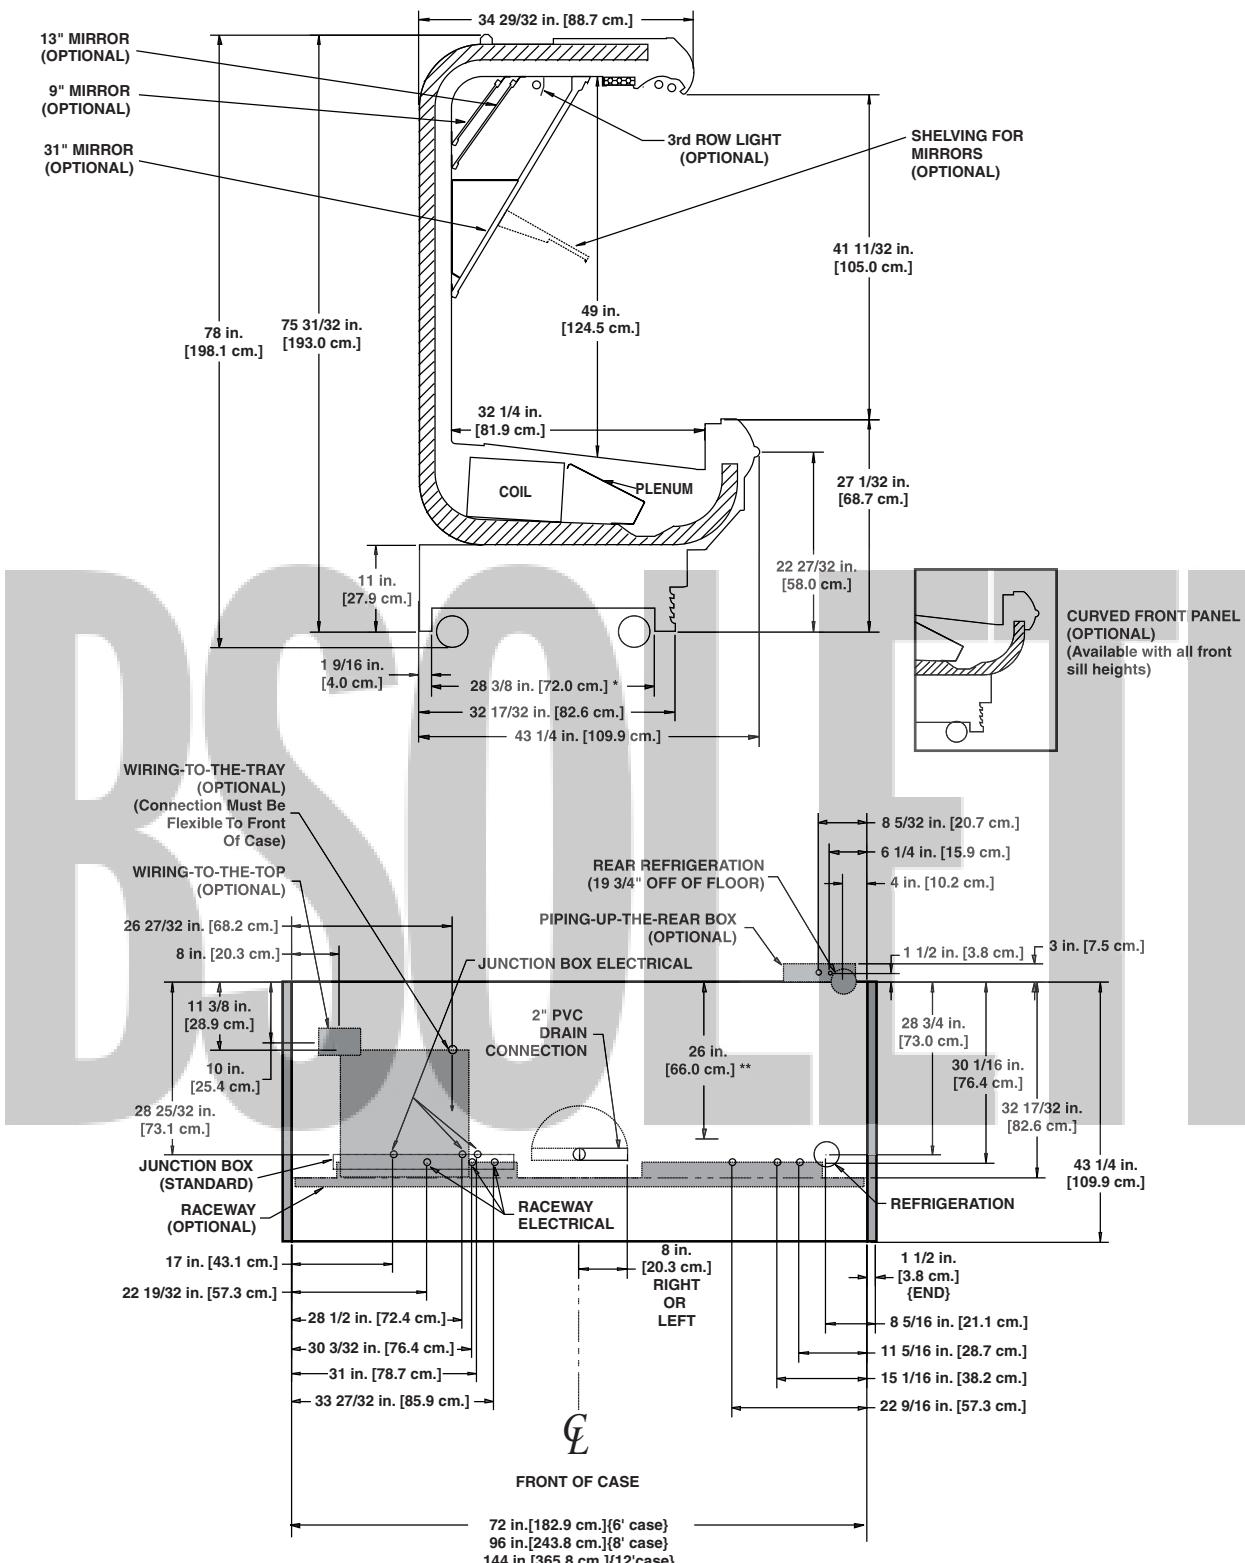

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
(WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", & 20"

High Multi-Deck Produce Merchandiser

OPHP- 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OPHP	6'	3	1.50	90	0.90	60	0.80	96	2.88	600	3.33	798
	8'	4	2.00	120	1.20	80	1.15	138	3.85	800	4.44	1065
	12'	5	2.50	150	1.50	100	1.67	200	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OPHP	6'	0.57	68	4.47	536
	8'	0.57	68	4.47	536
	12'	0.77	92	6.61	793

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OPHP	27"	1460	17	6-8	30	37	45	315

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OPHP	3	6 - 8	35	47	45	47	26	45	50	45


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

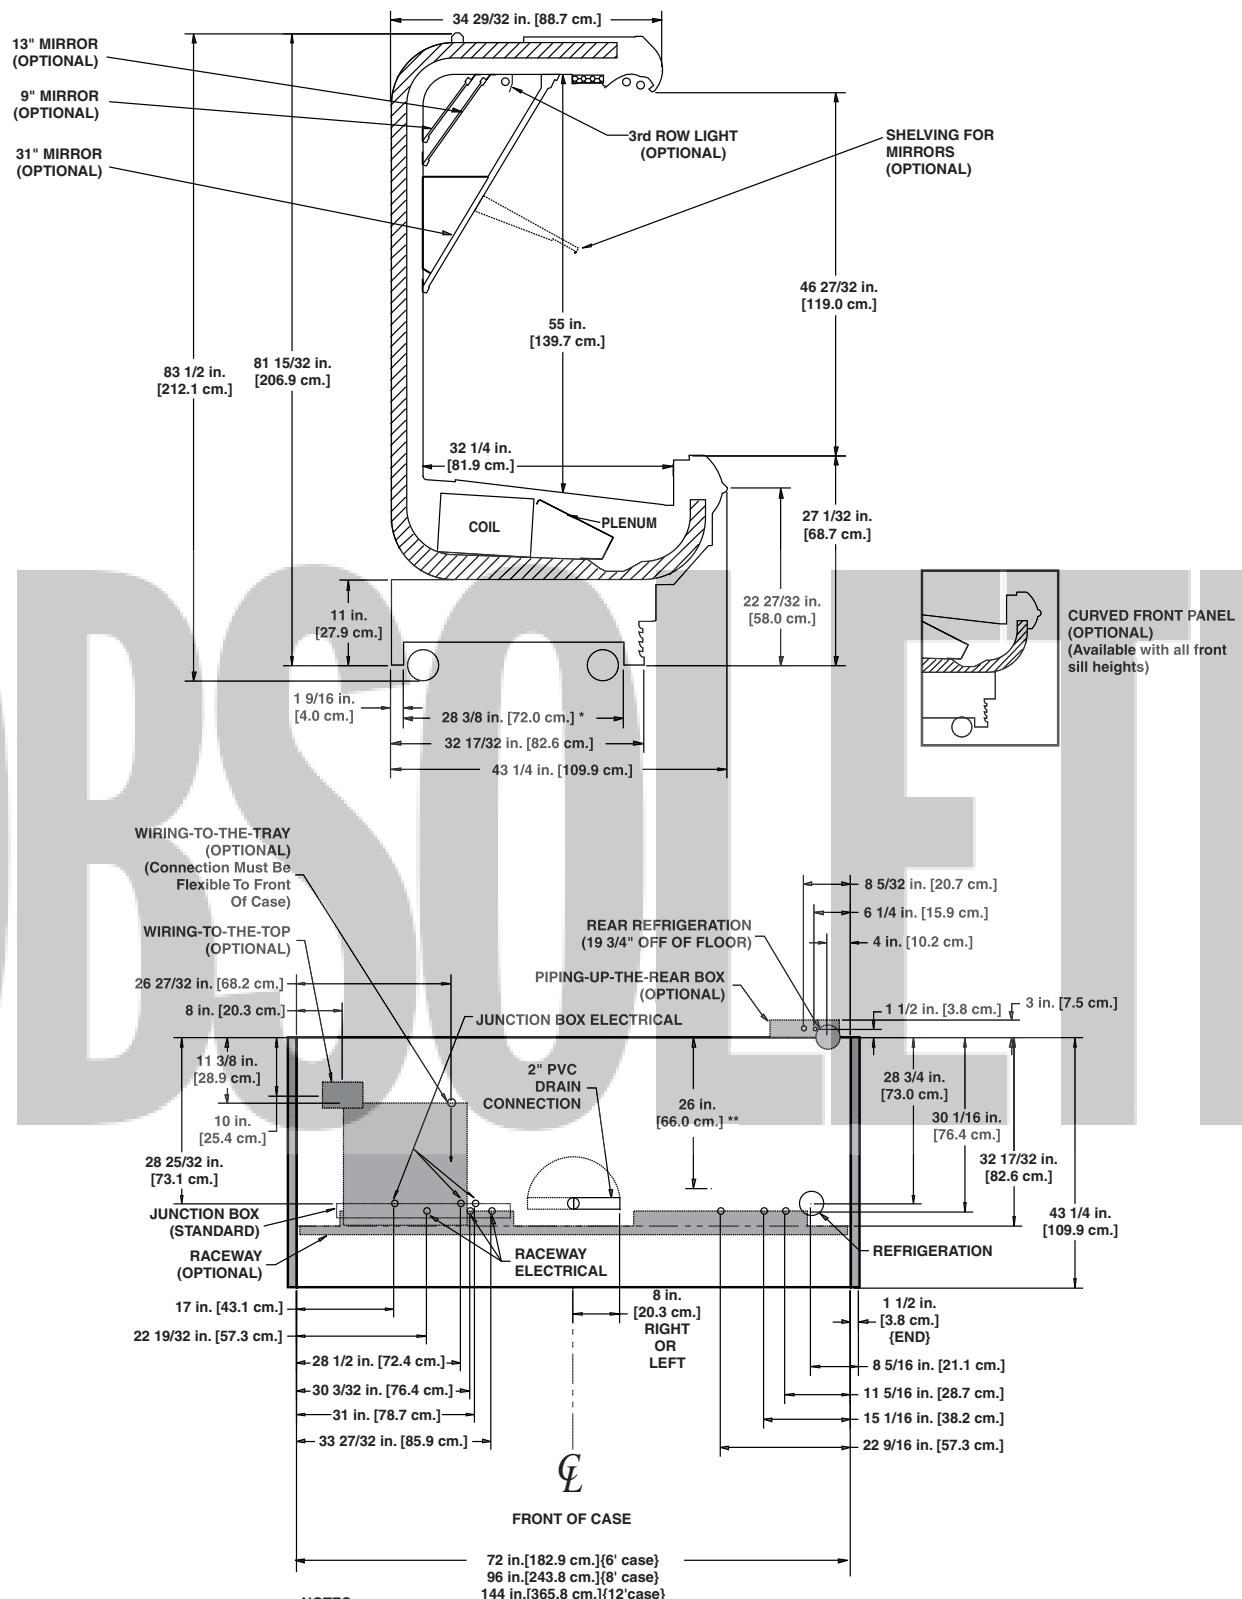

Narrow Multi-Deck Produce/Dairy/Deli/Meat Merchandiser

ONU- 4'47" & 6'71"

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONU	4'47"	2	1.00	60	1.00	34	---	1.92	400	2.22	532
	6'71"	3	1.50	90	1.50	51	---	2.88	600	3.33	798

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONU	4'47"	0.57	68	2.06	247
	6'71"	0.77	92	3.90	468

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ONU	21", 27"	1450	17	6-8	30	34	40	310

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONU	4	6 - 8	35	47	45 ⁴	47 ⁴	25	45

⁴ Timed Off Defrost not recommended for Fresh Meat application.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

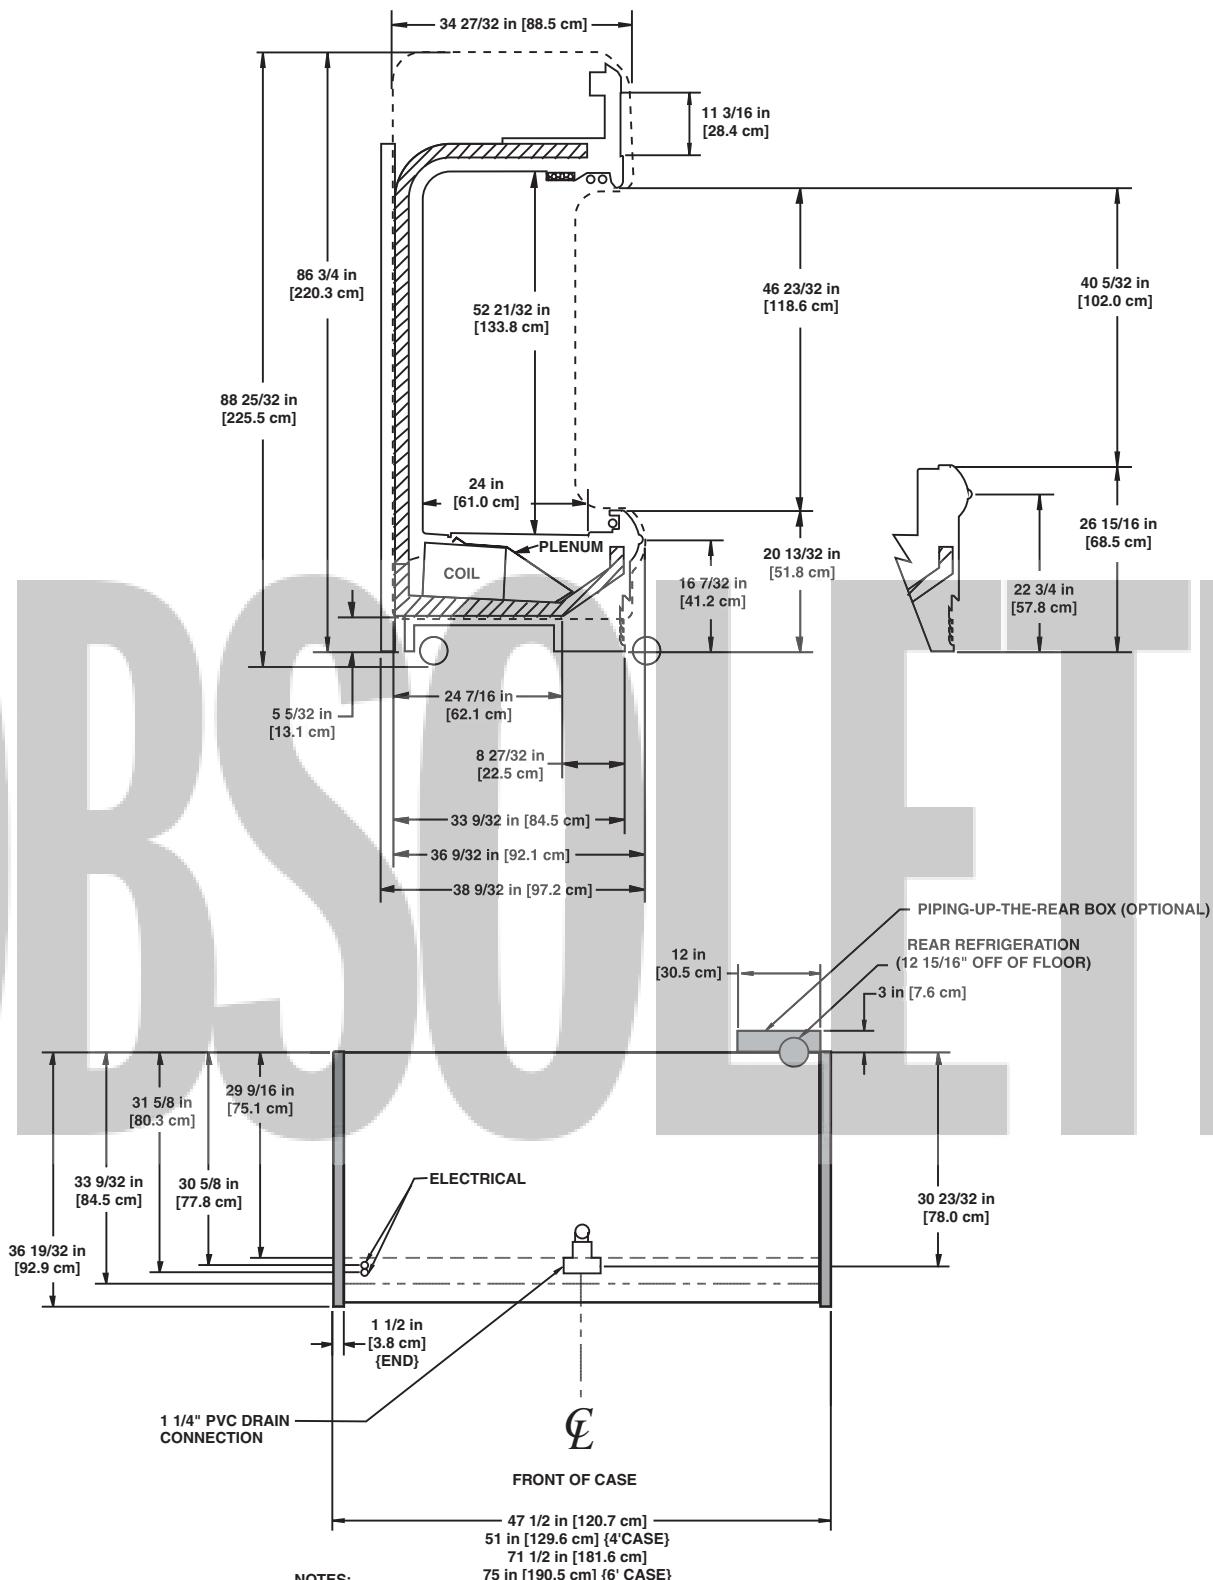

Roll-In Rear Load Dairy Merchandiser

ORDR - 8' & 12' dairy

Electrical Data

Model	Standard Fans				High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
	Fans per Case		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
	Discharge	Return	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ORDR	8'	3	4	2.95	157	1.29	104	---	3.85	800	4.44	1066
	12'	4	6	4.16	220	1.82	147	---	5.77	1200	6.67	1600

1 NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ORDR	8'	0.57	68	3.90	468
	12'	0.77	92	5.84	701

Guidelines & Control Settings

Model	Front Sill Heights	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ORDR ⁴	13 13/16"	739	17	6-8	28	40	44	310

2 BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

3 Average discharge air velocity at peak of defrost.

4 Back-up coils with a capacity of 1666 BTUH/ft at a suction temperature of 20°F must be used for each case to refrigerate the area immediately behind the line-up to a depth of 10'. If the cooler is longer than the ORDR line-up and deeper than 10', other coils are needed to refrigerate the balance of the cooler area. Each auxiliary coil should be centered on each case and set back a distance of 3' to 5' from the back of the ORDR

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORDR	4	6 - 8	30	47	30	47	26	45	---	---


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENEC™

A DOVER DIVERSIFIED COMPANY

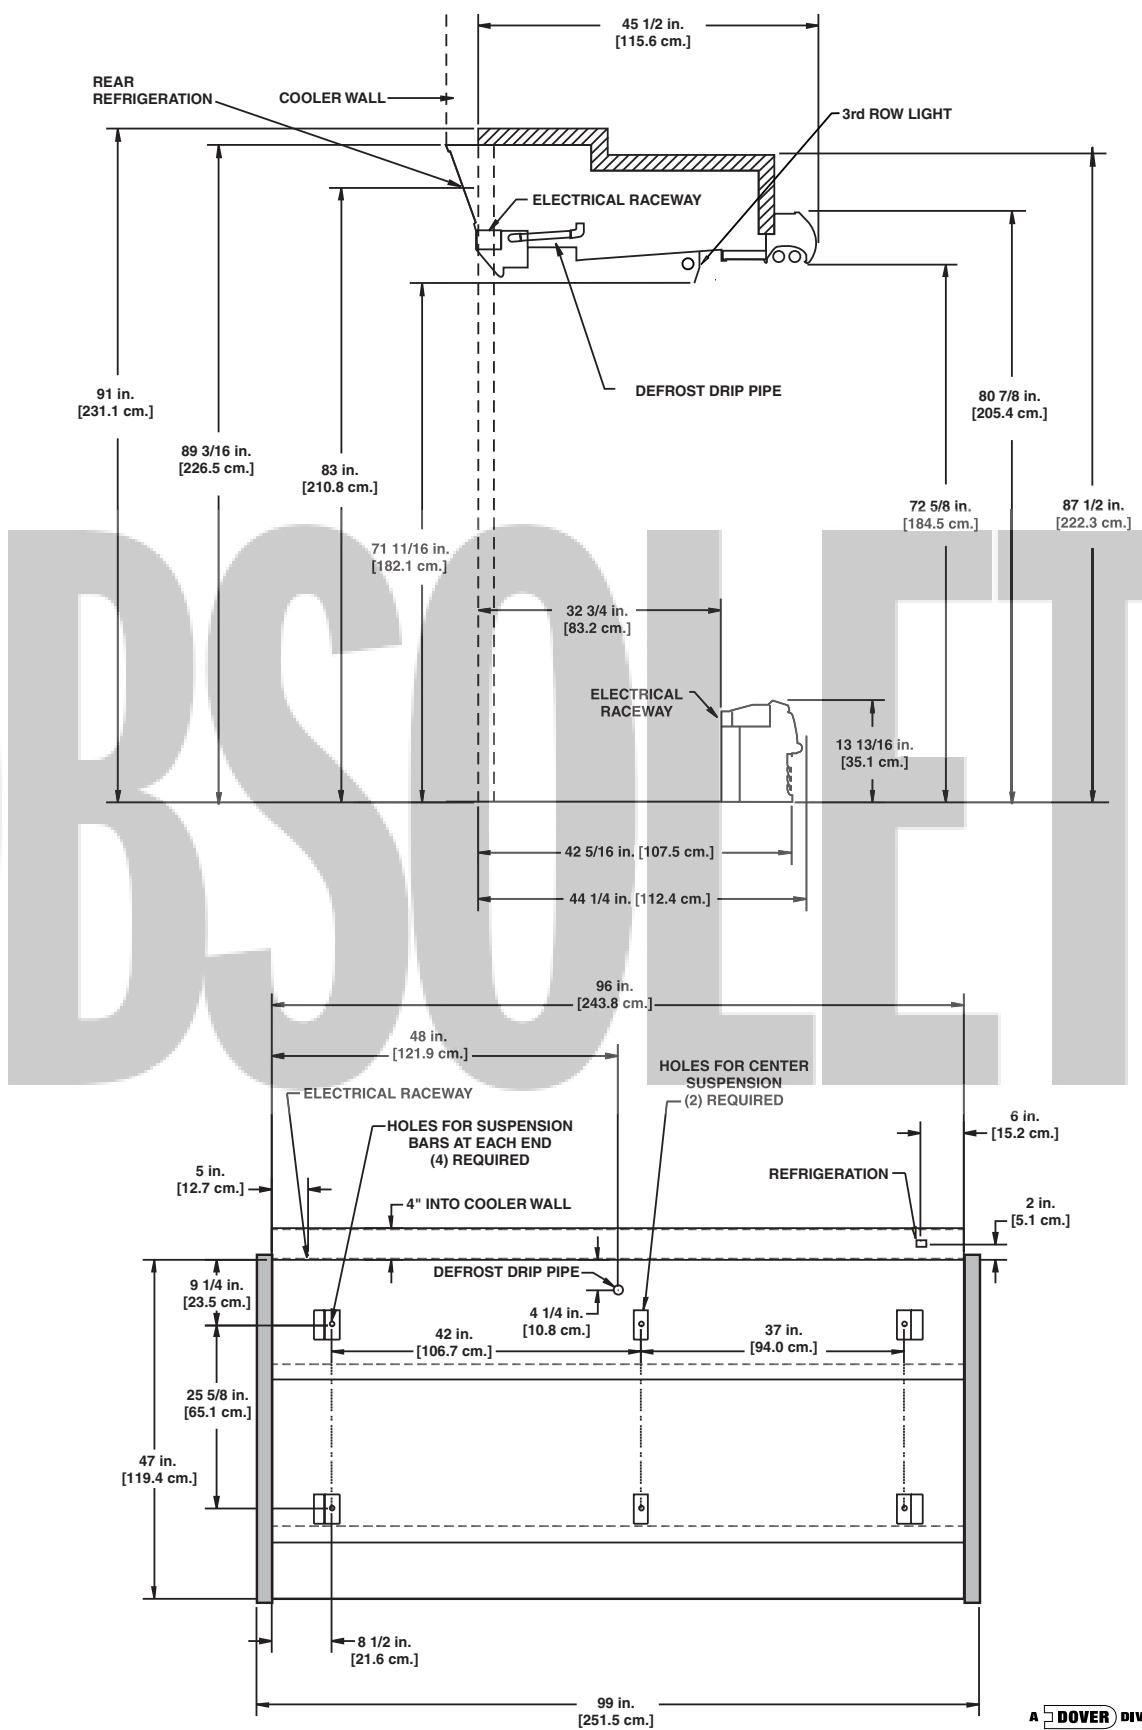

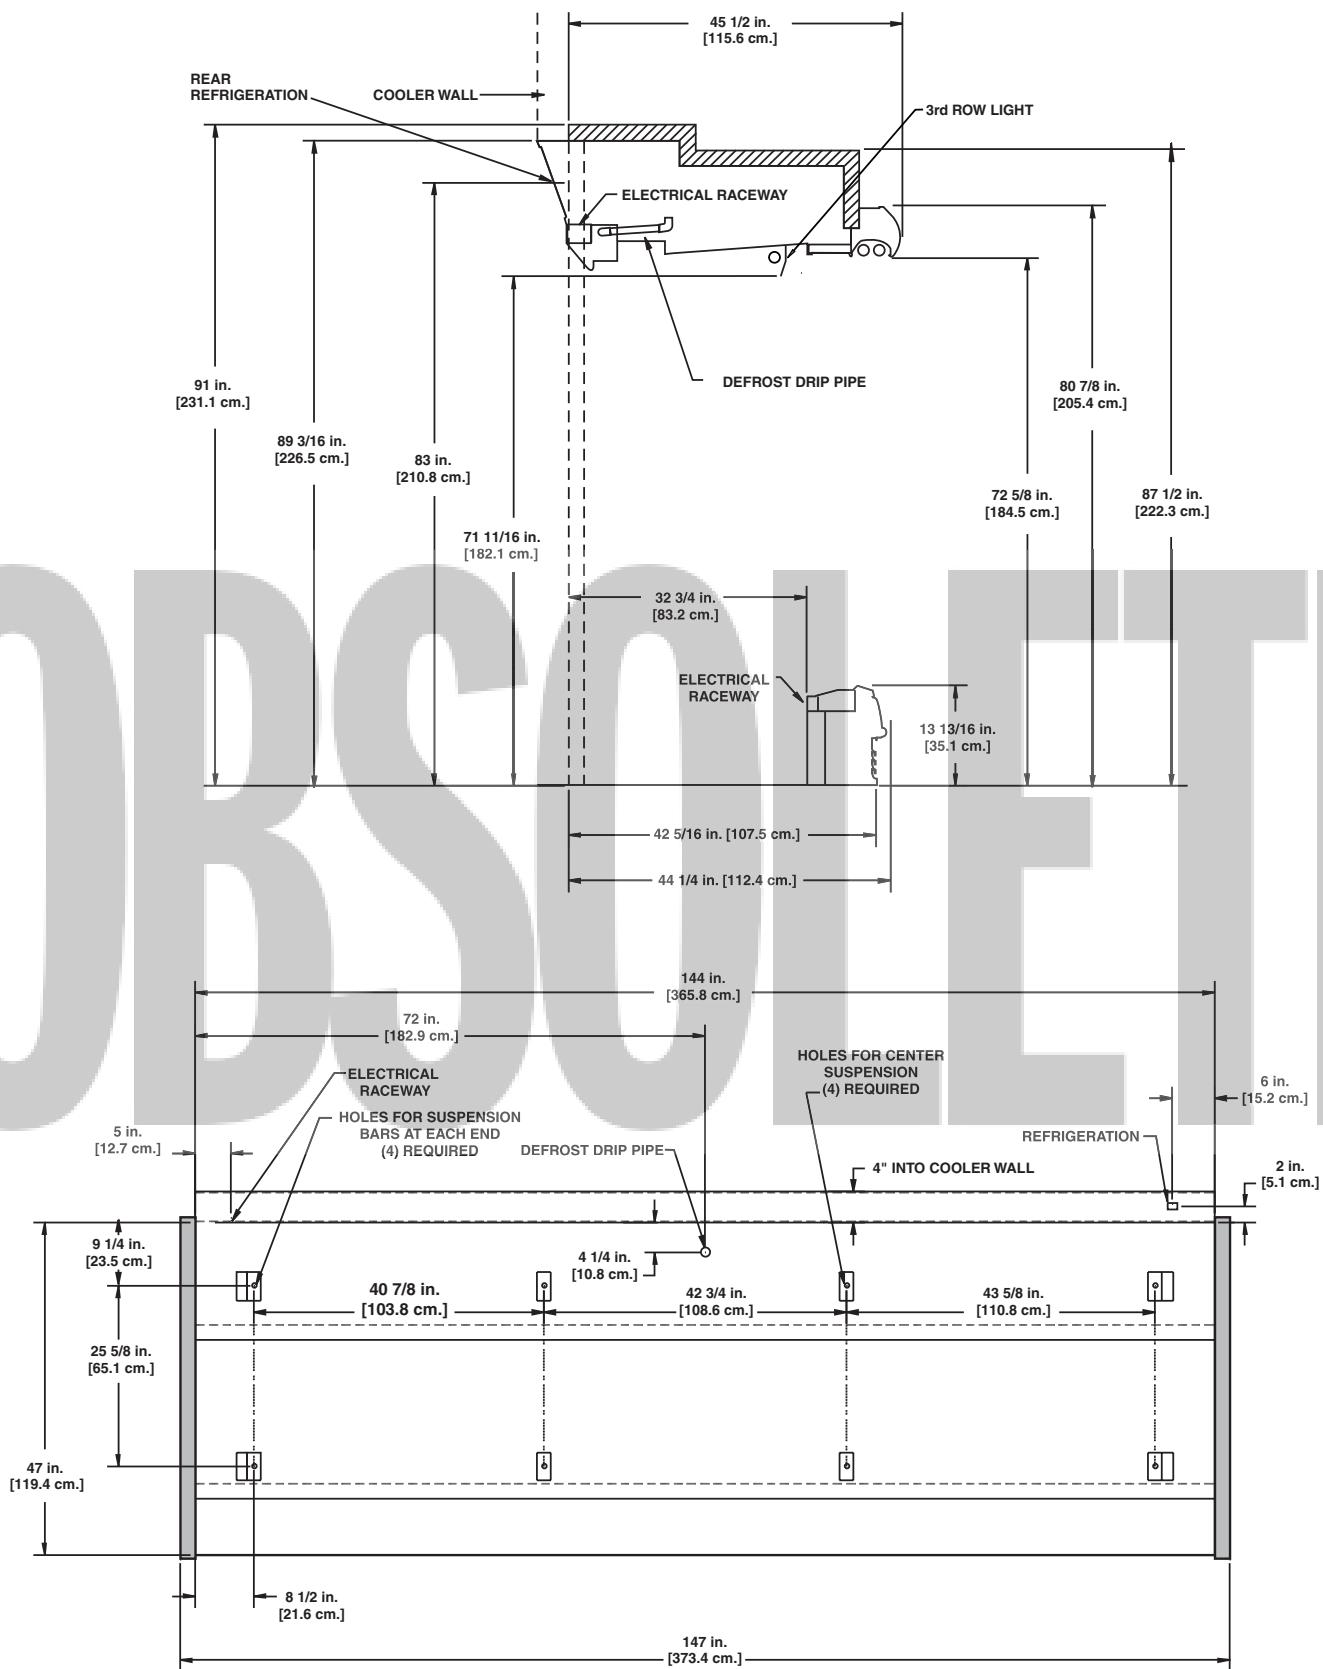

OBSCOLATE

Multi-Deck Deli Back Bar Merchandiser

BB- 6' & 8'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Auxiliary Fans (Optional)		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
BB	6'	4	1.80	68	0.60	44	1.60	92	---	2.88	600	3.33	798
	8'	5	2.25	85	0.75	55	1.60	92	---	3.85	800	4.44	1065

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
BB	6'	0.57	68	2.76	331
	8'	0.57	68	2.76	331

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
BB	1290	17	6-8	32	36	45	325

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
BB	4	6 - 8	30	47 ⁴	45	47 ⁴	---	---	45	45

⁴ Termination Temperature measured at the honeycomb.

Medium Temperature Defrost Schedule


No. Per Day	Hours
-------------	-------

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

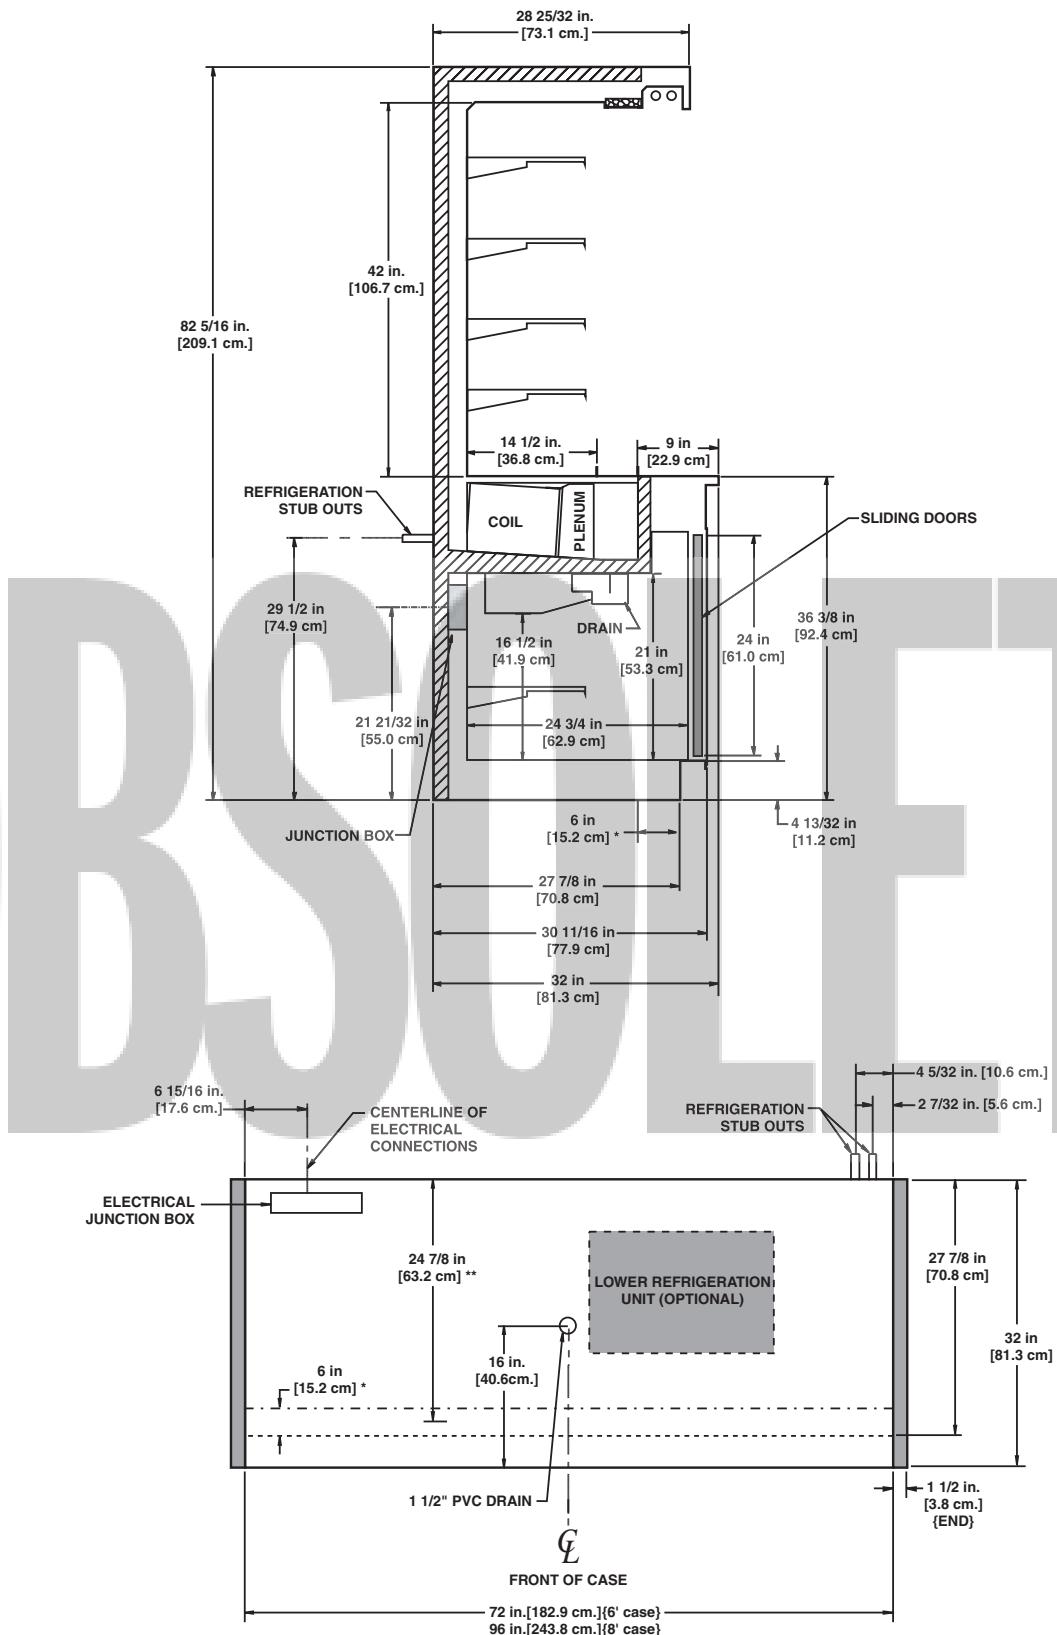

OBSOLETE

Reach-in Door Merchandisers

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

Narrow Glass Door Reach-in Beverage Merchandiser

ONRB - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONRB	2-door	2	1.00	60	0.64	34	2.40	288	4.39	914	5.06
	3-door	3	1.50	90	0.96	51	3.28	394	4.96	1032	5.71
	4-door	4	2.00	120	1.28	69	4.33	520	6.51	1355	7.55
	5-door	5	2.50	150	1.60	85	5.30	636	7.96	1655	9.17

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ONRB	2-door	NA ¹	NA	1.45 174
	3-door	NA	NA	1.94 233
	4-door	NA	NA	2.42 290
	5-door	NA	NA	2.91 349

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/door ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ONRB ²	900	22	6-8	32	35	35	460

² All data listed is for an ONRB configured with 20" shelves.

³ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRB	1	6 - 8	30	47	45	47	24	45
							-- - ⁵	-- --

⁵ NOTE: -- - not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN
REFRIGERATION

A  DOVER DIVERSIFIED COMPANY

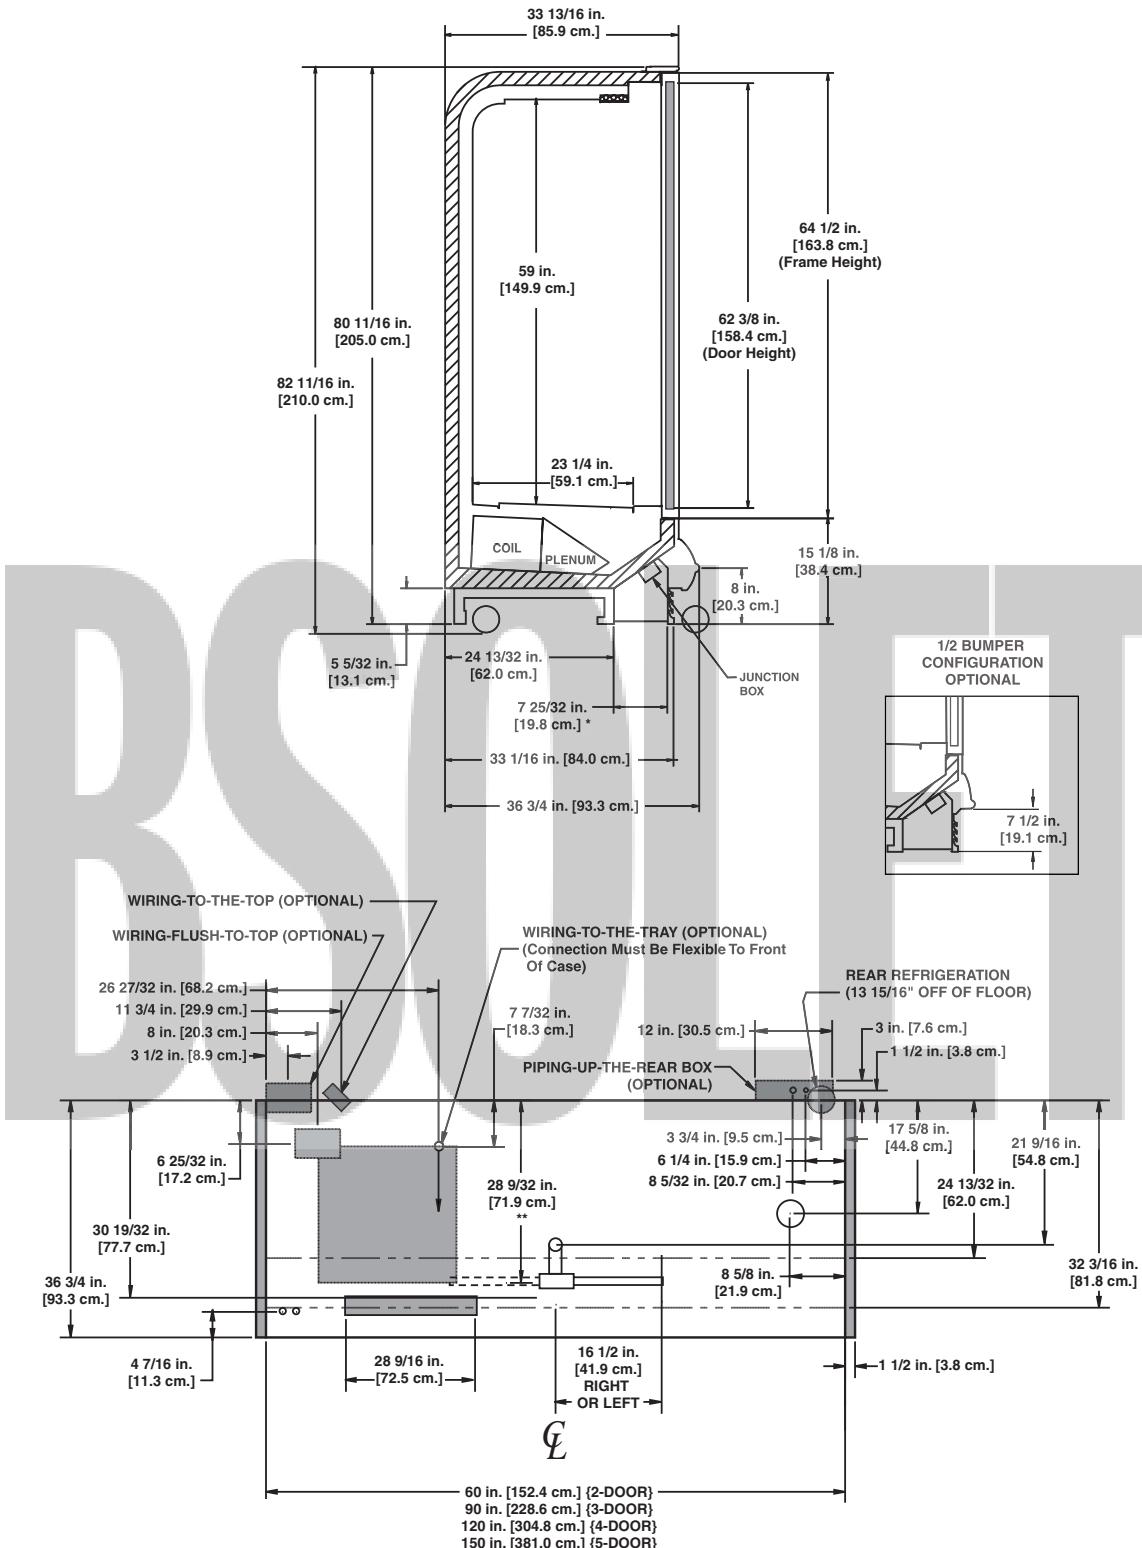

NOTES:

FRONT OF CASE

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: WIRE SHELVES 16", 18", 20", & 22"
SOLID SHELVES 18", 20", & 22"

High Narrow Glass Door Reach-in Beverage Merchandiser

ONRBH - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONRBH	2-door	2	1.00	60	0.64	34	2.45	294	4.39	914	5.06
	3-door	3	1.50	90	0.96	51	3.35	402	4.96	1032	5.71
	4-door	4	2.00	120	1.28	69	4.42	530	6.51	1355	7.55
	5-door	5	2.50	150	1.60	85	5.41	649	7.96	1655	9.17

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONRBH	2-door	NA ¹	NA	1.45	174
	3-door	NA	NA	1.94	233
	4-door	NA	NA	2.42	290
	5-door	NA	NA	2.91	349

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/door ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ONRBH ²	900	22	6-8	32	35	35	405

² All data listed is for an ONRBH configured with 20" shelves.

³ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRBH	1	6 - 8	30	47	45	47	24	45
							-- - ⁵	-- --

⁵ NOTE: -- - not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE

A DOVER DIVERSIFIED COMPANY

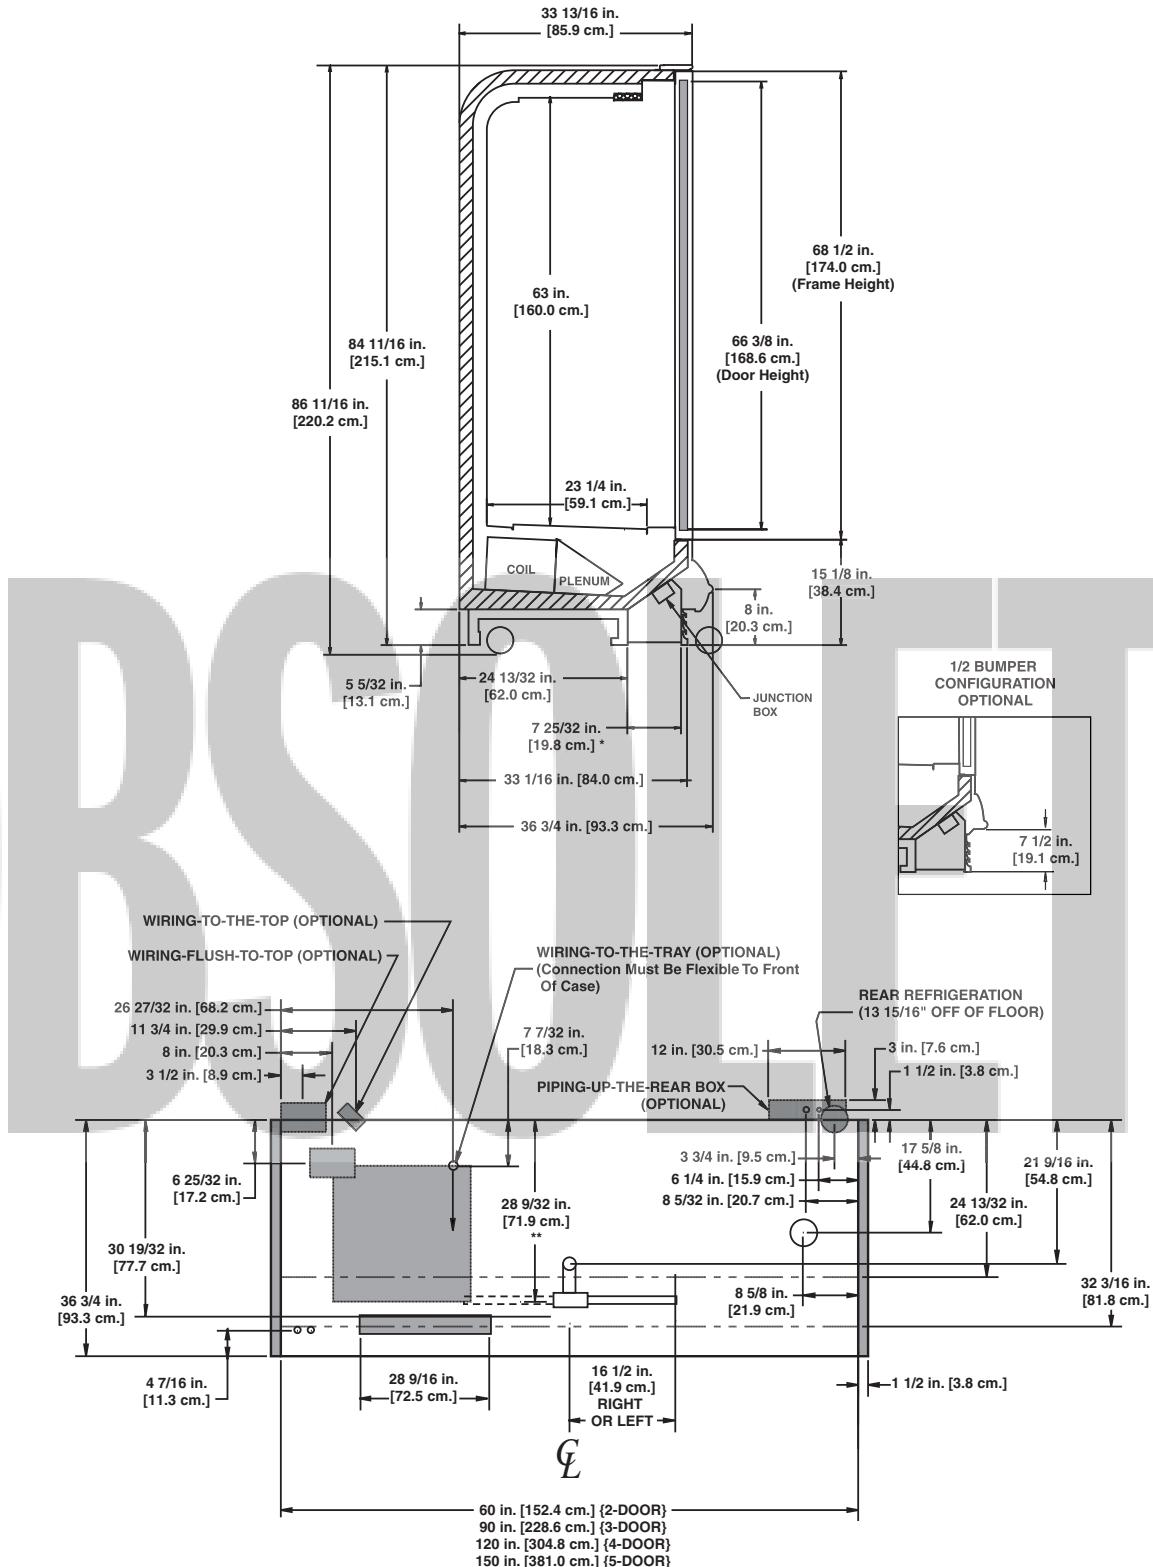

NOTES:

FRONT OF CASE

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: WIRE SHELVES 16", 18", 20", & 22"
SOLID SHELVES 18", 20", & 22"

Glass Door Reach-in Beverage Merchandiser

ORB - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ORB	2-door	2	1.00	60	0.64	34	2.40	288	4.39	914	5.06
	3-door	3	1.50	90	0.96	51	3.28	394	4.96	1032	5.71
	4-door	4	2.00	120	1.28	69	4.33	520	6.51	1355	7.55
	5-door	5	2.50	150	1.60	85	5.30	636	7.96	1655	9.17

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ORB	2-door	NA ¹	NA	1.45 174
	3-door	NA	NA	1.94 233
	4-door	NA	NA	2.42 290
	5-door	NA	NA	2.91 349

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/door ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ORB	900	22	6-8	27	39	30	380

² BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORB	1	6 - 8	30	47	45	47	24	45
							-- - ⁴	-- -

⁴ NOTE: -- - not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

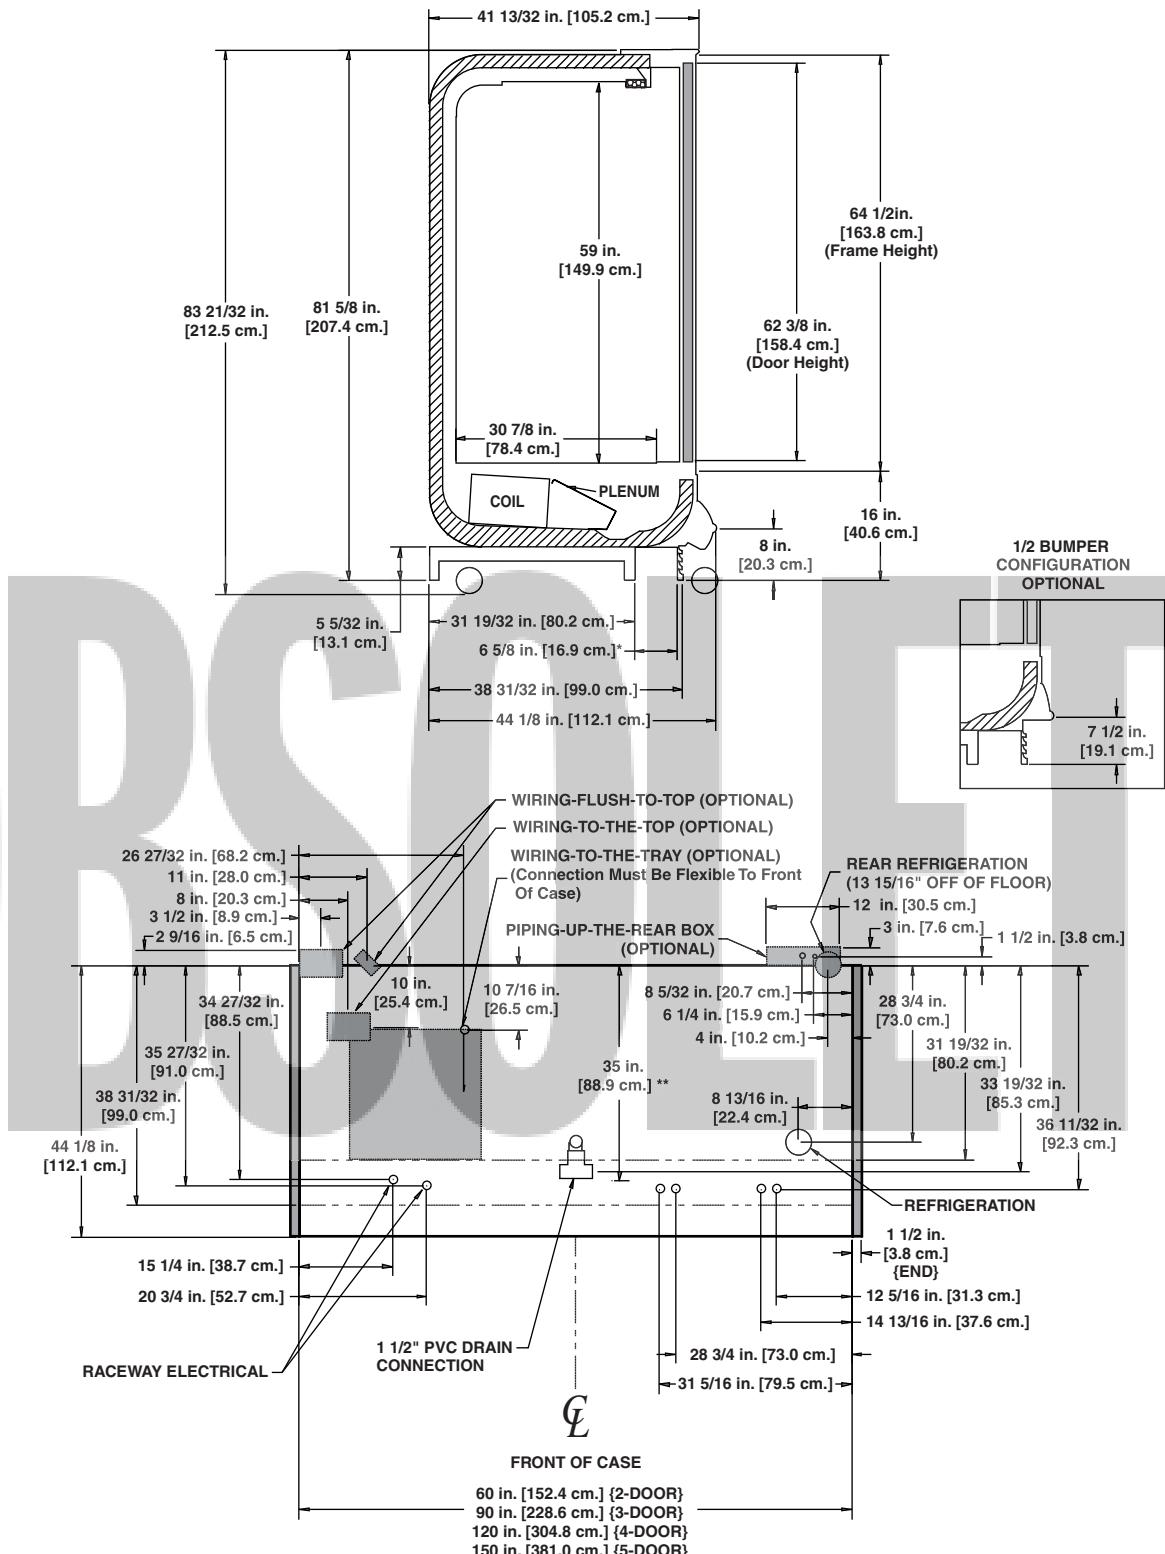

REACH-IN

Beverage

High Glass Door Reach-in Beverage Merchandiser

ORBH - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ORBH	2-door	2	1.00	60	0.64	34	2.45	294	4.39	914	5.06
	3-door	3	1.50	90	0.96	51	3.35	402	4.96	1032	5.71
	4-door	4	2.00	120	1.28	69	4.42	530	6.51	1355	7.55
	5-door	5	2.50	150	1.60	85	5.41	649	7.96	1655	9.17
											2201

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ORBH	2-door	NA ¹	NA	1.45 174
	3-door	NA	NA	1.94 233
	4-door	NA	NA	2.42 290
	5-door	NA	NA	2.91 349

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/door ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ORBH	900	22	6-8	27	39	30	280

² BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORBH	1	6 - 8	30	47	45	47	24	45
							- - - ⁴	- - -

⁴ NOTE: - - - not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

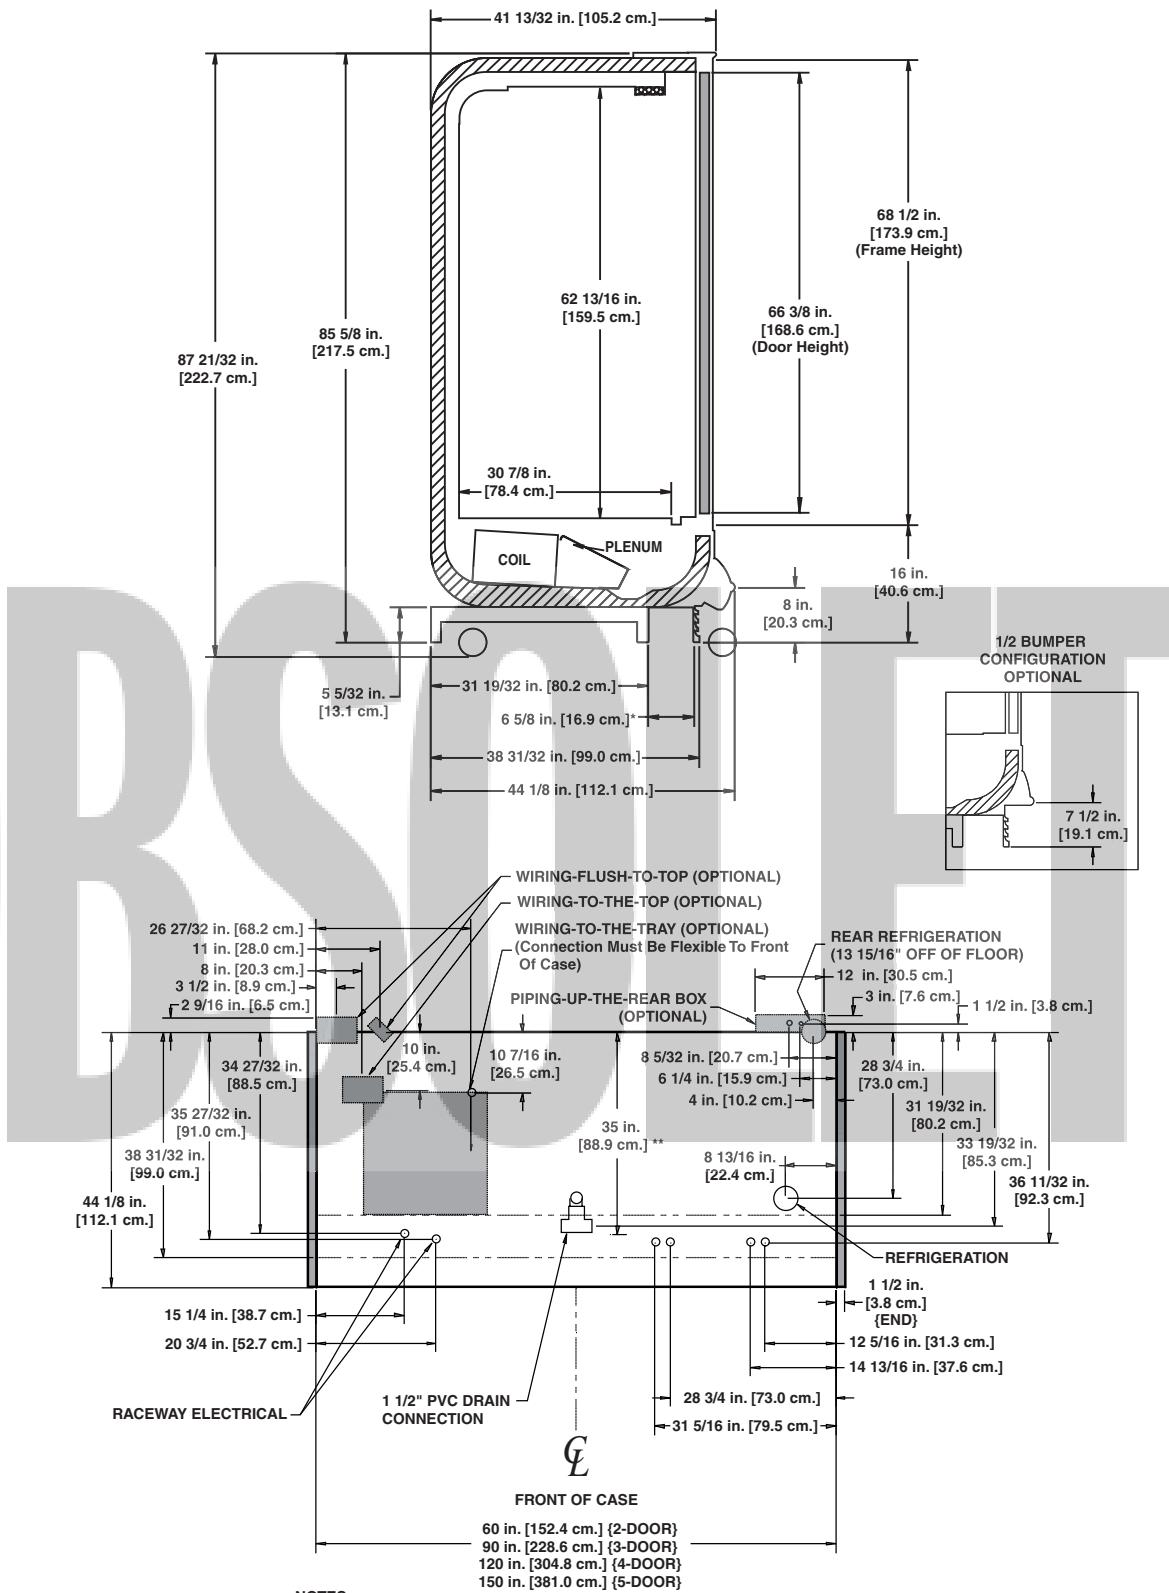

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: WIRE SHELVES 16", 18", 20", 22", & 23 1/2"
- SOLID SHELVES 18", 20", 22", & 24"

Narrow Glass Door Reach-in Frozen Food/Ice Cream Merchandiser

ONRZ - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ONRZ	2-door	2	1.00	60	0.64	34	3.82	458	7.61 ¹	2742	8.77 ¹	3645
	3-door	3	1.50	90	0.96	51	5.31	637	8.59 ¹	3096	9.89 ¹	4110
	4-door	4	2.00	120	1.28	69	6.93	832	11.28 ¹	4065	13.08 ¹	5439
	5-door	5	2.50	150	1.60	85	8.56	1027	13.78 ¹	4965	15.88 ¹	6603

¹ Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONRZ	2-door	NA ²	NA	1.45	174
	3-door	NA	NA	1.94	233
	4-door	NA	NA	2.42	290
	5-door	NA	NA	2.91	349

² Not applicable.

Guidelines & Control Settings

Model	BTUH/door ⁵	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁶ (FPM)
ONRZ ³ - F ⁴	1500	-13	3-5	-2	0	2	460
ONRZ ³ - C ⁴	1600	-23	3-5	-12	-10	-8	460

³ All data listed is for an ONRZ configured with 20" shelves.

⁴ F = Frozen food, C = Ice cream.

⁵ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁶ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRZ	1	13 - 15	46	73 ⁷	---	---	24	60

⁷ For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

⁸ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
CASES

A DOVER DIVERSIFIED COMPANY

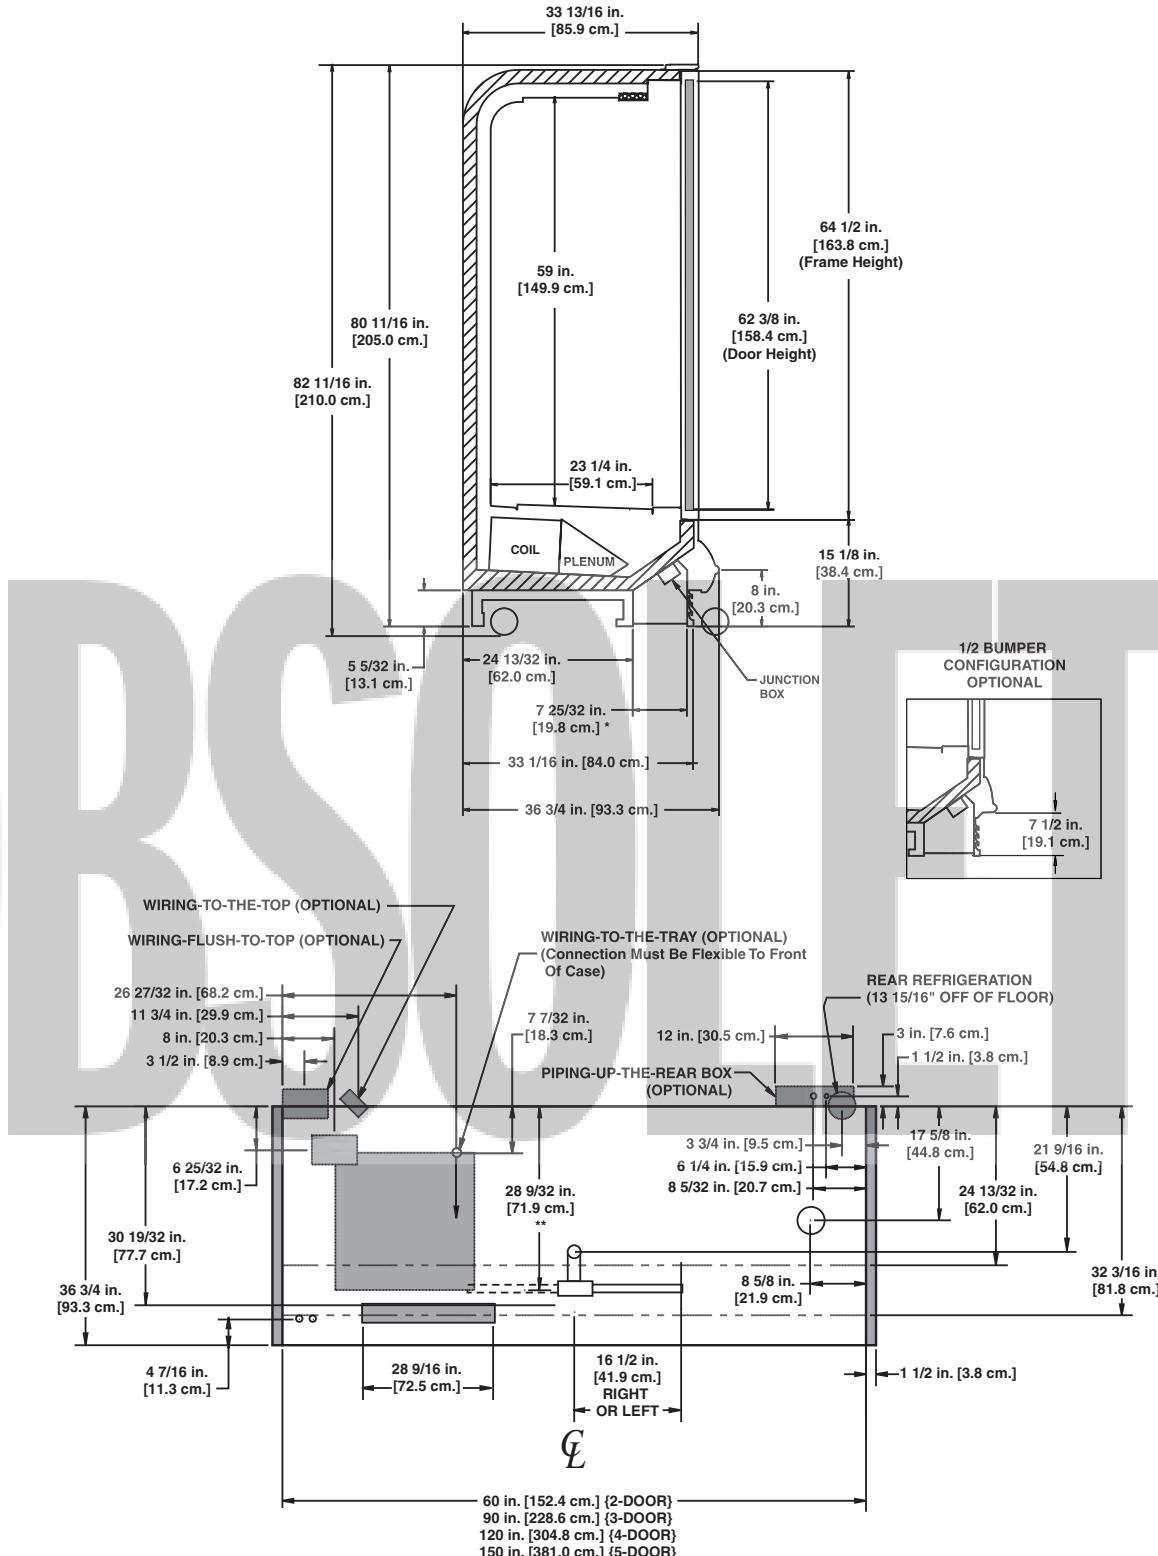

REACH-IN

Frozen Food/Ice Cream

High Narrow Glass Door Reach-in Frozen Food/Ice Cream Merchandiser

ONRZH - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONRZH	2-door	2	1.00	60	0.64	34	3.84	457	7.61 ¹	2742	8.77 ¹
	3-door	3	1.50	90	0.96	51	5.40	648	8.59 ¹	3096	9.89 ¹
	4-door	4	2.00	120	1.28	69	6.97	836	11.28 ¹	4065	13.08 ¹
	5-door	5	2.50	150	1.60	85	8.64	1037	13.78 ¹	4965	15.88 ¹
1 Note: 3 phase load. Figure given is maximum amps per phase.											

¹ Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ONRZH	2-door	NA ²	NA	1.45
	3-door	NA	NA	1.94
	4-door	NA	NA	2.42
	5-door	NA	NA	2.91
2 Not applicable.				

Guidelines & Control Settings

Model	BTUH/door ⁵	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁶ (FPM)
ONRZH ³ - F ⁴	1500	-13	3-5	-8	0	-4	405
ONRZH ³ - C ⁴	1600	-23	3-5	-12	-8	-4	405

³ All data listed is for an ONRZH configured with 20" shelves.

⁴ F = Frozen food, C = Ice cream.

⁵ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁶ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONRZH	1	13 - 15	46	73 ⁷	---	---	24	60

⁷ For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

⁸ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENEC™

A DOVER DIVERSIFIED COMPANY

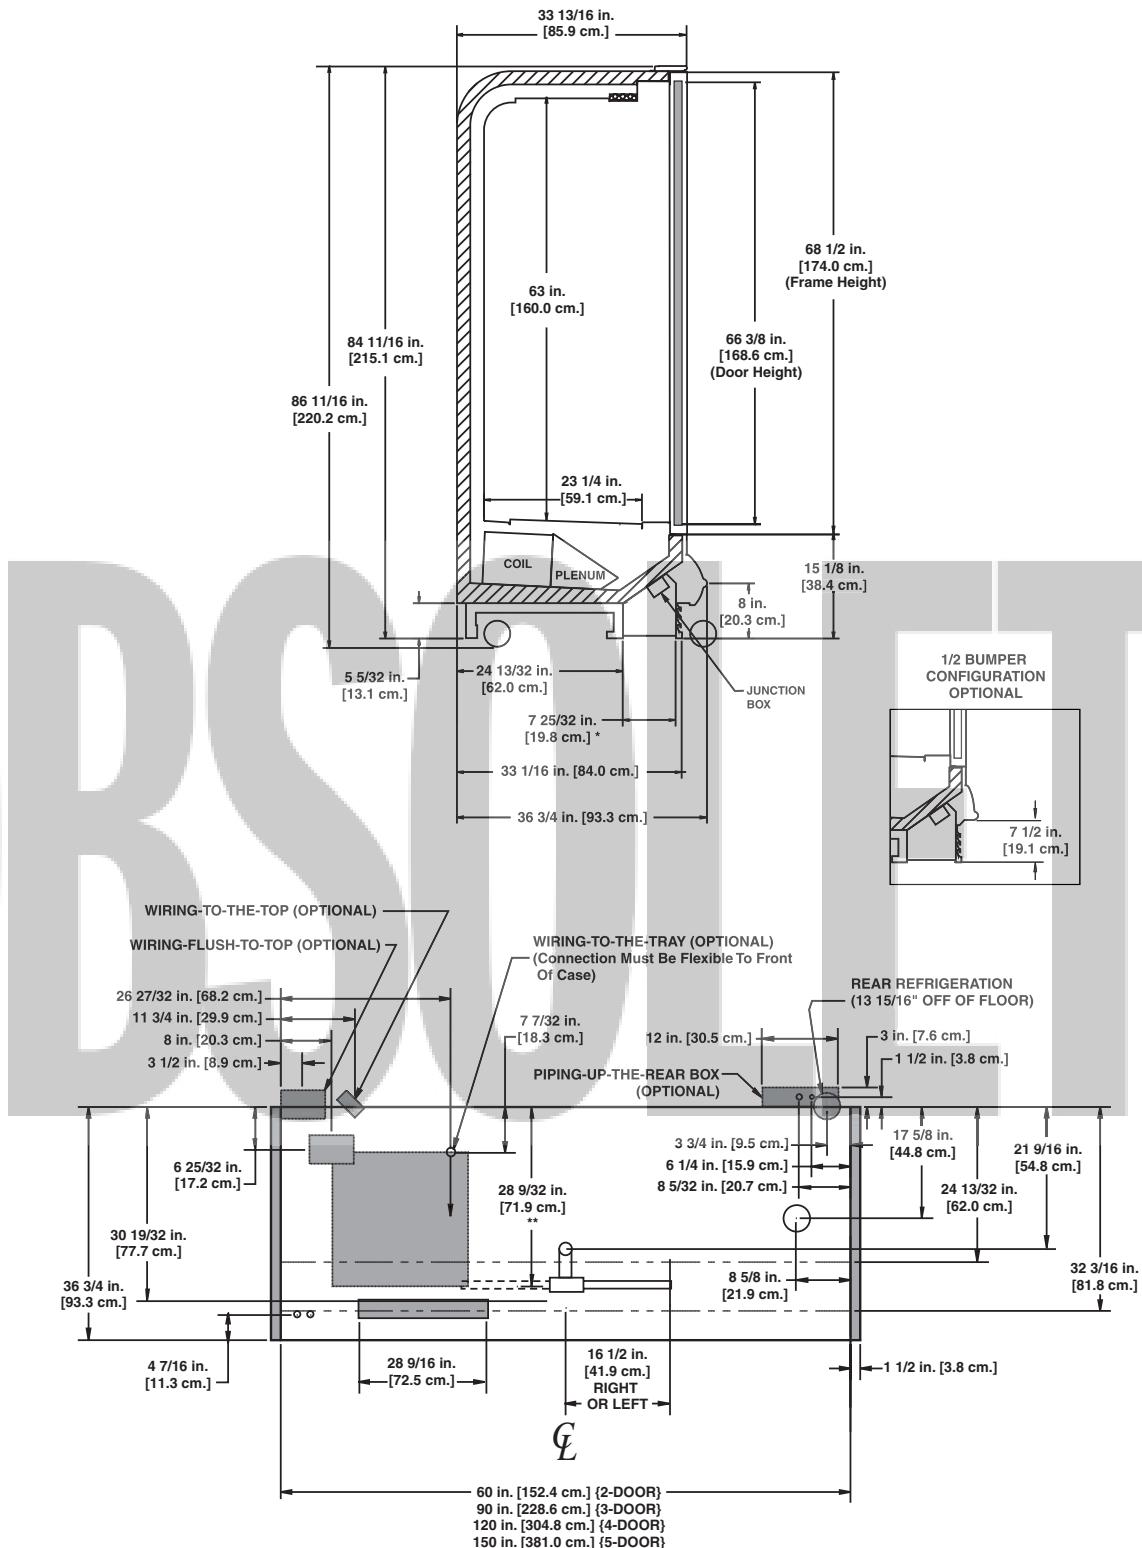

Glass Door Reach-in Frozen Food/Ice Cream Merchandiser

ORZ - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ORZ	2-door	2	1.00	60	0.64	34	3.82	458	7.61 ¹	2742	8.77 ¹
	3-door	3	1.50	90	0.96	51	5.31	637	8.59 ¹	3096	9.89 ¹
	4-door	4	2.00	120	1.28	69	6.93	832	11.28 ¹	4065	13.08 ¹
	5-door	5	2.50	150	1.60	85	8.56	1027	13.78 ¹	4965	15.88 ¹

¹ Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ORZ	2-door	NA ²	NA	1.45 174
	3-door	NA	NA	1.94 233
	4-door	NA	NA	2.42 290
	5-door	NA	NA	2.91 349

² Not applicable.

Guidelines & Control Settings

Model	BTUH/door ⁴	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁵ (FPM)
ORZ - F ³	1400	-13	3-5	-8	0	-5	380
ORZ - C ³	1600	-23	3-5	-12	-3	-10	380

³ F = Frozen food, C = Ice cream.

⁴ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁵ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORZ	1	13 - 15	46	73 ⁶	---	---	24	60

⁶ For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

⁷ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COLD

A DOVER DIVERSIFIED COMPANY

REACH-IN

Frozen Food/Ice Cream

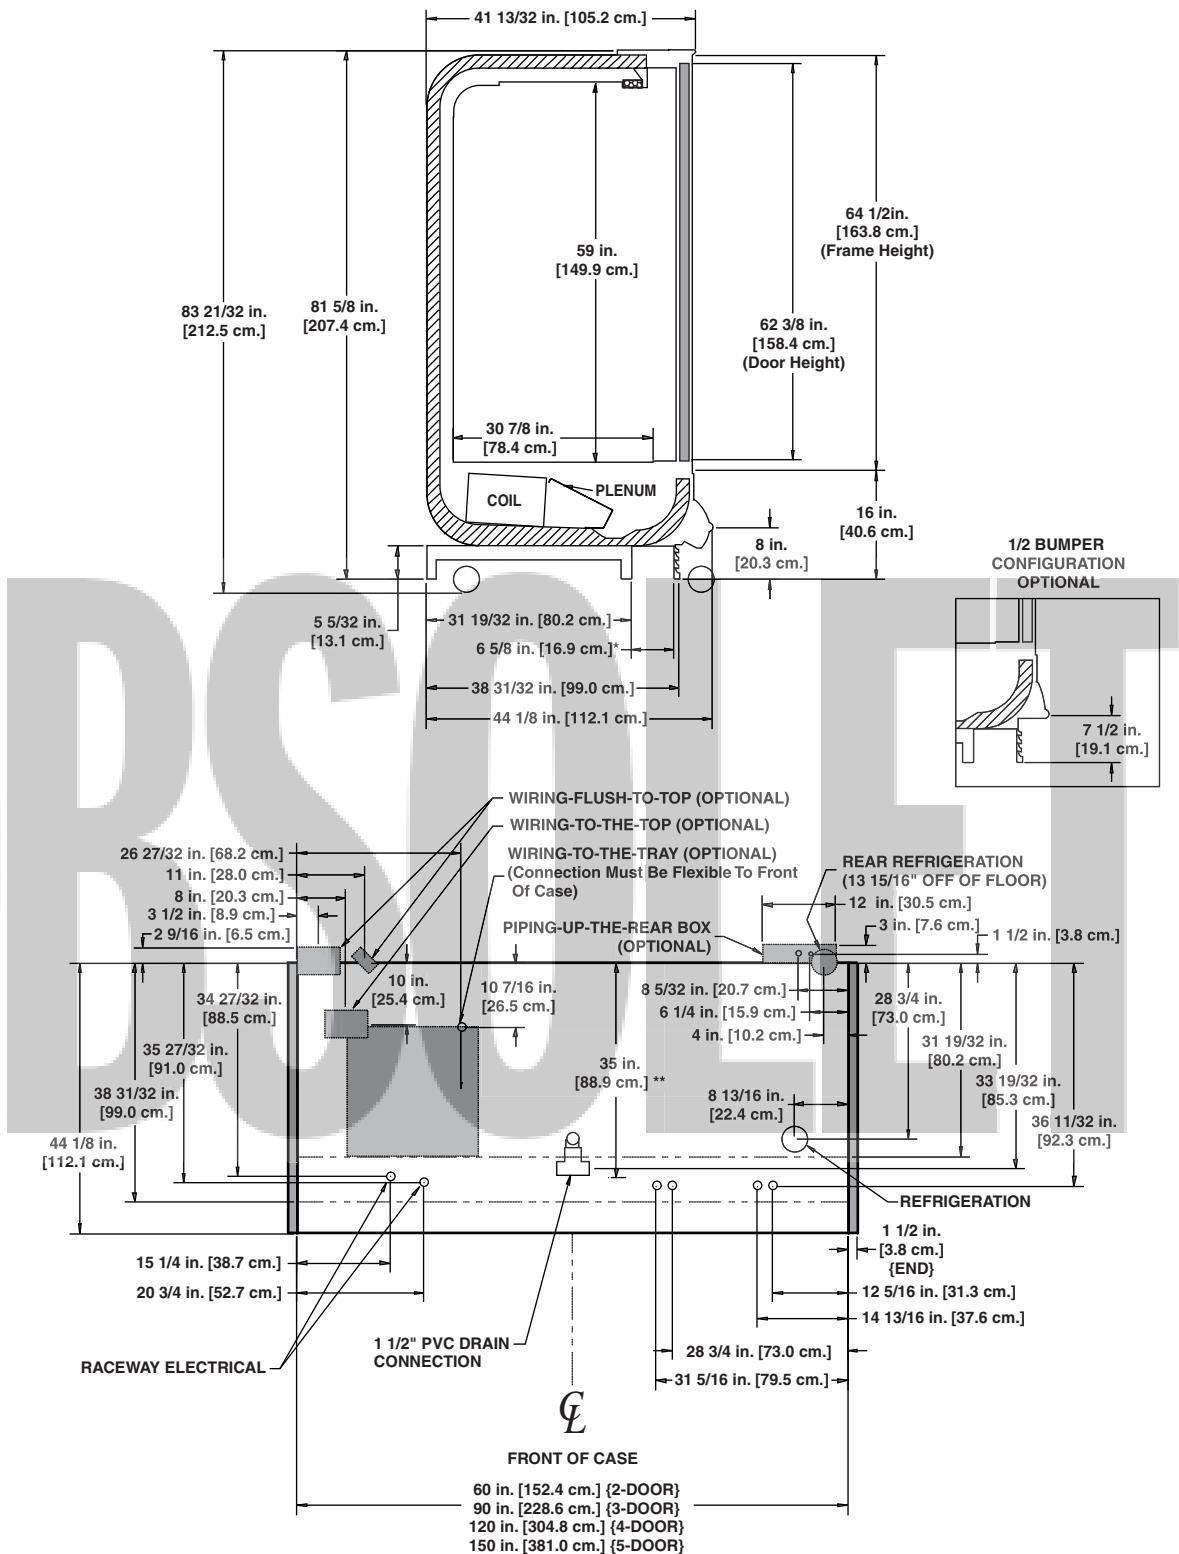

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- WIRING-TO-THE-TOP- ADDS APPROXIMATELY 1 INCH TO CASE HEIGHT
- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL (WHEN THE CASE IS PIPED TO THE REAR A 3" TO 4" GAP MAY BE REQUIRED)
- BACK PANELS ADD APPROXIMATELY 1" TO THE REAR OF THE CASE
- SUCTION LINE 7/8", LIQUID LINE - 3/8", LIQUID LINE PIPED TO TOP 5/8"
- AVAILABLE SHELF SIZES: WIRE SHELVES 16", 18", 20", 22", & 23 1/2"
SOLID SHELVES 18", 20", 22", & 24"

High Glass Door Reach-in Frozen Food/Ice Cream Merchandiser

ORZH - 2, 3, 4, & 5-door

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ORZH	2-door	2	1.00	60	0.64	34	3.84	457	7.61 ¹	2742	8.77 ¹
	3-door	3	1.50	90	0.96	51	5.40	648	8.59 ¹	3096	9.89 ¹
	4-door	4	2.00	120	1.28	69	6.97	836	11.28 ¹	4065	13.08 ¹
	5-door	5	2.50	150	1.60	85	8.64	1037	13.78 ¹	4965	15.88 ¹
1 Note: 3 phase load. Figure given is maximum amps per phase.											

¹ Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ORZH	2-door	NA ²	NA	1.45 174
	3-door	NA	NA	1.94 233
	4-door	NA	NA	2.42 290
	5-door	NA	NA	2.91 349

² Not applicable.

Guidelines & Control Settings

Model	BTUH/door ⁴	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁵ (FPM)
ORZH - F ³	1500	-13	3-5	-8	0	-4	405
ORZH - C ³	1600	-23	3-5	-12	-8	-4	405

³ F = Frozen food, C = Ice cream.

⁴ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁵ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ORZH	1	13 - 15	46	73 ⁶	---	---	24	60

⁶ For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

⁷ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN
CASES

A DOVER DIVERSIFIED COMPANY

REACH-IN

Frozen Food/Ice Cream

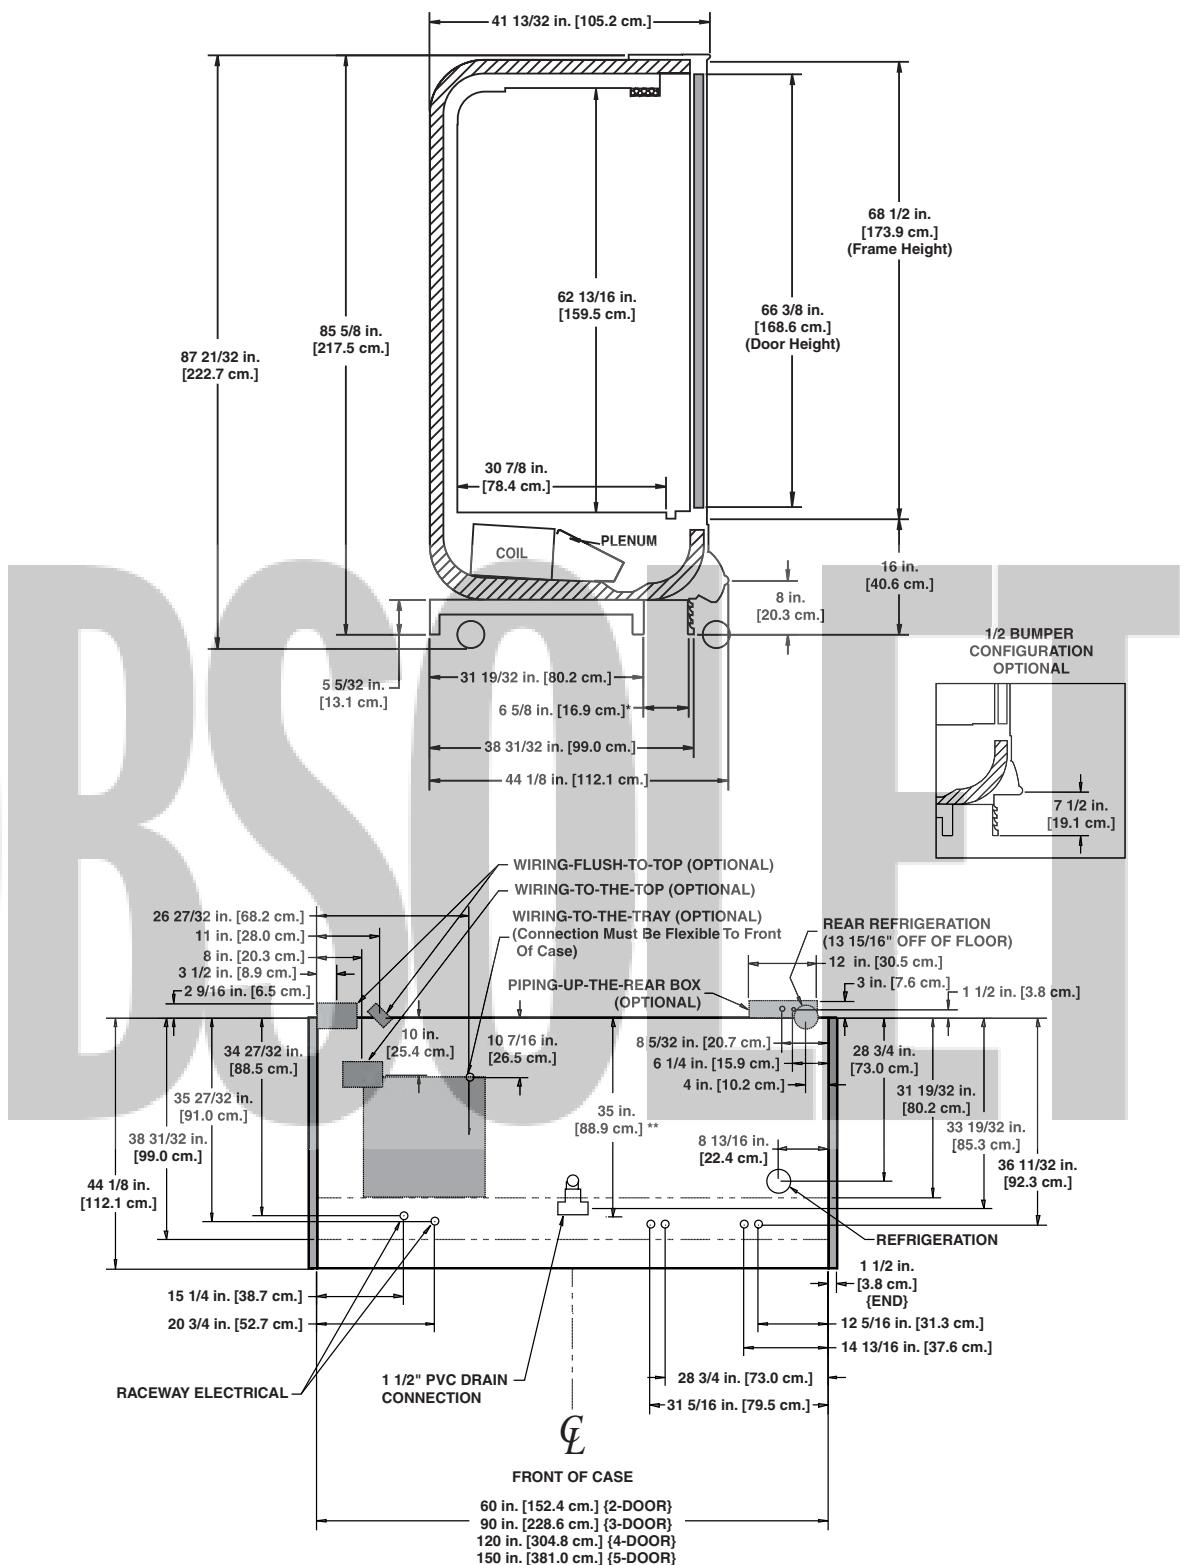

Glass Door Reach-in Crown End Frozen Food/Ice Cream Merchandiser

OREZ

Electrical Data

Model	Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OREZ	3	1.50	90	0.96	51	6.52	782	5.00 ¹	1800	5.77 ¹	2394

¹ Note: 3 phase load. Figure given is maximum amps per phase.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OREZ	NA ²	NA	2.91	349

² Not applicable.

Guidelines & Control Settings

Model	BTUH/door ⁴	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁵ (FPM)
OREZ - F ³	1768	-13	3-5	2	6	7	350
OREZ - C ³	1811	-23	3-5	-6	-2	-1	340

³ F = Frozen food, C = Ice cream.

⁴ BTUH's/door listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁵ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OREZ-F	1	13 - 15	55	73 ⁶	---	---	26	60	---	---
OREZ-C	1	13 - 15	75	73 ⁶	---	---	26	60	---	---

⁶ For cases equipped with CPC case controllers use bi-metallic defrost controls with a setting of 73° F.

⁷ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.



A DOVER DIVERSIFIED COMPANY

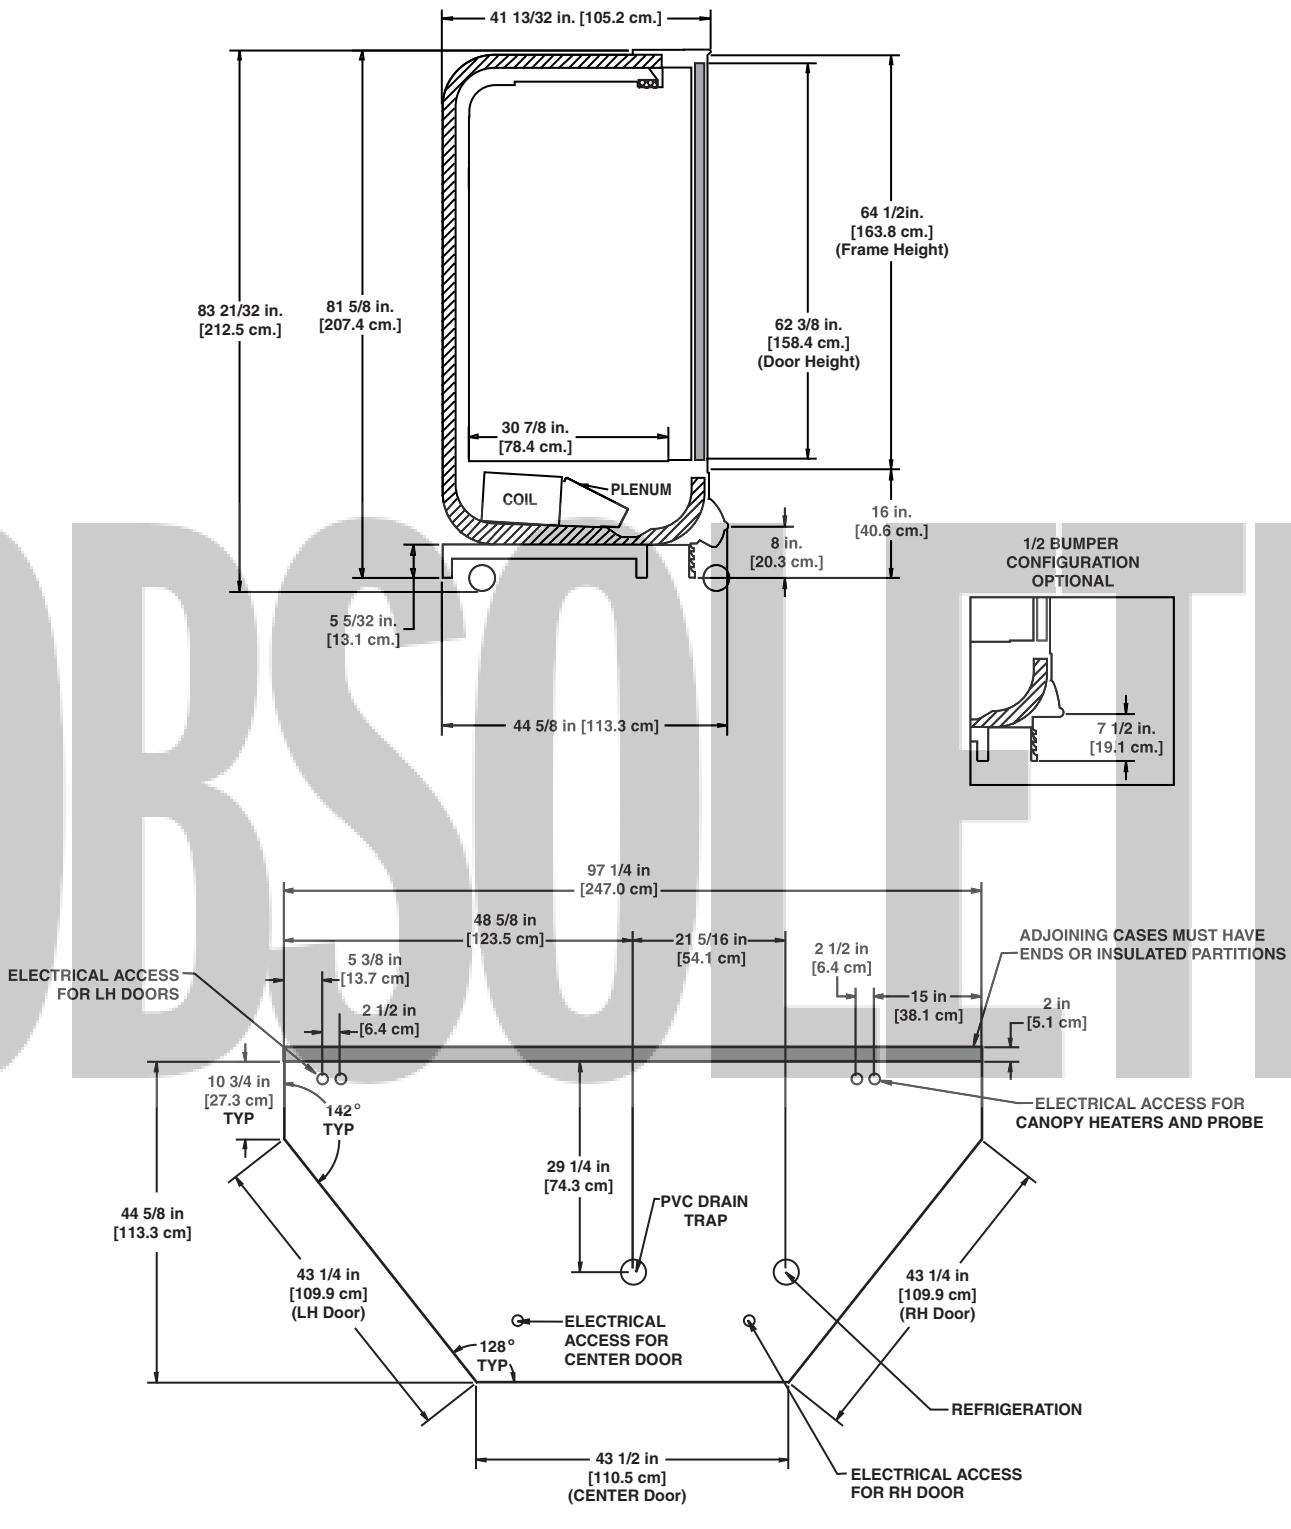

REACH-IN

Frozen Food/Ice Cream

OBSOLETE

Single Deck Island Merchandisers

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

Narrow Island Deli/Meat Merchandiser

ONIM - 8' & 12' double wraparound ends

ONIMB - 8' & 12' single wraparound end

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIM	8'	6	2.70	102	0.90	66	0.82	98	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.08	130	7.22	1502	8.33
ONIMB	8'	6	2.70	102	0.90	66	0.75	90	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.17	140	7.22	1502	8.33

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
ONIM	8'	NA ¹	NA	1.26	151
	12'	NA	NA	1.46	175
ONIMB	8'	NA	NA	1.26	151
	12'	NA	NA	1.46	175

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
ONIM/ONIMB Meat	885 ⁴	12	6-8	25	33	34	180
ONIM/ONIMB Deli	860 ⁵	17	6-8	28	36	37	180

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

⁴ ONIM (meat): +400 BTUH per wraparound end.

⁵ ONIM (deli): +250 BTUH per wraparound end.

Defrost Controls


Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONIM/ONIMB	3	6 - 8	35	47	45	47	26	45

⁶ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

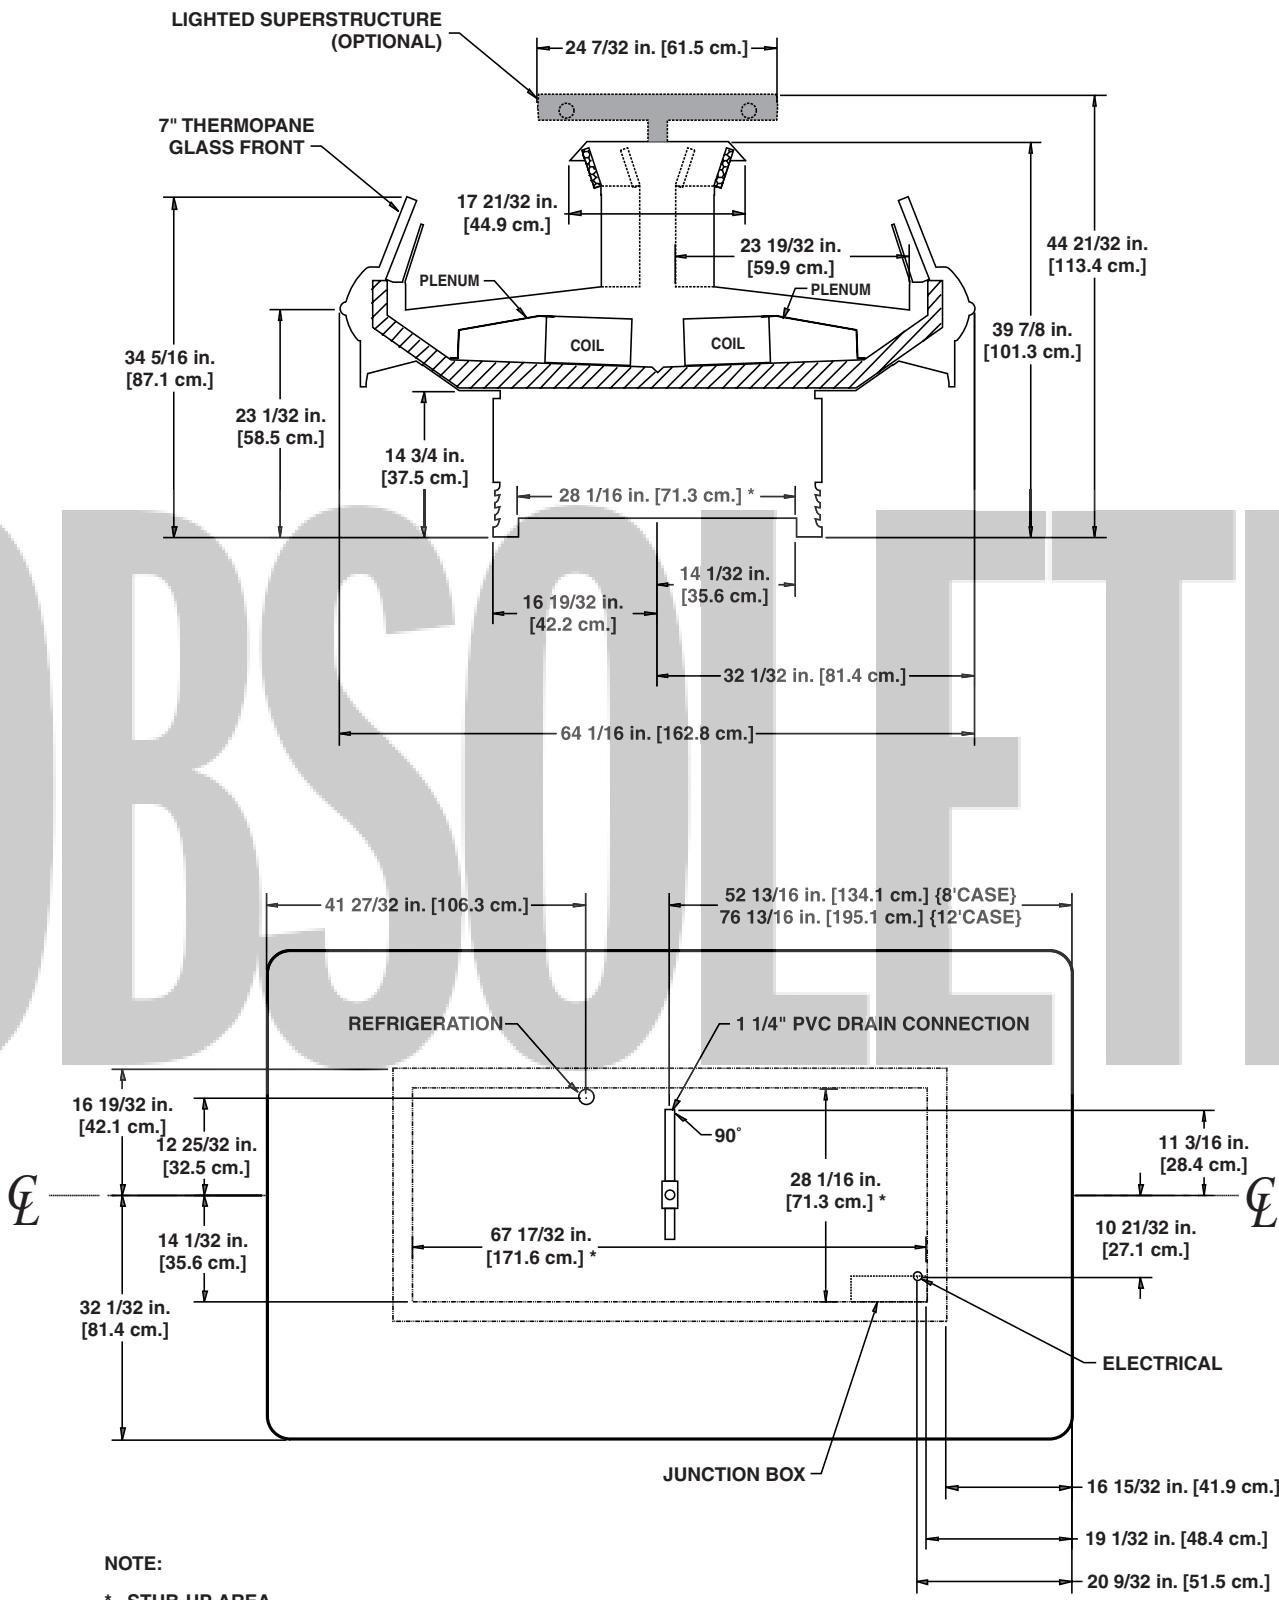

SINGLE DECK ISLAND

Deli/Meat

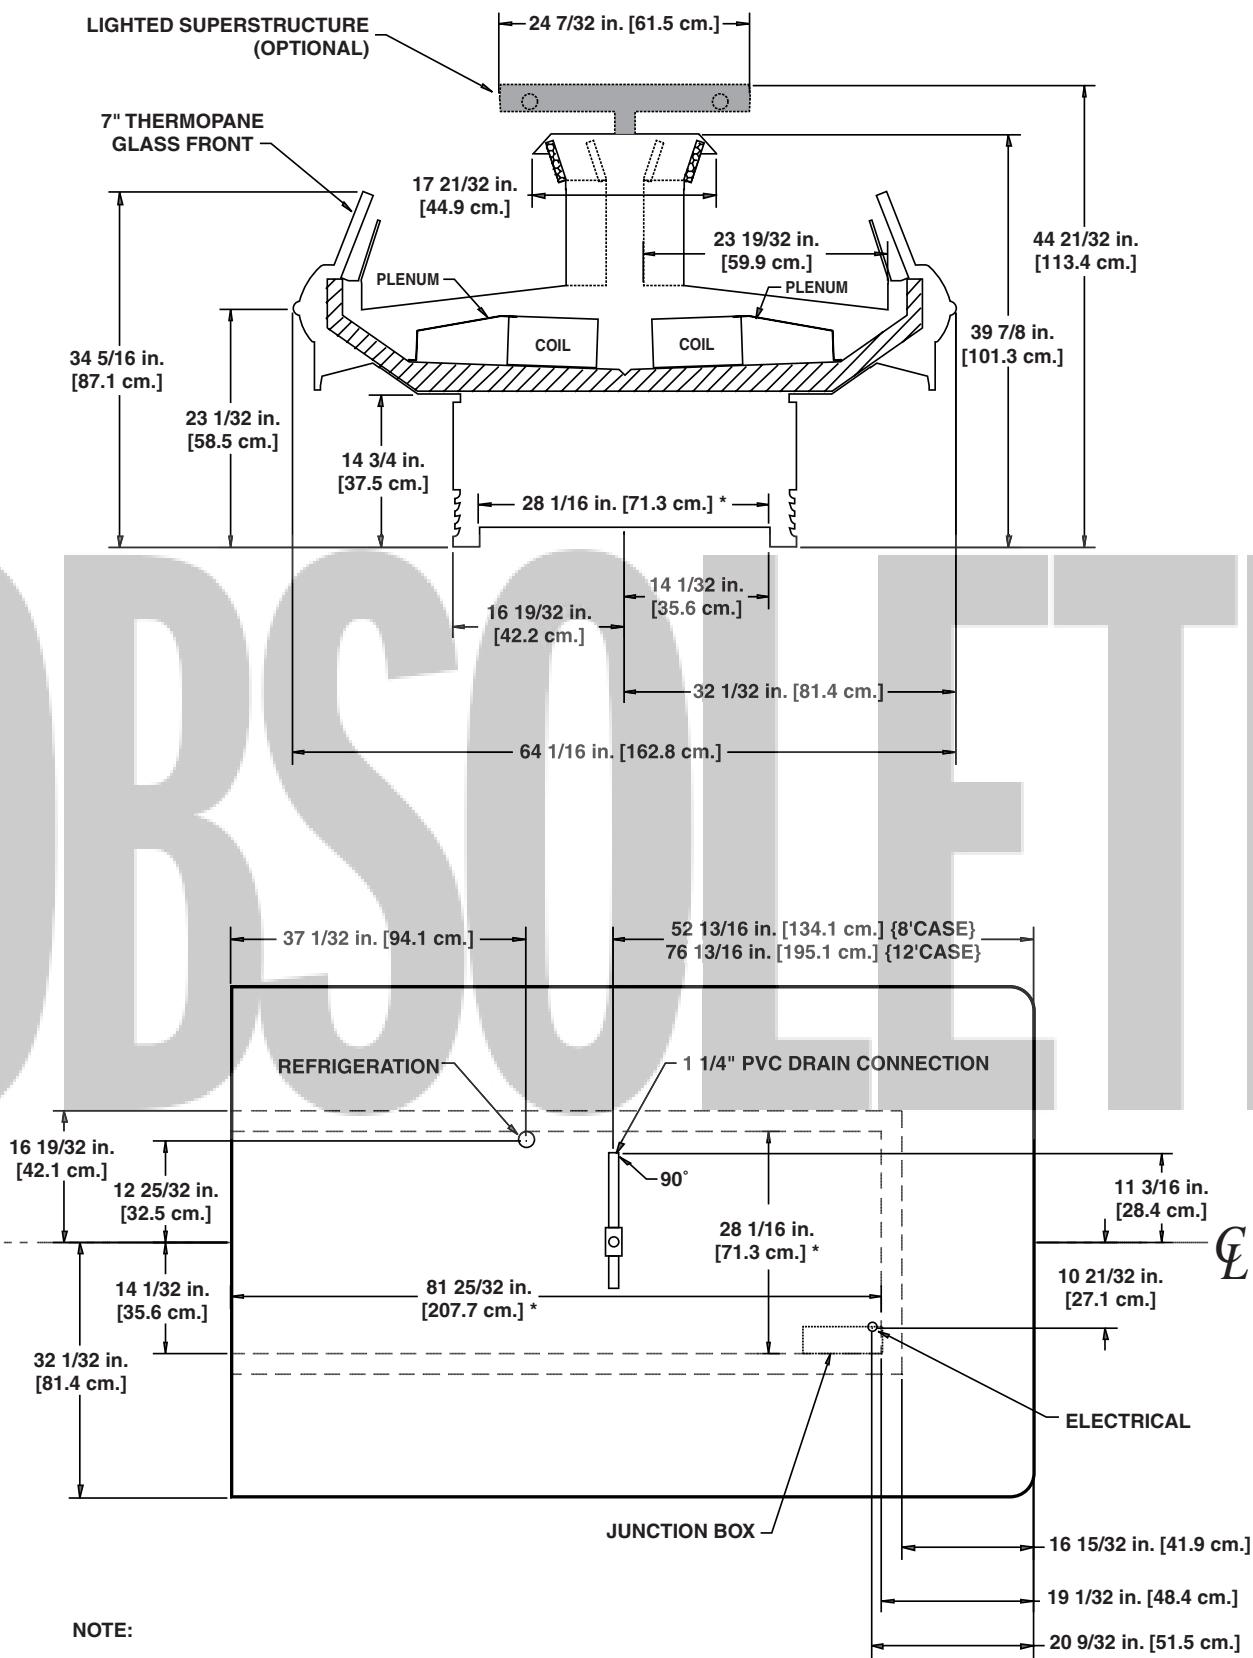

SINGLE DECK ISLAND

Meat/Deli

OBSCURE

Wide Island Deli/Meat Merchandiser

OIM - 8' & 12' double wraparound ends

OIMB - 6', 8' & 12' single wraparound end

OIMBB - 8' double joint ends

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIM	8'	6	2.70	102	0.90	66	0.82	98	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.08	130	7.22	1502	8.33
OIMB	6'	4	1.80	76	0.60	44	0.57	68	3.25	676	3.75
	8'	6	2.70	102	0.90	66	0.75	90	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.17	140	7.22	1502	8.33
OIMBB	8'	6	2.70	102	0.90	66	0.92	110	4.34	902	5.00
											1200

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OIM	8'	NA ¹	NA	5.04
	12'	NA	NA	6.50
OIMB	6'	NA	NA	3.15
	8'	NA	NA	4.41
	12'	NA	NA	5.87
OIMBB	8'	NA	NA	3.78
				454

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OIM/OIMB/OIMBB Meat	770 ⁴	12	6-8	26	34	31	140
OIM/OIMB/OIMBB Deli	560 ⁵	17	6-8	28	36	33	140

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

⁴ OIM (meat): +400 BTUH per wraparound end.

⁵ OIM (deli): +250 BTUH per wraparound end.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OIM/OIMB/OIMBB	3	6 - 8	40	47	45	47	26	45

⁶ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm

All measurements taken per CRMA specifications.


HILL PHOENIX
EXCELLENCE


A DOVER DIVERSIFIED COMPANY

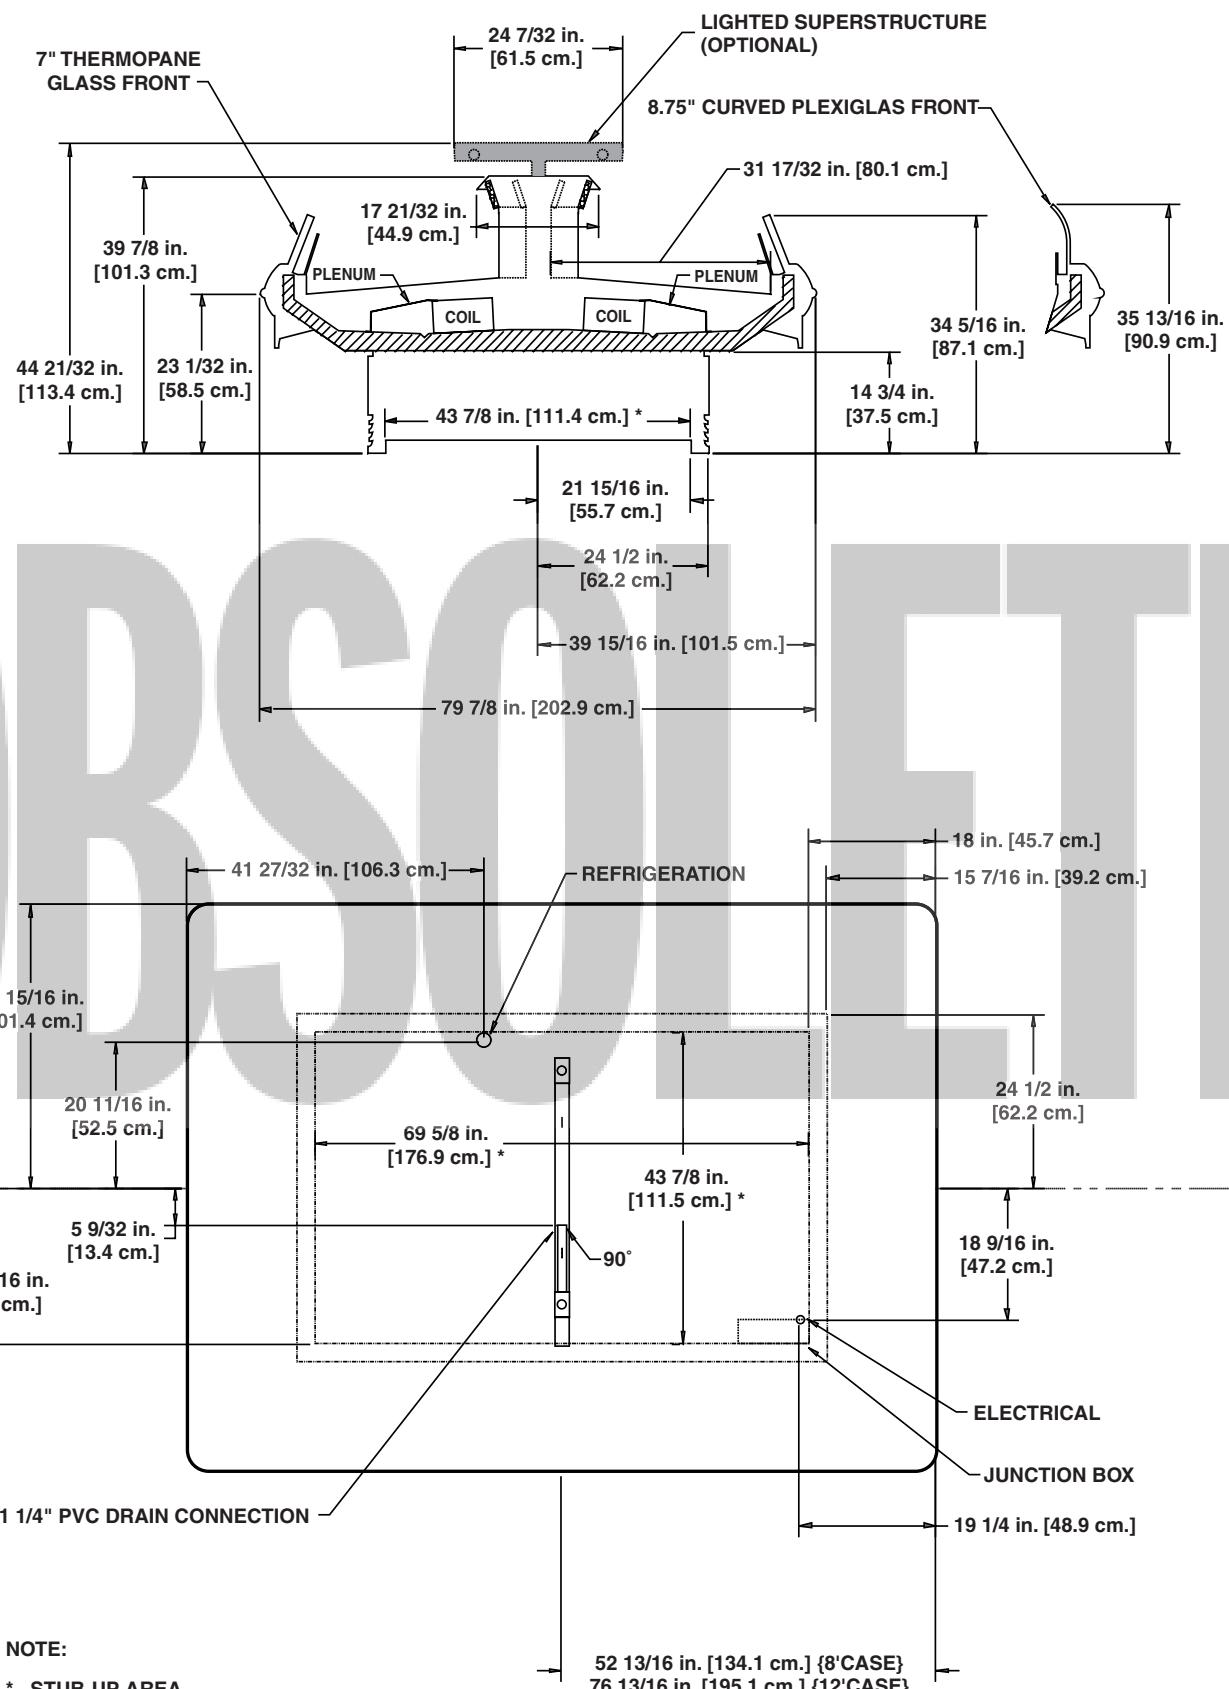

SINGLE DECK ISLAND

Deli/Meat

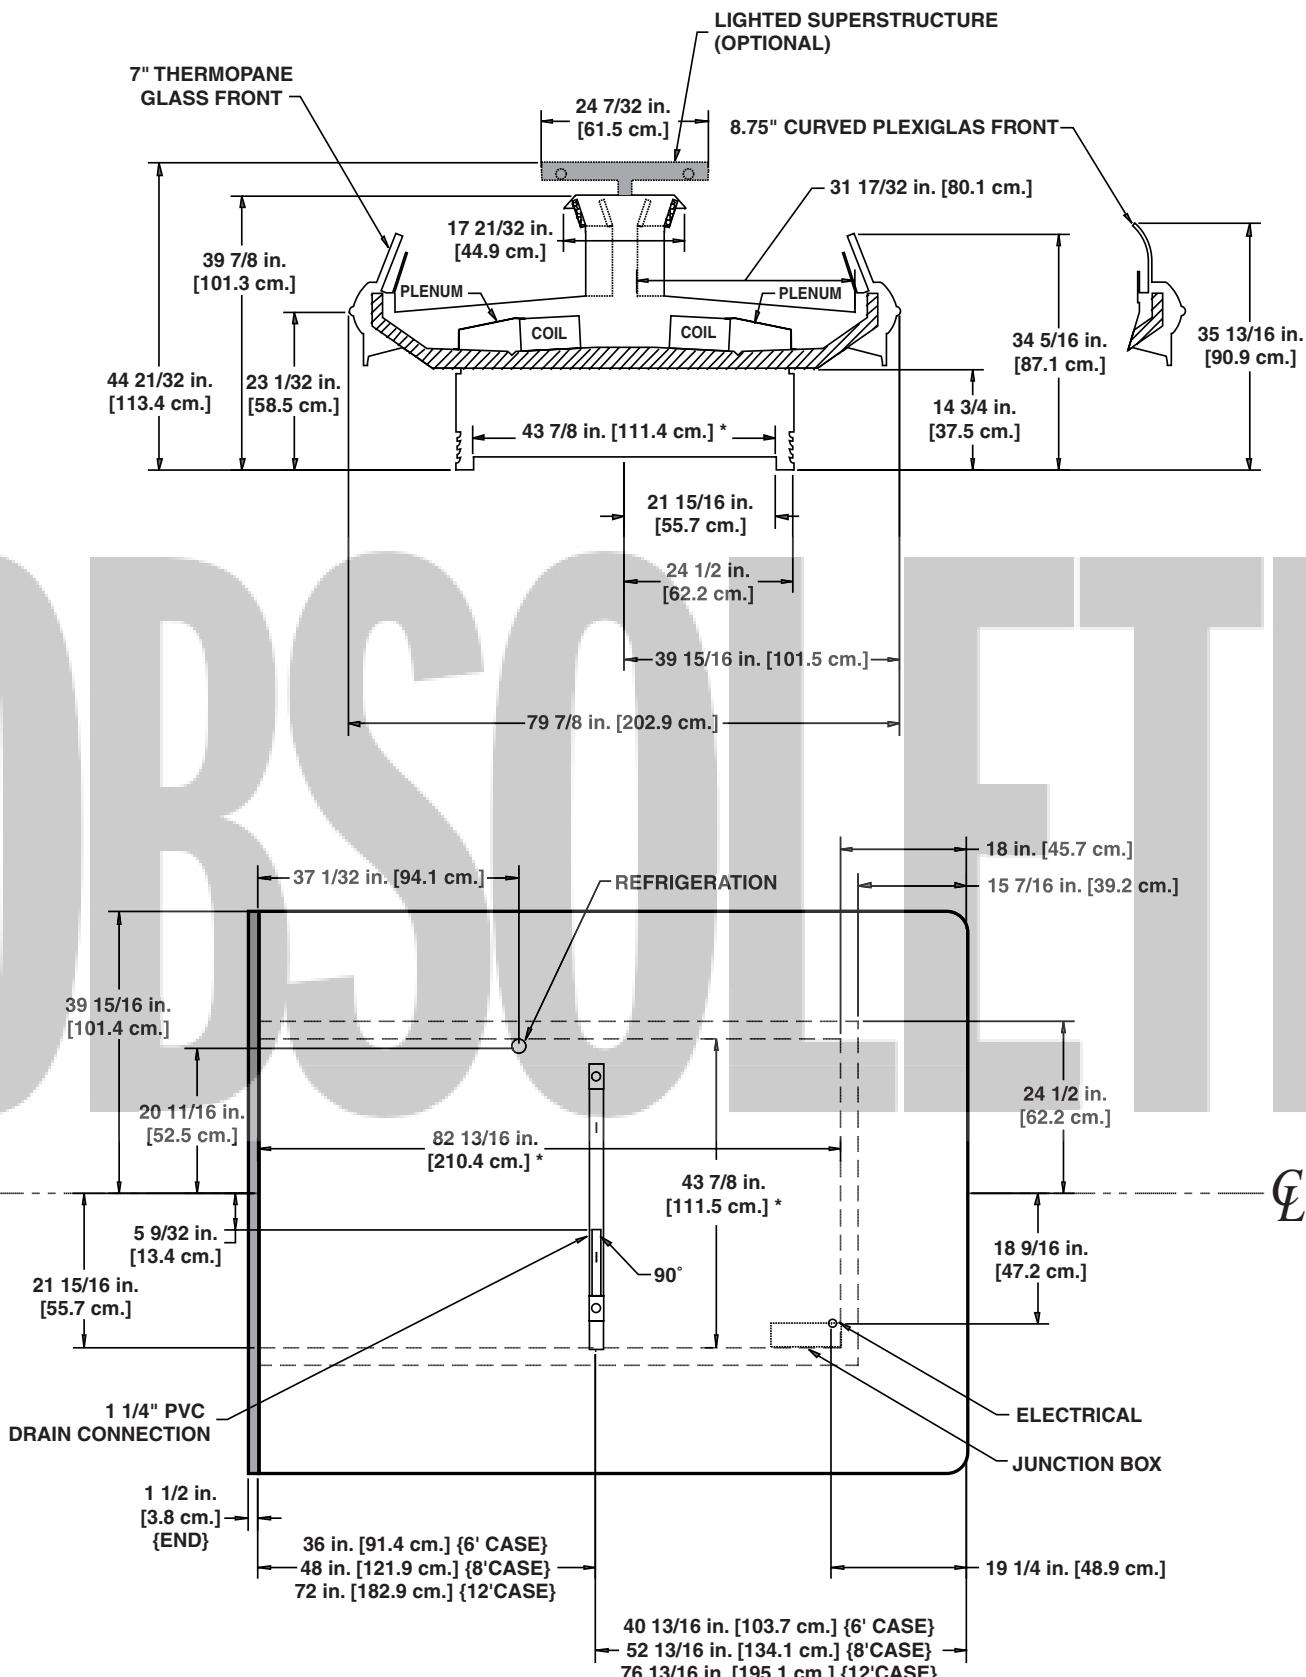

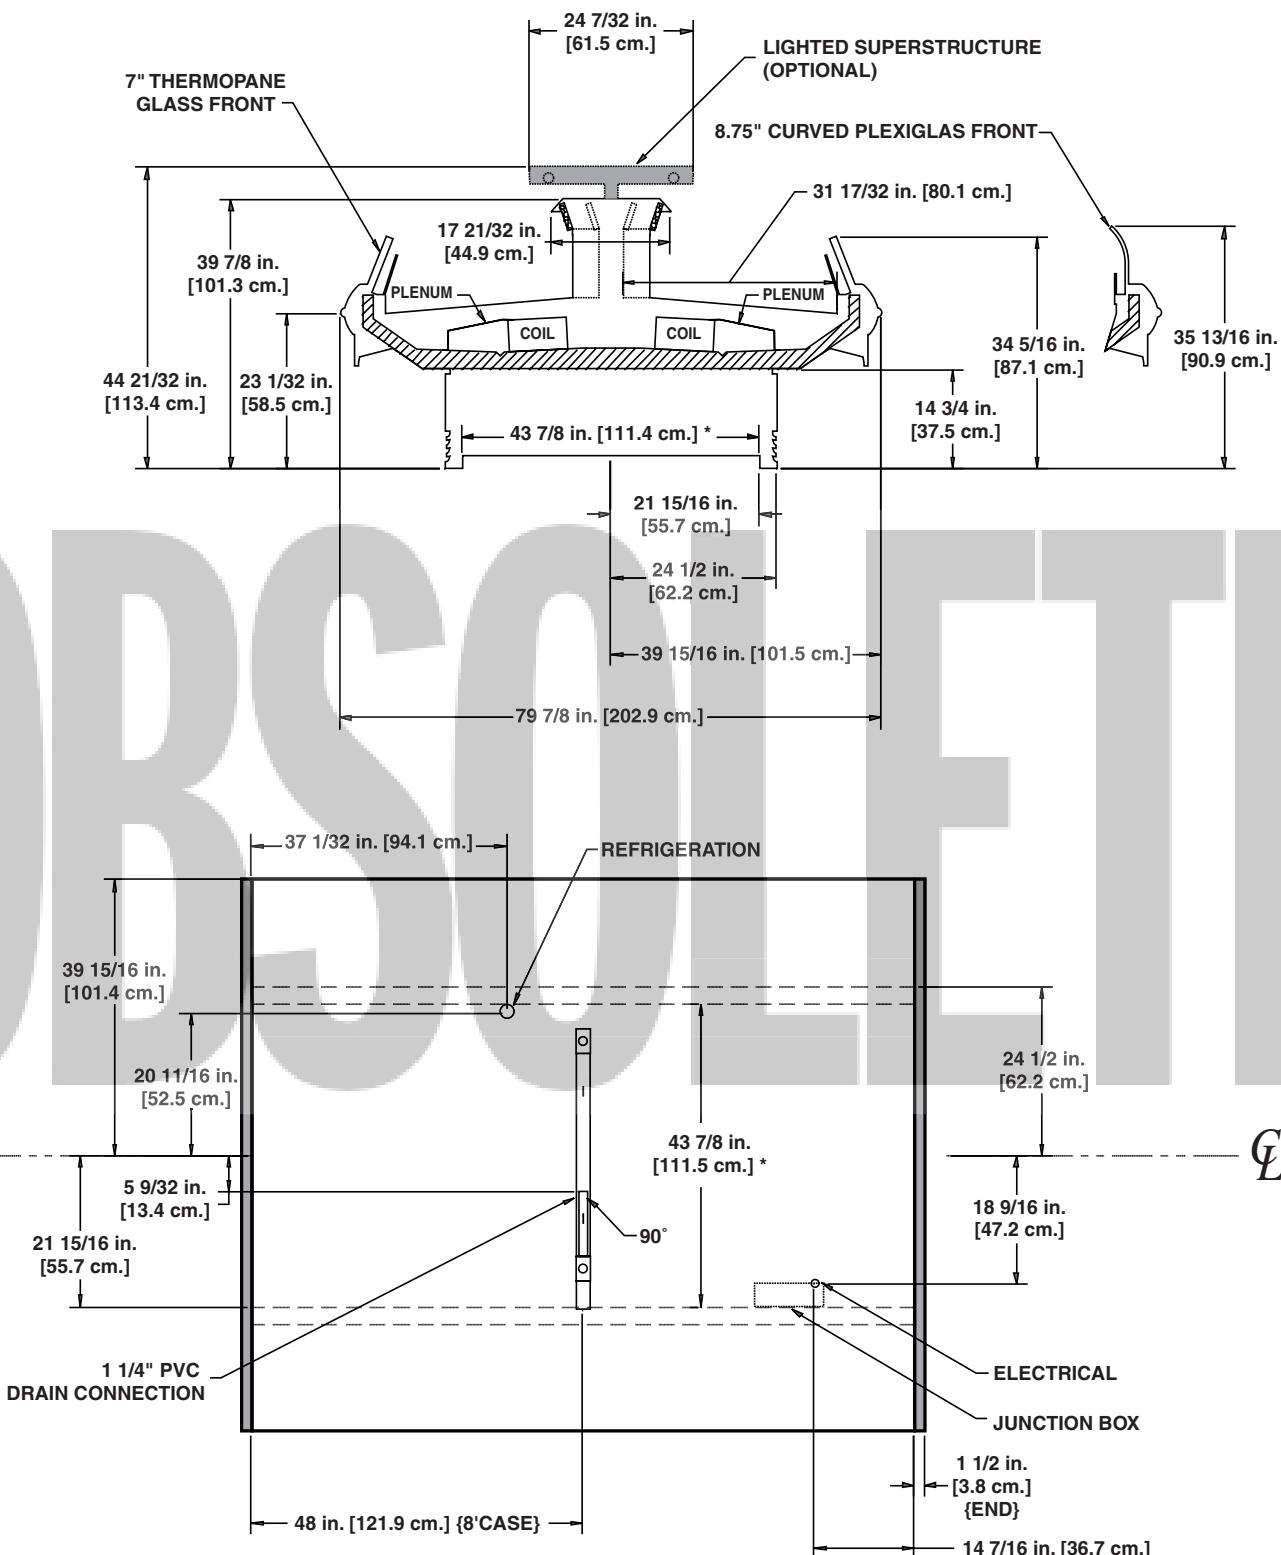**SINGLE DECK ISLAND**

Deli/Meat

Wide Island Bulk Produce Merchandiser

OIP - 8' & 12' wide island double wraparound end

OIPB - 6', 8', 10' & 12' wide island single wraparound end

OIPBB - 8' & 12' wide island double joint

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIP	8'	6	2.70	102	0.90	66	0.23	28	---	---	---
	12'	8	3.60	136	1.20	88	0.55	66	---	---	---
OIPB	6'	4	1.80	76	0.60	44	0.31	37	---	---	---
	8'	6	2.70	102	0.90	66	0.46	55	---	---	---
	10'	6	2.70	102	0.90	66	0.66	79	---	---	---
	12'	8	3.60	136	1.20	88	0.78	94	---	---	---
OIPBB	8'	6	2.70	102	0.90	66	0.84	101	---	---	---
	12'	8	3.60	136	1.20	88	1.26	151	---	---	---

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OIP	8'	NA ²	NA	3.78	454
	12'	NA	NA	5.04	605
OIPB	6'	NA	NA	1.89	227
	8'	NA	NA	3.15	378
	10'	NA	NA	---	---
	12'	NA	NA	4.41	529
OIPBB	8'	NA	NA	2.52	302
	12'	NA	NA	3.78	454

² Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
OIP/OIPB/OIPBB	650 ⁵	22	6-8	34	40	48	140

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

⁵ OIP: +600 BTUH per wraparound end.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OIP/OIPB/OIPBB	3	6 - 8	---	---	44	38	---	---	---	---


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLENCE


A DOVER DIVERSIFIED COMPANY

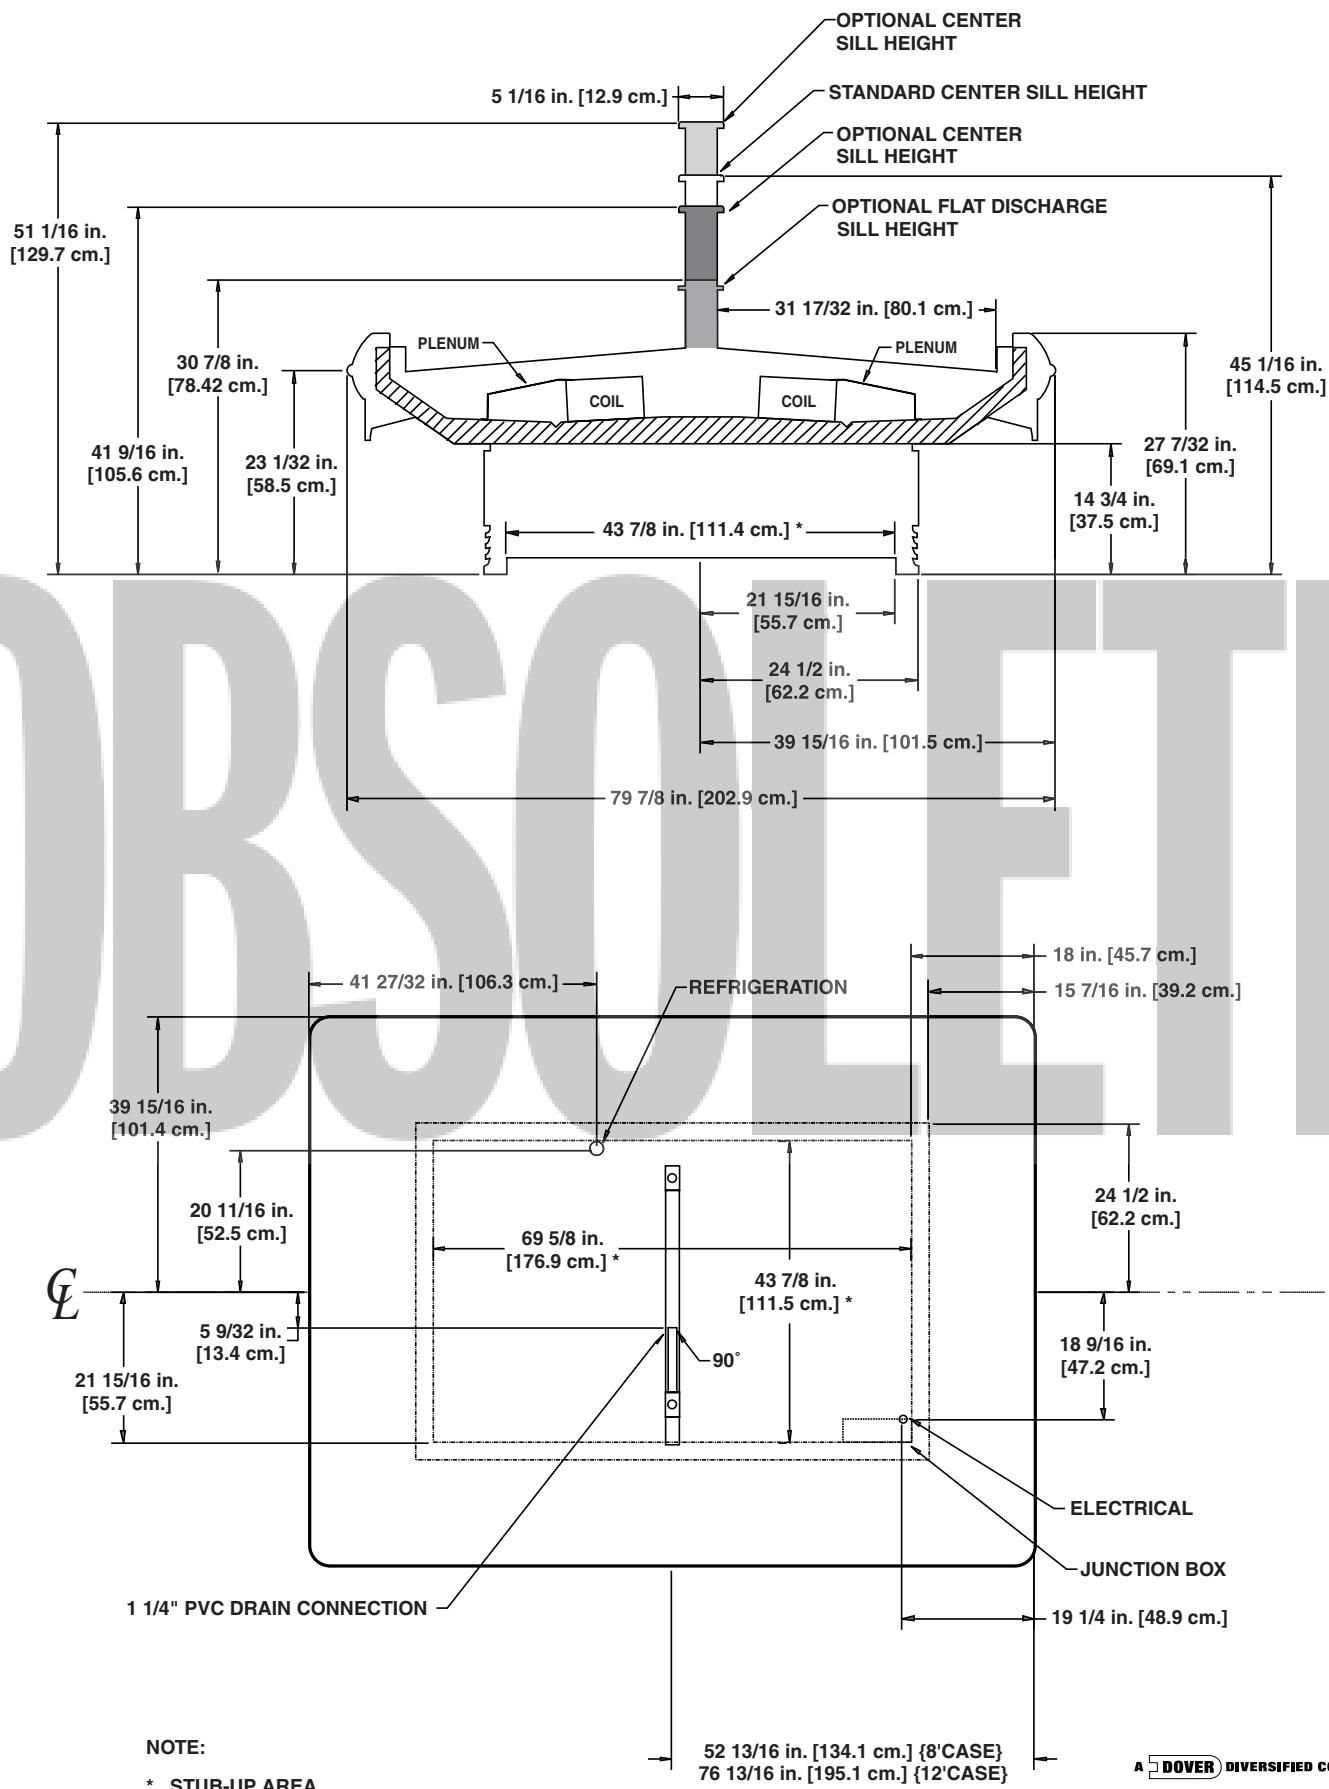

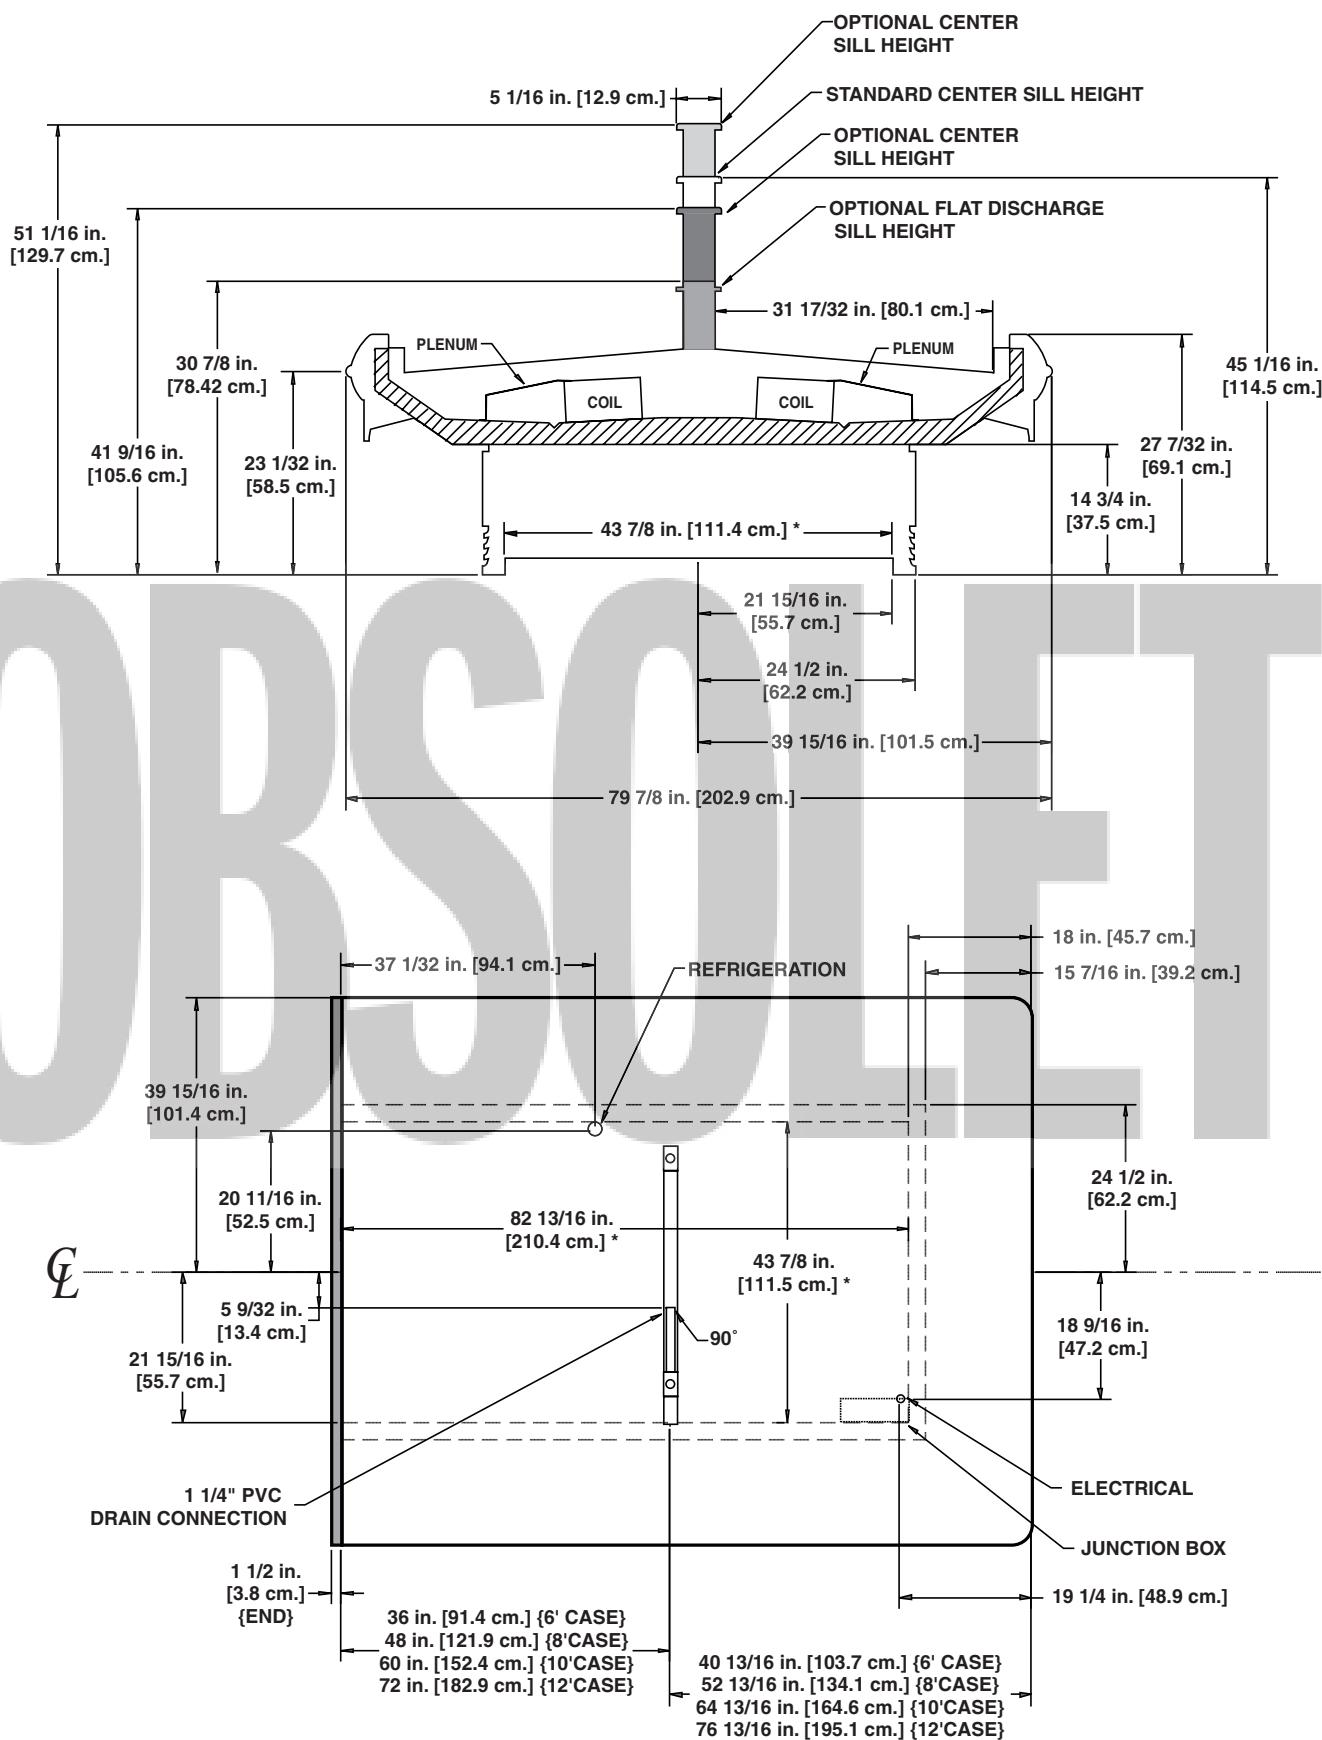

NOTE:

* STUB-UP AREA

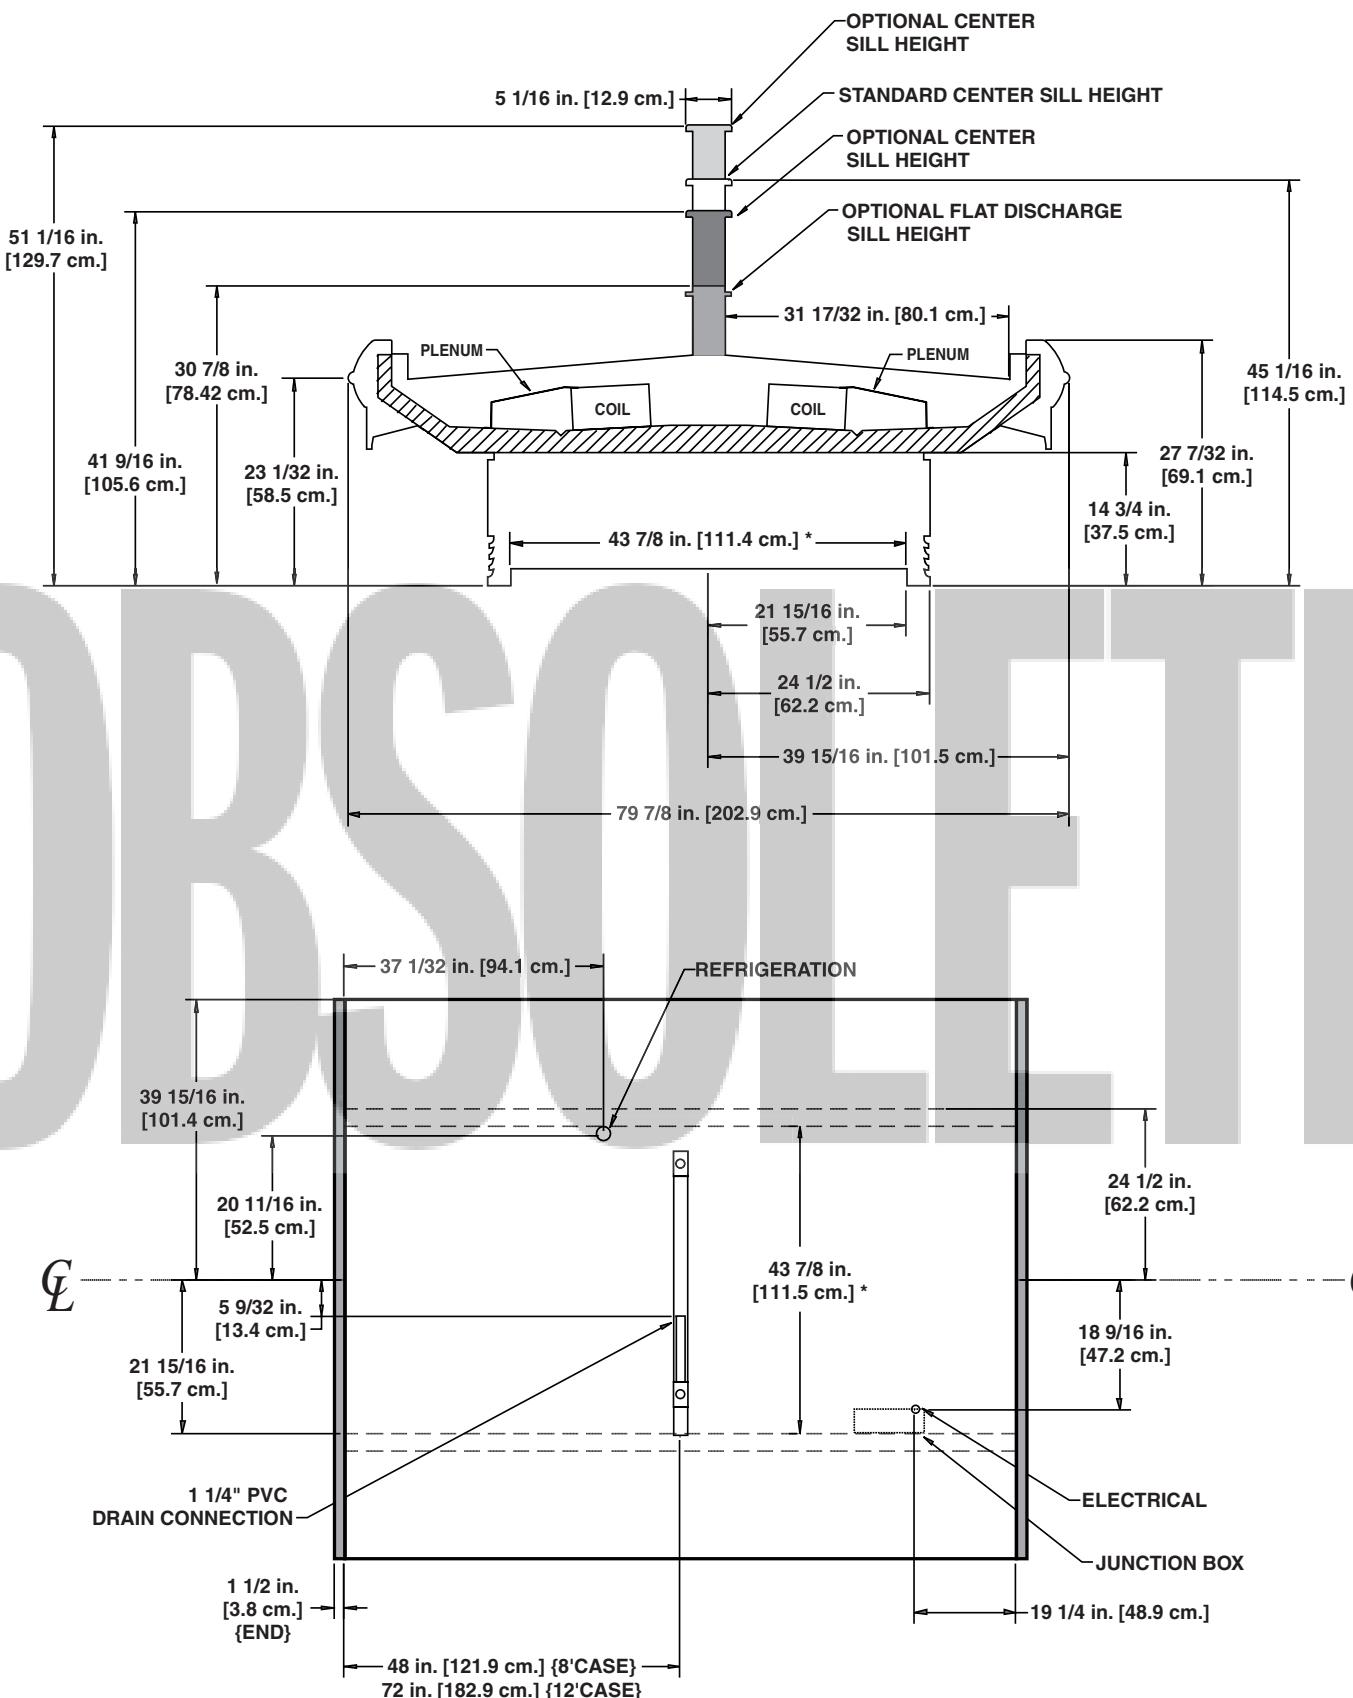

NOTE:

* STUB-UP AREA

Narrow Island Frozen Food/Ice Cream Merchandiser

ONIZ - 8' & 12' standard front

ONIZG - 8' & 12' glass front

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters		Drain Heaters	
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIZ	F-8'	2	0.90	34	0.30	22	1.46	175	7.69	1600	8.88
	F-12'	3	1.35	51	0.45	33	1.87	224	11.54	2400	13.31
	C-8'	2	0.90	34	0.30	22	1.46	175	15.38	3200	17.75
	C-12'	3	1.35	51	0.45	33	1.87	224	23.08	4800	26.63
ONIZG	F-8'	2	0.90	34	0.30	22	3.12	374	7.69	1600	8.88
	F-12'	3	1.35	51	0.45	33	3.40	408	11.54	2400	13.31
	C-8'	2	0.90	34	0.30	22	3.12	374	15.38	3200	17.75
	C-12'	3	1.35	51	0.45	33	3.40	408	23.08	4800	26.63

1 F = Frozen food, C = Ice cream.

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
ONIZ/ONIZG	8'	---	---	---
	12'	---	---	---

2 NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
ONIZ/ONIZG-F	369	-23	3-5	-12	-1	0	180
ONIZ/ONIZG-C	412	-33	3-5	-22	-11	-9	180

3 BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

4 Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONIZ/ONIZG	1	13 - 15	48	47	---	---	20	60

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE


A DOVER DIVERSIFIED COMPANY

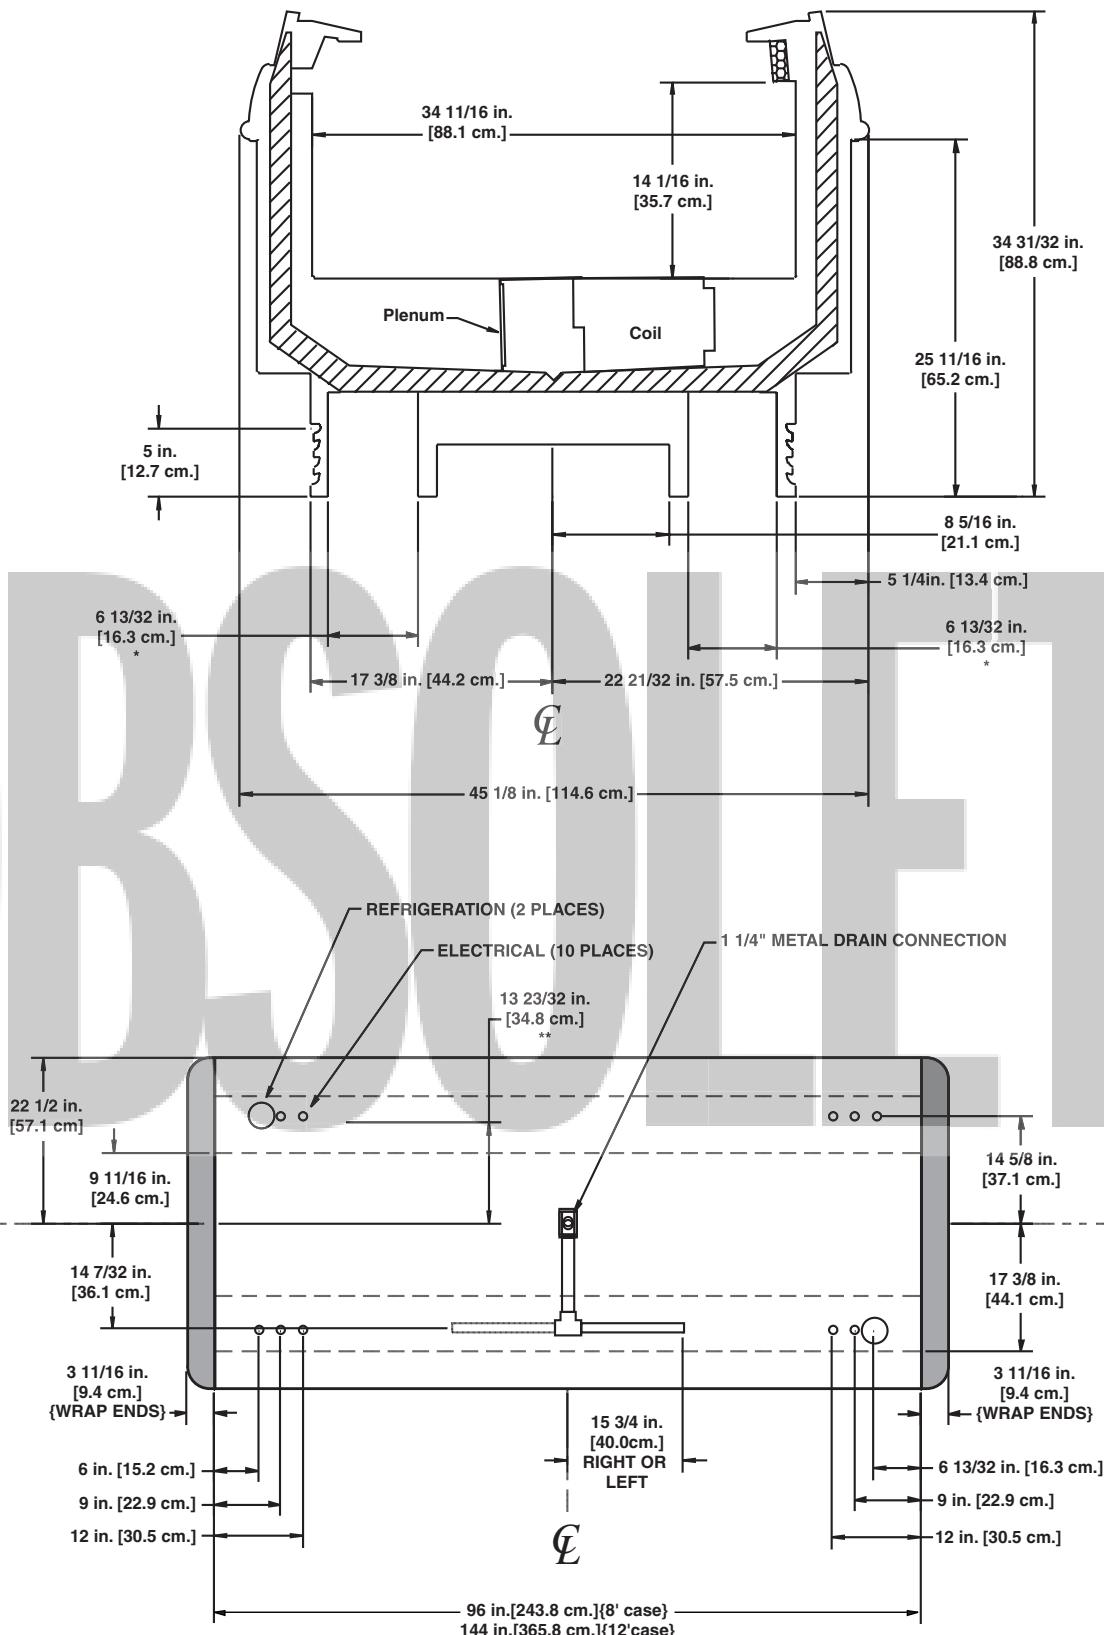

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

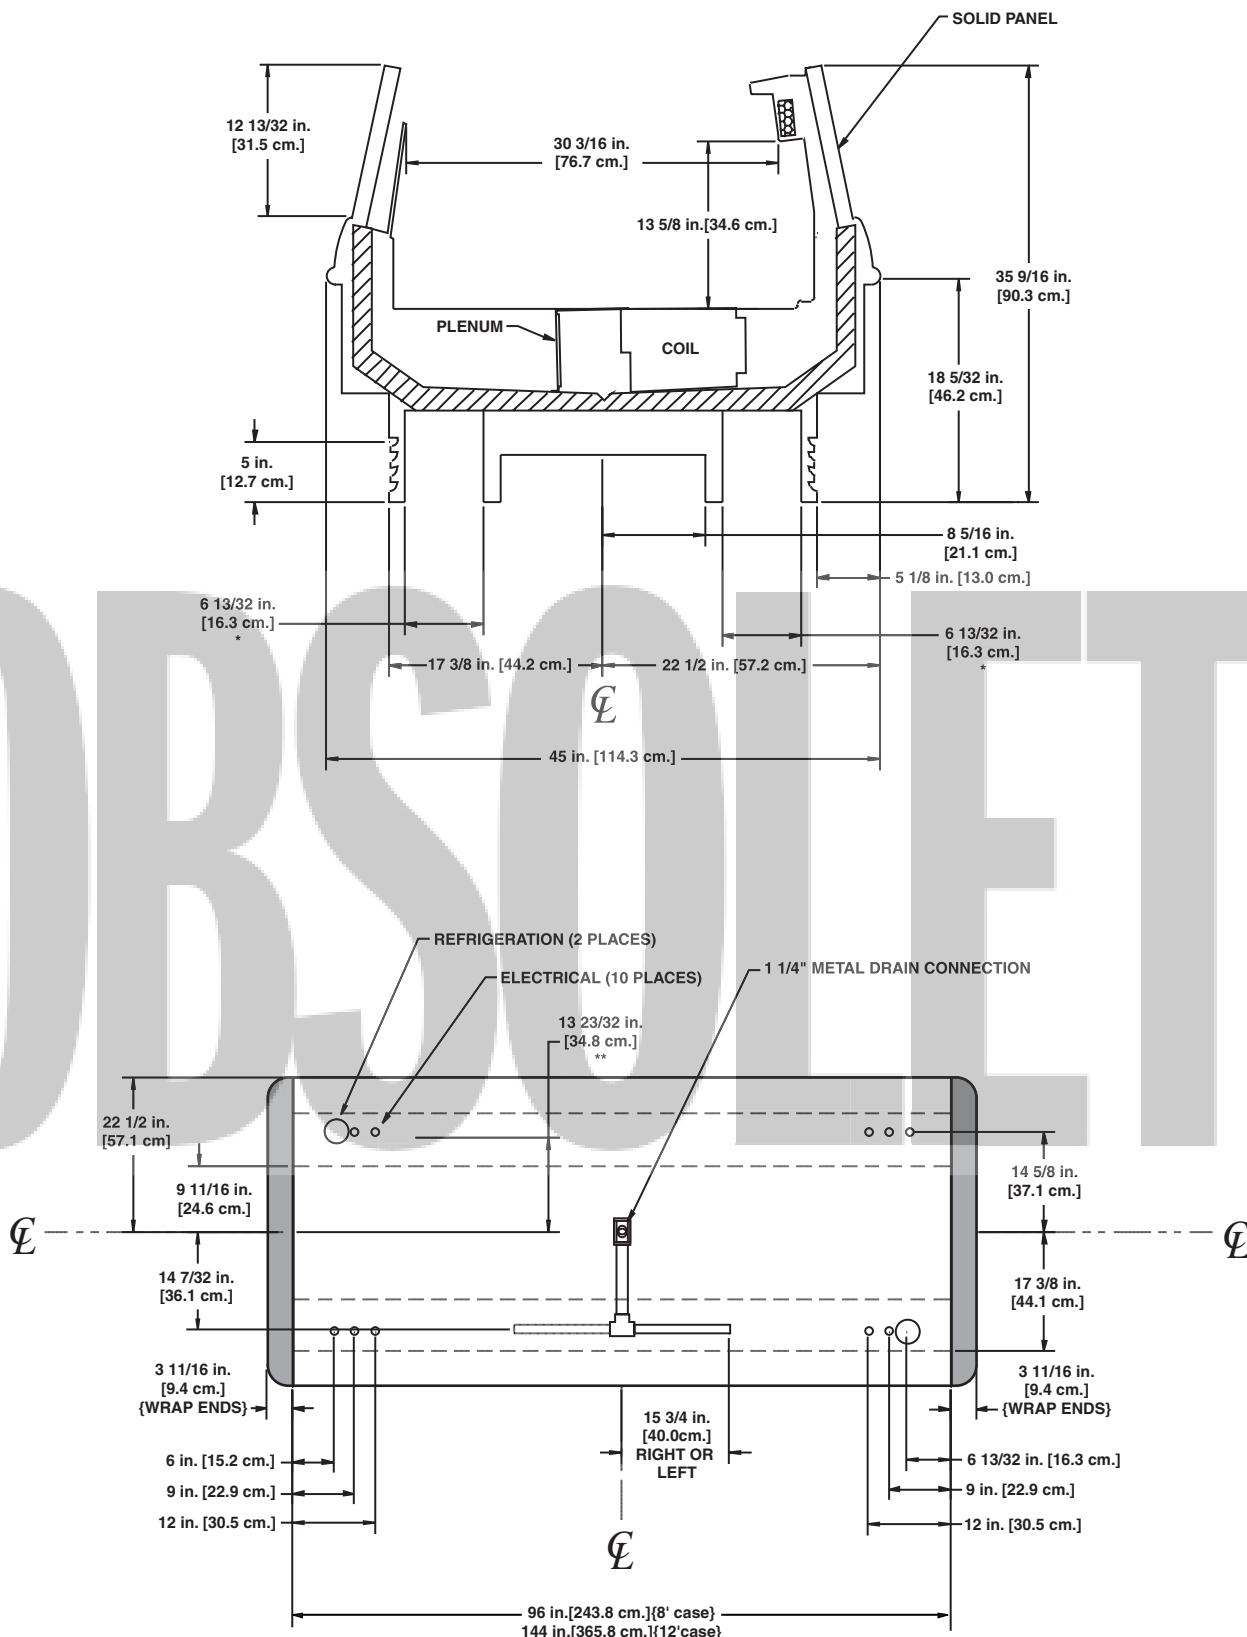

SINGLE DECK ISLAND

Frozen Food/Ice Cream

OBSCOTT

Island Frozen Food Merchandiser

OIZ - 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters		Drain Heaters	
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIZ	8'	1.35	51	0.45	33	1.31	157	15.38	3200	17.75	4260
	12'	1.80	68	0.60	44	1.99	239	23.08	4800	26.63	6390

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OIZ	8'	---	---	---
	12'	---	---	---

1 NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OIZ ⁴	520	-24	3-5	-12	-3	-4	200

2 BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

3 Average discharge air velocity at peak of defrost.

4 Not intended for Frozen Juice application

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost		
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	
OIZ	1	13 - 15	45	47	---	---	20	60	---	---

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COLD

A DOVER DIVERSIFIED COMPANY

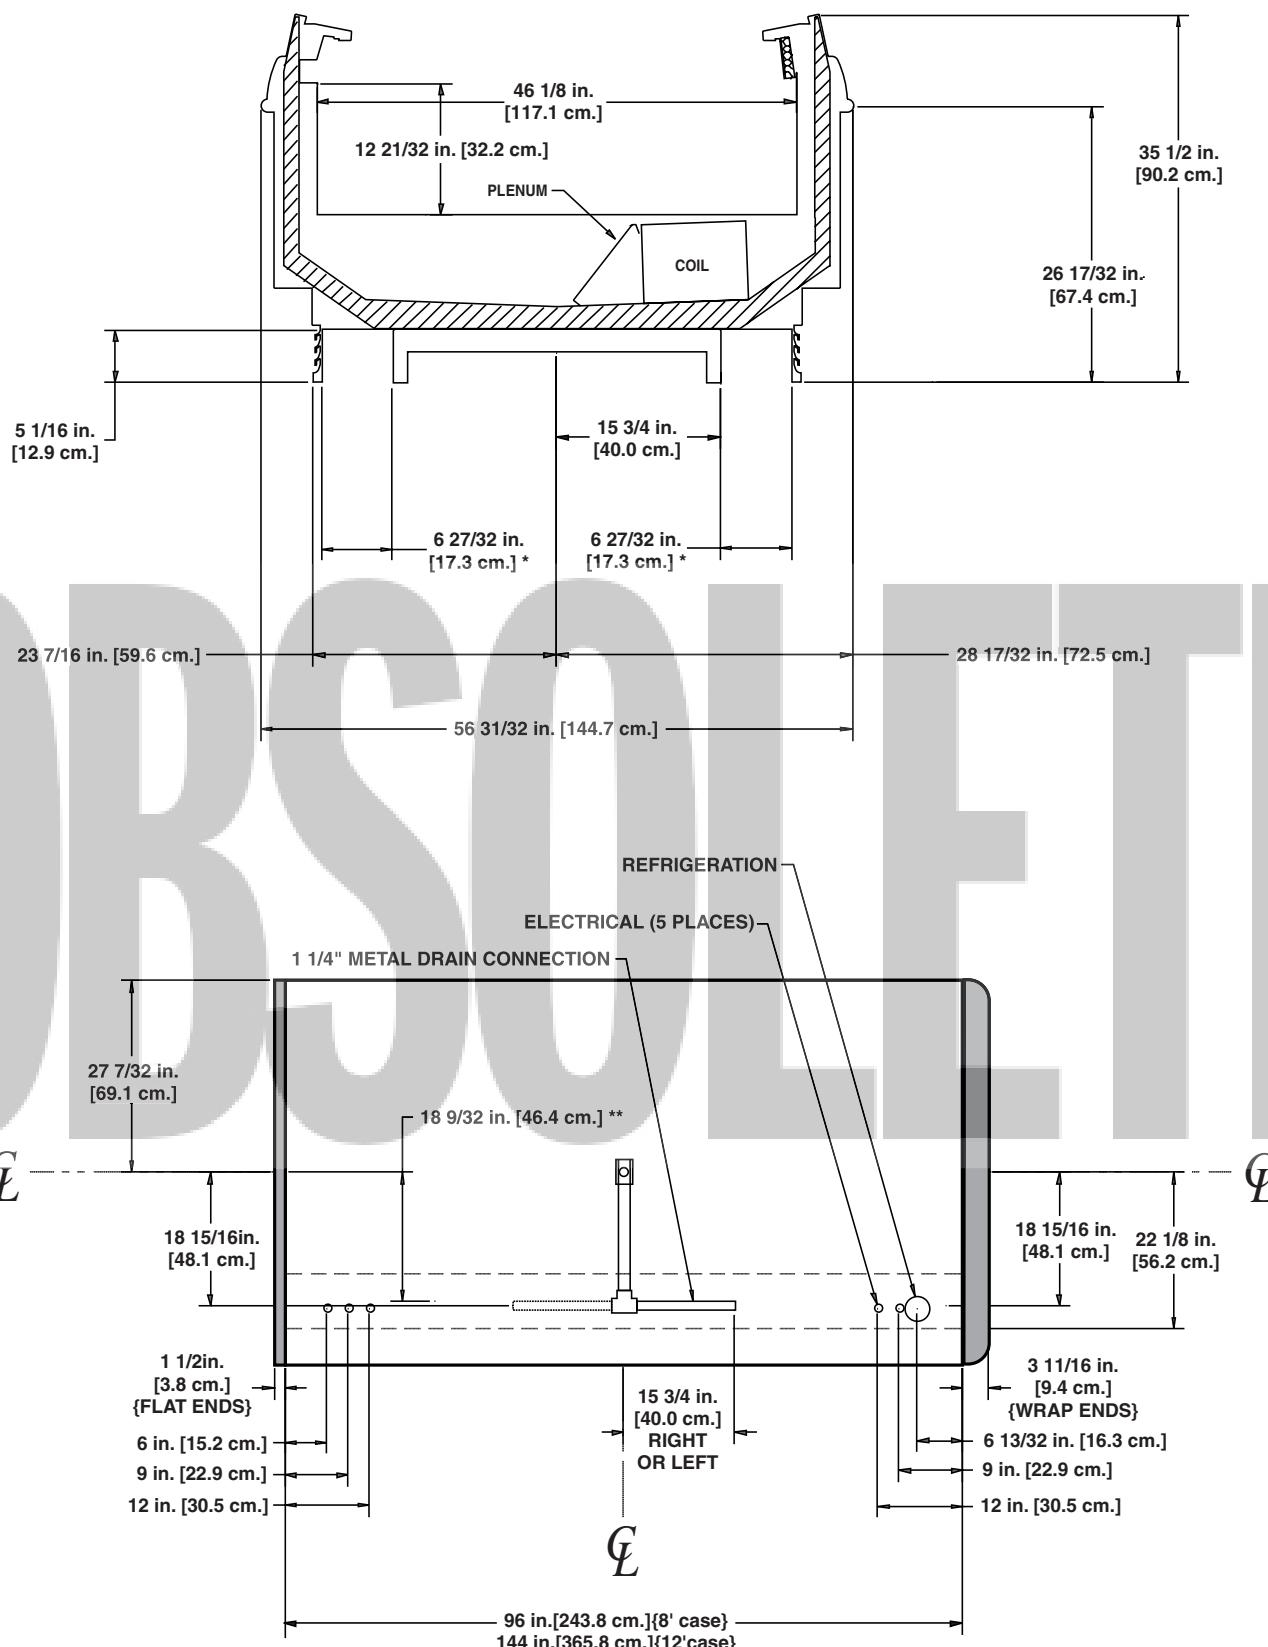**NOTES:**

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

Wide Island Frozen Food/Ice Cream Merchandiser

OWIZ - 8' & 12' standard front

OWIZG - 8' & 12' glass front

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heaters	
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OWIZ	F-8"	4	1.80	68	0.60	44	3.19 ²	383	7.69 ³	1600	8.88 ³	2130	0.26
	F-12'	6	2.70	102	0.90	66	4.81 ²	577	11.54 ³	2400	13.31 ³	3195	0.26
	C-8'	4	1.80	68	0.60	44	3.19 ²	383	11.54 ³	2400	13.31 ³	3195	0.26
	C-12'	6	2.70	102	0.90	66	4.81 ²	577	17.31 ³	3600	19.98 ³	4795	0.26
OWIZG	F-8"	4	1.80	68	0.60	44	4.58 ²	550	7.69 ³	1600	8.88 ³	2130	0.26
	F-12'	6	2.70	102	0.90	66	6.68 ²	802	11.54 ³	2400	13.31 ³	3195	0.26
	C-8'	4	1.80	68	0.60	44	4.58 ²	550	11.54 ³	2400	13.31 ³	3195	0.26
	C-12'	6	2.70	102	0.90	66	6.68 ²	802	17.31 ³	3600	19.98 ³	4795	0.26

¹ F = frozen food, C = ice cream.

² Anti-Condensate heater data for No Wrap End configuration. For solid fronts add 0.28 amps per wrap end. For glass fronts add 0.68 amps per wrap end.

³ Defrost data for one side of case only.

Lighting Data⁴

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OWIZ/ 8'	1.14	137	4.56	547
OWIZG 12'	1.71	205	6.84	821

⁴ Lighting is for cases with superstructures.

Guidelines & Control Settings

Model	BTUH/ft ⁵	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁶ (FPM)
OWIZ - F	600	-18	3-5	-10	0	0	180
OWIZ - C	700	-33	3-5	-20	-4	-12	180
OWIZG - F	600	-18	3-5	-12	0	0	180
OWIZG - C	700	-33	3-5	-20	-4	-12	180

⁵ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁶ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost		
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	
OWIZ/OWIZG	1	13 - 15	60	49	---	---	20	60	---	---

⁷ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule

No. Per Day Hours


1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE

A DOVER DIVERSIFIED COMPANY

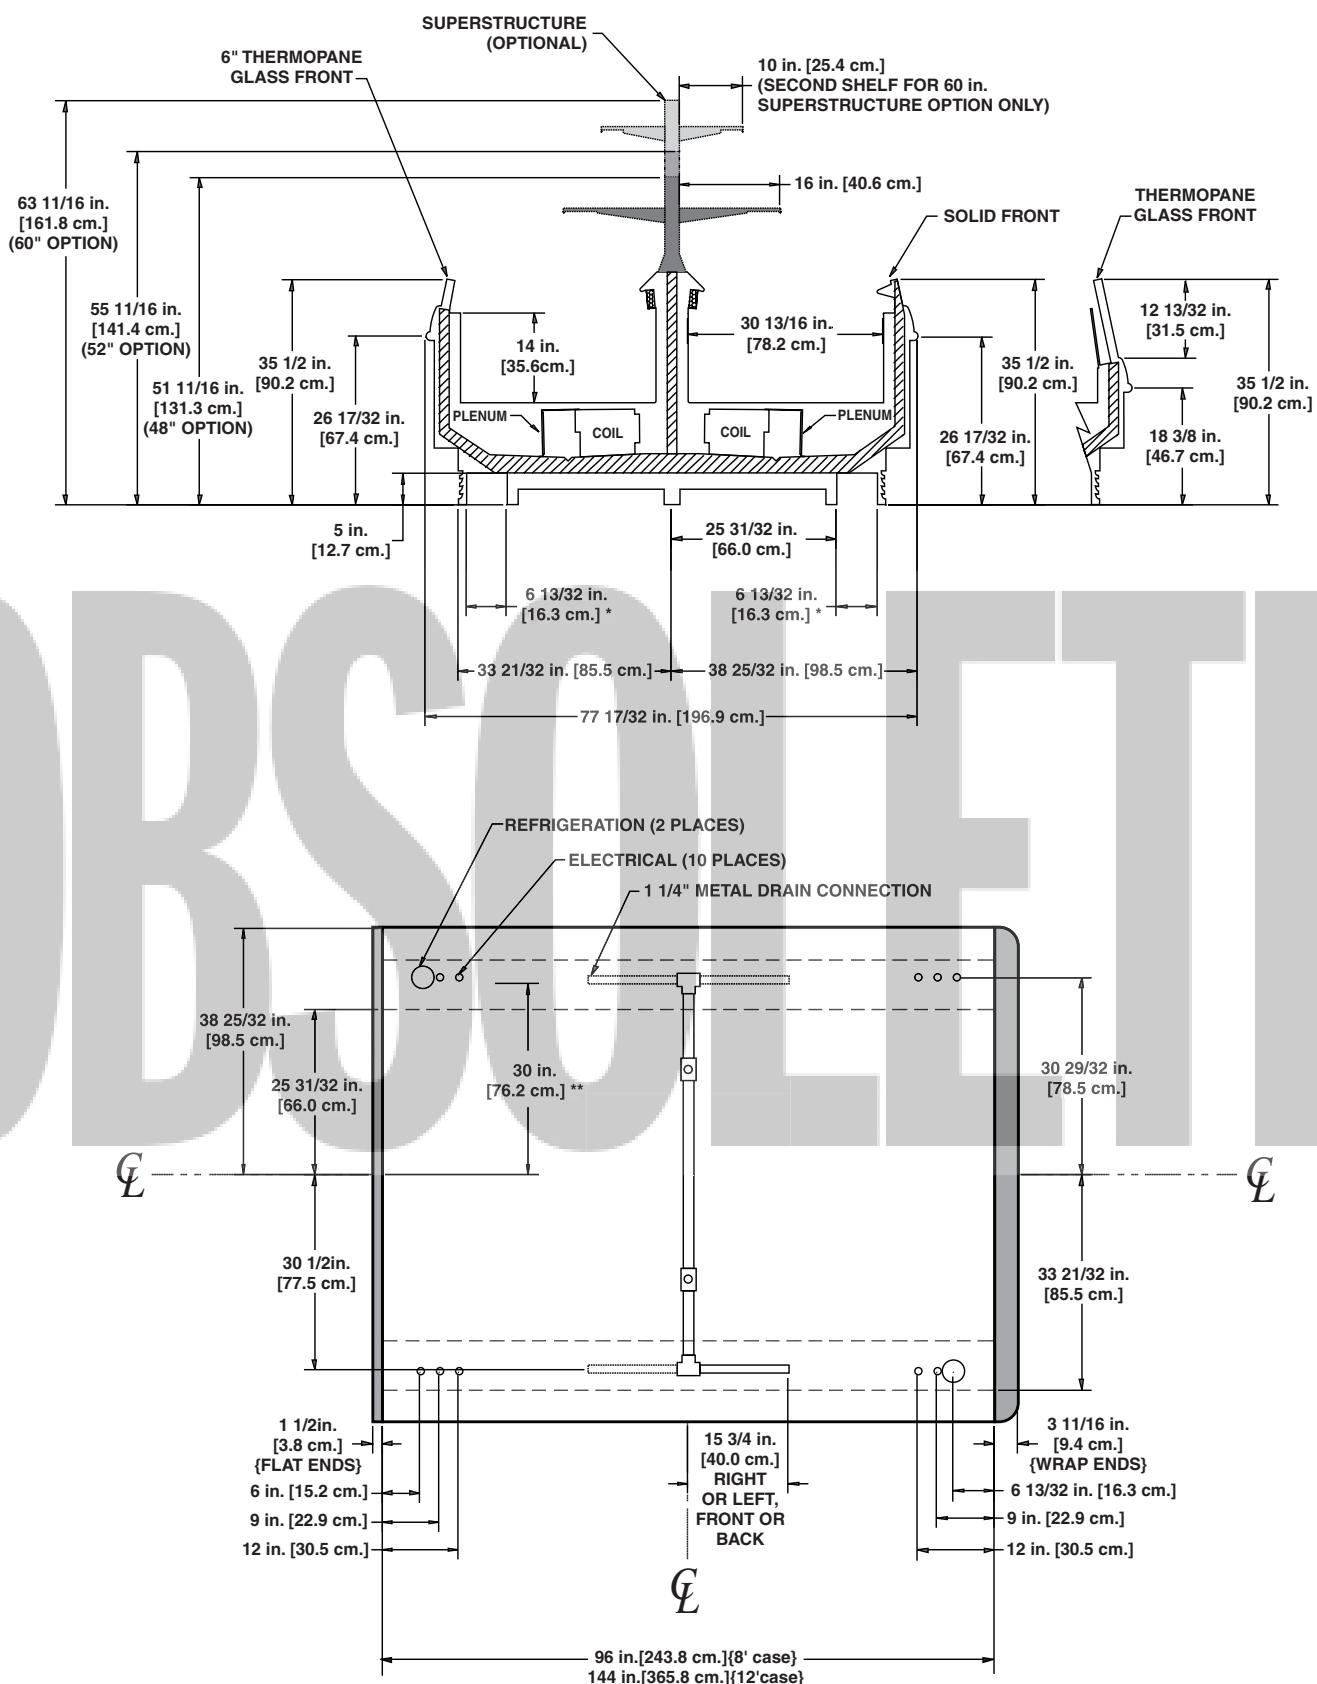**SINGLE DECK ISLAND**

Frozen Food/Ice Cream

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

Wide Island End Cap Frozen Food/Ice Cream Merchandiser

OWEZ - standard front

OWEZG - glass front

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters		Drain Heaters	
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OWEZ	F ¹	2	0.90	34	0.30	22	1.56	187	5.77	1200	6.65
	C	2	0.90	34	0.30	22	1.56	187	8.65	1800	9.98
OWEZG	F	2	0.90	34	0.30	22	2.46	295	5.77	1200	6.65
	C	2	0.90	34	0.30	22	2.46	295	8.65	1800	9.98

¹ F = Frozen food, C = Ice cream

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OWEZ/	---	---	---	---
OWEZG	---	---	---	---

² NOTE: --- not an option on this case model.

Guidelines & Control Settings

Model	BTUH/cs ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
OWEZ - F	2700	-18	3-5	-12	0	0	200
OWEZ - C	3300	-33	3-5	-22	-1	-12	200
OWEZG - F	2700	-18	3-5	-12	0	0	200
OWEZG - C	3300	-33	3-5	-22	-1	-12	200

³ BTUH's/case listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OWEZ/OWEZG	1	13 - 15	60	49	---	---	20	60

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour

All measurements are taken per CRMA specifications.

Hill Phoenix
EXCELLLENCE

A DOVER DIVERSIFIED COMPANY

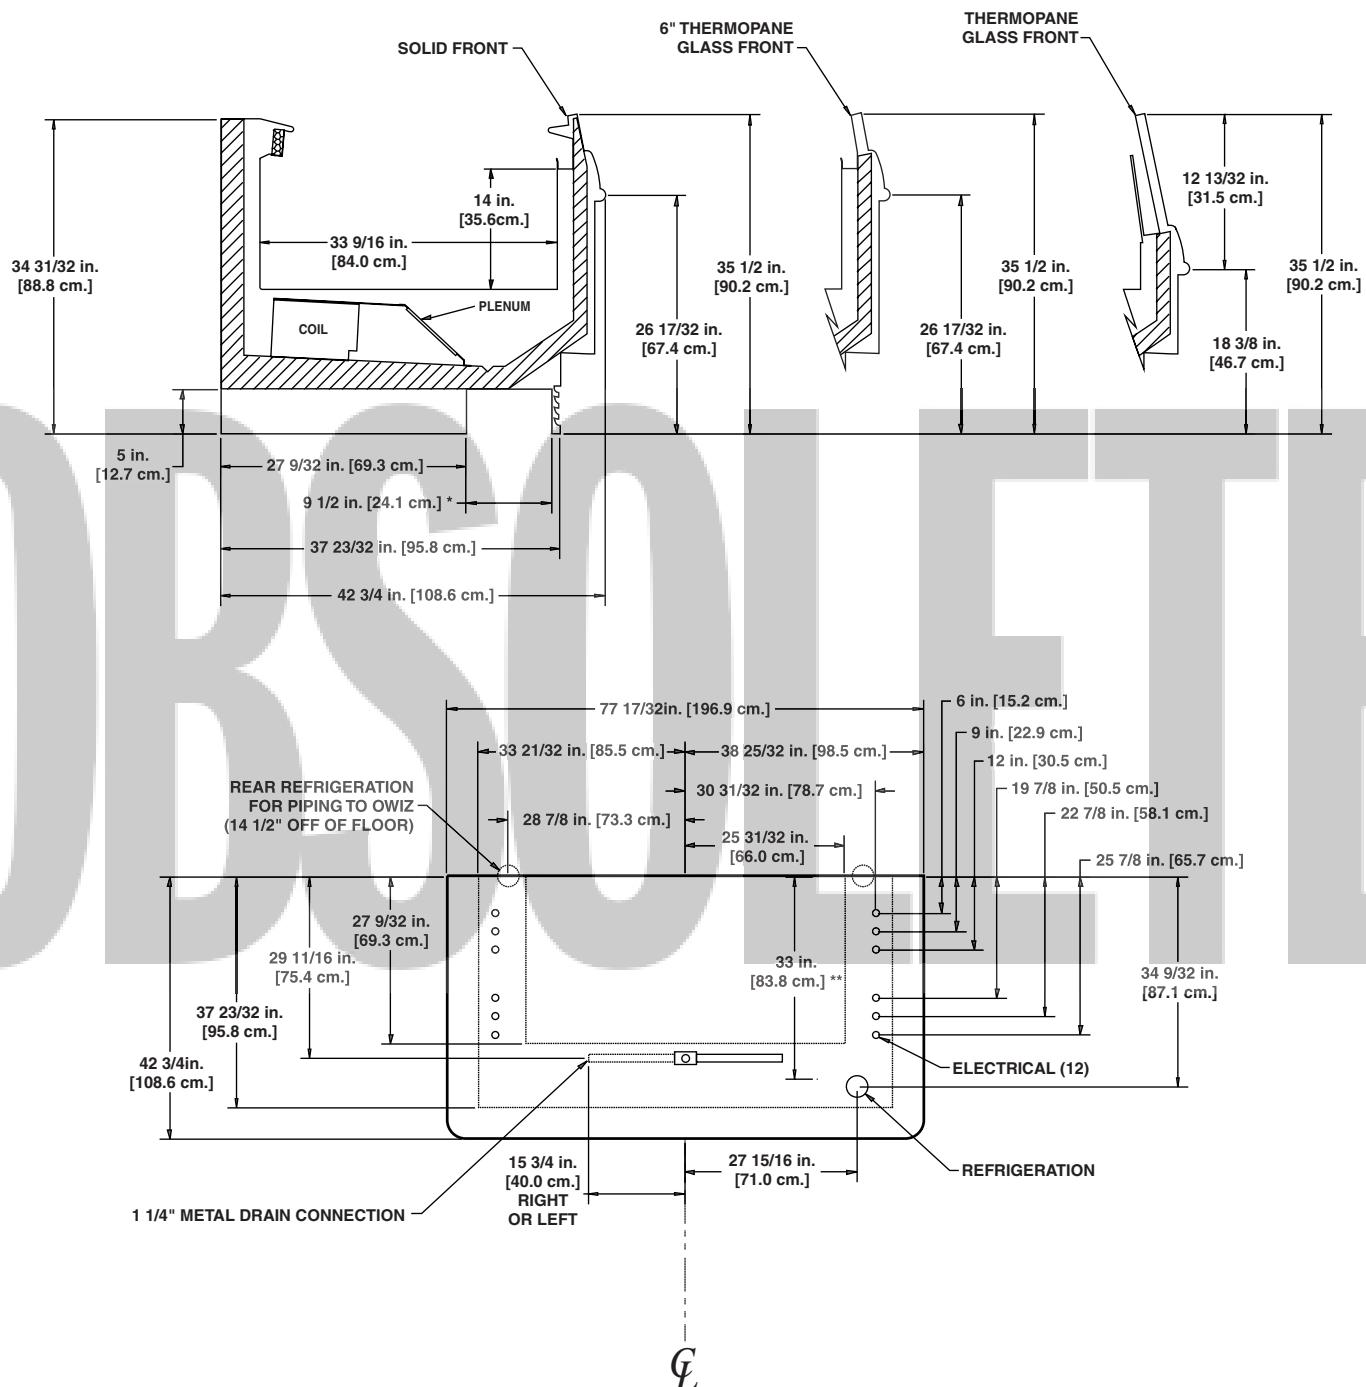

OBSOLETE

Multi-Deck Island Merchandisers

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

Wide Island Multi-Deck Cheese Merchandiser

O3IC - 8' & 12' double wraparound end

O3ICB - 6', 8', & 12' single wraparound end

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IC	8'	6	2.70	102	0.90	66	0.82	98	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.08	130	7.22	1502	8.33
O3ICB	6'	4	1.80	68	0.60	44	0.57	68	3.25	676	3.75
	8'	6	2.70	102	0.90	66	0.75	90	4.34	902	5.00
	12'	8	3.60	136	1.20	88	1.17	140	7.22	1502	8.33

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
O3IC	8'	NA ¹	NA	5.71
	12'	NA	NA	7.46
O3ICB	6'	NA	NA	3.50
	8'	NA	NA	4.76
	12'	NA	NA	6.02

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O3IC/O3ICB	1150 ⁴	17	6-8	29	37	48	160

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

⁴ Add 700 BTUH per wrap end.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3IC/O3ICB	4	6 - 8	30	47	---	---	26	45

⁵ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN CHEESE

A DOVER DIVERSIFIED COMPANY


O3IC
(14 3/4" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

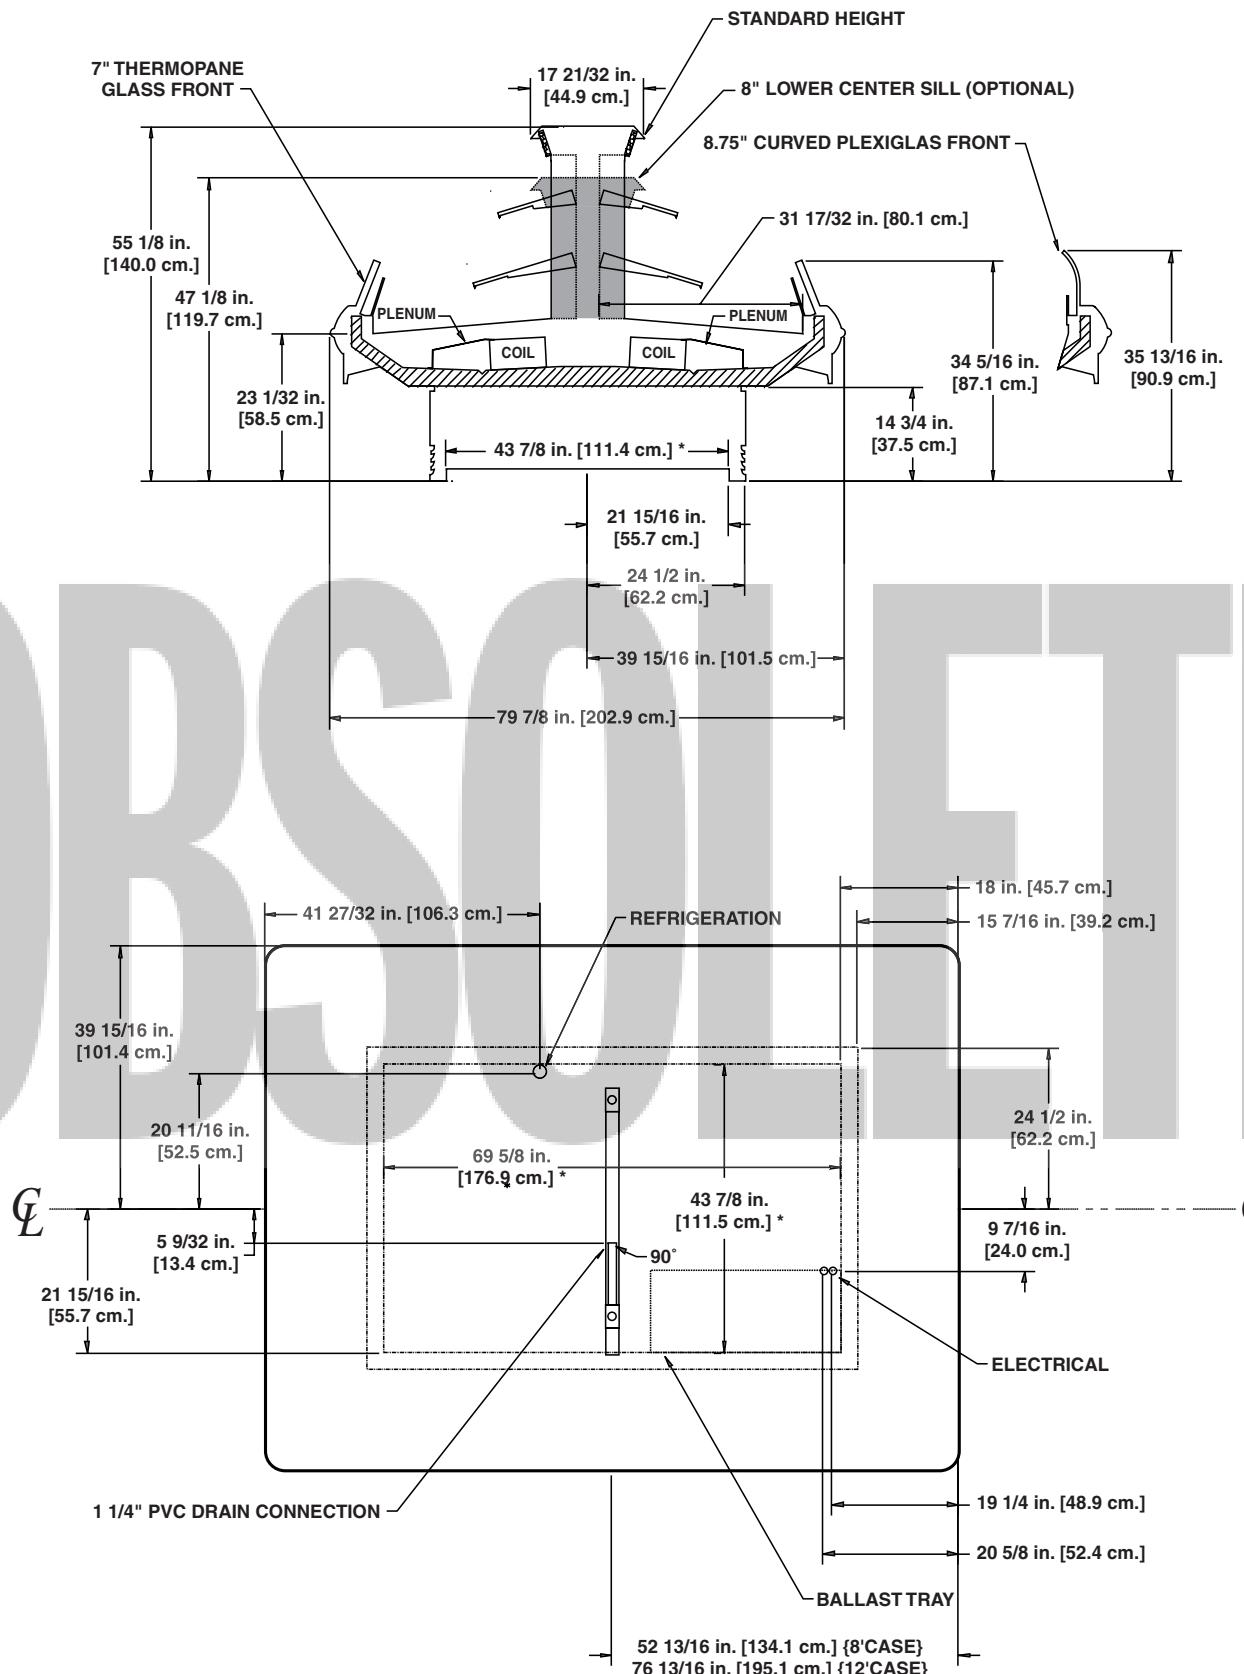

O3IC
(5" BASEFRAME)

HILL PHOENIX™
E X C E L L E N C E

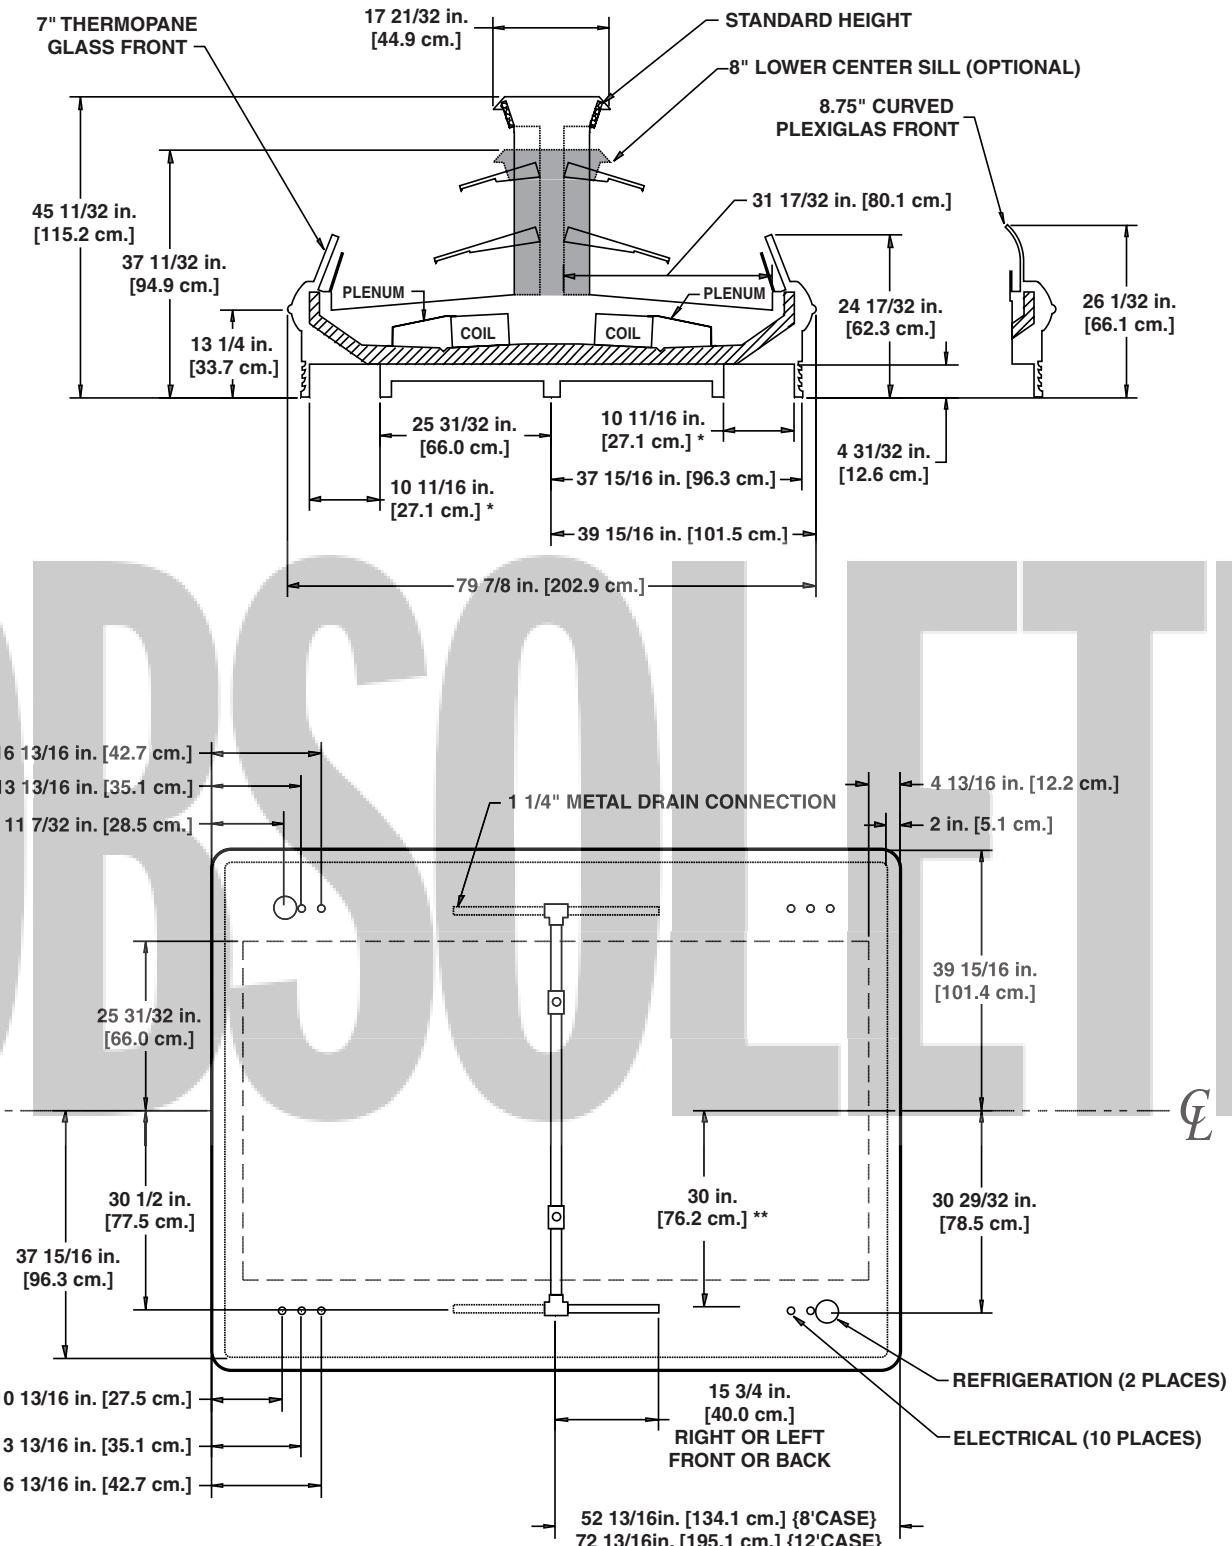

NOTES:

* STUB-UP AREA


** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• AVAILABLE SHELF SIZES: 12" & 16"

A DOVER DIVERSIFIED COMPANY

O3ICB
(14 3/4" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

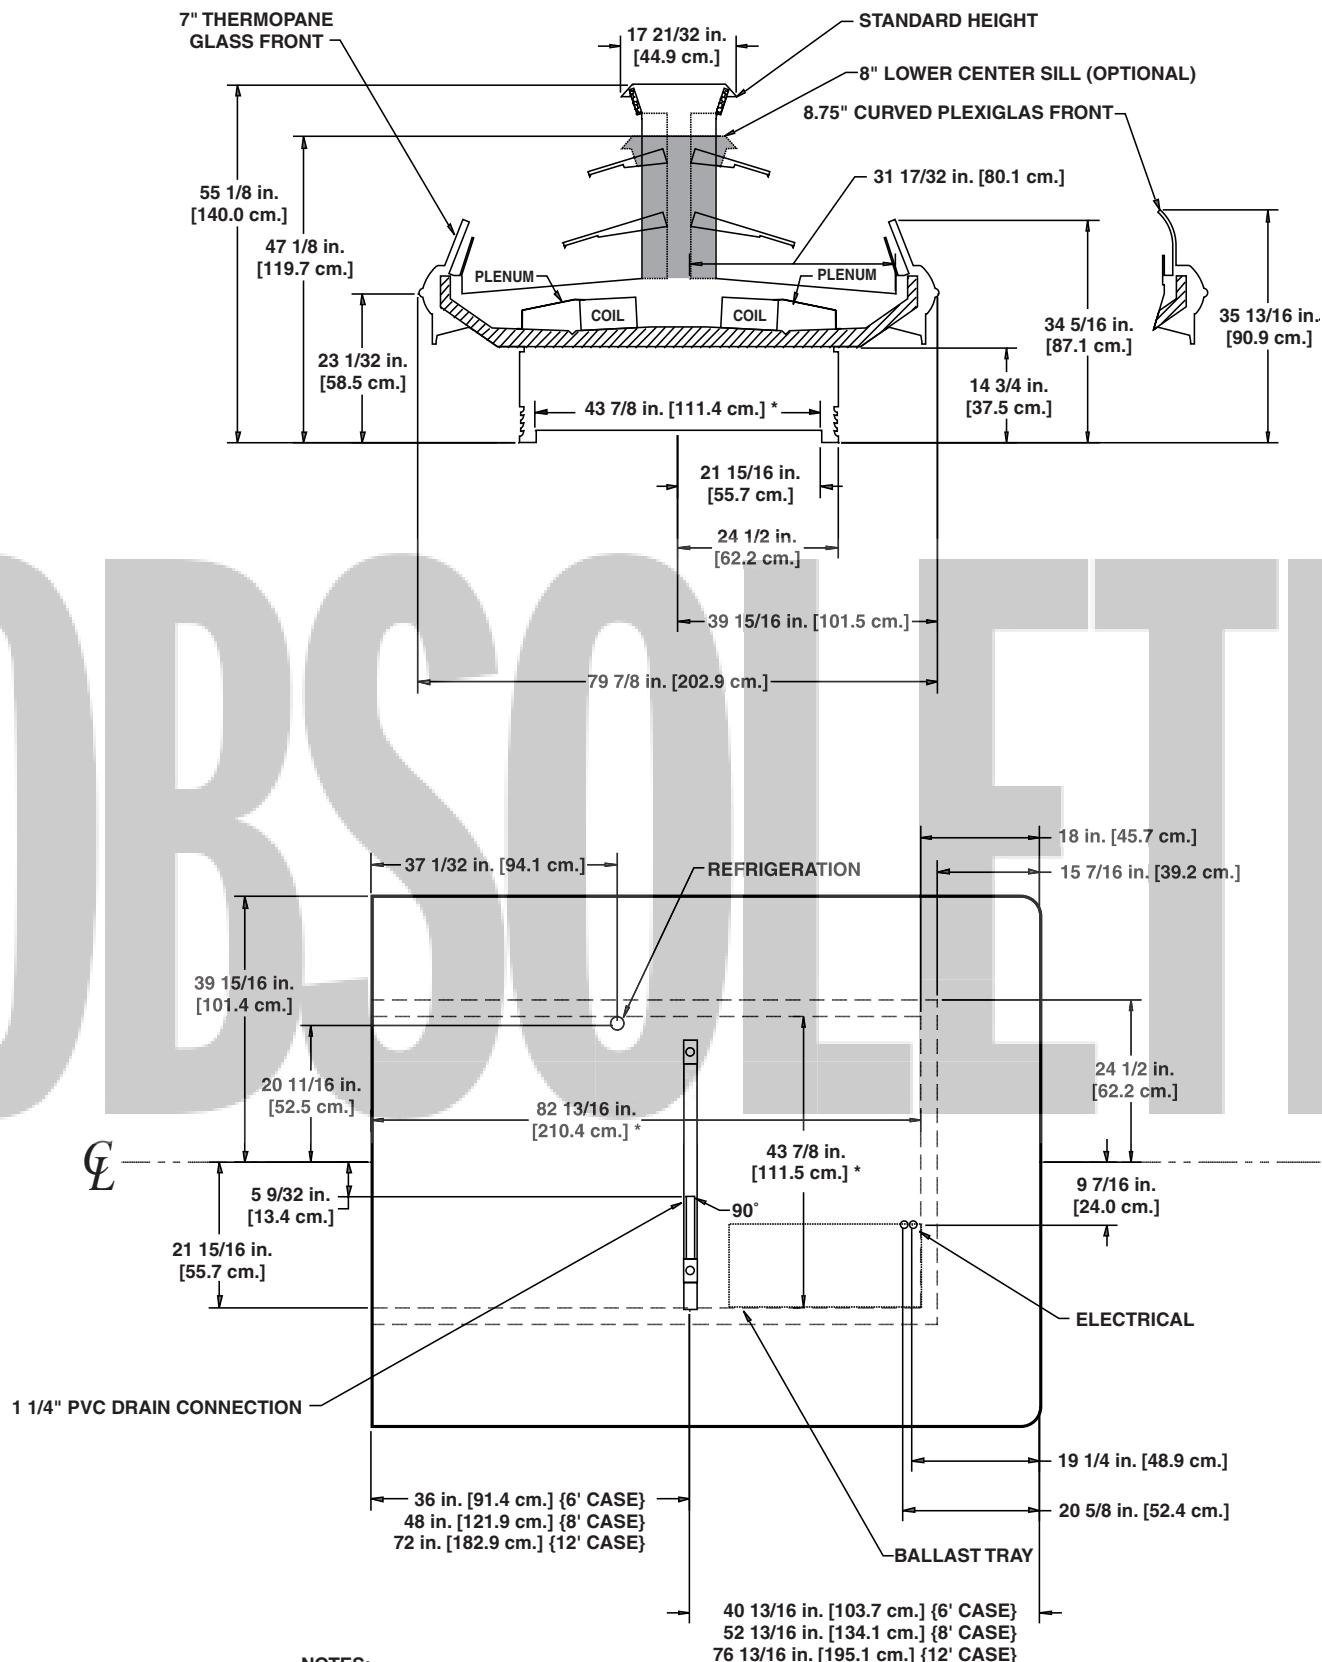


MULTI-DECK ISLAND
Cheese

C
C

O3ICB
(5" BASEFRAME)

HILL PHOENIXTM

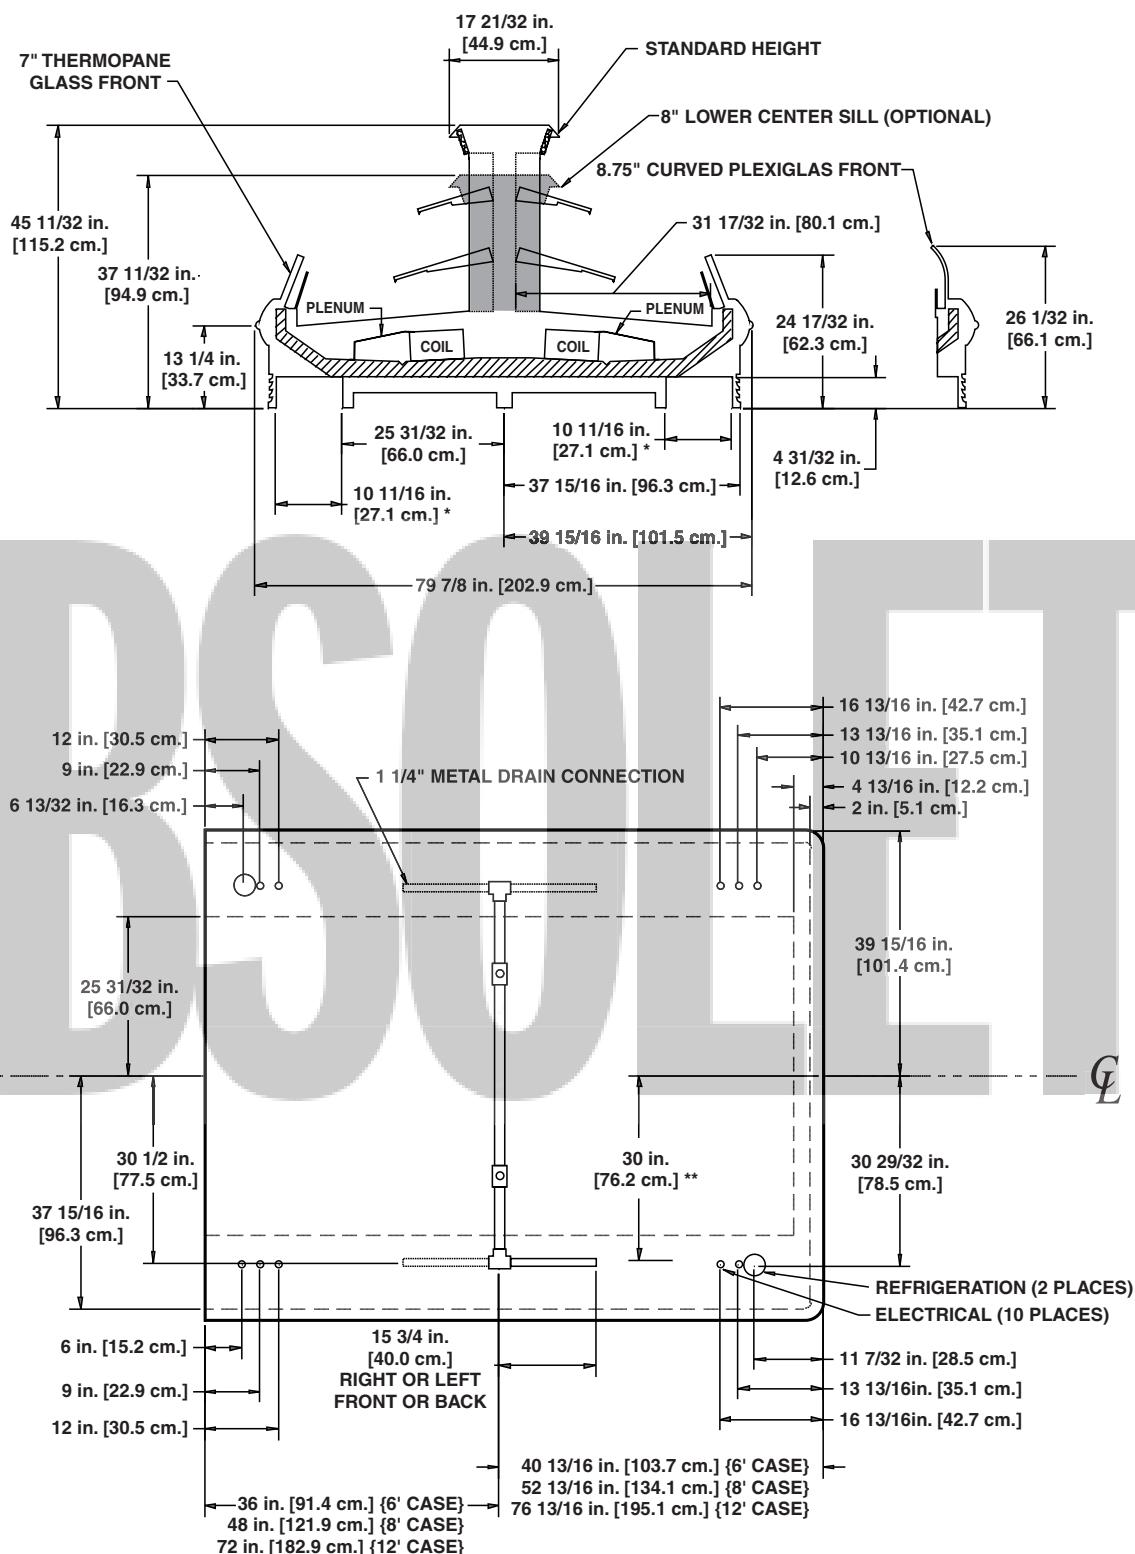

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• AVAILABLE SHELF SIZES: 12" & 16"

A DOVER DIVERSIFIED COMPANY

MULTI-DECK ISLAND

Cheese

OBSCURE

Wide Island Multi-Deck Deli/Meat Merchandiser

O3IM - 8' & 12' double wraparound end

O3IMB - 8' single wraparound end

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IM	8'	6	3.00	180	1.8	120	0.67	80	7.70	1600	8.88 2130
	12'	8	4.00	240	2.4	160	1.06	127	11.54	2400	13.32 3200
O3IMB	8'	6	3.00	180	1.8	120	1.77	212	7.70	1600	8.88 2130

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
O3IM	8'	NA ¹	NA	1.88 226
	12'	NA	NA	2.80 336
O3IMB	8'	NA	NA	2.02 242

¹ Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
O3IM	1527	17	6-8	28	32	38	270
O3IMB	1548	17	6-8	28	32	38	270

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3IM/O3IMB	3	6 - 8	30	47	---	---	26	45	---	---

⁵NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm


Hill Phoenix
EXCELLLENCE IN COOLING

All measurements are taken per CRMA specifications.

A  DOVER DIVERSIFIED COMPANY

O3IM
(15" Baseframe)


HILL PHOENIX
EXCELENCE™

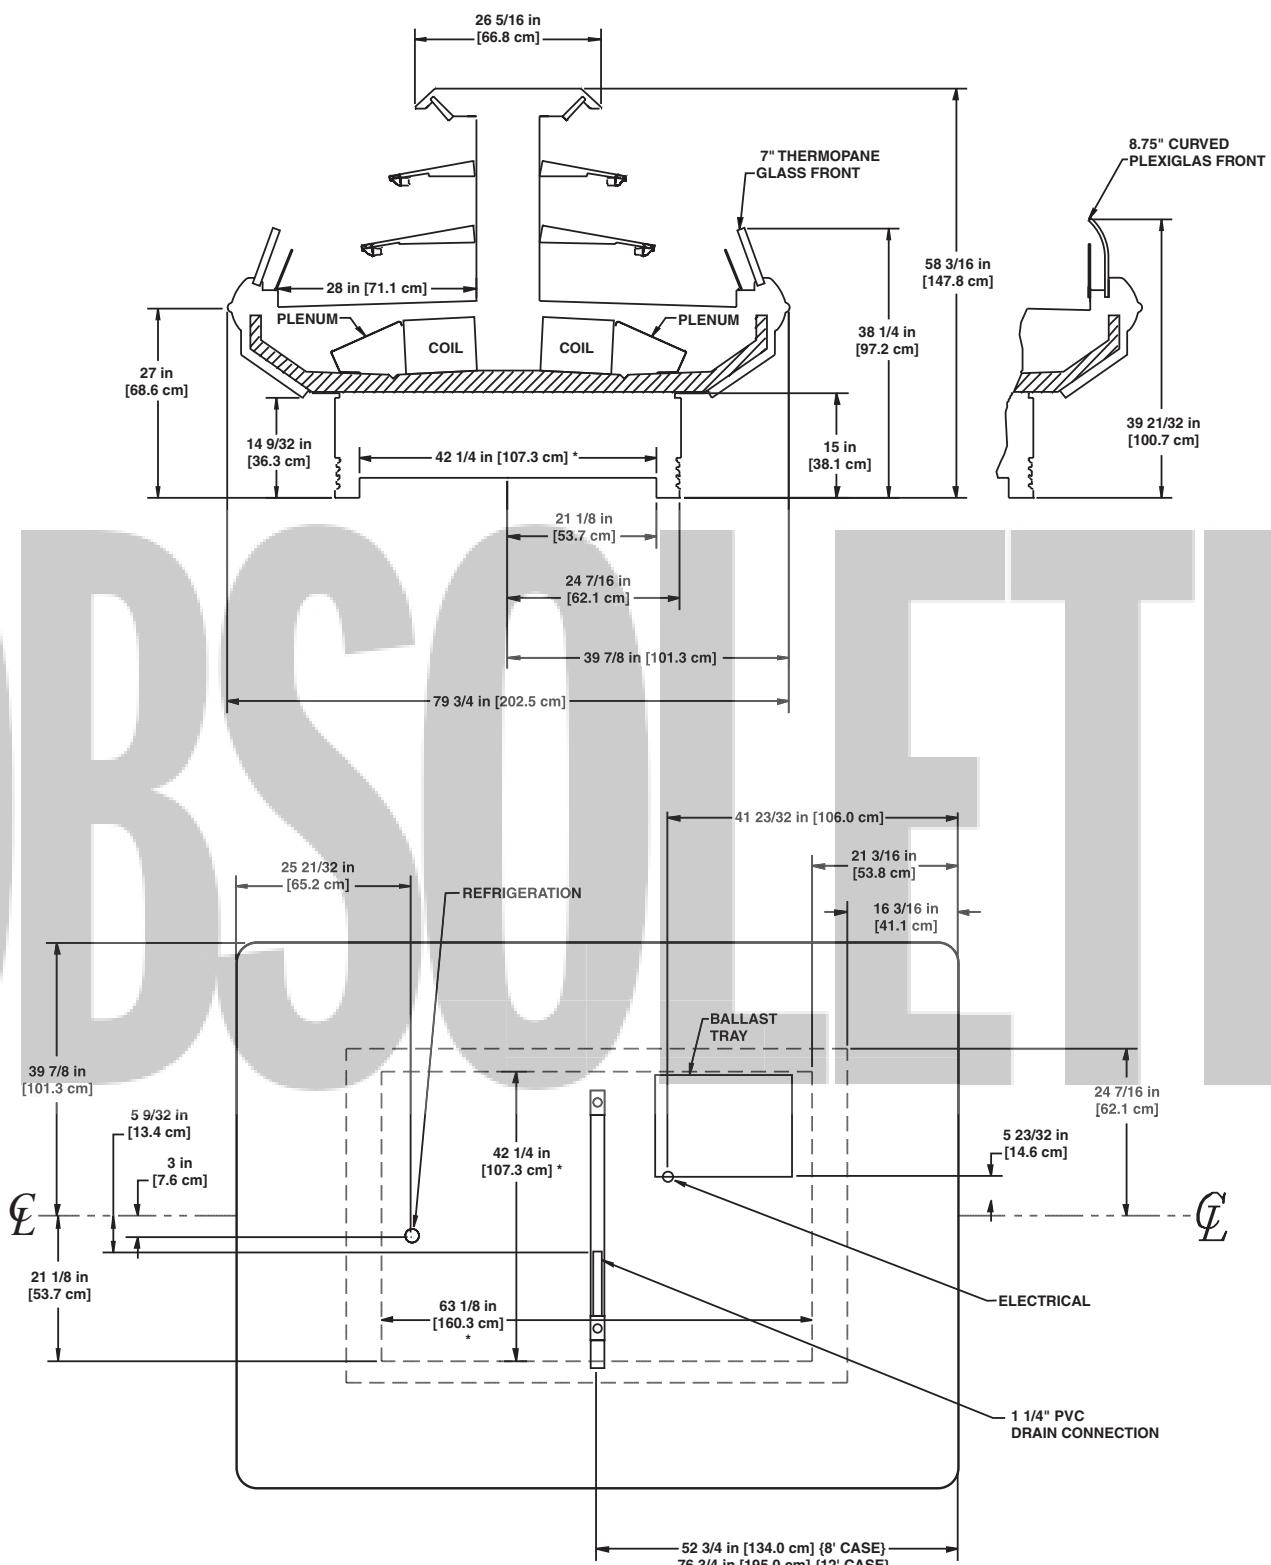

O3IM
(10" Baseframe)

HILL PHOENIXTM

E X C E L L E N C E

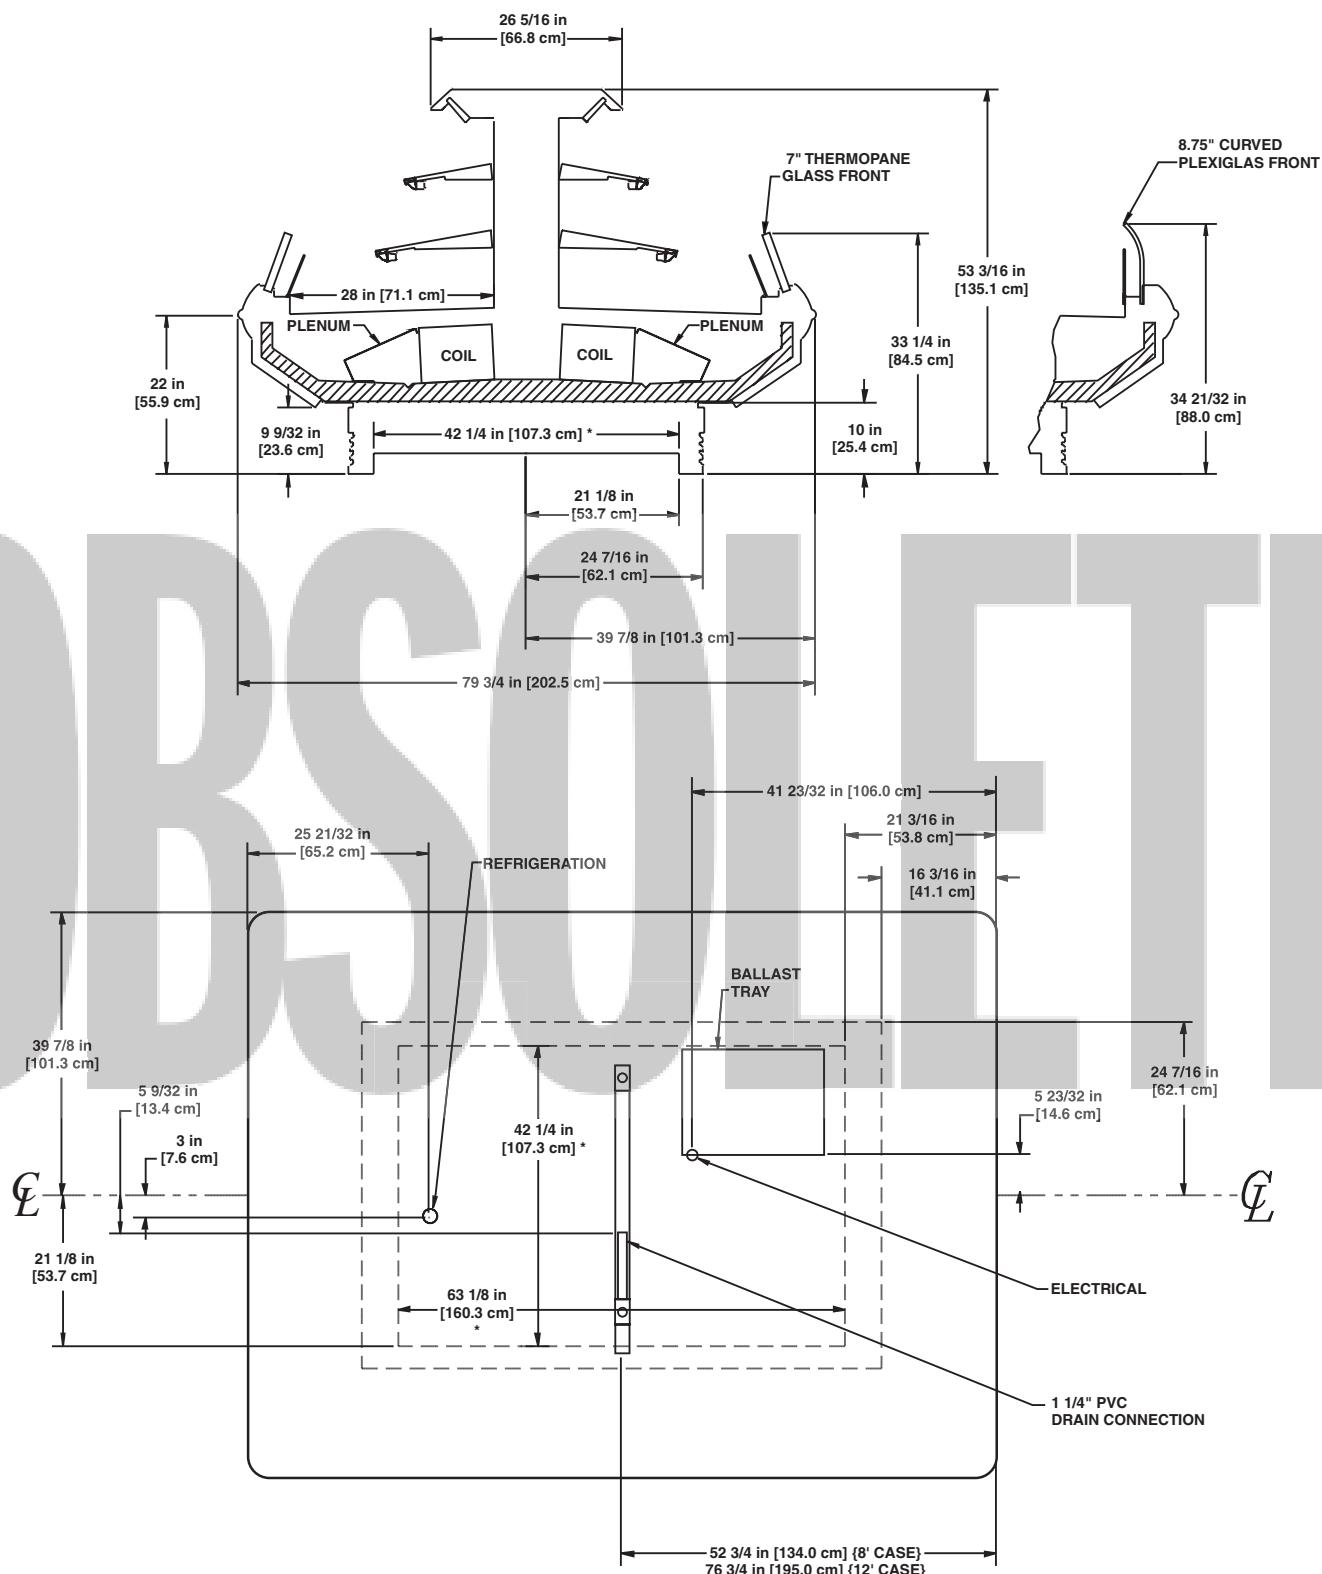


NOTES:

* STUB-UP AREA

• AVAILABLE SHELF SIZES: 12" & 16"

O3IMB
(15" Baseframe)

HILL PHOENIX
EXCELLENCE™

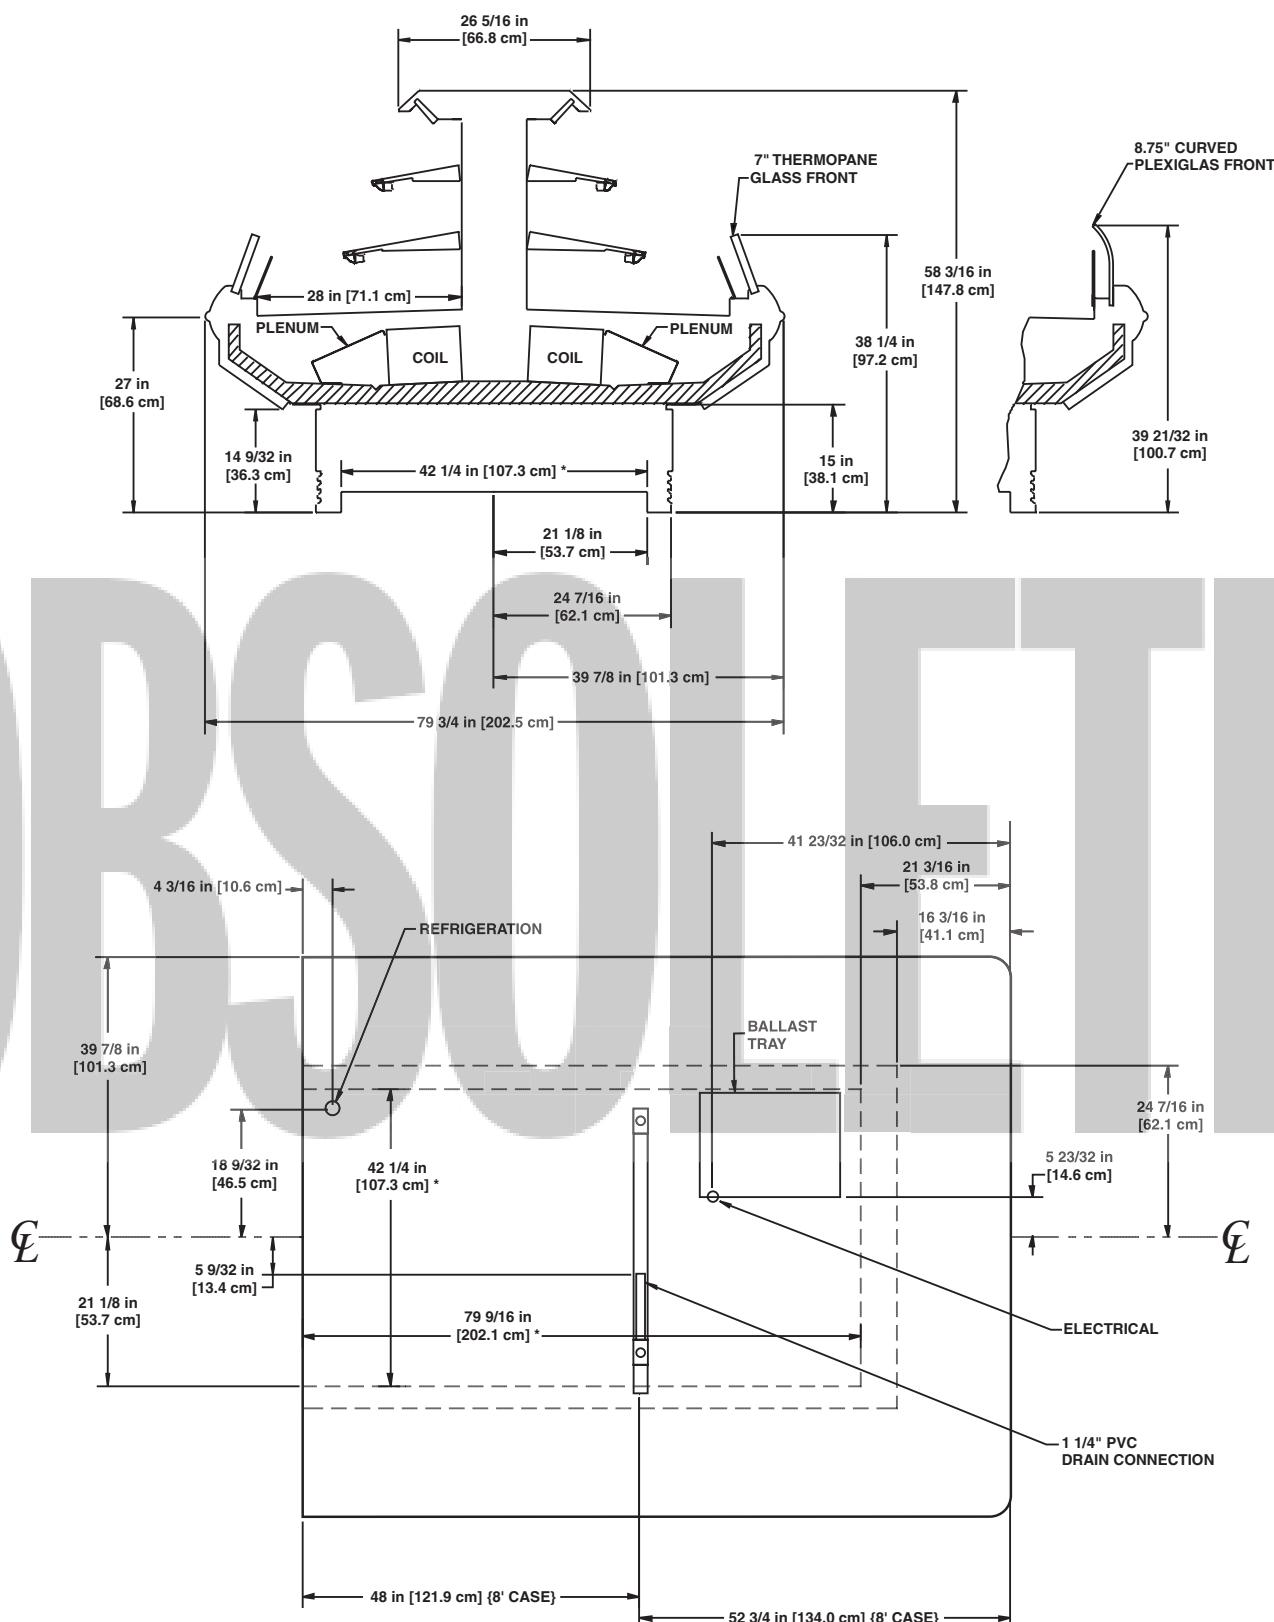


NOTES:

* STUB-UP AREA

• AVAILABLE SHELF SIZES: 12" & 16"

O3IMB
(10" Baseframe)

HILL PHOENIXTM

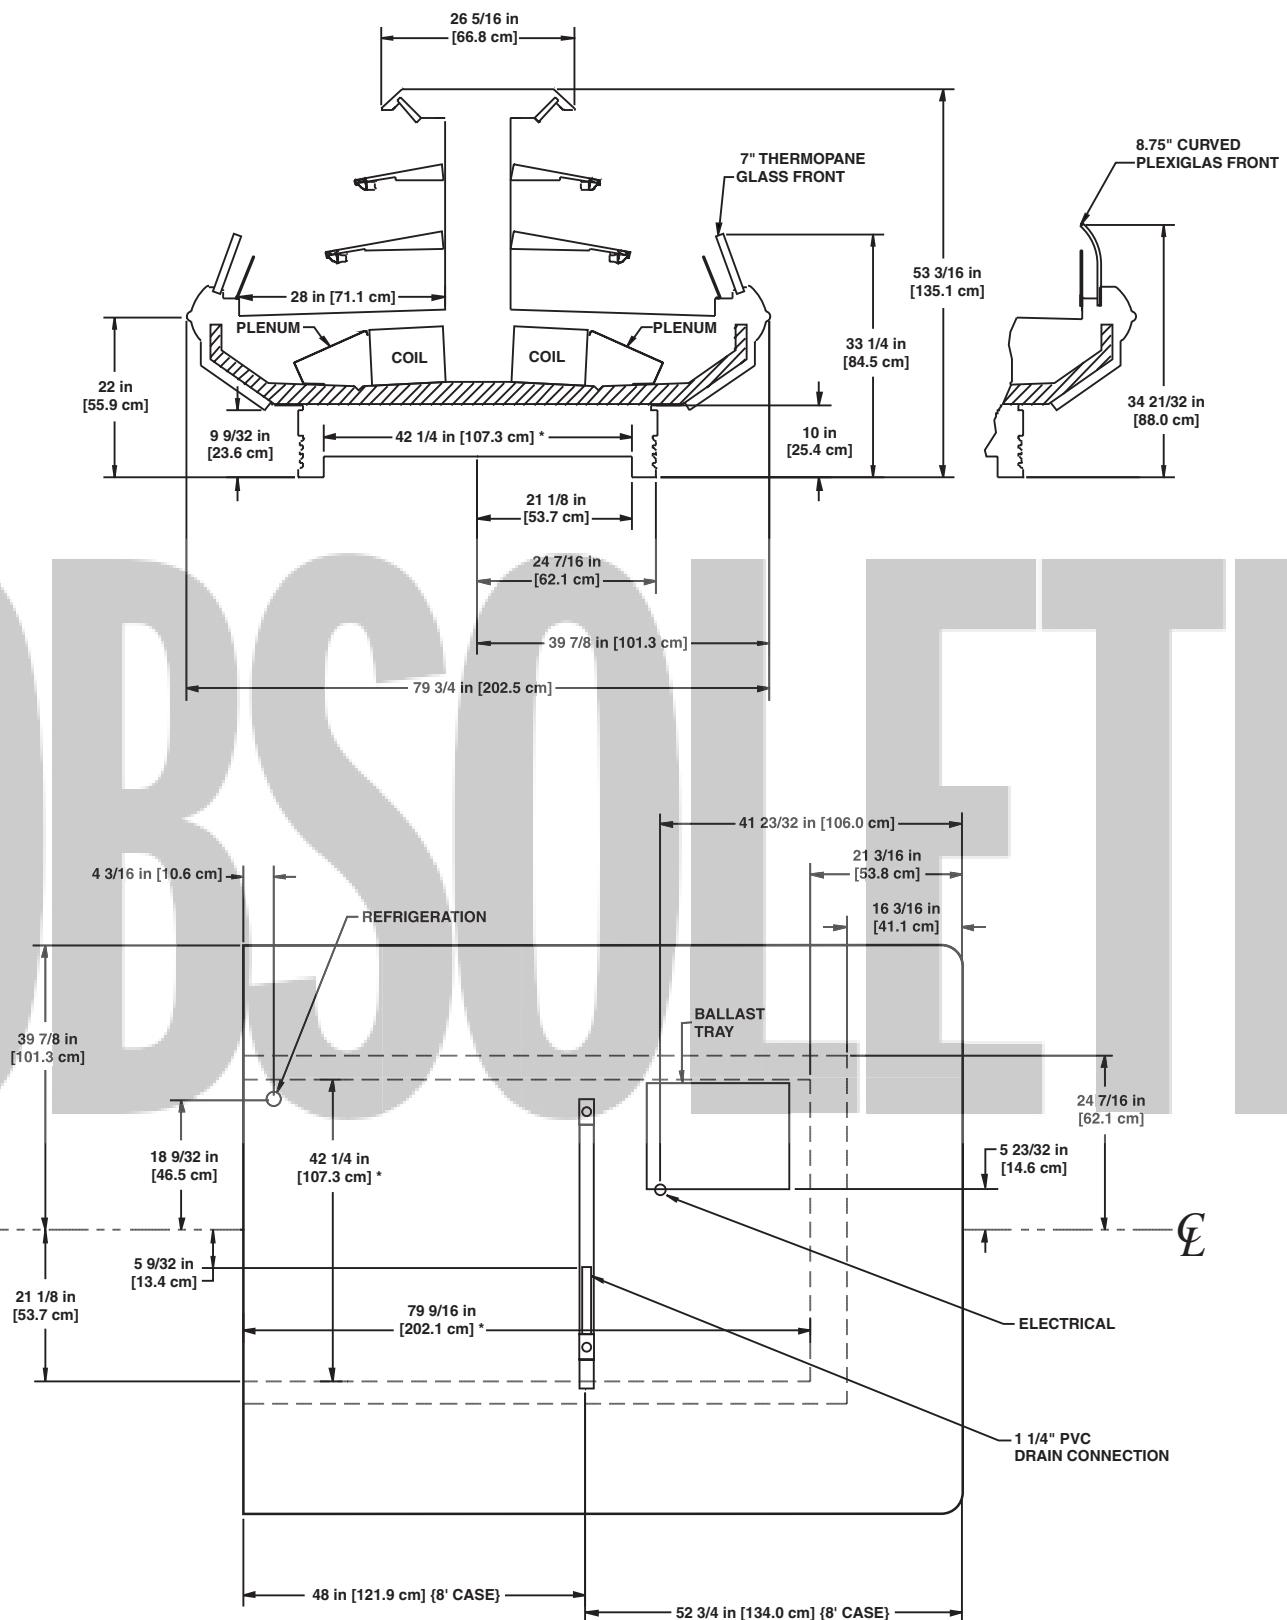

OBSCURE

MULTI-DECK ISLAND

Deli/Meat

Wide Island Multi-Deck Produce Merchandiser

O3IP - 8' & 12' wide island double wraparound end

O3IPB - 8' & 12' wide island single wraparound end

Electrical Data

Model	Fans per Case	Standard Fan		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3IP	8'	6	2.70	102	0.90	66	0.82	98	---	---	---
	12'	8	3.60	136	1.20	88	1.08	130	---	---	---
O3IPB	8'	6	2.70	102	0.90	66	0.75	90	---	---	---
	12'	8	3.60	136	1.20	88	1.17	140	---	---	---

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
O3IP	8'	NA ²	NA	5.71	546
	12'	NA	NA	7.46	779
O3IPB	8'	NA	NA	4.76	514
	12'	NA	NA	6.02	665

² Not applicable.

Guidelines & Control Settings

Model	BTUH/ft ³	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
O3IP/O3IPB	1050 ⁵	22	6-8	34	41	48	160

³ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

⁴ Average discharge air velocity at peak of defrost.

⁵ Add 650 BTUH per wrap end.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3IP/O3IPB	4	6 - 8	---	---	44	38	---	---	---	---


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
MANUFACTURING

A  DOVER DIVERSIFIED COMPANY

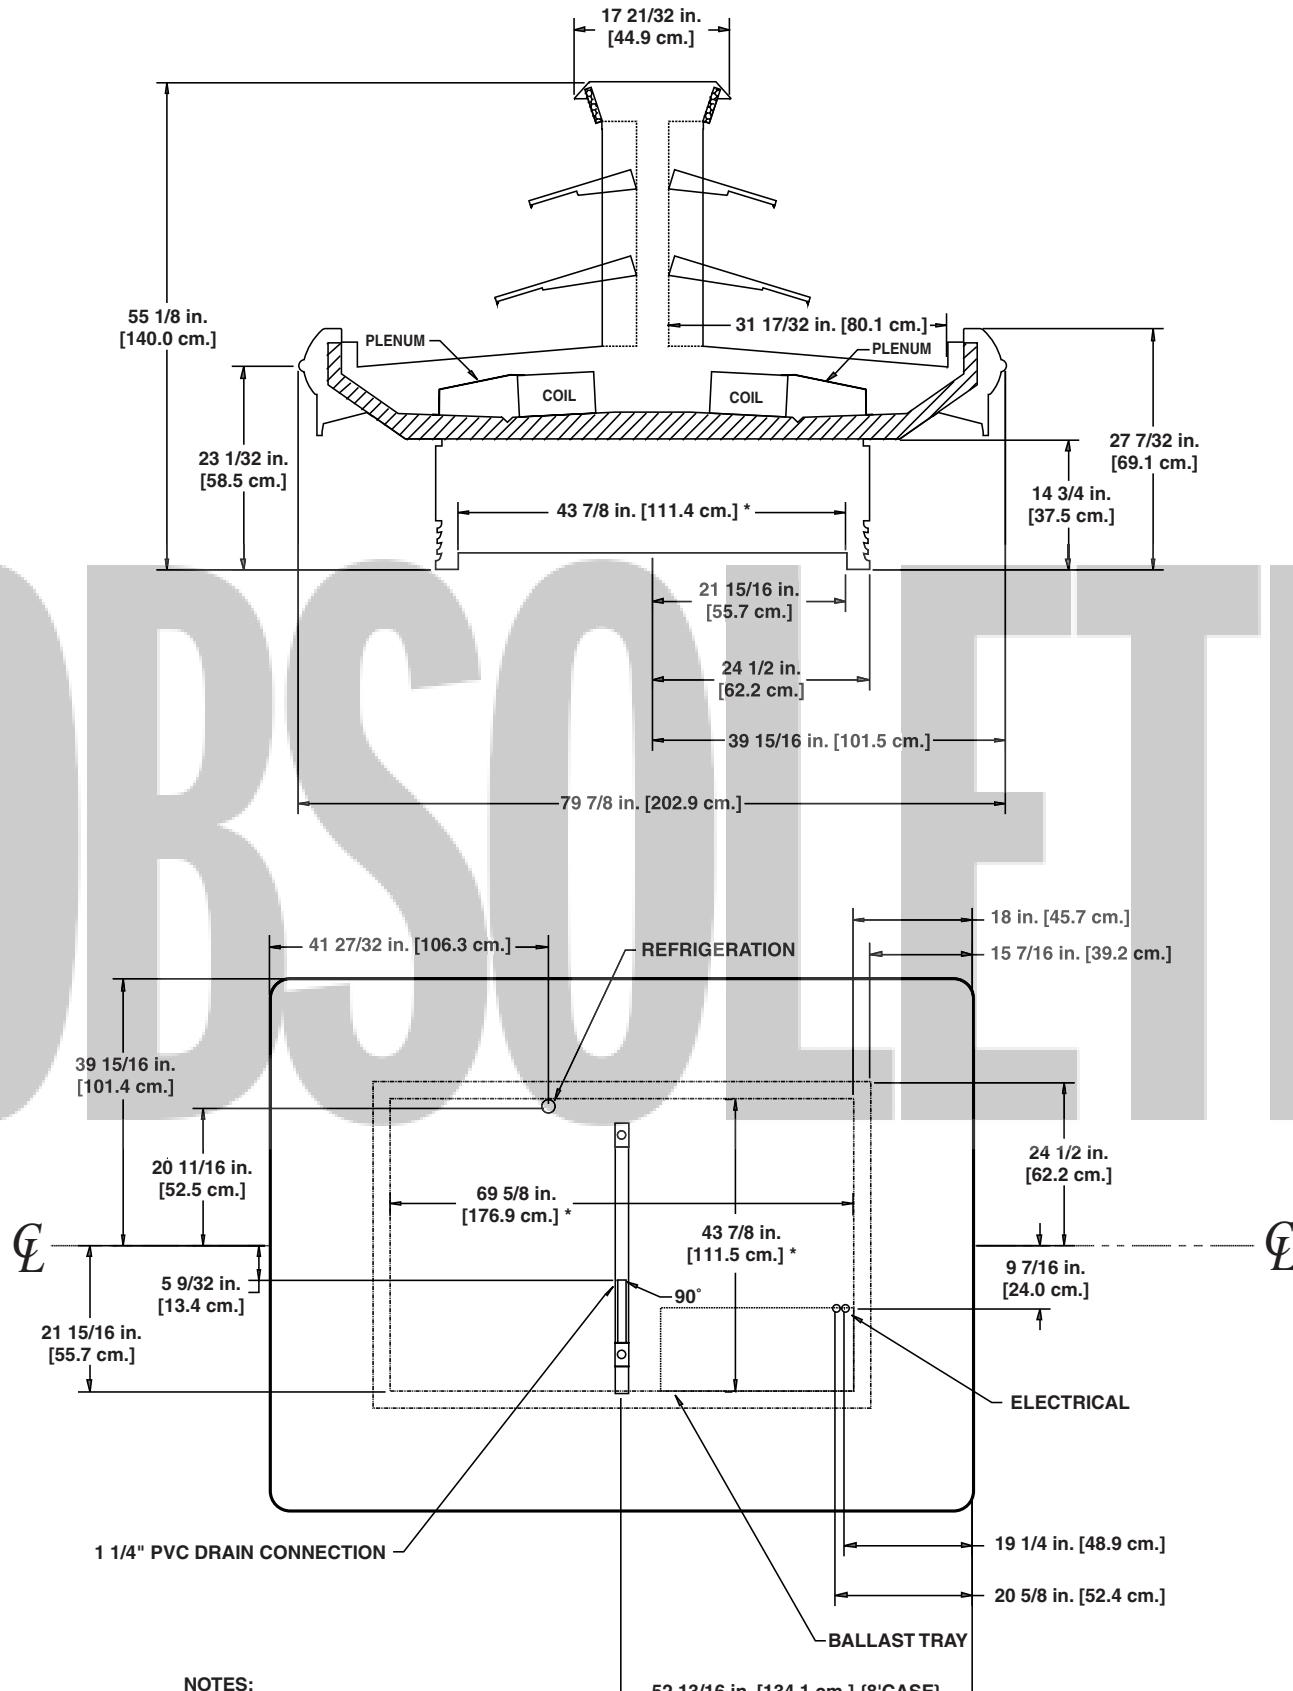

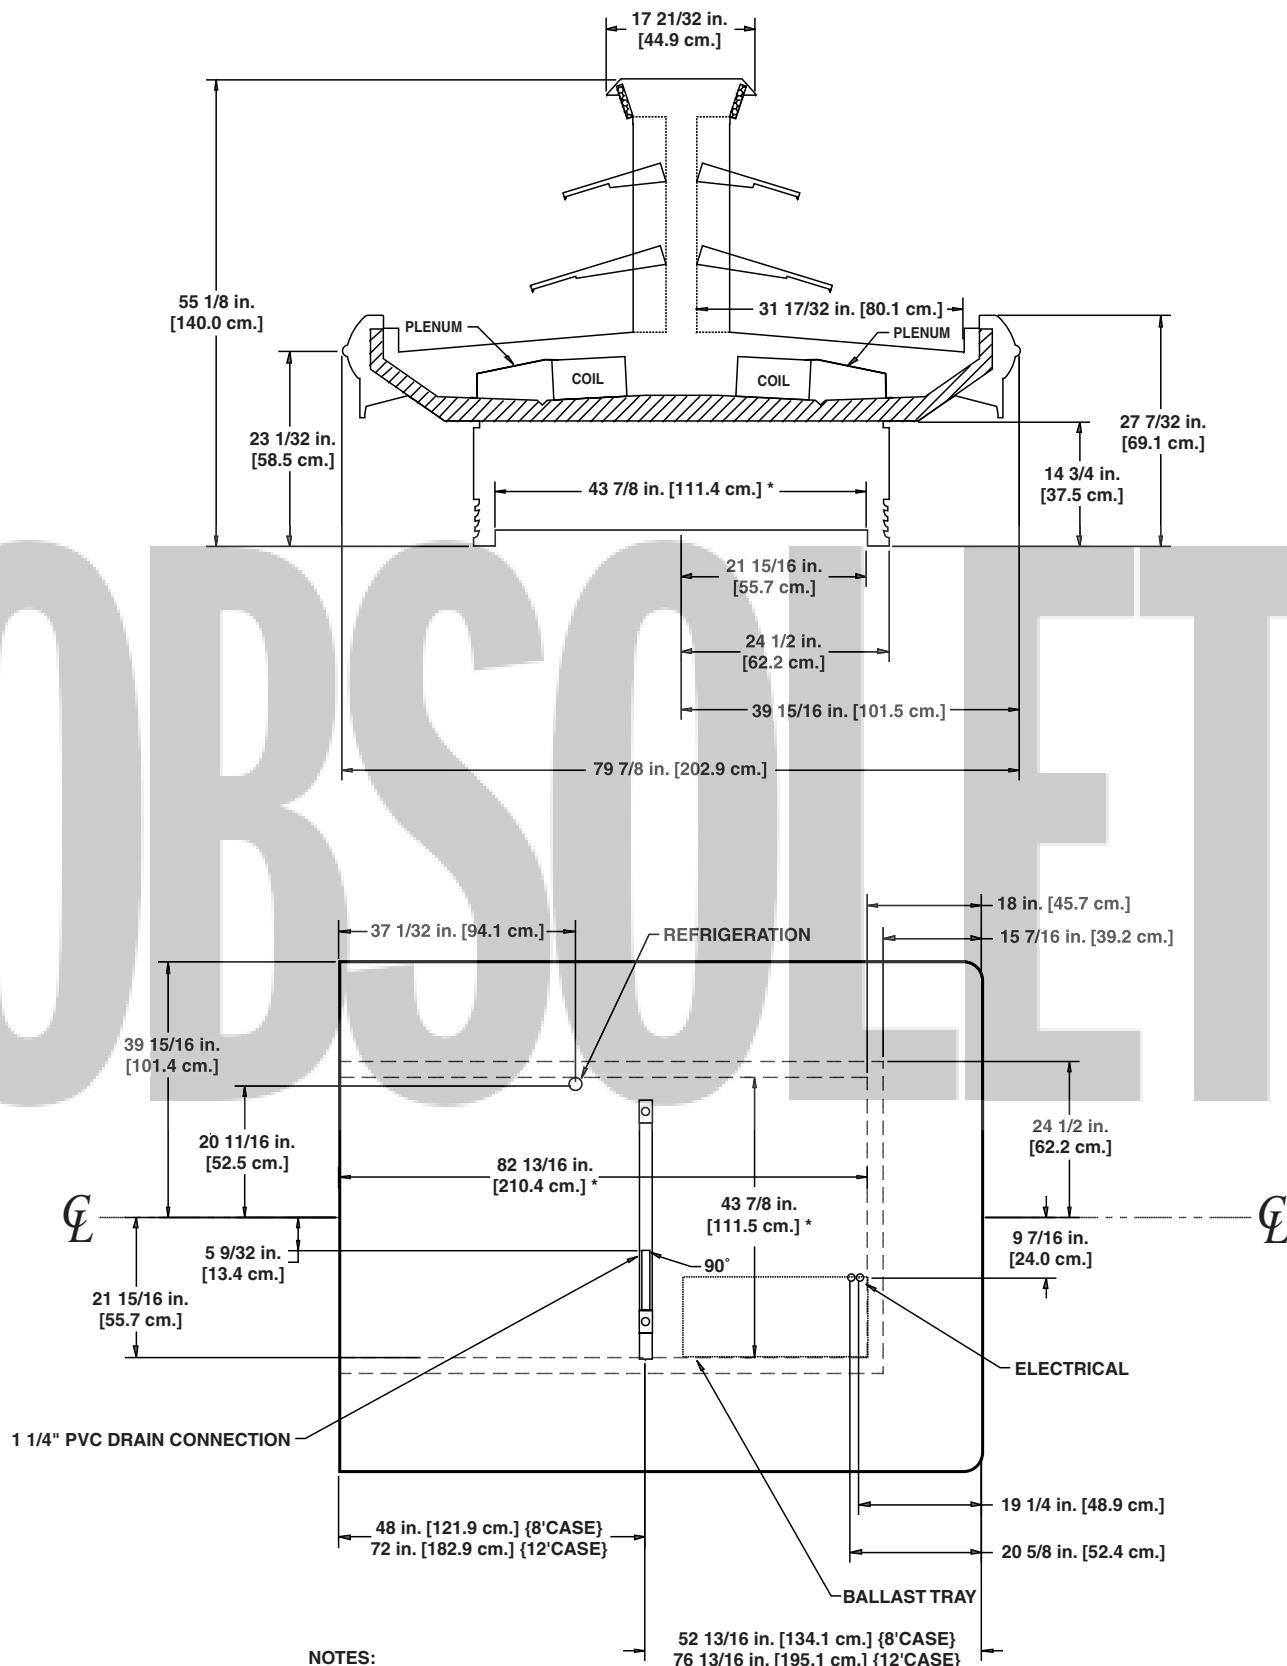

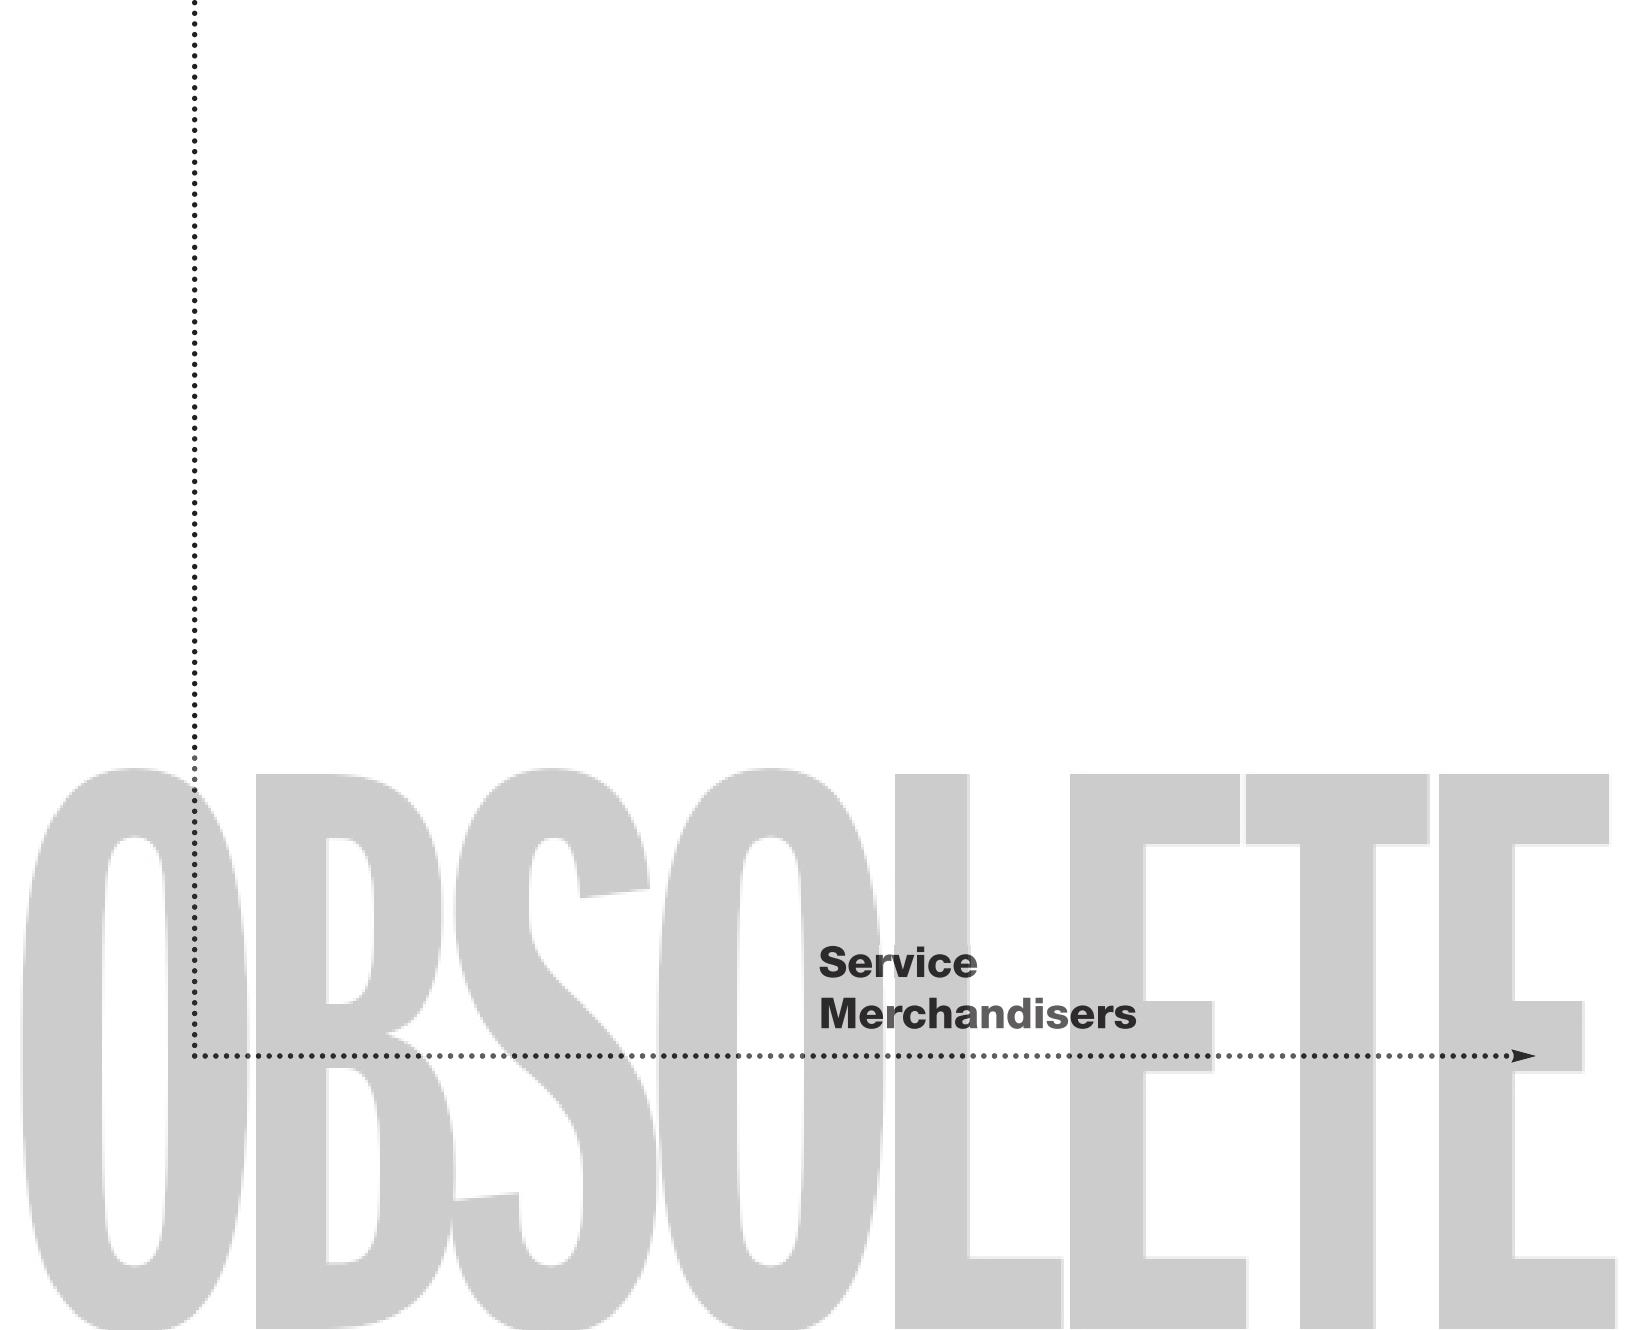

**Service
Merchandisers**

Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

American Style Curved Glass Service Deli Merchandiser

OSA - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters ¹		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OSA	4'	2	0.90	34	0.30	22	0.17	20	1.92	400	2.22	532
	6'	2	0.90	34	0.30	22	0.42	50	2.88	600	3.33	798
	8'	3	1.35	51	0.45	33	0.97	116	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.50	180	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSA	4'	0.57	68	1.71	205
	6'	0.57	68	2.41	289
	8'	0.57	68	2.41	289
	12'	0.77	92	3.85	462

Guidelines & Control Settings

Model	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OSA w/ Shelf Lights	320	22	6-8	24	37	39	235
OSA w/o Shelf Lights	290	22	6-8	24	35	39	235

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
OSA	2	6 - 8	35	50	75 ³	50 ³	20	45	- - - ⁴

³ Not recommended on this model due to long defrost time.

⁴ NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
COLD


A  DOVER DIVERSIFIED COMPANY


OSA
(11" BASEFRAME)

HII PHOENIX
EXCELLENCE™

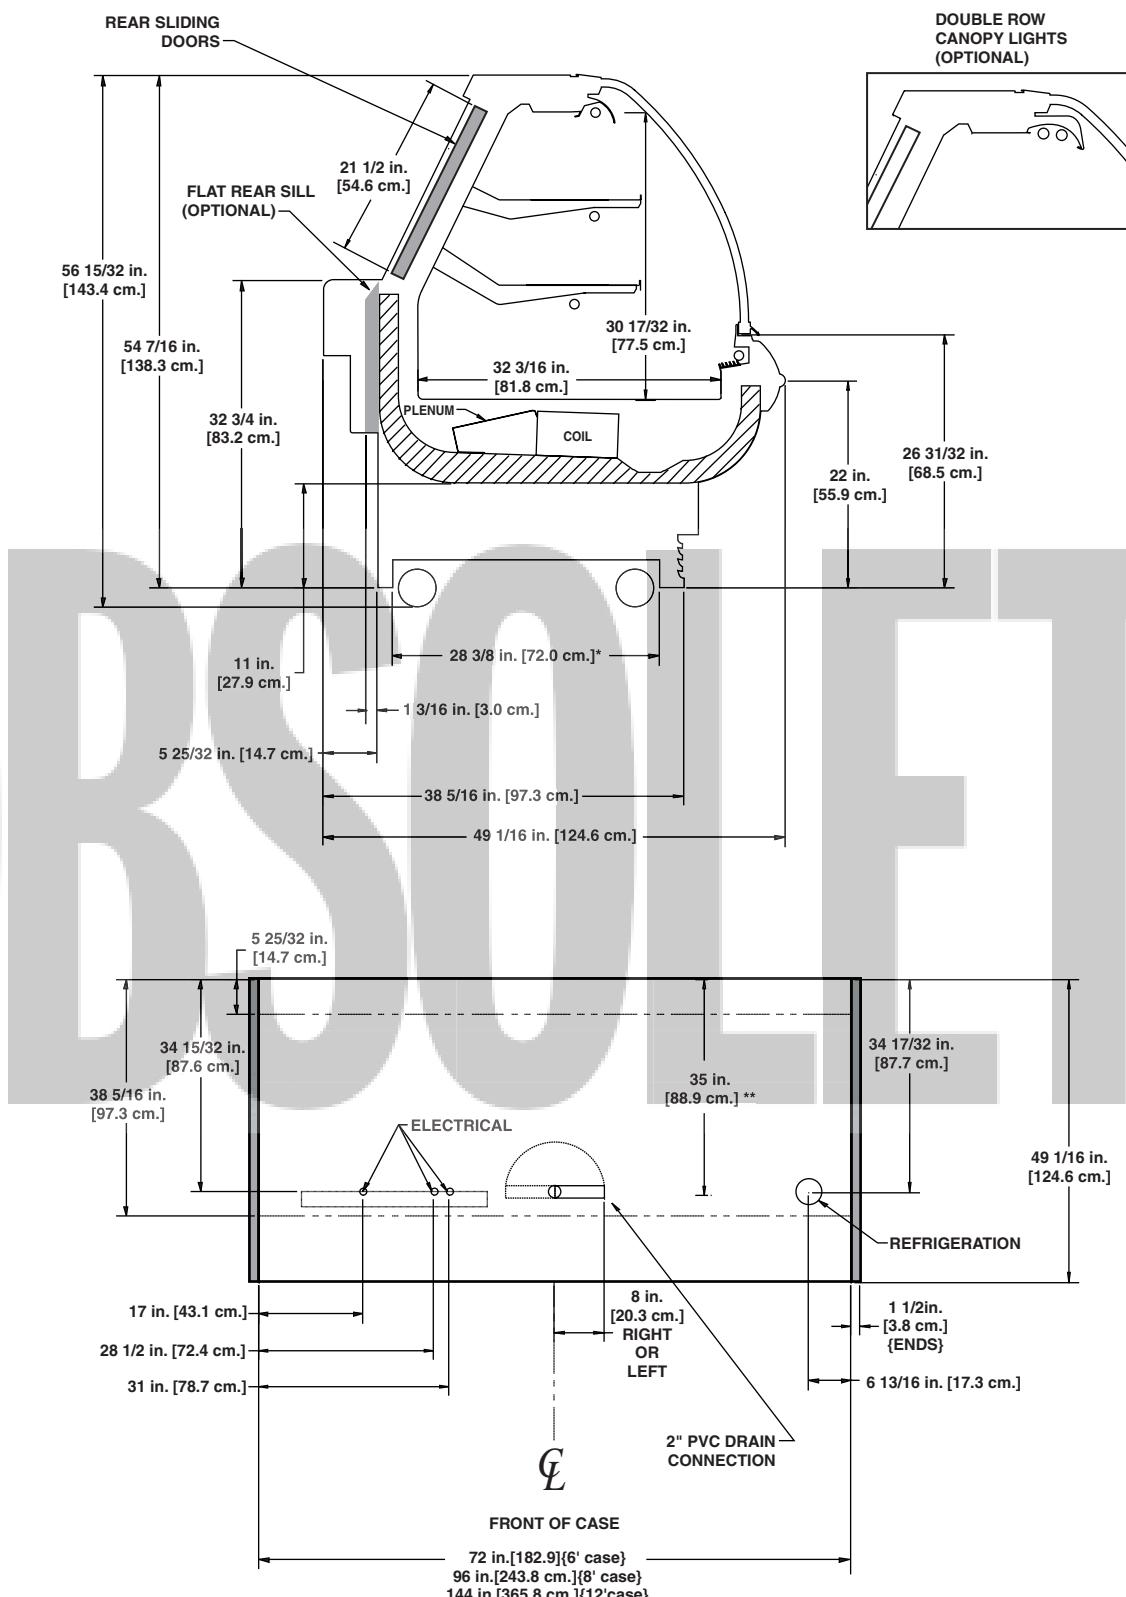

SERVICE
Deli

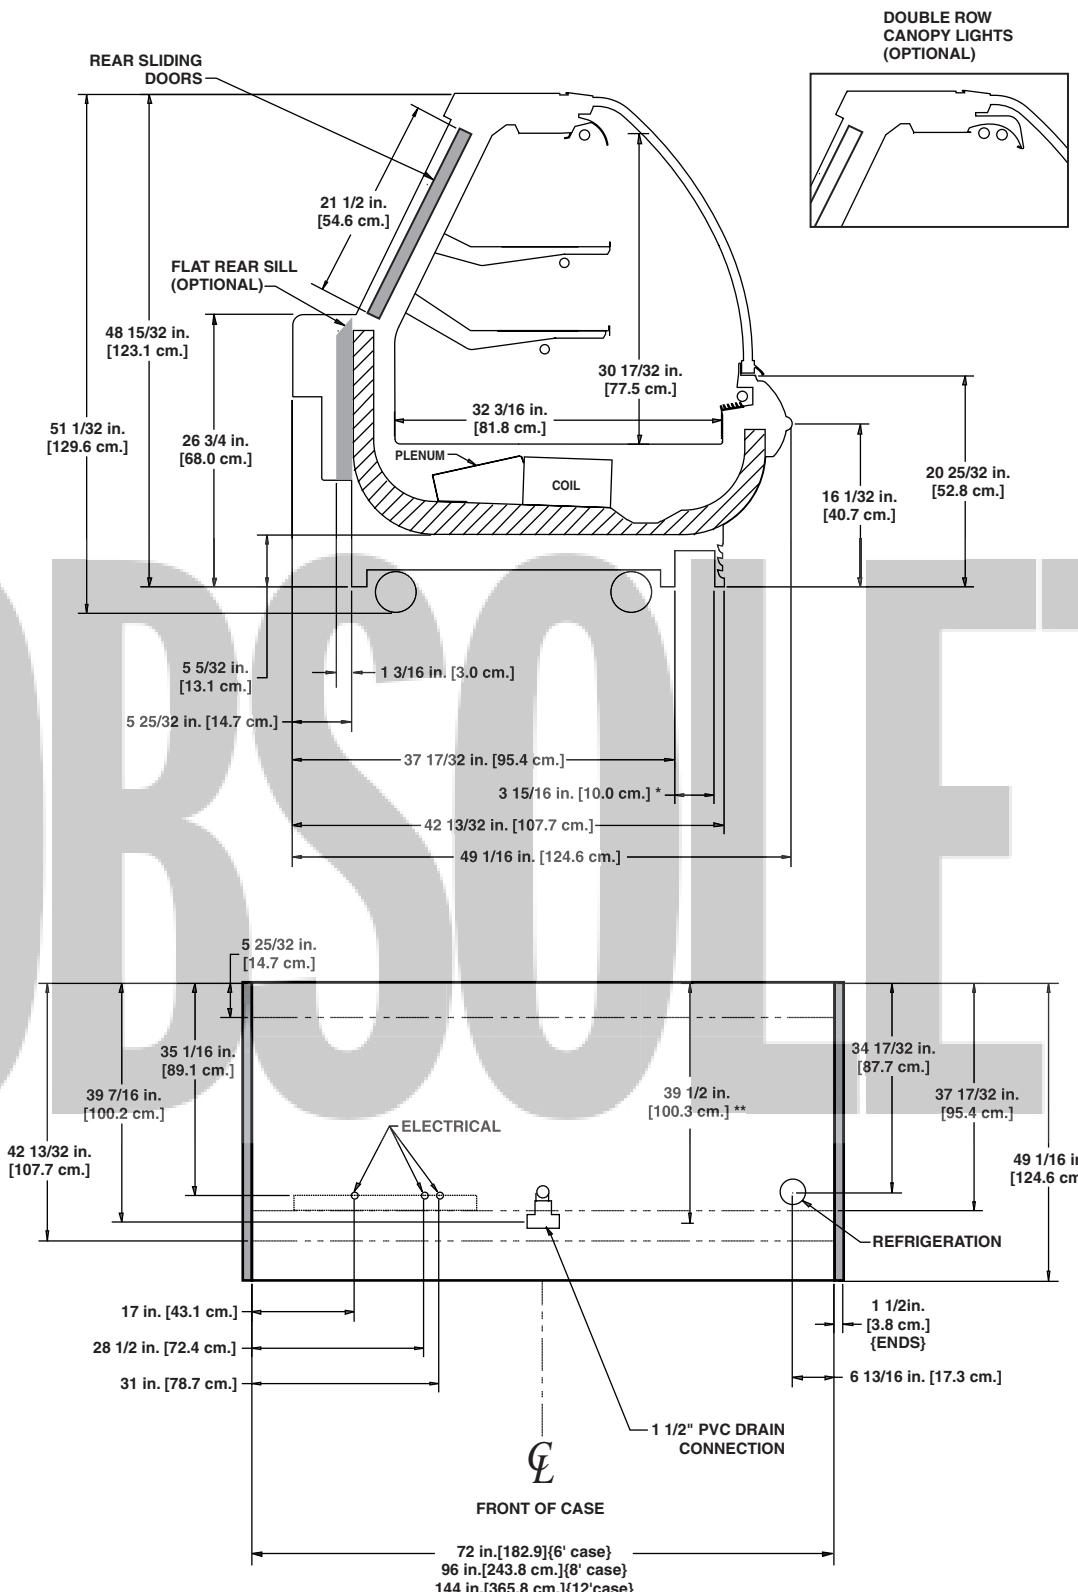

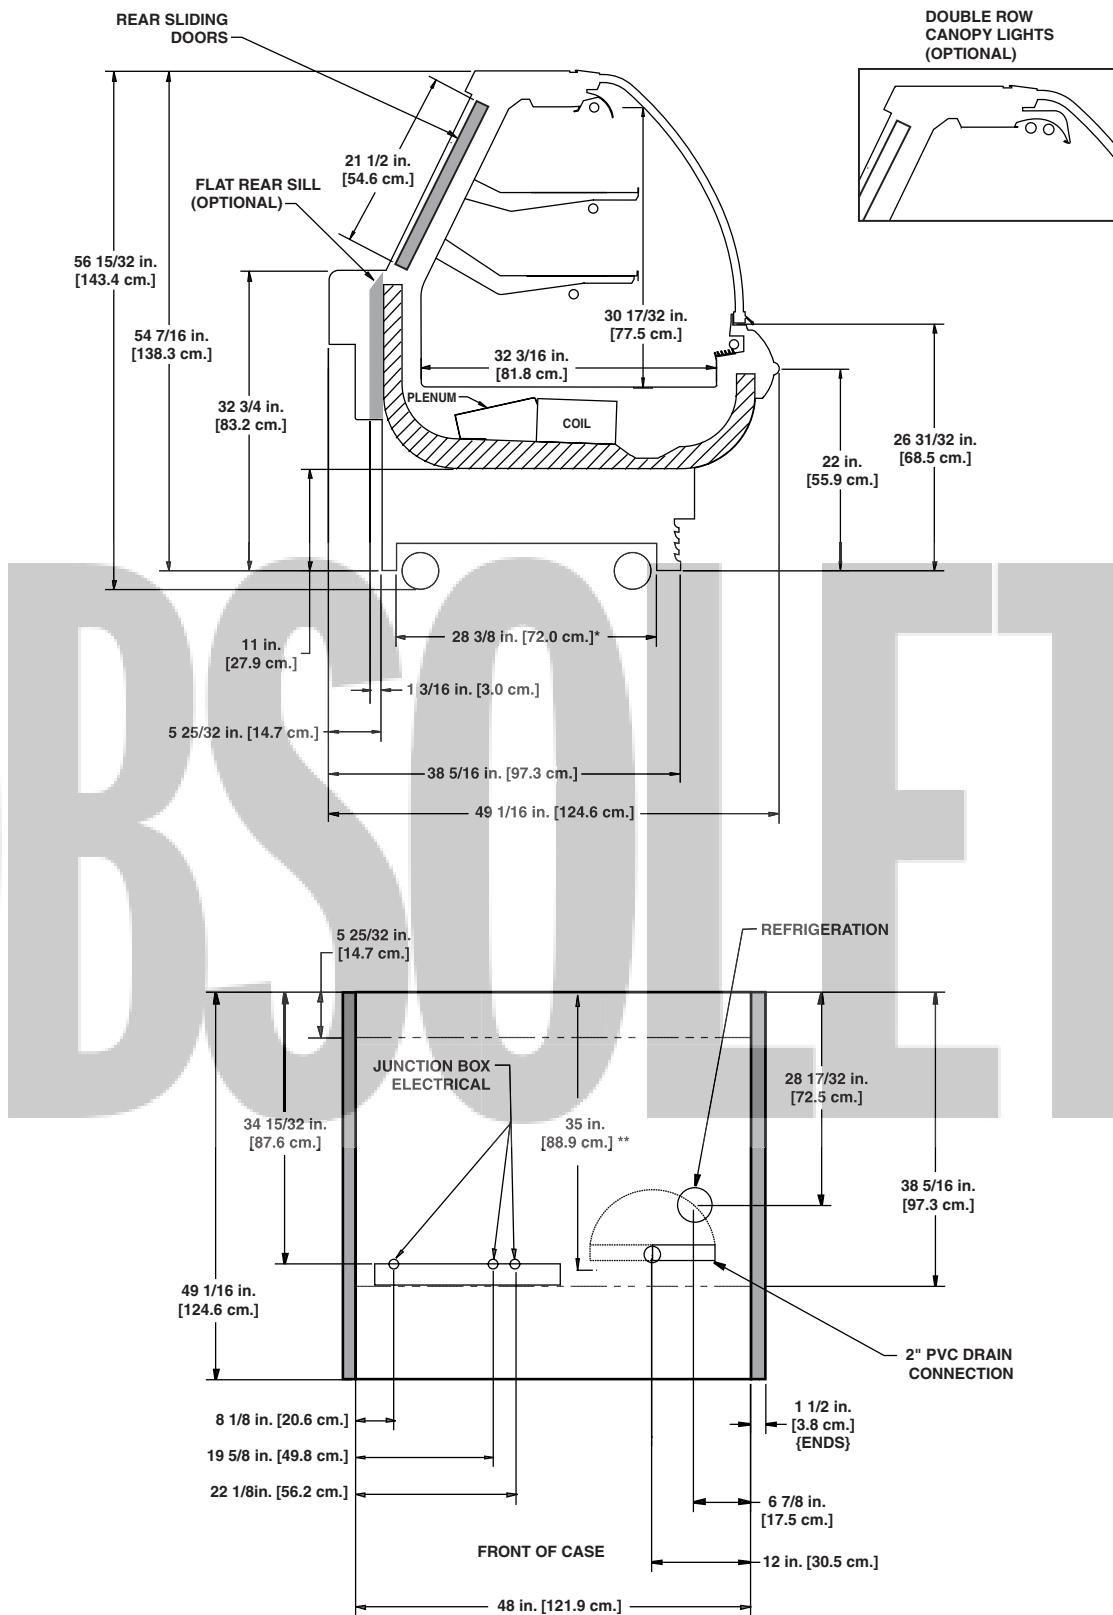

American Style Vertical Glass Service Deli Merchandiser

OSM - 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OSM	8'	3	1.35	51	0.45	33	0.97	116	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.50	180	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSM	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OSM	320	22	6-8	24	37	39	235

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSM	2	6 - 8	35	50	75 ³	50 ³	20	45	- - - ⁴	- - -

³ Not recommended on this model due to long defrost time.

⁴ NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
COLD

A  DOVER DIVERSIFIED COMPANY

OSM
(11" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

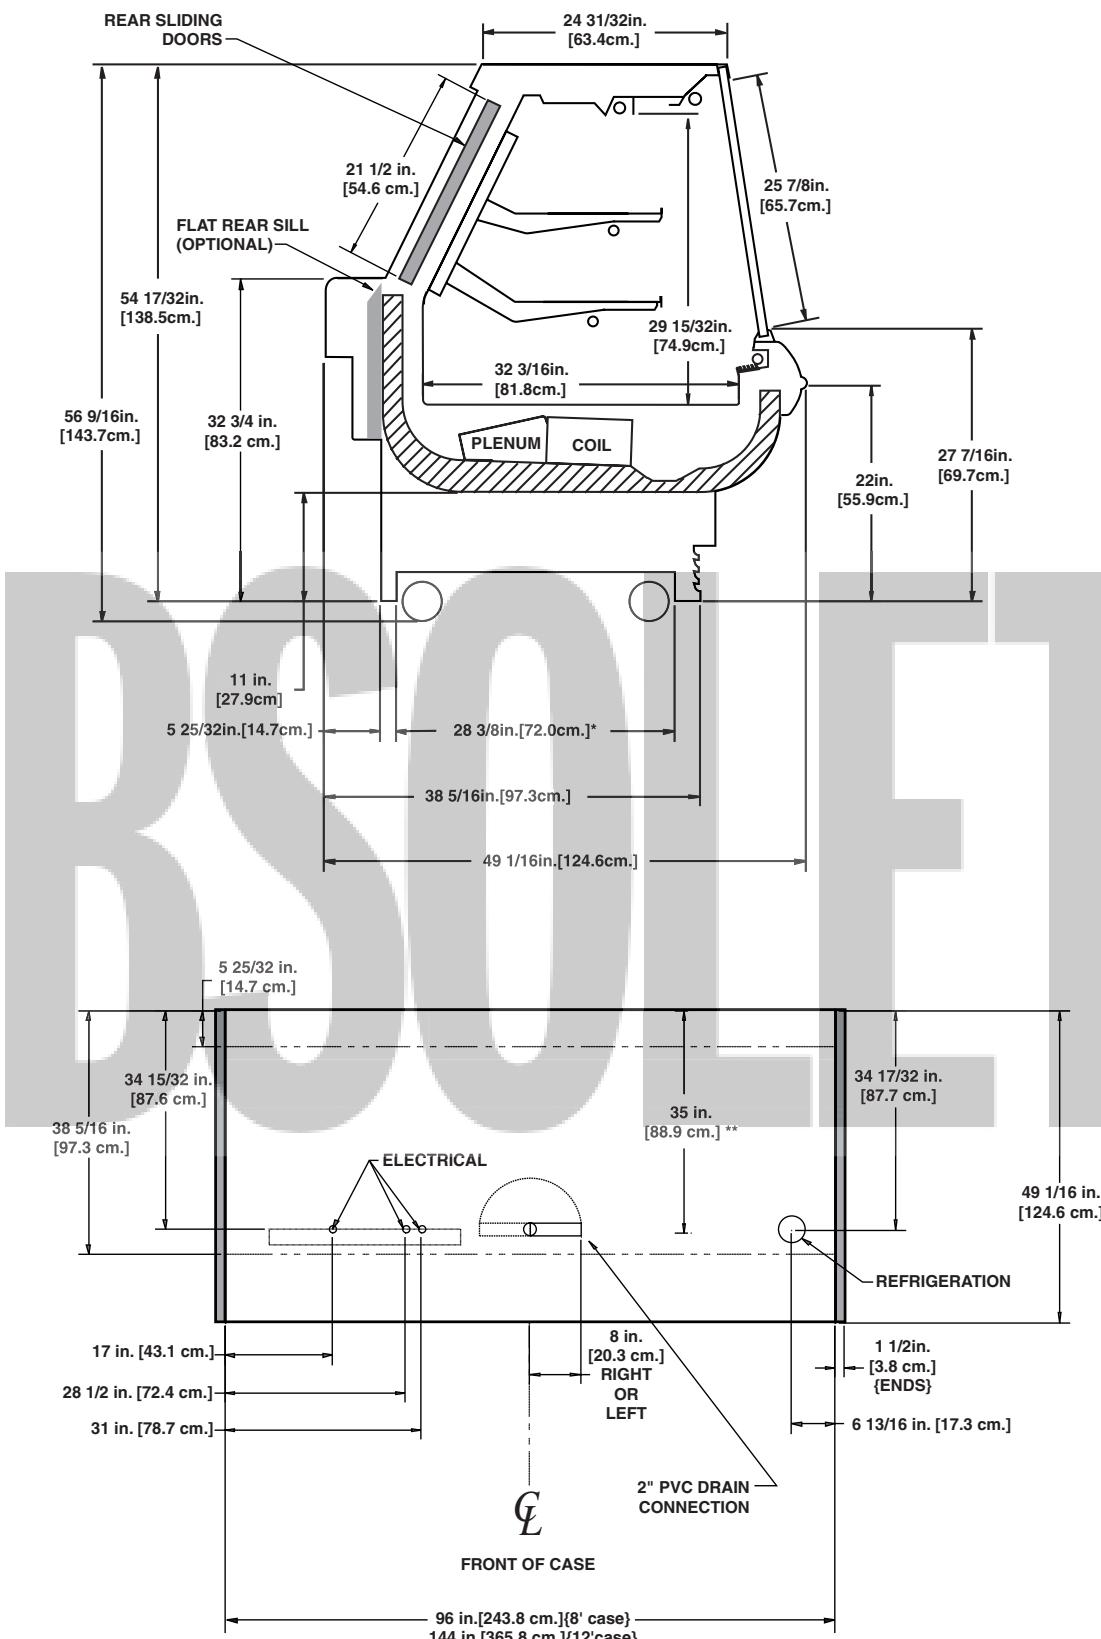

NOTES:


* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- AVAILABLE SHELF SIZES: 10" & 12"

A DOVER DIVERSIFIED COMPANY

(5 5/32" BASEFRAME)

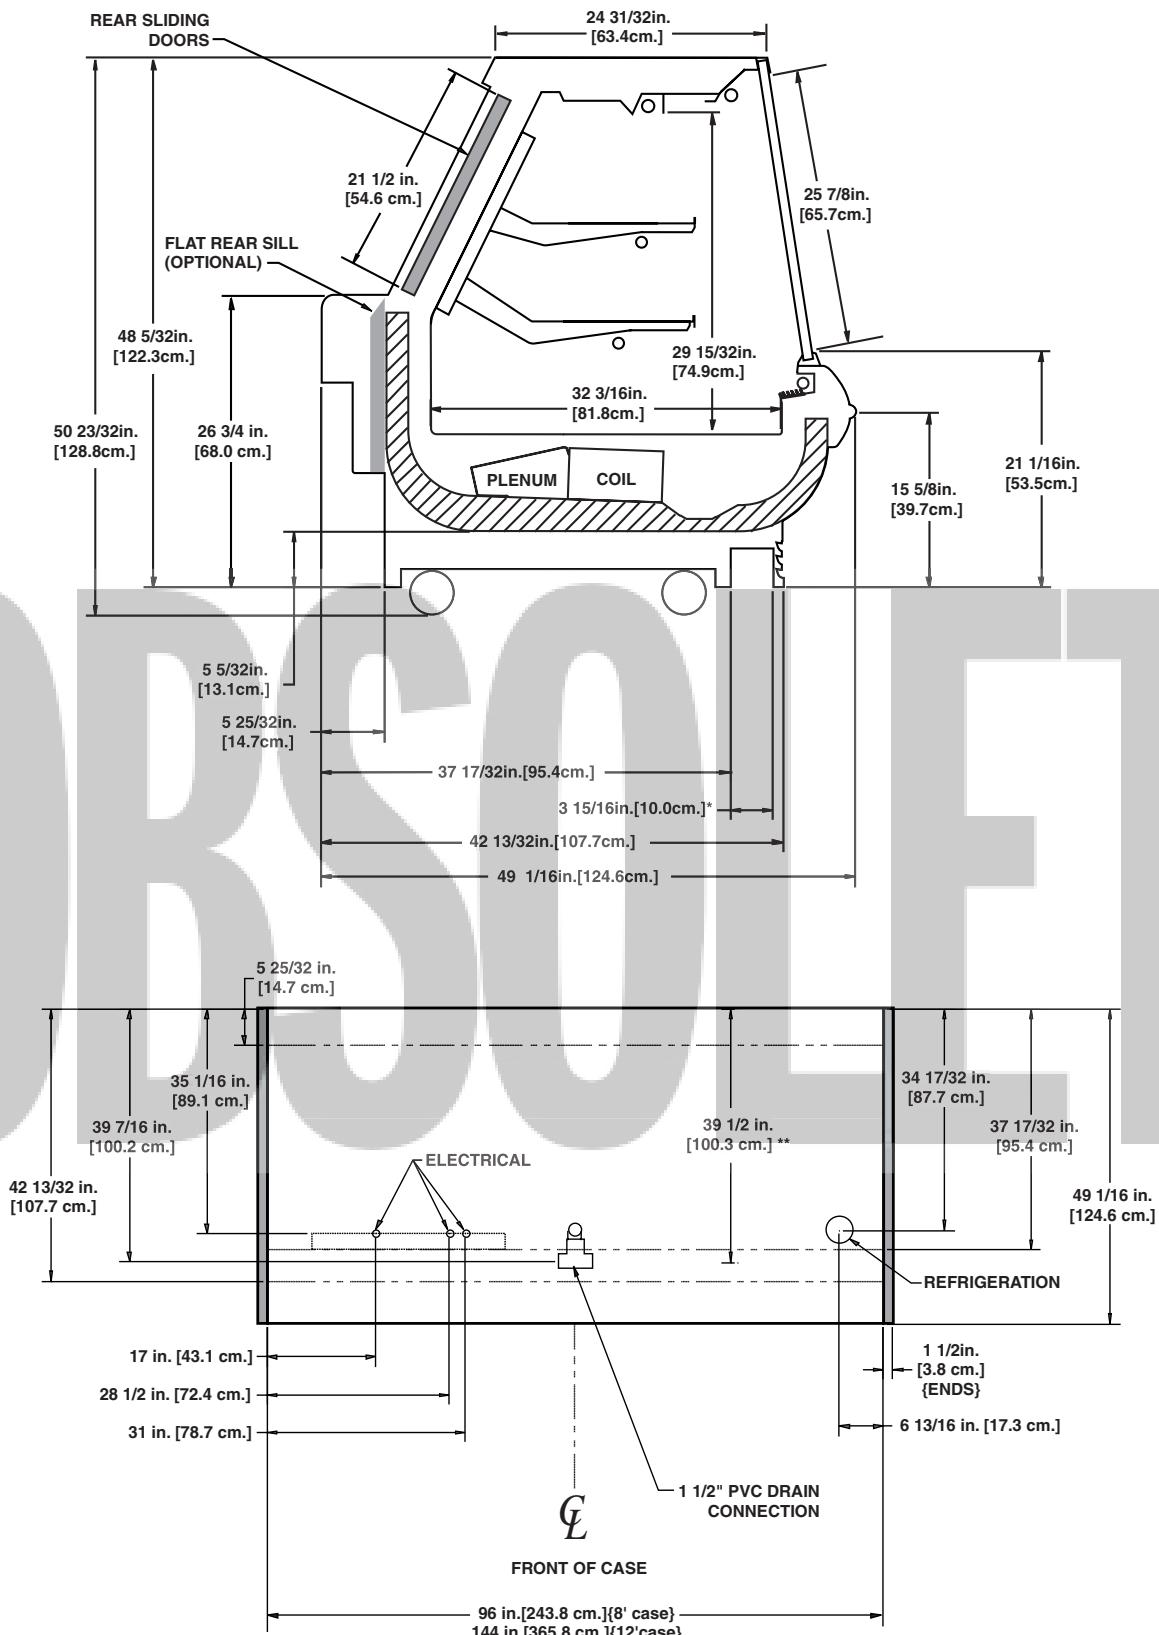

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- AVAILABLE SHELF SIZES: 10" & 12"

OBSCURE

SERVICE

Deli

American Style Curved Glass Service Deli/Meat/Seafood Gravity Coil Merchandiser

OSAG - 4', 6', 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters ¹		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OSAG	4'	2	0.90	34	0.30	22	0.17	20	---	---	---
	6'	2	0.90	34	0.30	22	0.42	50	---	---	---
	8'	3	1.35	51	0.45	33	0.97	116	---	---	---
	12'	4	1.80	68	0.60	44	1.50	180	---	---	---

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSAG	4'	0.57	68	1.14	137
	6'	0.57	68	1.49	179
	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OSAG ⁴	270	12	6-8	21-31	37	38	125

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

⁴ If the OSAG is piped to a suction header lower than 10°F an EPR with a suction stop solenoid is required. A liquid line solenoid alone does not allow the case to cycle properly. The thermostat probe should be located on the inlet of the top coil. The cut out point should be set to 12°F and the cut in point should be set so that refrigeration starts as soon as the top coil ice starts to drip.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSAG	2	6 - 8	---	---	65	46	---	---

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

OSAG
(11" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

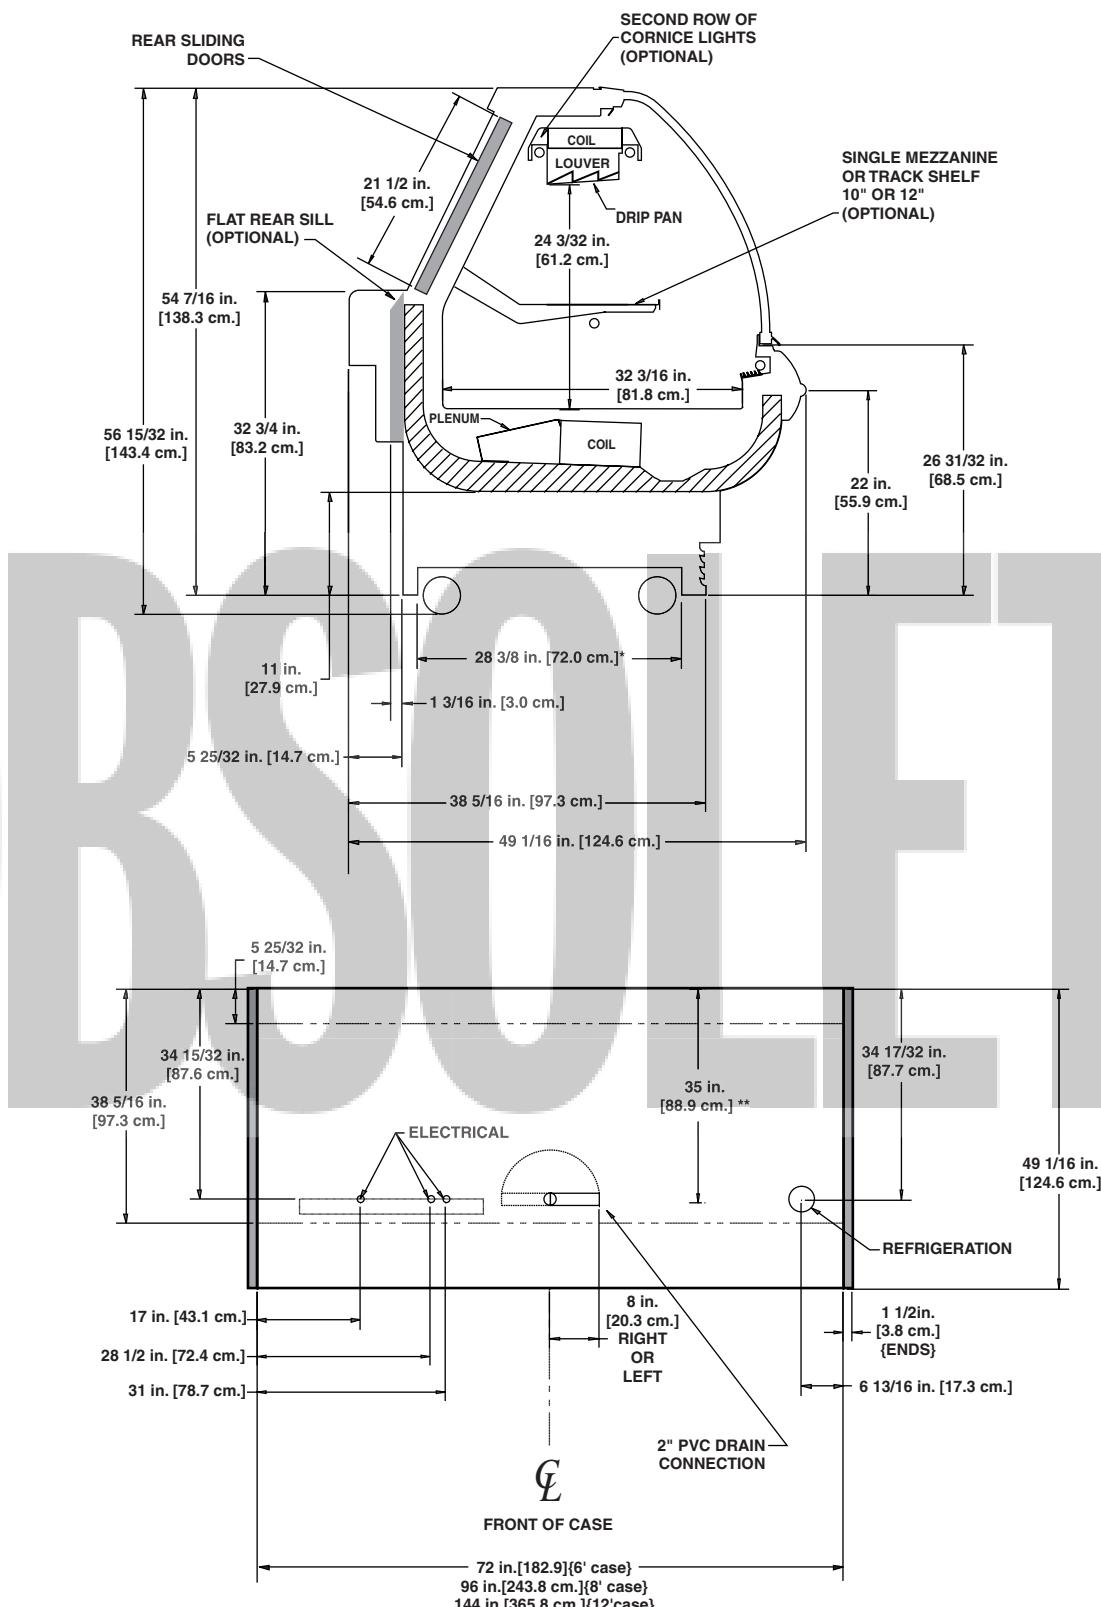

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• SERPENTINE COIL AVAILABLE FOR FISH/SEAFOOD APPLICATION ONLY

• AVAILABLE SHELF SIZES: 10" & 12" (SINGLE ROW OF SHELVES PER CASE)


A DOVER DIVERSIFIED COMPANY

SERVICE

Deli/Meat/Seafood

OSAG
(5 5/32" BASEFRAME)

HILL PHOENIXTM

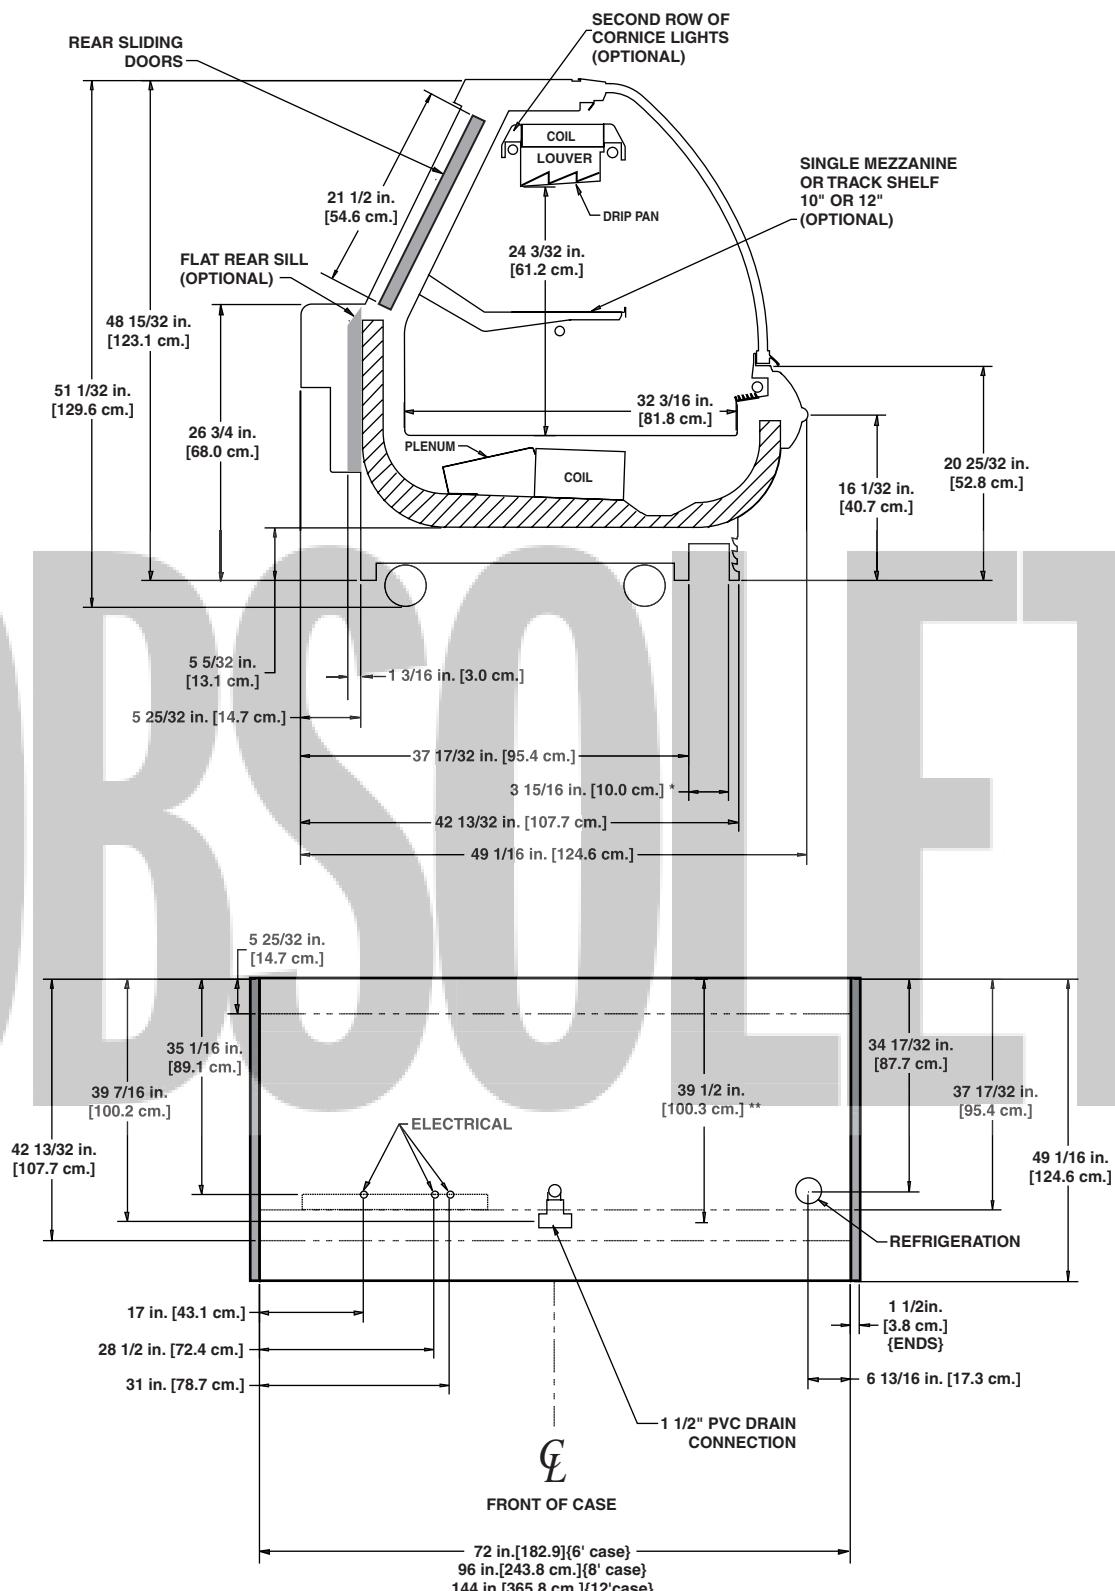


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- SERPENTINE COIL AVAILABLE FOR FISH/SEAFOOD APPLICATION ONLY
- AVAILABLE SHELF SIZES: 10" & 12" (SINGLE ROW OF SHELVES PER CASE)

A DOVER DIVERSIFIED COMPANY

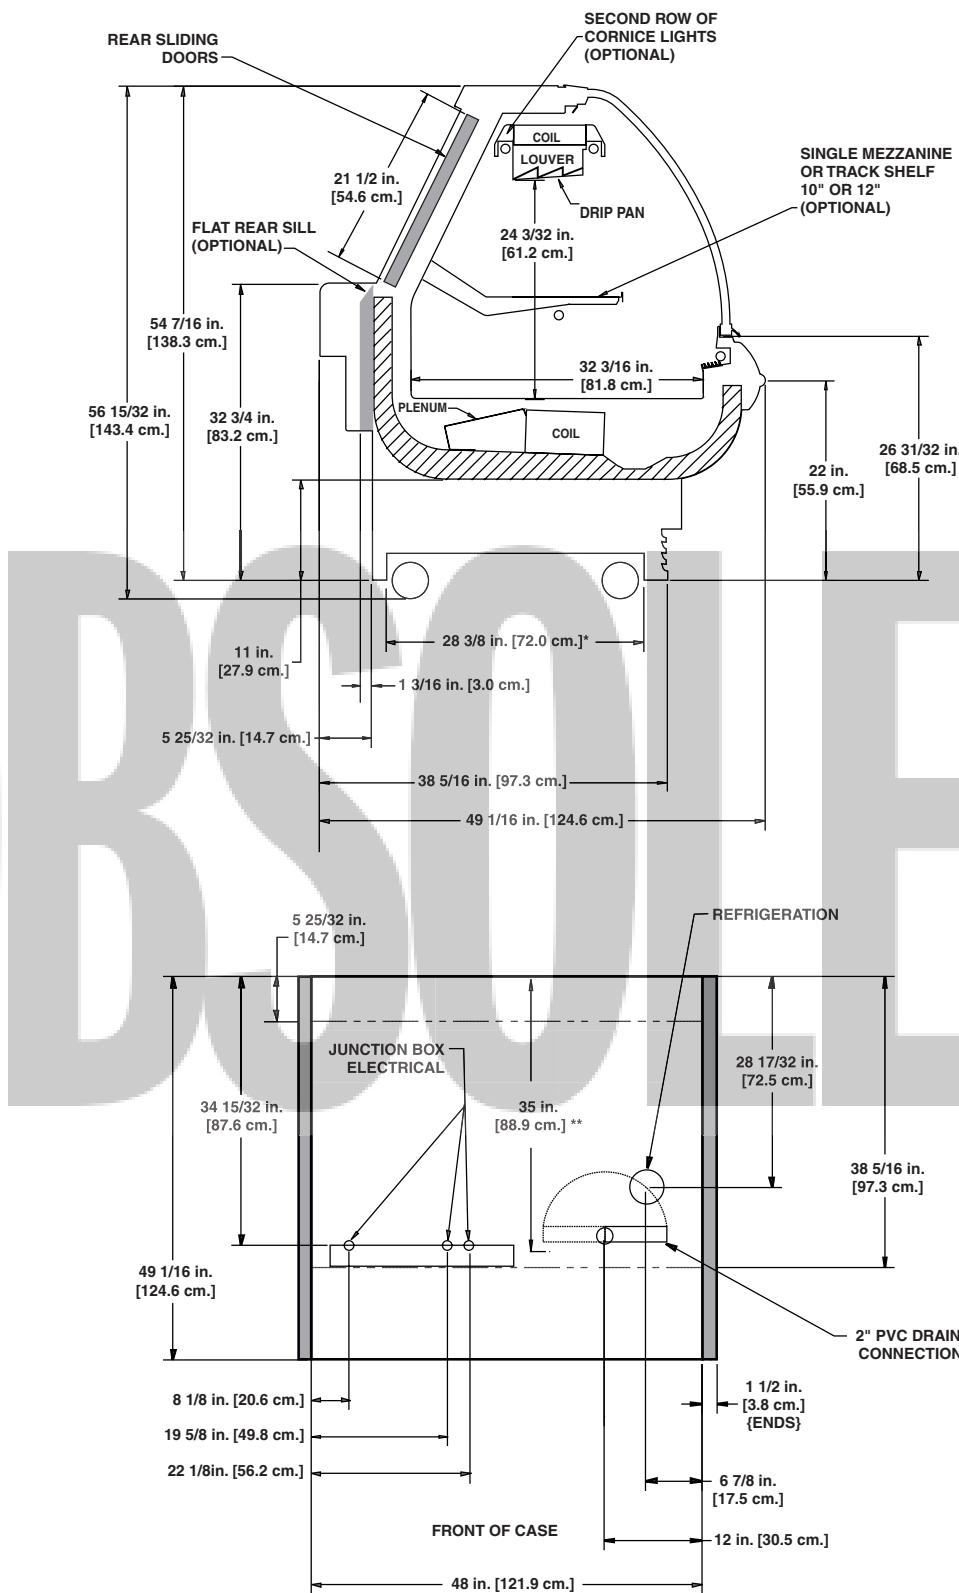

SERVICE

Deli/Meat/Seafood

American Style Vertical Glass Service Deli/Meat/Seafood Gravity Coil Merchandiser

OGM - 8' & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OGM	8'	0	---	---	---	0.97	116	---	---	---	---
	12'	0	---	---	---	1.50	180	---	---	---	---

¹ NOTE: --- not an option on this case model.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OGM	8'	0.57	68	2.06	247
	12'	0.77	92	3.08	370

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ⁴ (FPM)
OGM	226	17	6-8	NA ³	35	NA	NA

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Not applicable

⁴ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OGM	2	6 - 8	---	---	65	46	---	---	---	---

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

OGM
(11" BASEFRAME)

HILL PHOENIX
EXCELLENCE™

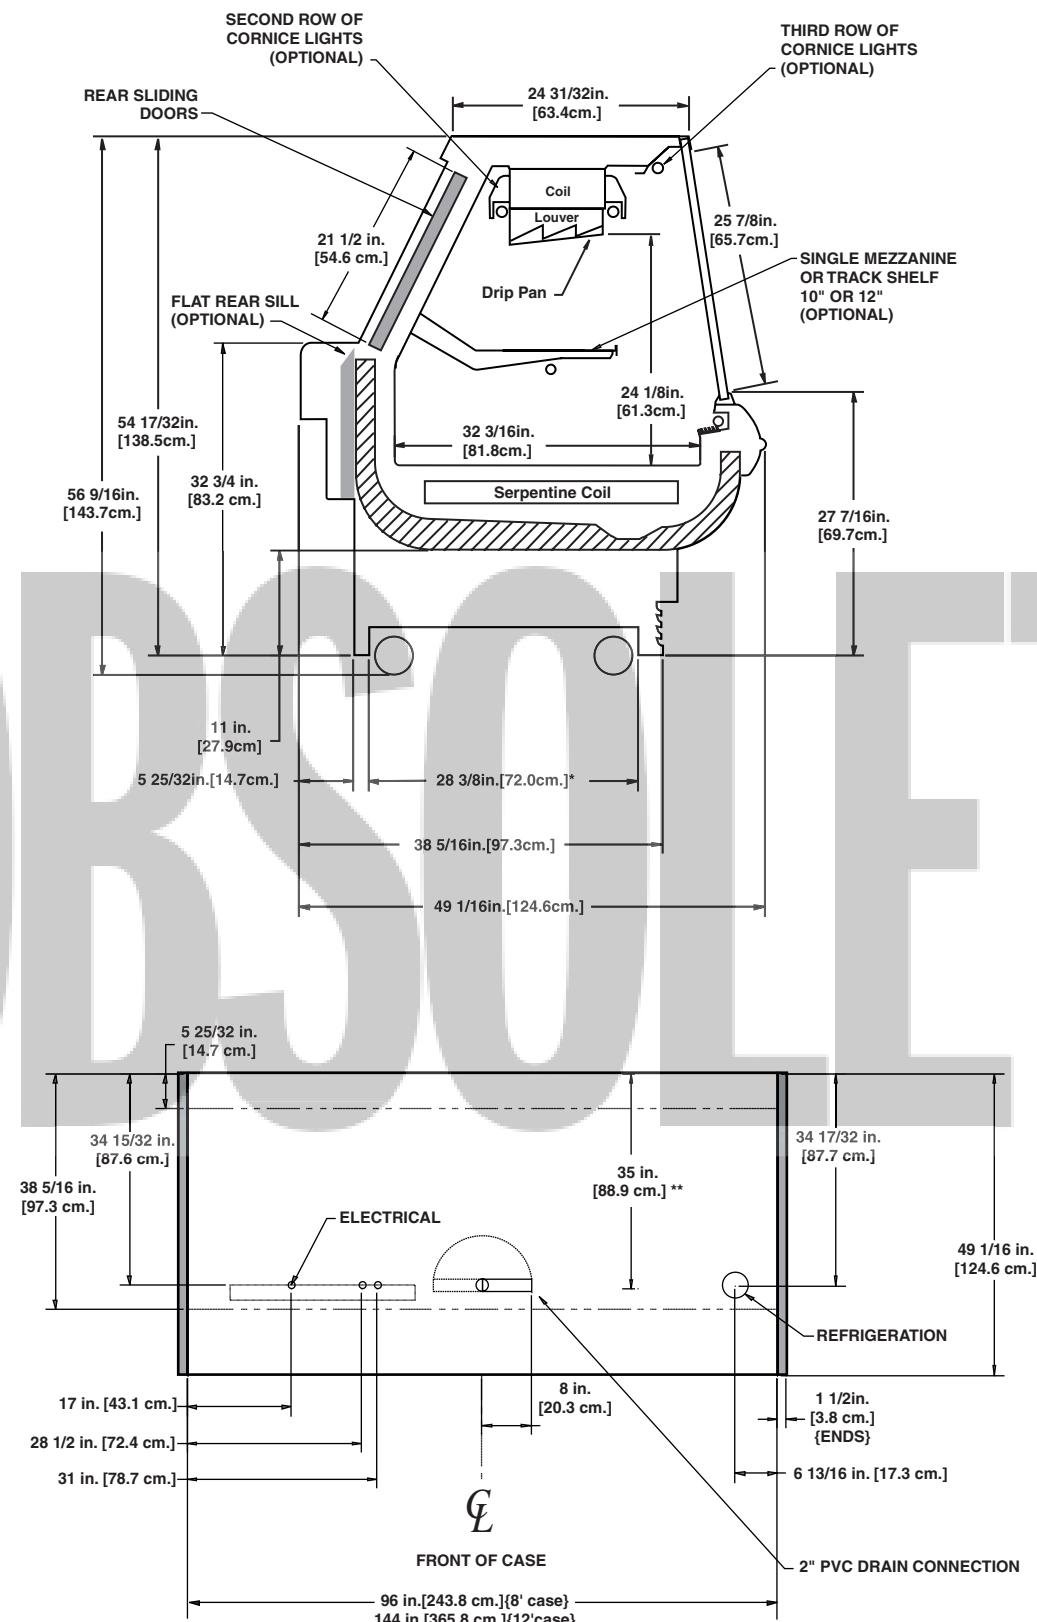

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS


- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

- AVAILABLE SHELF SIZES: 10" & 12" (SINGLE ROW OF SHELVES PER CASE)

A DOVER DIVERSIFIED COMPANY

SERVICE

Deli/Meat/Seafood

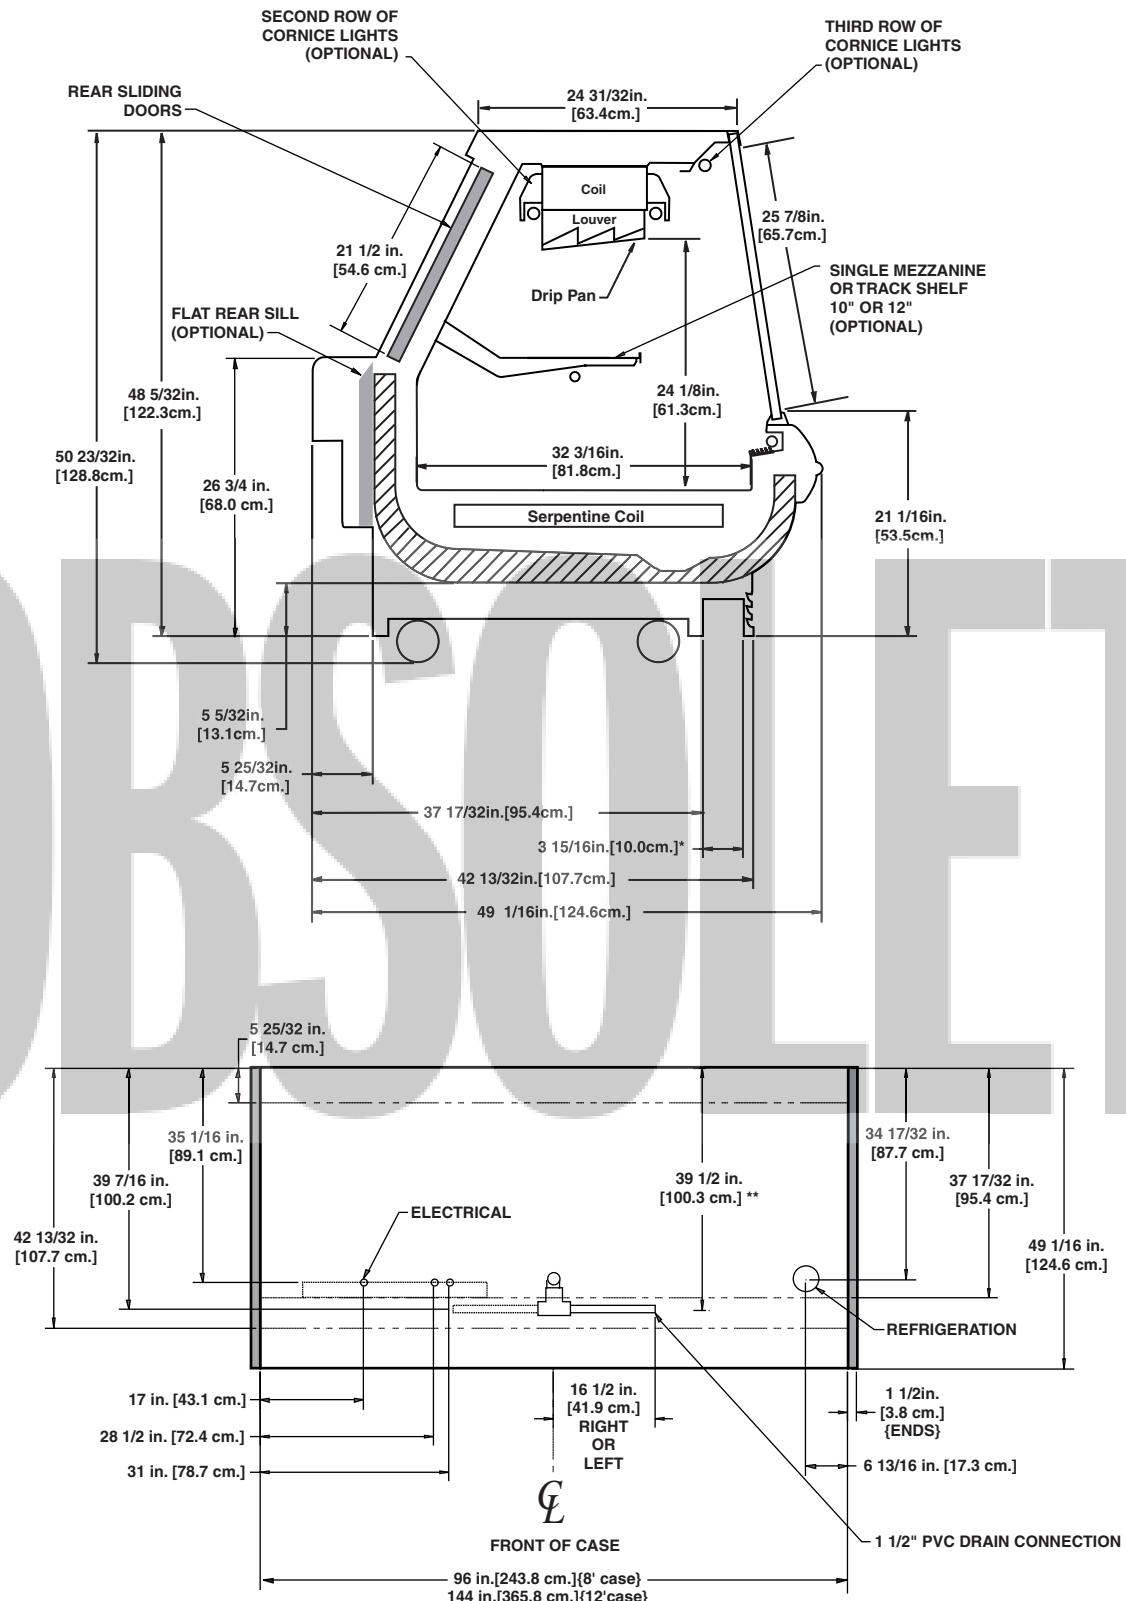

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• AVAILABLE SHELF SIZES: 10" & 12" (SINGLE ROW OF SHELVES PER CASE)

SERVICE

Deli/Meat/Seafood

OBSCULTE

International Style Service Deli/Meat/Seafood Merchandiser

OSI - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OSI	4'	2	0.90	34	0.30	22	0.55	66	1.92	400	2.22	532
	6'	2	0.90	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.35	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSI	4'	0.57	68	1.14	137
	6'	0.57	68	1.43	172
	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OSI ³	350	22	6-8	31	36	38	175

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ Humidification system required on this case when used for Fresh Meat application

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSI	3	6 - 8	30	47	60 ⁴	47 ⁴	26	45

⁴ Not recommended on this model due to long defrost time.

⁵ NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

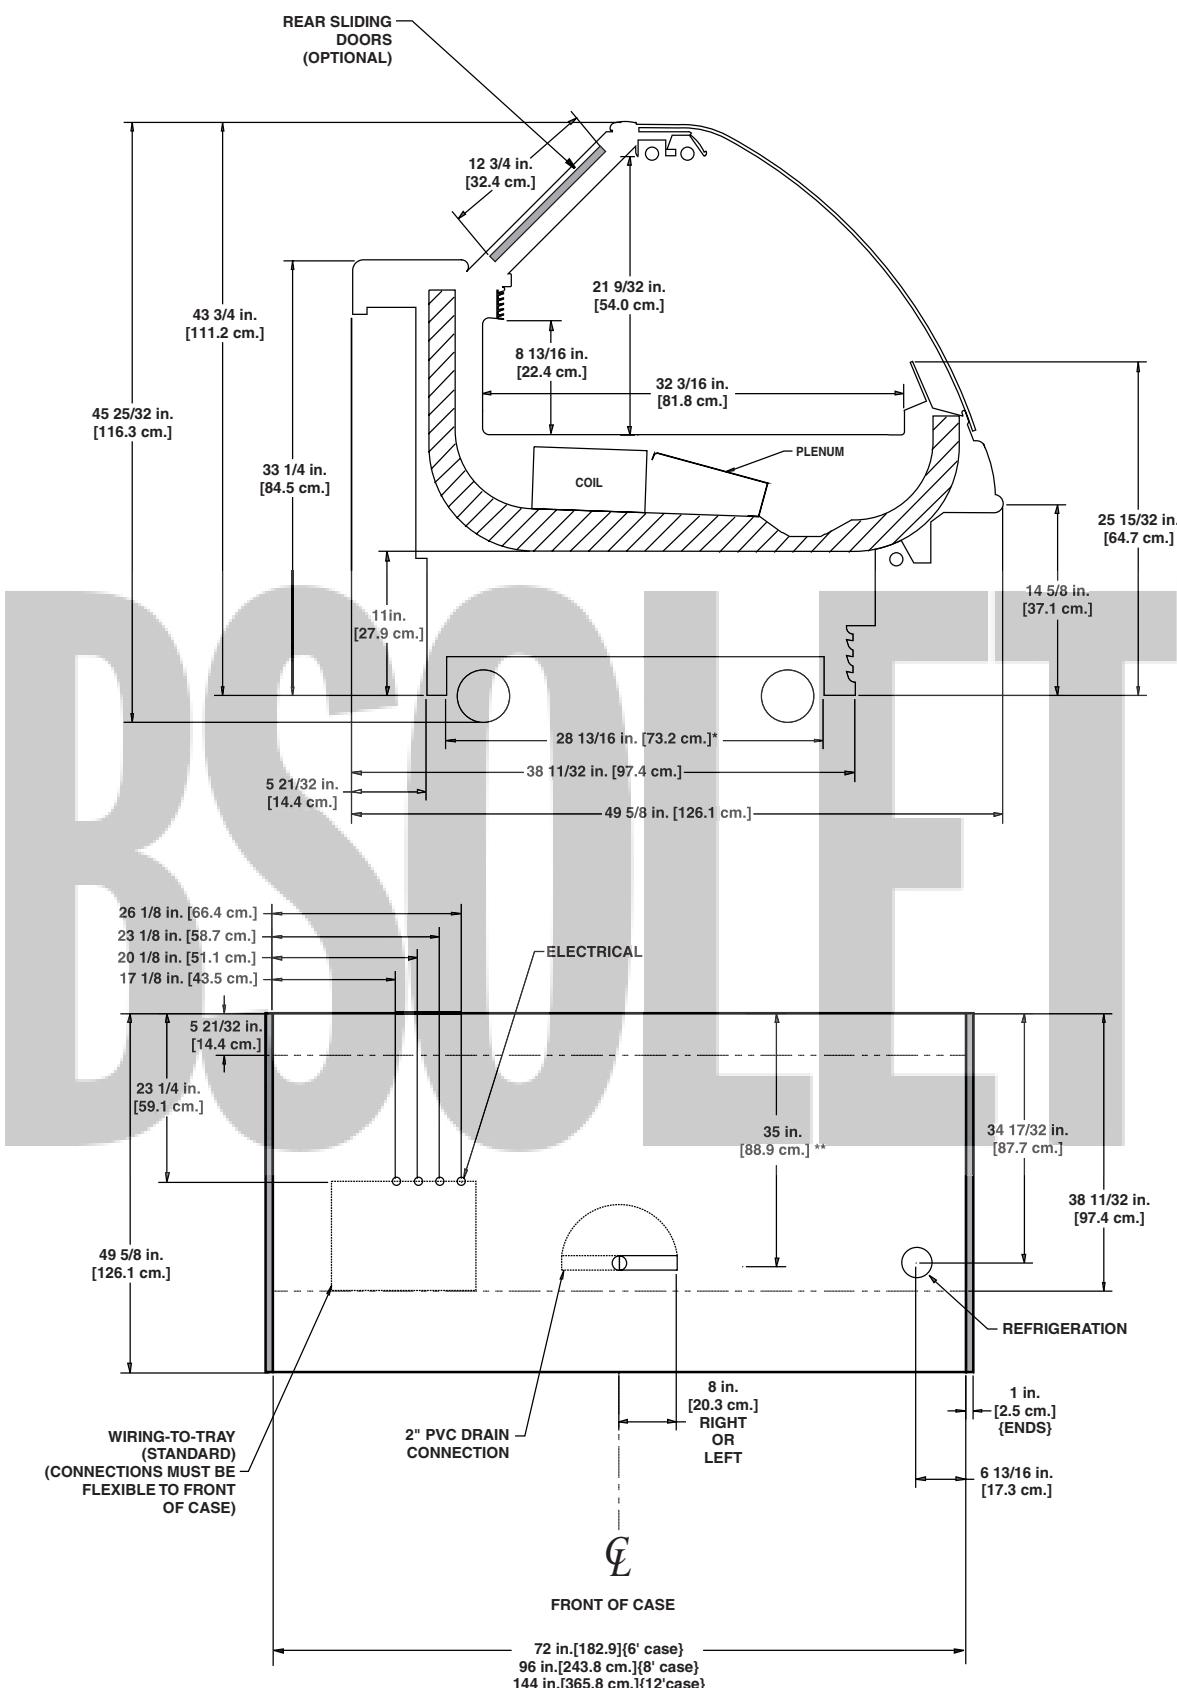


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

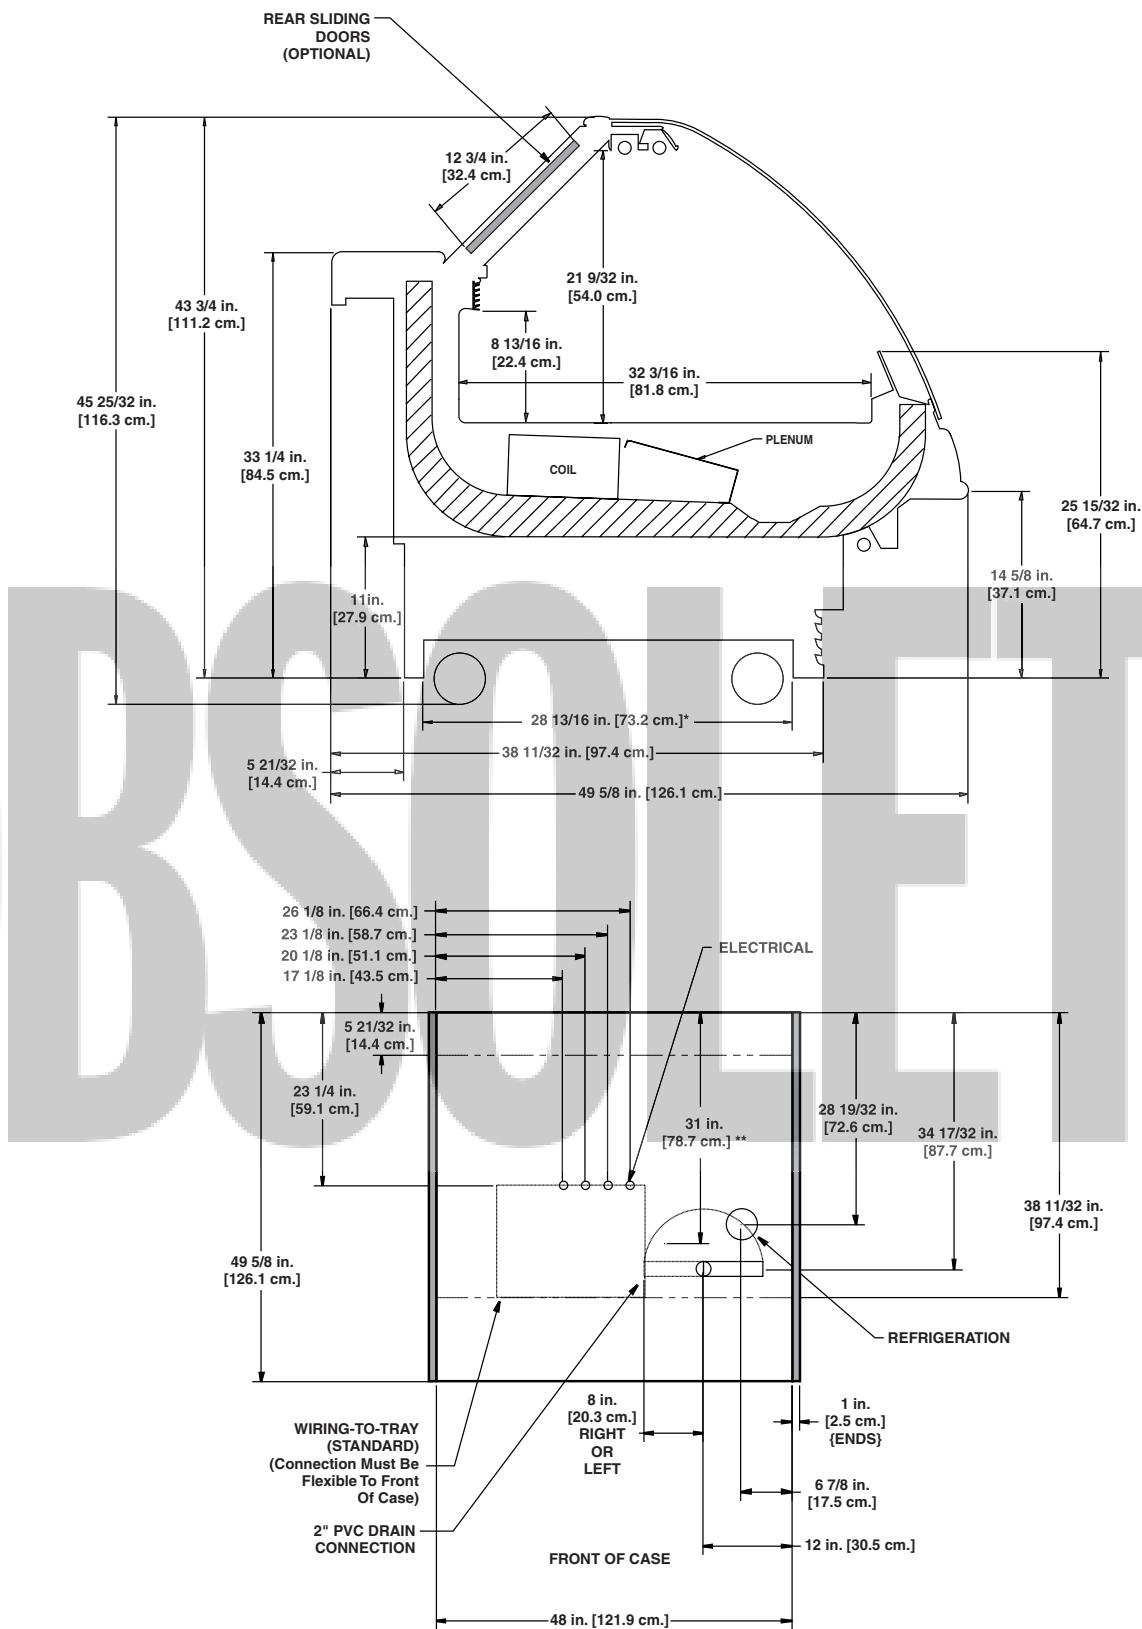

SERVICE

Deli/Meat/Seafood

OBSCULTE

Wide International Style Service Deli/Meat/Seafood Merchandiser

OWSI - 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters			
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OWSI	6'	2	0.90	34	0.30	22	1.03	124	2.88	600	3.33
	8'	3	1.35	51	0.45	33	1.22	146	3.85	800	4.44
	12'	4	1.80	68	0.60	44	1.88	226	5.77	1200	6.67
											1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting	
	120 Volts		120 Volts	
	Amps	Watts	Amps	Watts
OWSI	6'	0.57	68	1.43
	8'	0.57	68	1.49
	12'	0.77	92	2.31
				277

Guidelines & Control Settings

Model	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OWSI ³	450	22	6-8	31	36	38	175

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ Humidification system required on this case when used for Fresh Meat application

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OWSI	3	6 - 8	30	47	60 ⁴	47 ⁴	26	45	- - - ⁵	- - -

⁴ Not recommended on this model due to long defrost time.

⁵ NOTE: - - - not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

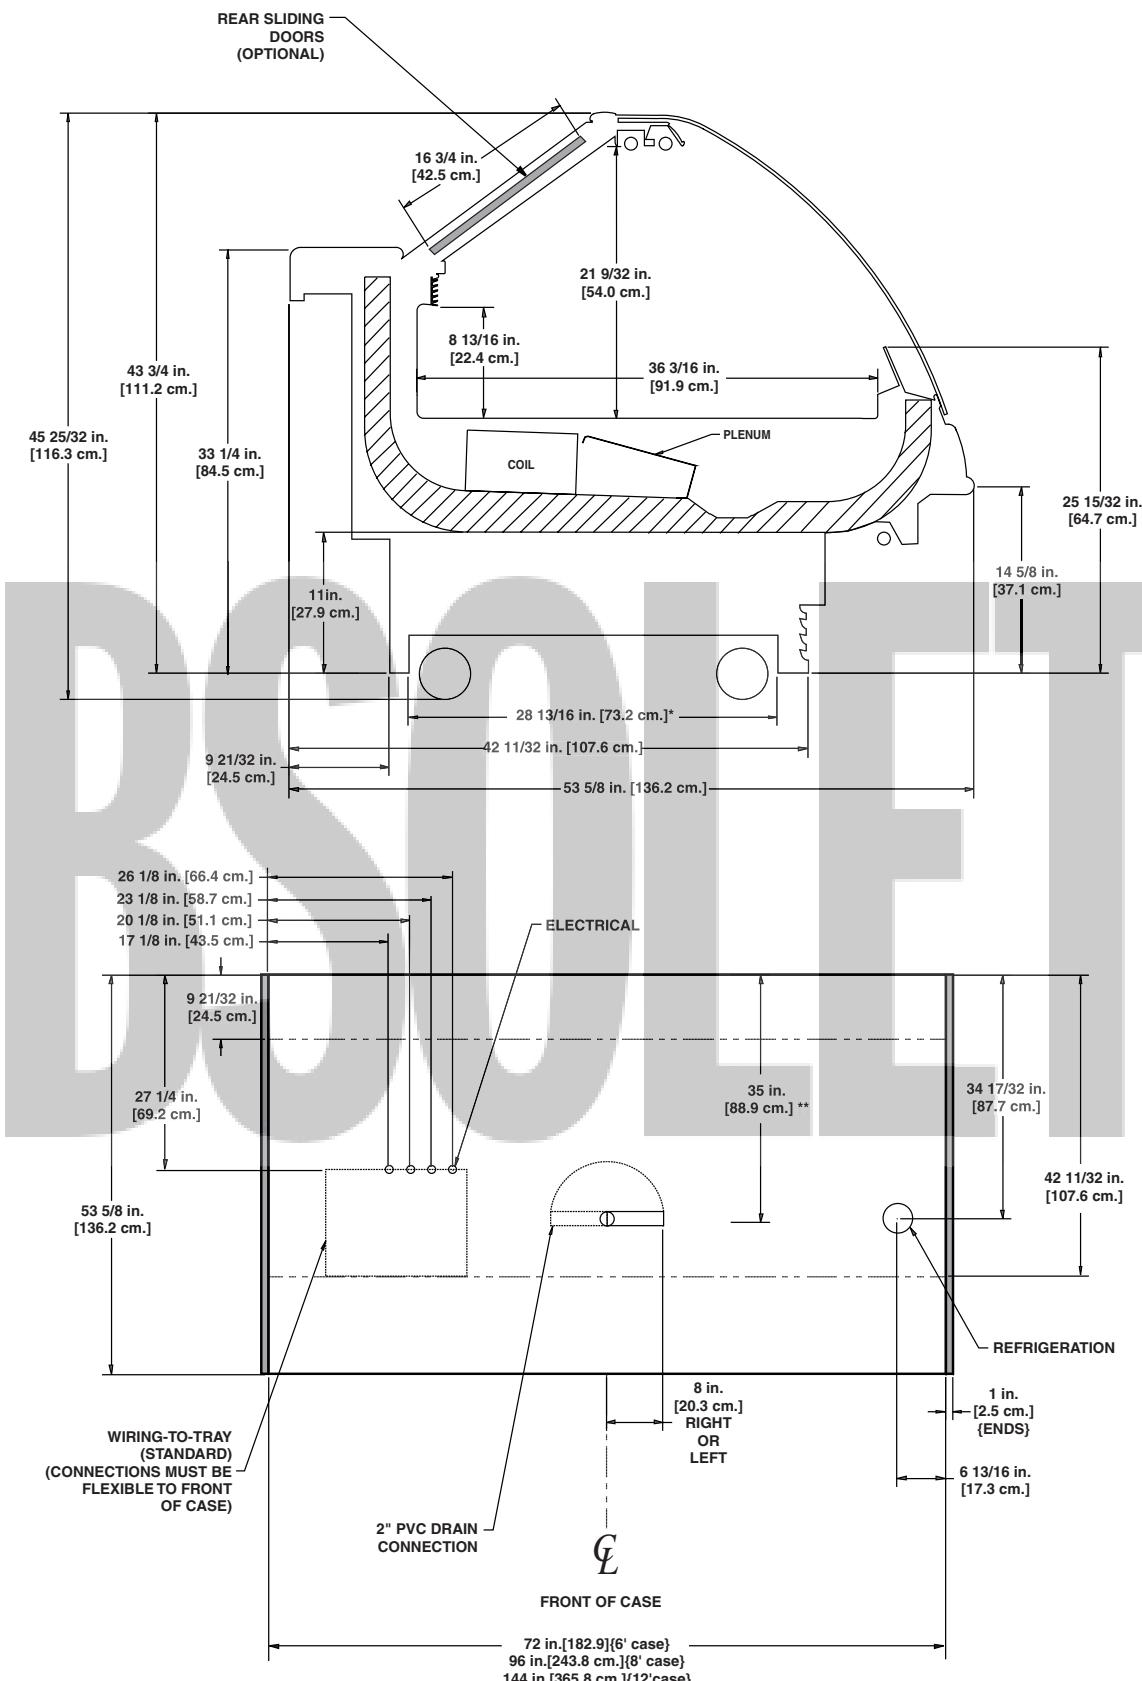

International Style Flat Glass Service Deli/Meat/Seafood Merchandiser

OSIF - 4', 6', 8', & 12'

Electrical Data

Model	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
		120 Volts		120 Volts		120 Volts		208 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OSIF	4'	2	0.90	34	0.30	22	0.55	66	1.92	400	2.22	532
	6'	2	0.90	34	0.30	22	1.03	124	2.88	600	3.33	798
	8'	3	1.35	51	0.45	33	1.22	146	3.85	800	4.44	1065
	12'	4	1.80	68	0.60	44	1.88	226	5.77	1200	6.67	1600

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OSIF	4'	0.57	68	1.14	137
	6'	0.57	68	1.43	172
	8'	0.57	68	1.49	179
	12'	0.77	92	2.31	277

Guidelines & Control Settings

Model	BTUH/ft ¹	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OSIF ³	350	22	6-8	31	36	38	175

¹ BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

² Average discharge air velocity at peak of defrost.

³ Humidification system required on this case when used for Fresh Meat application

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIF	3	6 - 8	30	47	60 ⁴	47 ⁴	26	45

⁴ Not recommended on this model due to long defrost time.

⁵ NOTE: - - - not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COLD

A  DOVER DIVERSIFIED COMPANY

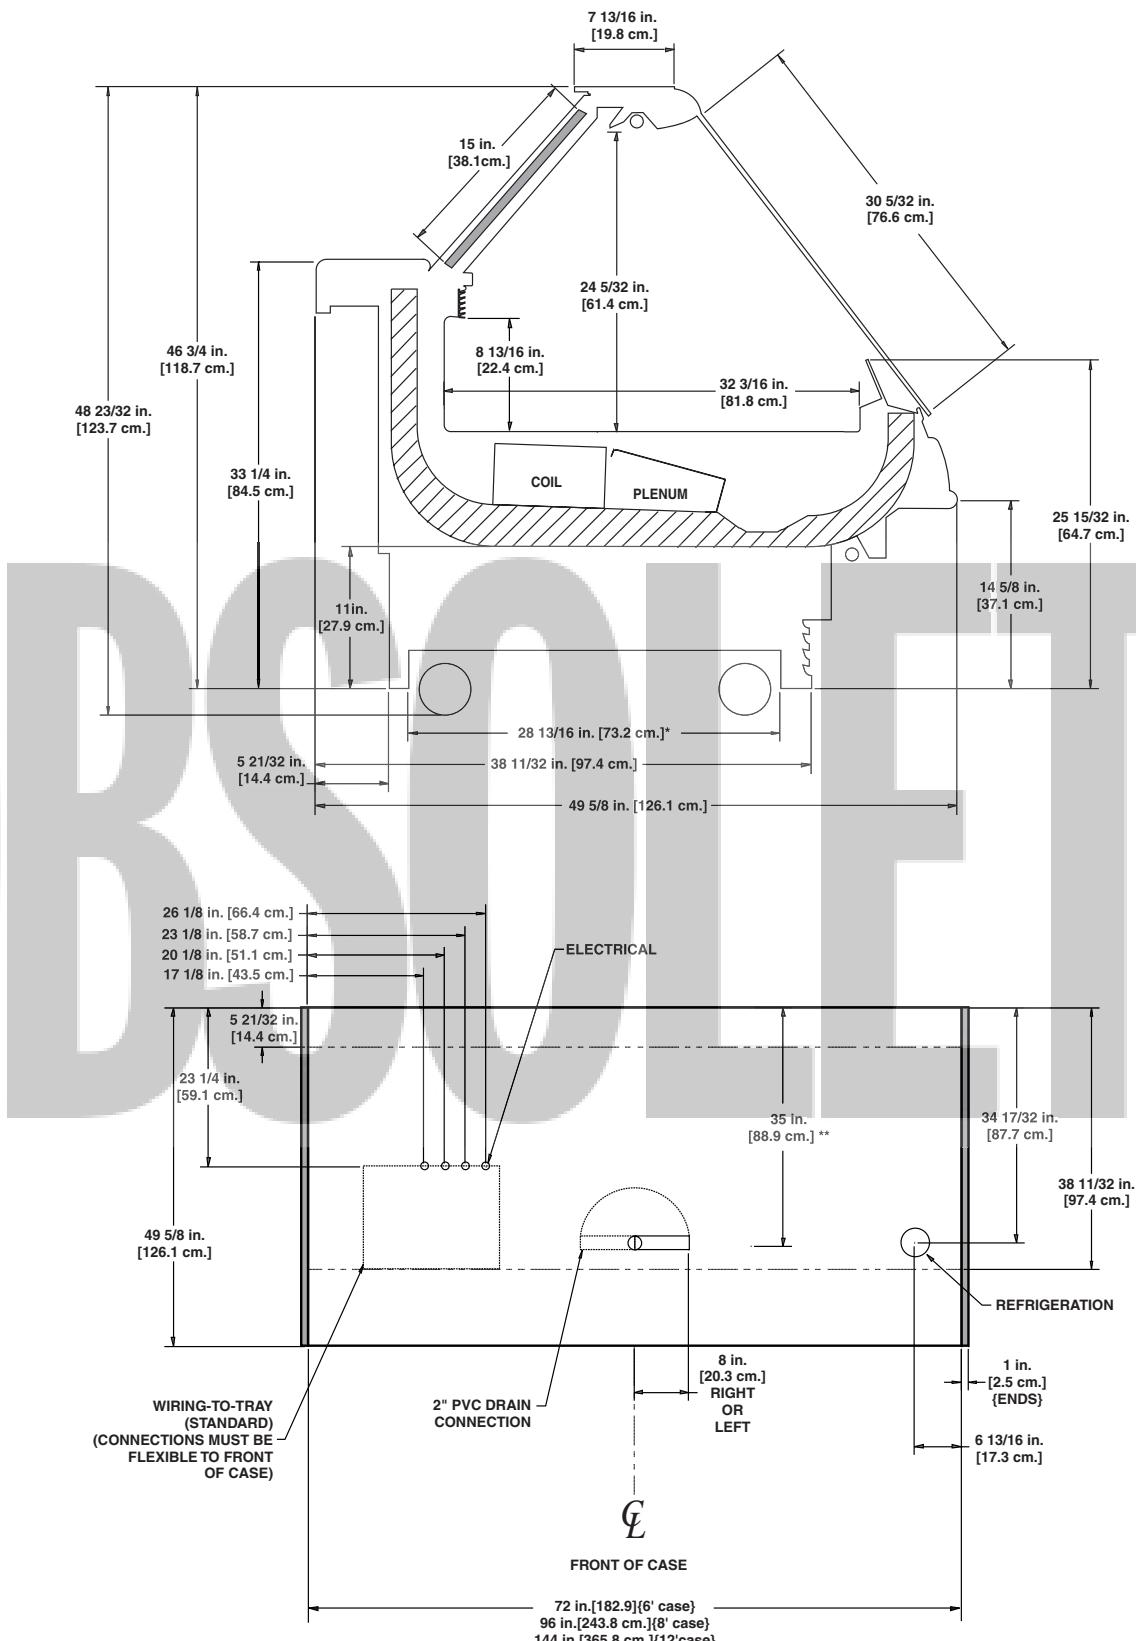


NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

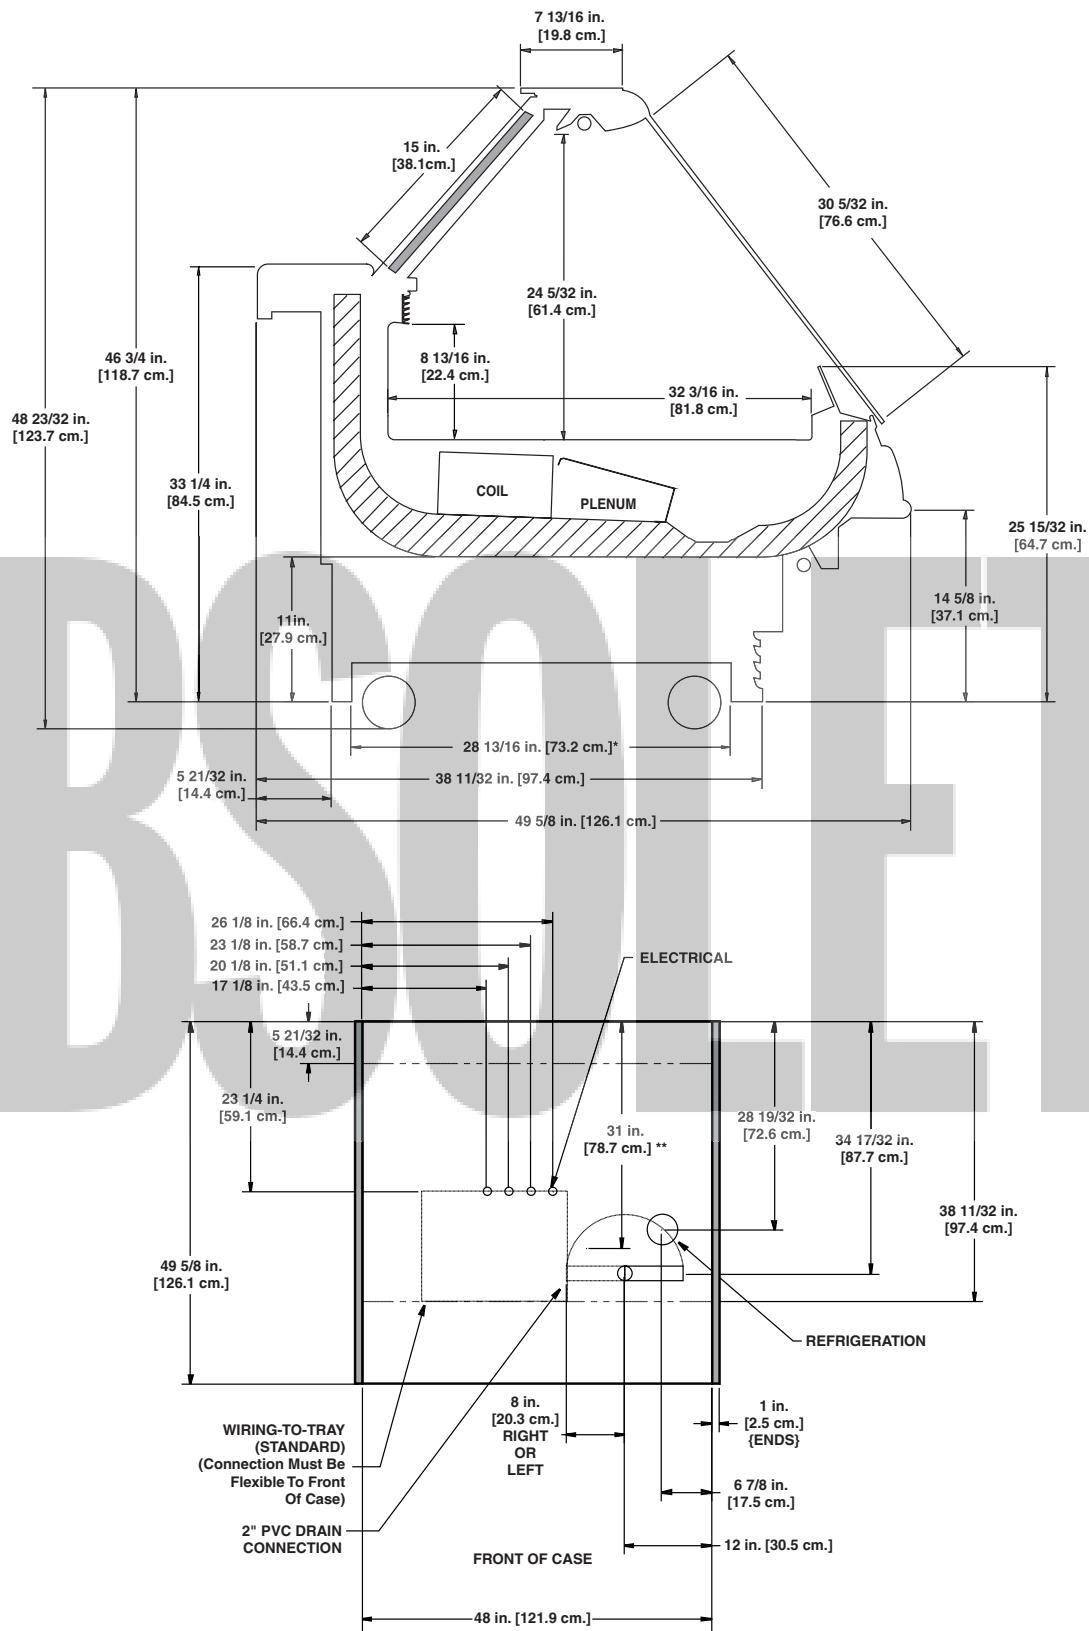

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

SERVICE

Deli/Meat/Seafood

OBSCULTE

Flat Glass Service Deli Merchandiser

OLF - 4', 8', & 12'

Electrical Data

Model	Fans per Case		Ambient Fans ¹		Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
			120 Volts		120 Volts		120 Volts		120 Volts		208 Volts		220 Volts		
	Pri.	Amb.	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OLF	4'	2	2	0.30	11	0.90	34	0.30	22	0.38	47	1.92	400	2.22	532
	8'	3	4	0.60	22	1.35	51	0.45	33	0.97	116	3.85	800	4.44	1065
	12'	4	6	0.90	33	1.80	68	0.60	44	1.49	179	5.77	1200	6.67	1600

¹ Ambient fans are standard equipment for this case model. The primary fans can either be standard or high efficiency.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OLF	4'	0.57	68	1.49	179
	8'	0.57	68	2.41	289
	12'	0.77	92	3.85	462

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OLF	431	17	6-8	27	33	34	363

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

Defrost Controls

Model			Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OLF	2	6 - 8	35	47	50 ⁴	47 ⁴	--- ⁵	---	---	---

⁴ Not recommended on this model due to long defrost time.

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.


HILL PHOENIX
EXCELLENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

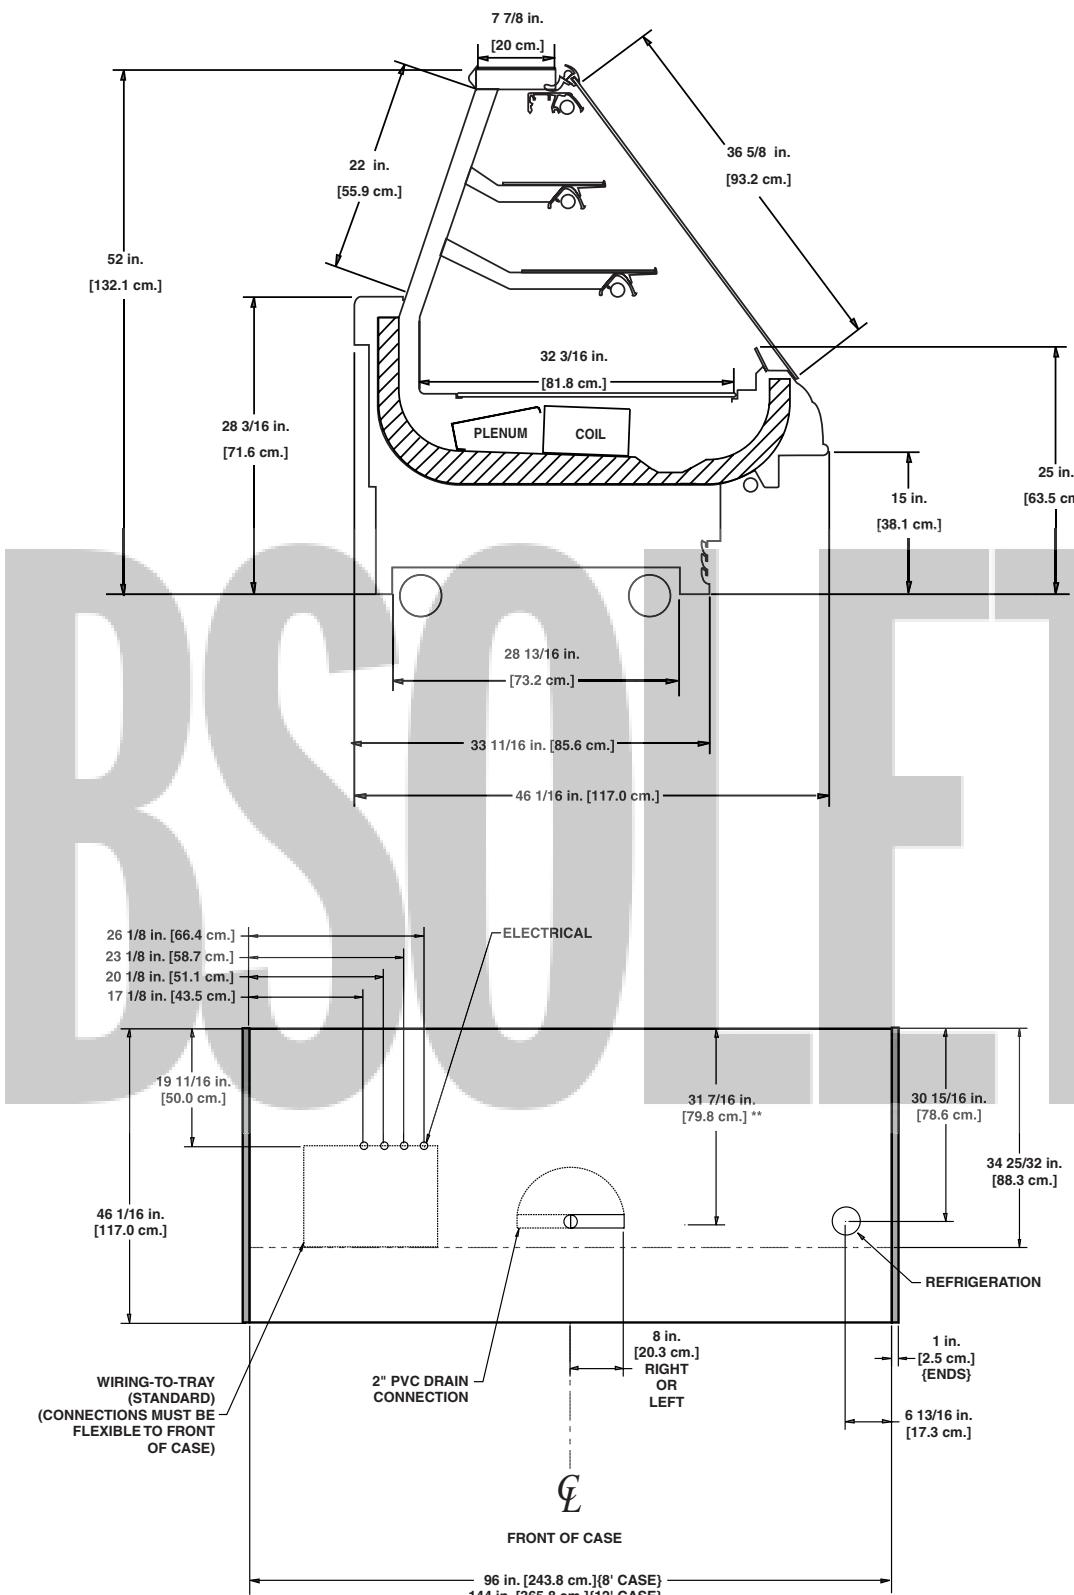

NOTES:

- * STUB-UP AREA
- ** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS
- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- AVAILABLE SHELF SIZES: 10" & 12"

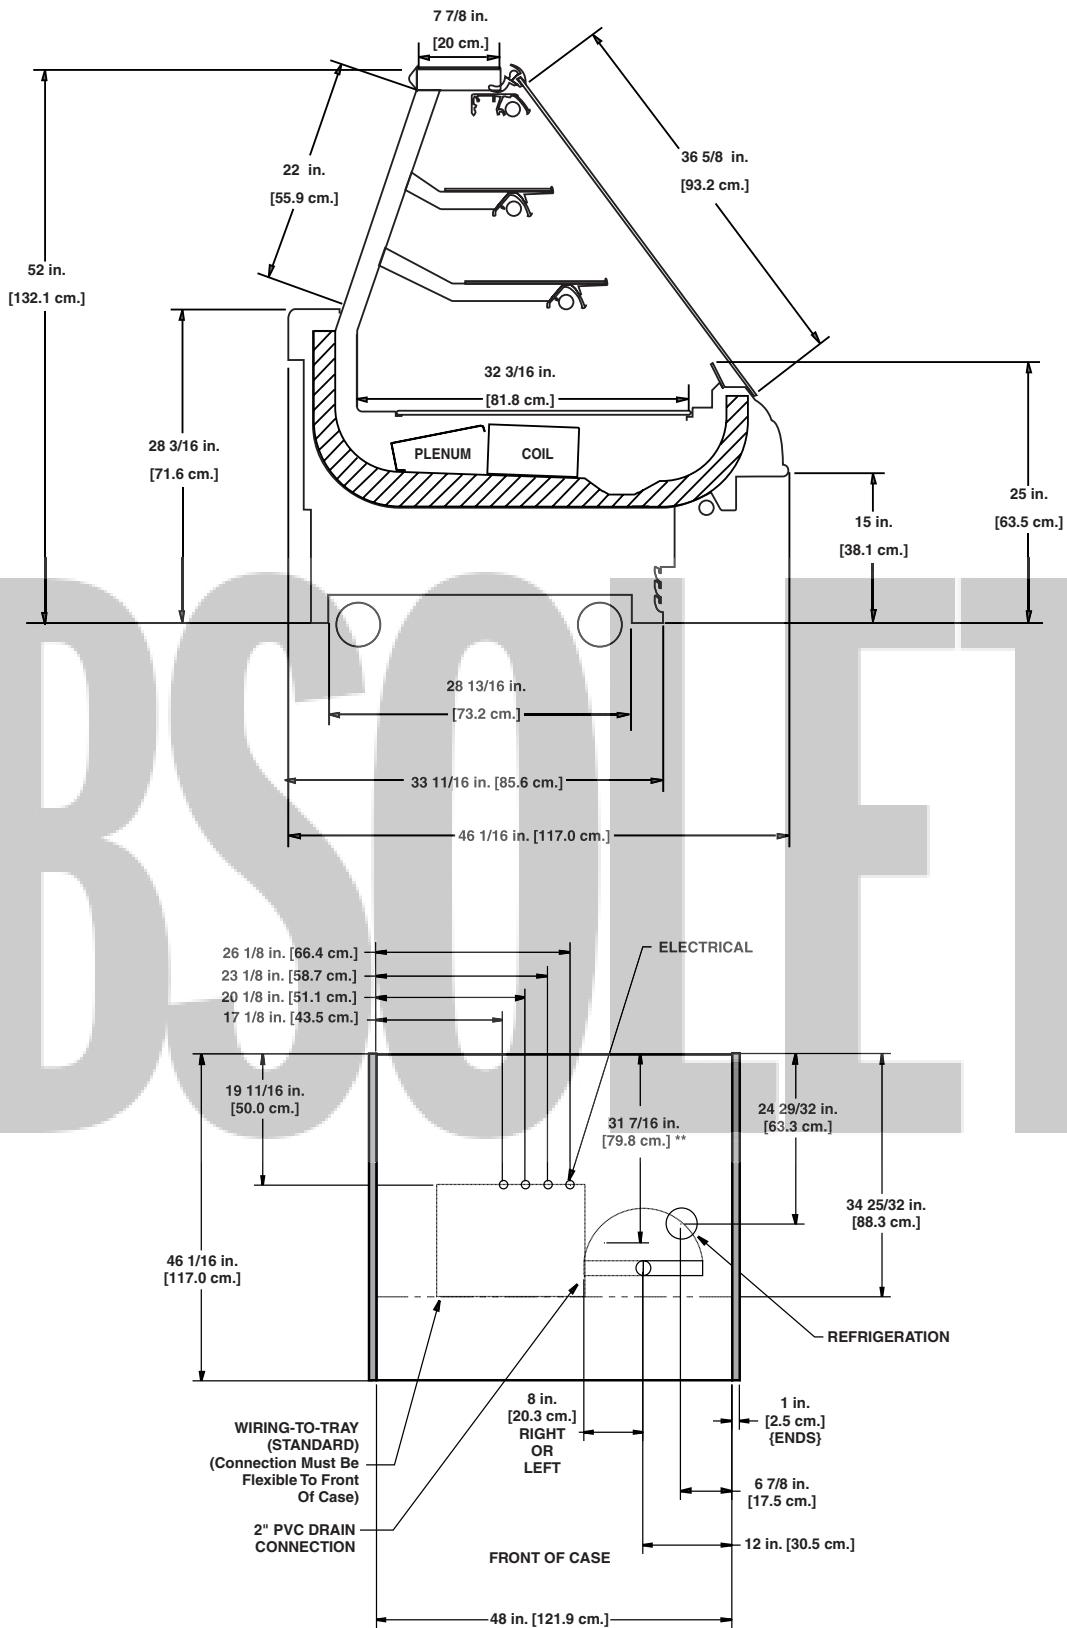

NOTES:

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

• AVAILABLE SHELF SIZES: 10" & 12"

OBSCURATE

SERVICE

Deli

Flat Glass Service Deli Gravity Coil Merchandiser

OLFG - 4', 8', & 12'

Electrical Data

Model	Fans per Case		Ambient Fans ¹		Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Defrost Heaters				
			120 Volts		120 Volts		120 Volts		120 Volts		208 Volts		220 Volts		
	Pri.	Amb.	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OLFG	4'	2	2	0.30	11	0.90	34	0.30	22	3.33	400	1.92	400	2.22	532
	8'	3	4	0.60	22	1.35	51	0.45	33	6.66	800	3.85	800	4.44	1065
	12'	4	6	0.90	33	1.80	68	0.60	44	10.00	1200	5.77	1200	6.67	1600

¹ Ambient fans are standard equipment for this case model. The primary fans can either be standard or high efficiency.

Lighting Data

Model	Typical per Light Row		Maximum Lighting		
	120 Volts		120 Volts		
	Amps	Watts	Amps	Watts	
OLFG	4'	0.57	68	2.06	247
	8'	0.57	68	2.98	358
	12'	0.77	92	4.62	554

Guidelines & Control Settings

Model	BTUH/ft ²	Evaporator (°F)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ³ (FPM)
OLFG ⁴	275	12	6-8	31	35	38	125

² BTUH's/ft listed are for parallel operation. Conventional ratings may be approximated by multiplying listed rating by 1.04.

³ Average discharge air velocity at peak of defrost.

⁴ If the OLFG is piped to a suction header lower than 10°F an EPR with a suction stop solenoid is required. A liquid line solenoid alone does not allow the case to cycle properly. The thermostat probe should be located on the inlet of the top coil. The cut out point should be set to 12°F and the cut in point should be set so that refrigeration starts as soon as the top coil ice starts to drip.

Defrost Controls

Model	Electric Defrost				Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Run-Off Time (min)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OLFG	2	6 - 8	35	47	65	47	---	5	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE IN COOLING

A  DOVER DIVERSIFIED COMPANY

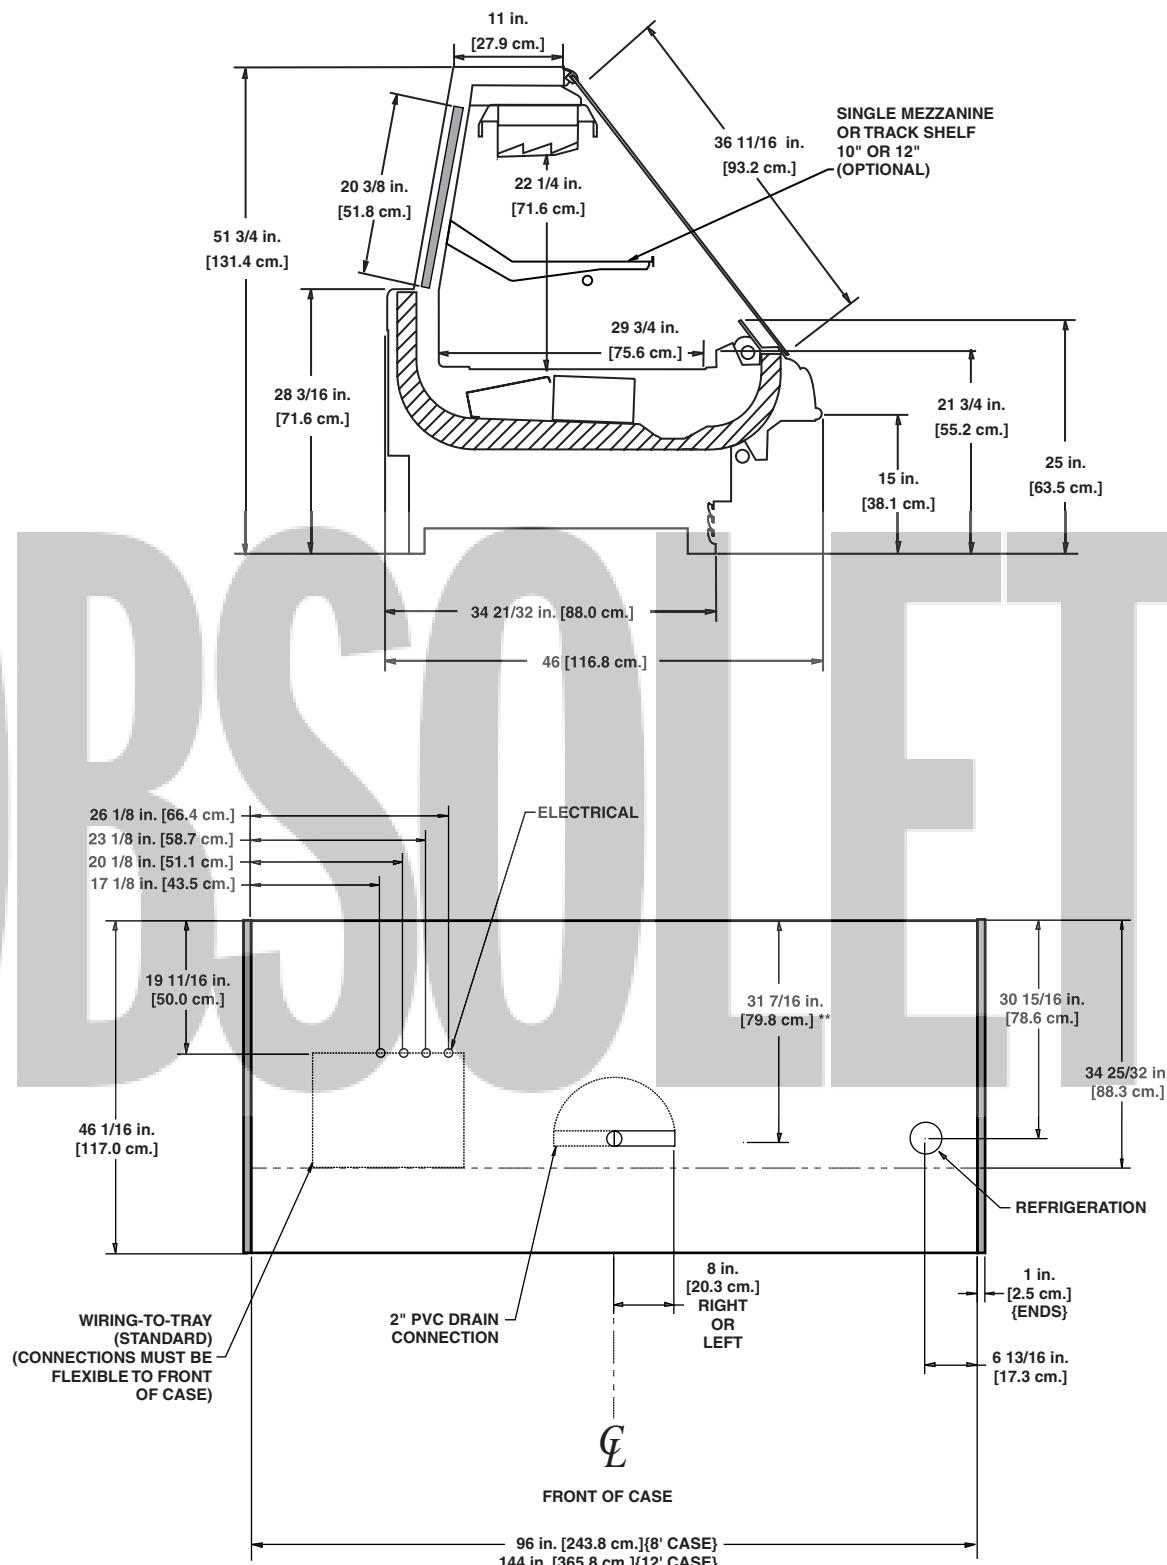

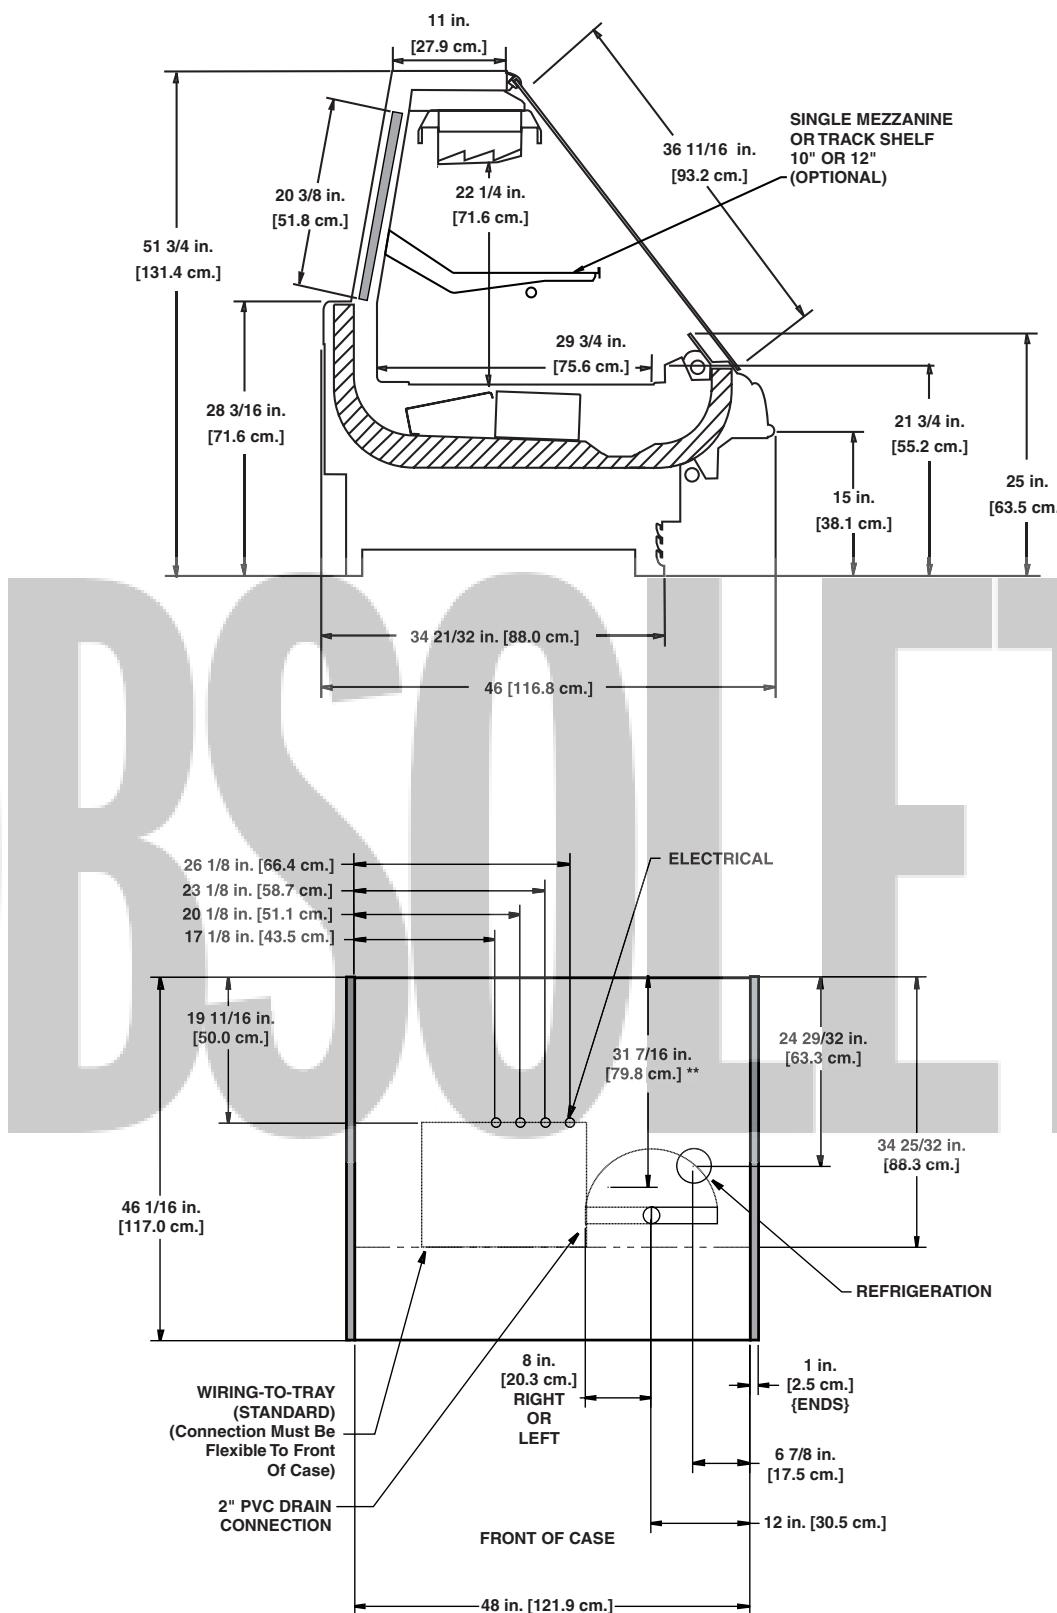**NOTES:**

* STUB-UP AREA

** RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

- AVAILABLE SHELF SIZES: 10" & 12" (SINGLE ROW OF SHELVES PER CASE)

OBSCURATE

SERVICE

Deli

American Style Curved Glass Service Hot Foods Merchandiser

OSAH - 4', 6', 8', & 12'

Electrical Data (Domestic)

Model	Number of Hot Wells	Single Phase						Three Phase						
		208 Volts			220 Volts			208 Volts			220 Volts			
		Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker	
OSAH	4'	3	16	3300	20	17.1	3800	25	10.0	3300	15	10.7	3800	15
	6'	5	25.3	5600	35	28.6	6300	40	15.8	5600	20	17.6	6300	25
	8'	7	36.9	7700	50	41.6	8700	55	23.7	7700	30	26.7	8700	35
	12'	10	50.6	11200	70	57.2	12600	80	31.6	11200	40	35.2	12600	50

Electrical Data (European)


Model	Number of Hot Wells	Single Phase			Three Phase		
		220 Volts			220/380 Volts		
		Amps	Watts	Breaker	Amps	Watts	Breaker
OSAH	4'	3	17.1	3800	25	---	---
	6'	5	---	---	10.2	6300	15
	8'	7	---	---	15.3	8700	20
	12'	10	---	---	20.4	12600	30

Hill Phoenix
EXCELLLENCE™

A  DOVER DIVERSIFIED COMPANY

OSAH
(11" BASEFRAME)

HILL PHOENIX
EXCELENCE™

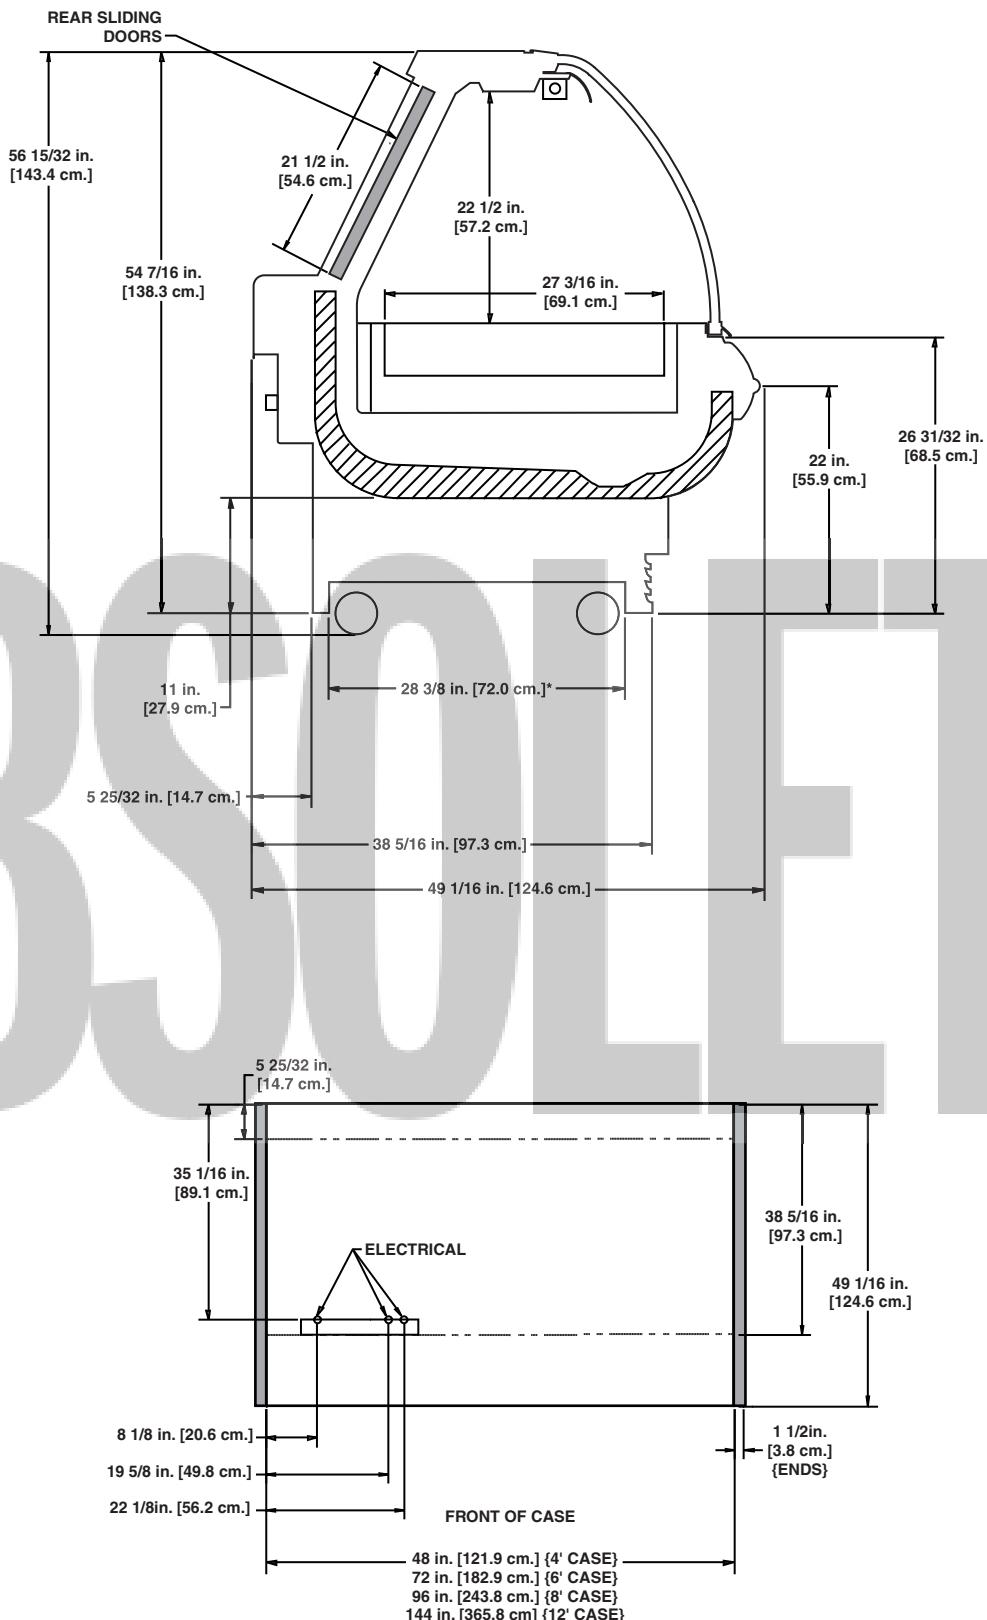


SERVICE

Hot Foods

OSAH
(5 5/32" BASEFRAME)

HILL PHOENIX™
EXCELENE™

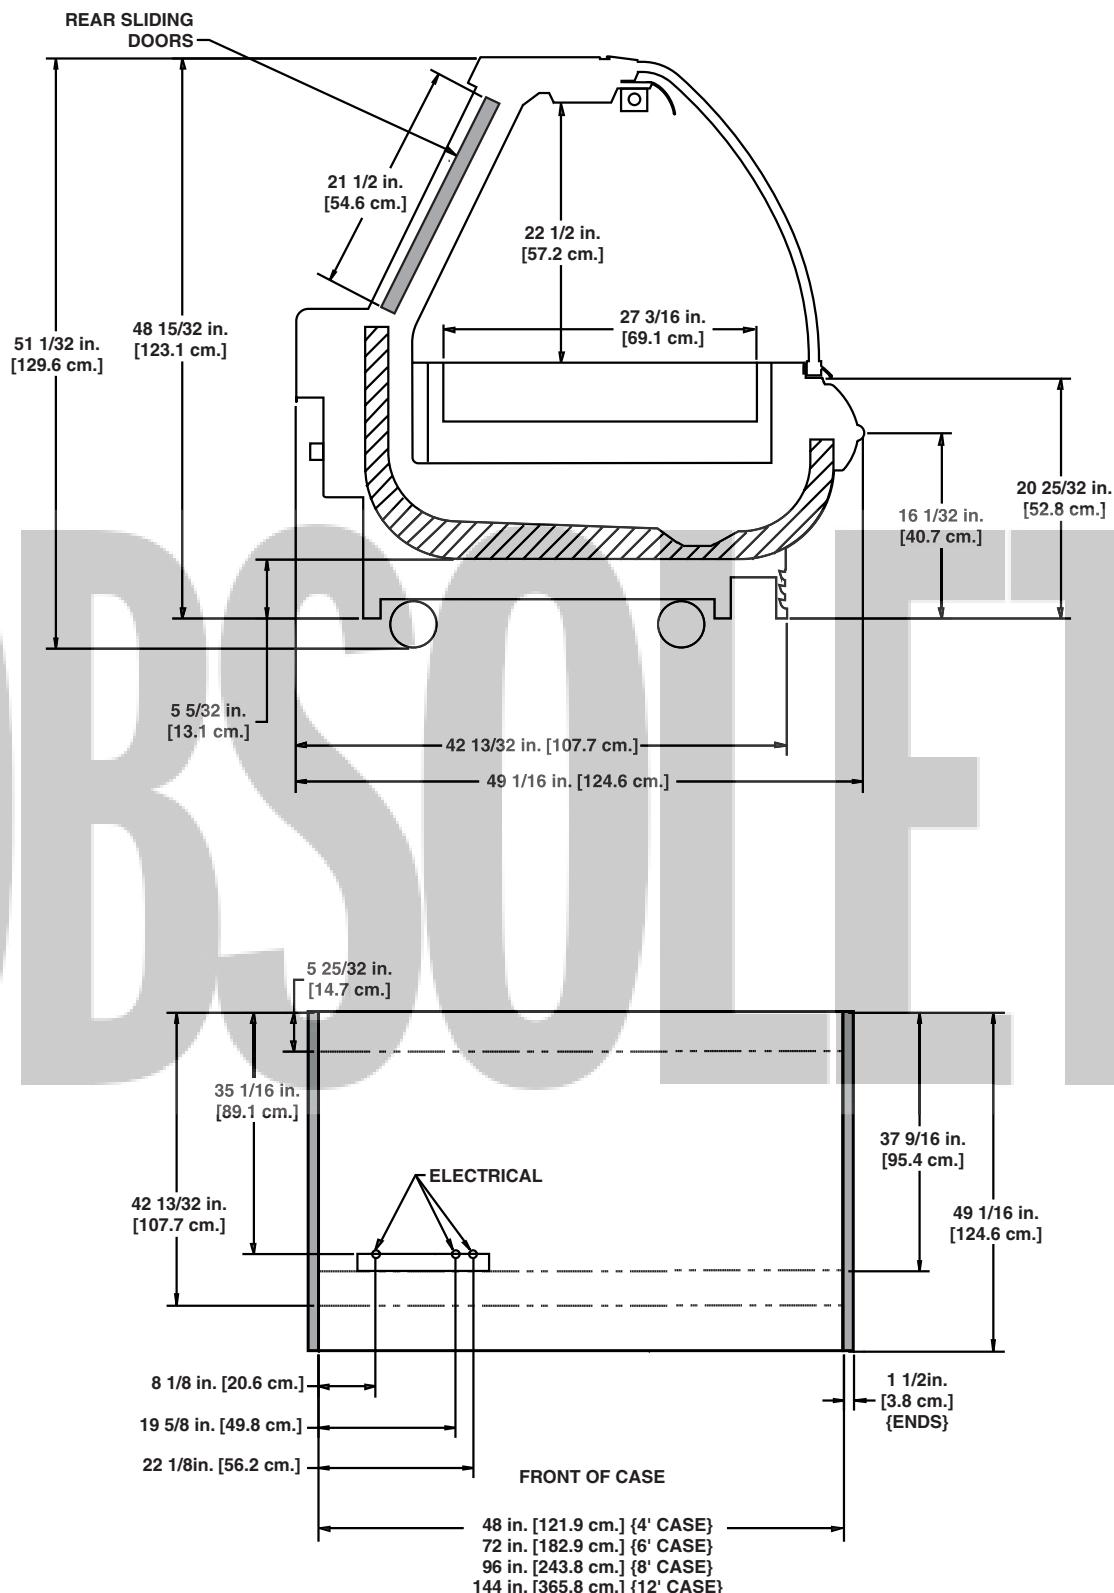

OBSCULTE

SERVICE

Hot Foods

International Style Service Hot Foods Merchandiser

OSIH - 4', 6', & 8'

Electrical Data (Domestic)


Model	Number of Hot Wells	Single Phase						Three Phase						
		208 Volts			220 Volts			208 Volts			220 Volts			
		Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker	Amps	Watts	Breaker	
OSIH	4'	3	16	3300	20	17.1	3800	25	10.0	3300	15	10.7	3800	15
	6'	5	25.3	5600	35	28.6	6300	40	15.8	5600	20	17.6	6300	25
	8'	7	36.9	7700	50	41.6	8700	55	23.7	7700	30	26.7	8700	35

Electrical Data (European)

Model	Number of Hot Wells	Single Phase			Three Phase		
		220 Volts			380 Volts		
		Amps	Watts	Breaker	Amps	Watts	Breaker
OSIH	4'	3	17.1	3800	25	---	---
	6'	5	---	---	10.2	6300	15
	8'	7	---	---	15.3	8700	20

Hill Phoenix
E X C E L L E N C E™

A  DOVER DIVERSIFIED COMPANY

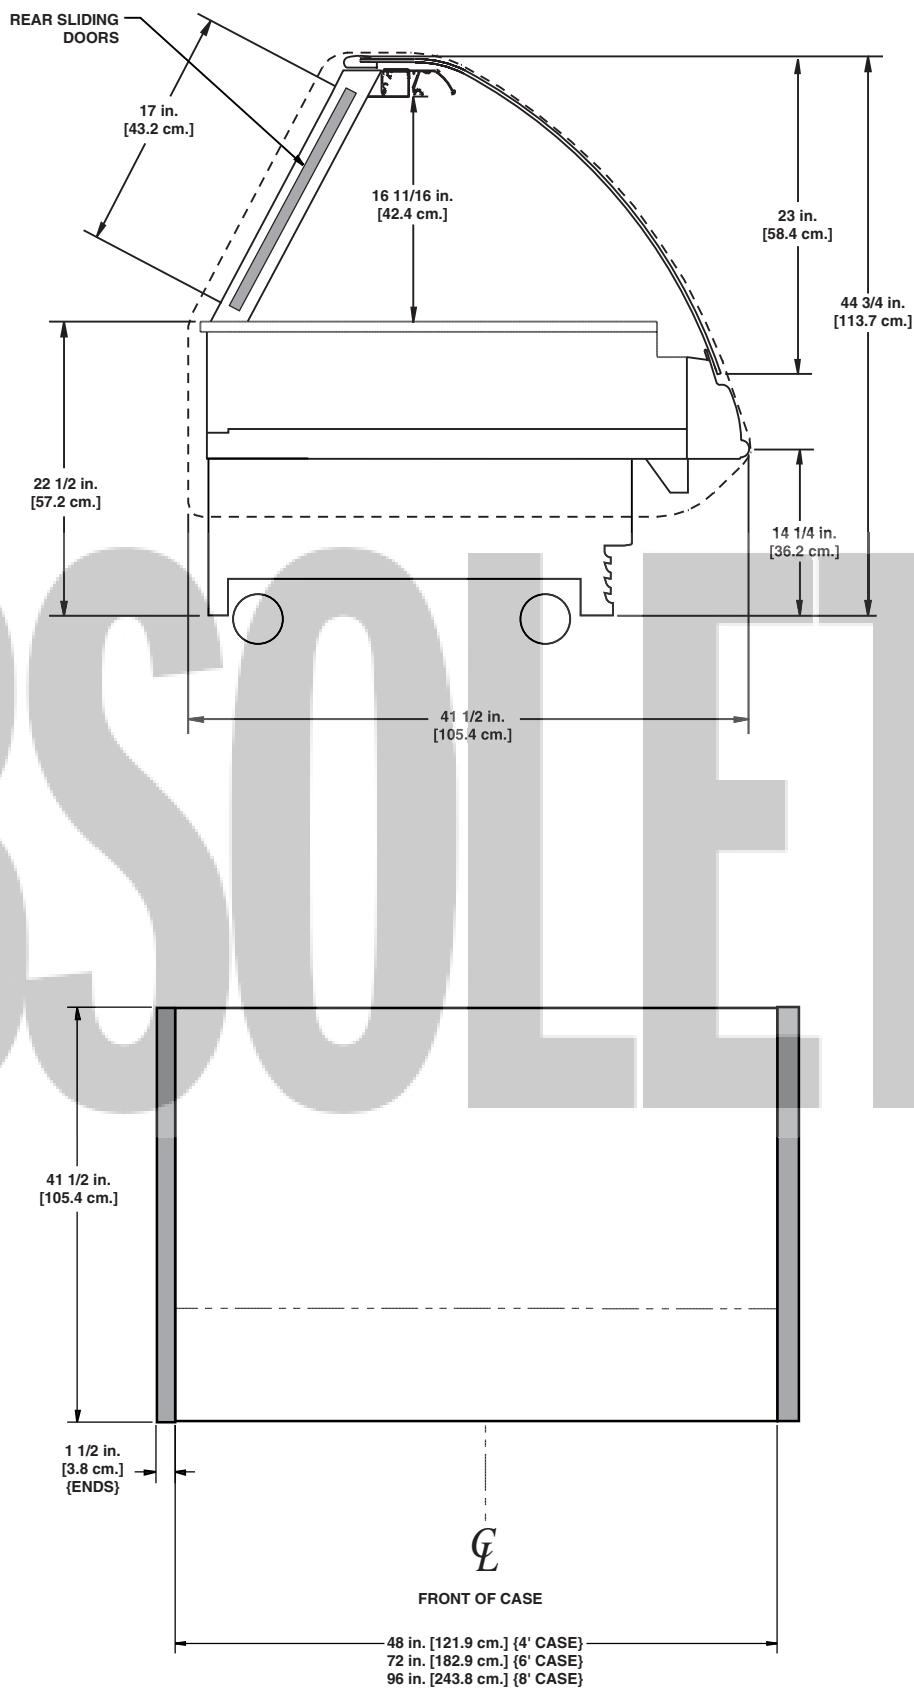

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

A DOVER DIVERSIFIED COMPANY

OBSOLETE



Notes:

- Average product temperatures are calculated as defined by ASHRAE* standards and should not be used to determine application.
- Cases meet FDA** Food Code 1997 product temperature requirements (41°F or less) for hazardous foods when used for their prescribed applications.
- Allow for an extra 1/8" per joint when lining up merchandisers.
- Front sill height does not affect case performance unless specifically shown.

* American Society of Heating Refrigeration and Air Conditioning Engineers

** Food and Drug Administration

Single Deck Self-Contained Mobile Deli Merchandiser

MDCA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
MDCA-4'	120	1	60	NEMA L5-20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
MDCA-4'	26"-31"	16.6	52	6-8	25	35	36	

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
MDCA-4'	115	1	60	1/3	7.4	29.8	R404A	3.5	45	500	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
MDCA-4'	4	35	47	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE

A  DOVER DIVERSIFIED COMPANY

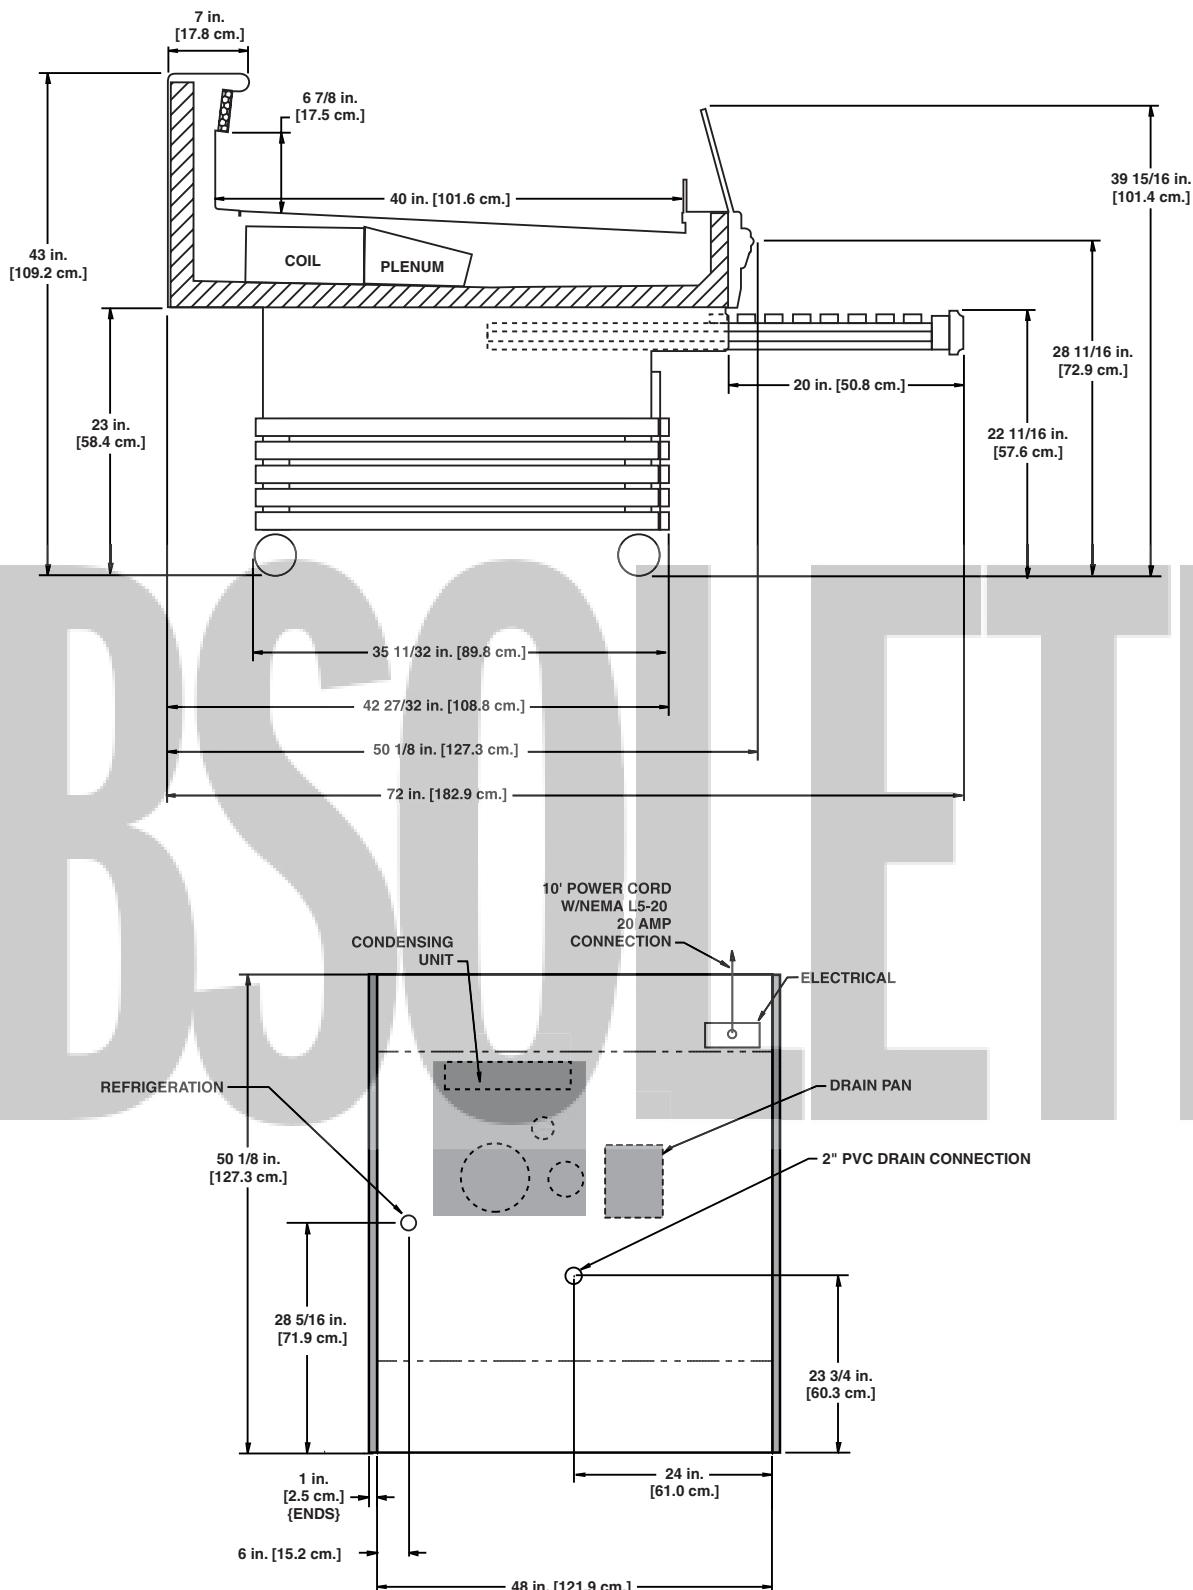

SELF-CONTAINED
Deli

Single Deck Self-Contained Mobile Deli/Meat Merchandiser

MMCA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
MMCA-4'	120	1	60	NEMA L5-20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
MMCA-4'	35"	17.2	49	6-8	24	32	35	180

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
MMCA-4'	115	1	60	1/3	7.4	29.8	R404A	3.5	45	500	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
MMCA-4'	3	35	47	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.



A DOVER DIVERSIFIED COMPANY

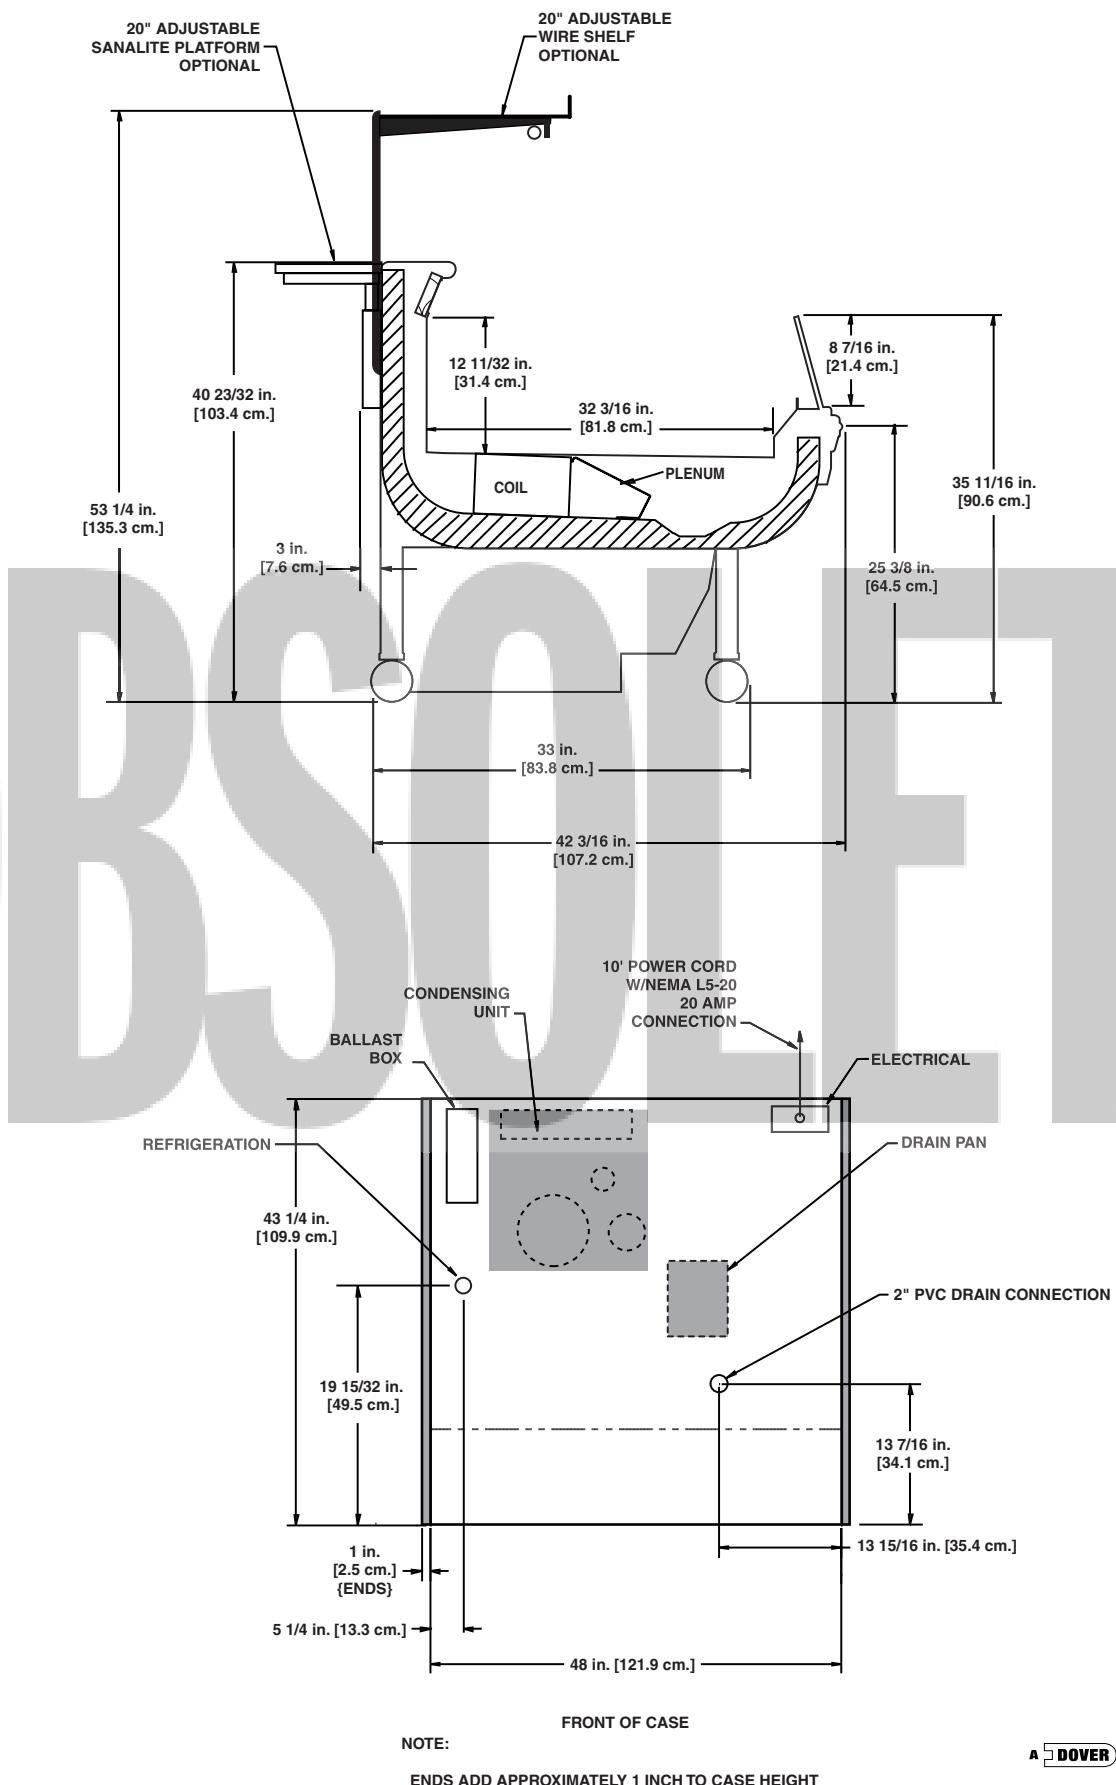

SELF-CONTAINED

Deli/Meat

Single Deck Produce Self-Contained Merchandiser

OPA - 6', 8', & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OPA	6'	120	1	60	2 wire + ground	12.5
	8'	120	1	60	2 wire + ground	17.6
	12'	120	1	60	2 wire + ground	21.2

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Anti-Condensate Heaters		Defrost Heaters		Drain Heater	
		120 Volts		208 Volts		120 Volts		120 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OPA	6'	2	1.00	60	0.36	33	0.20	24	5.00	600	4.17
	8'	2	1.00	60	0.58	44	0.25	30	6.67	800	4.17
	12'	3	1.50	90	1.40	101	0.38	46	10.00	1200	4.17

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OPA-6'		19.9	6-8	30	36	45	210
OPA-8'		19.9	6-8	30	36	45	210
OPA-12'		19.9	6-8	30	30	45	210

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OPA-6'	120	1	60	1/4	5.4	34	R134A		0	440	162
OPA-8'	120	1	60	1/2	9.3	36	R134A		0	440	162
OPA-12'	120	1	60	1/2	11	51	R134A		0	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
OPA	2	40	47	60	47	--- ⁴	---	---

⁴ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE

A DOVER DIVERSIFIED COMPANY

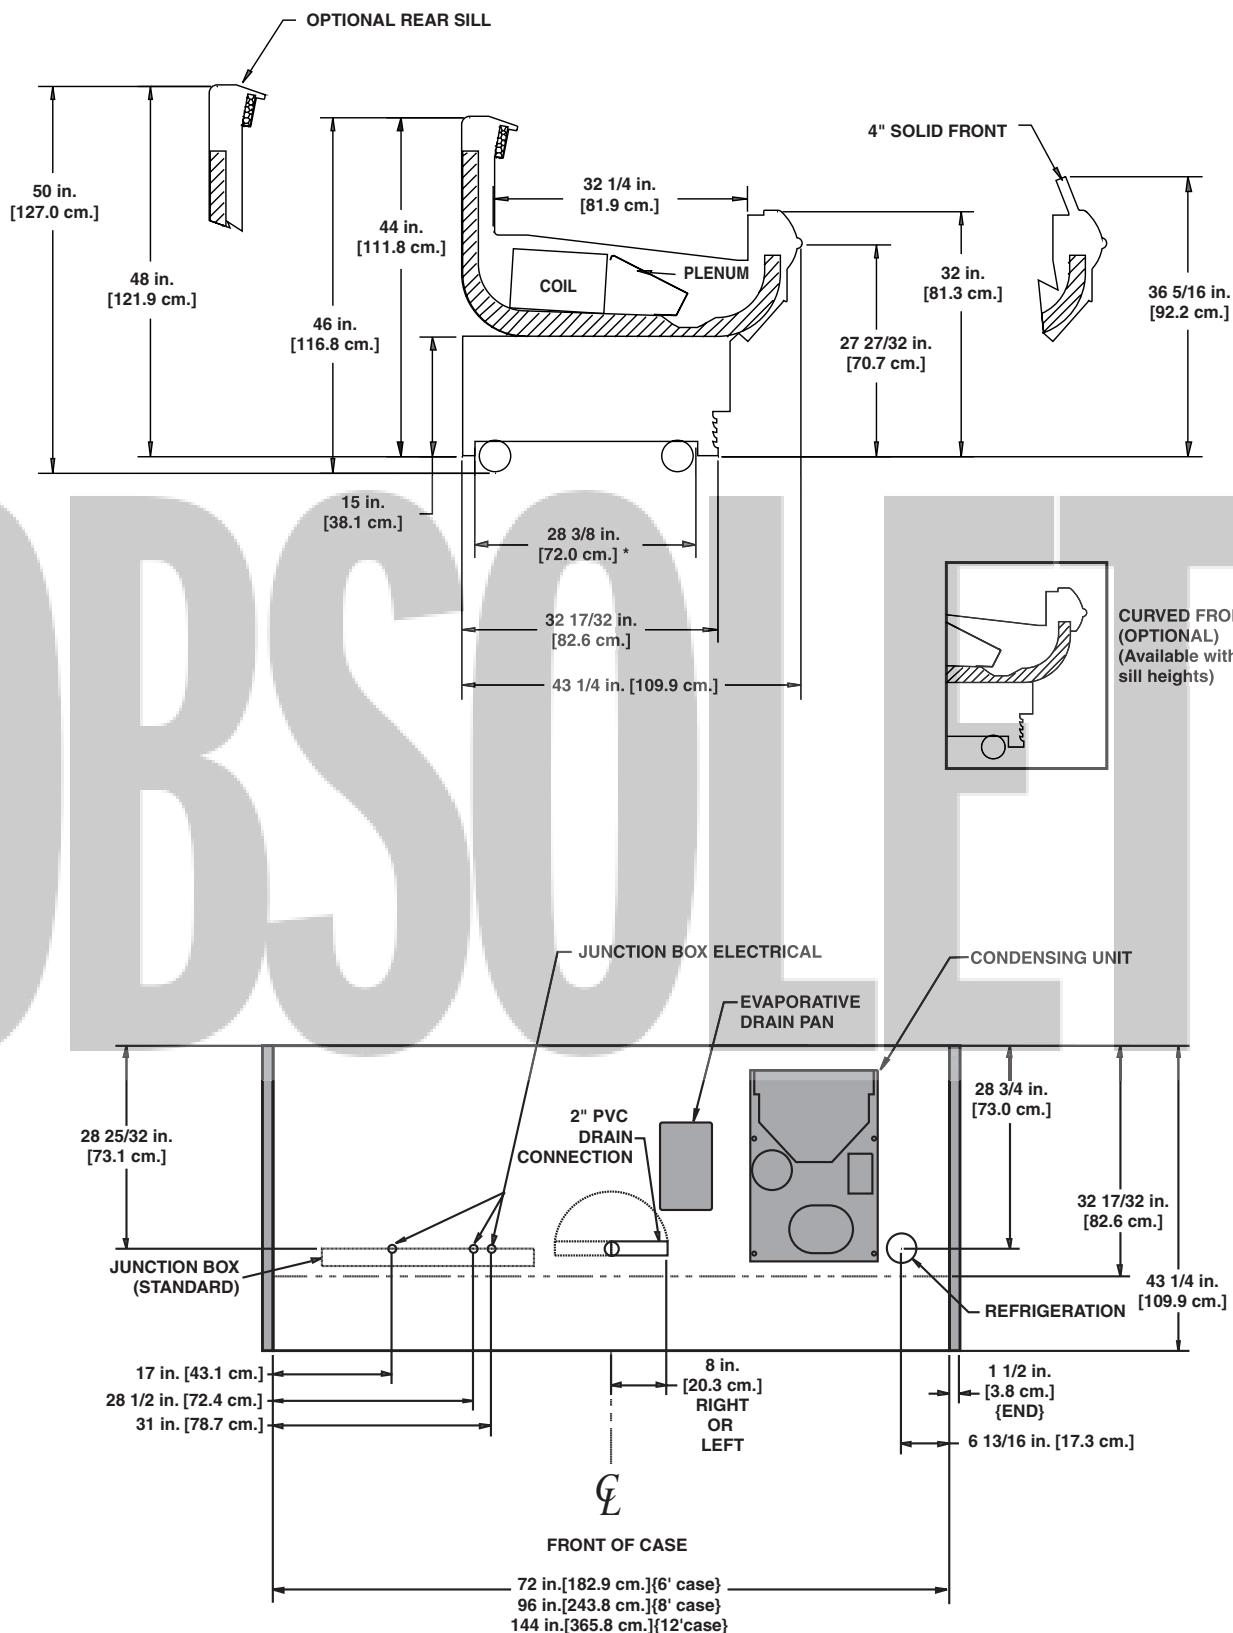**SELF-CONTAINED**

Product

International Style Self-Contained Mobile Deli/Meat/Seafood Merchandiser

OSIOA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIOA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OSIOA-4'	14.1	12-14	6-8	26	33	34	182

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIOA-4'	115	1	60	1/2	10.4	48.0	R134A	3.25	45	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIOA-4'	4	40	47	---	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.



A DOVER DIVERSIFIED COMPANY

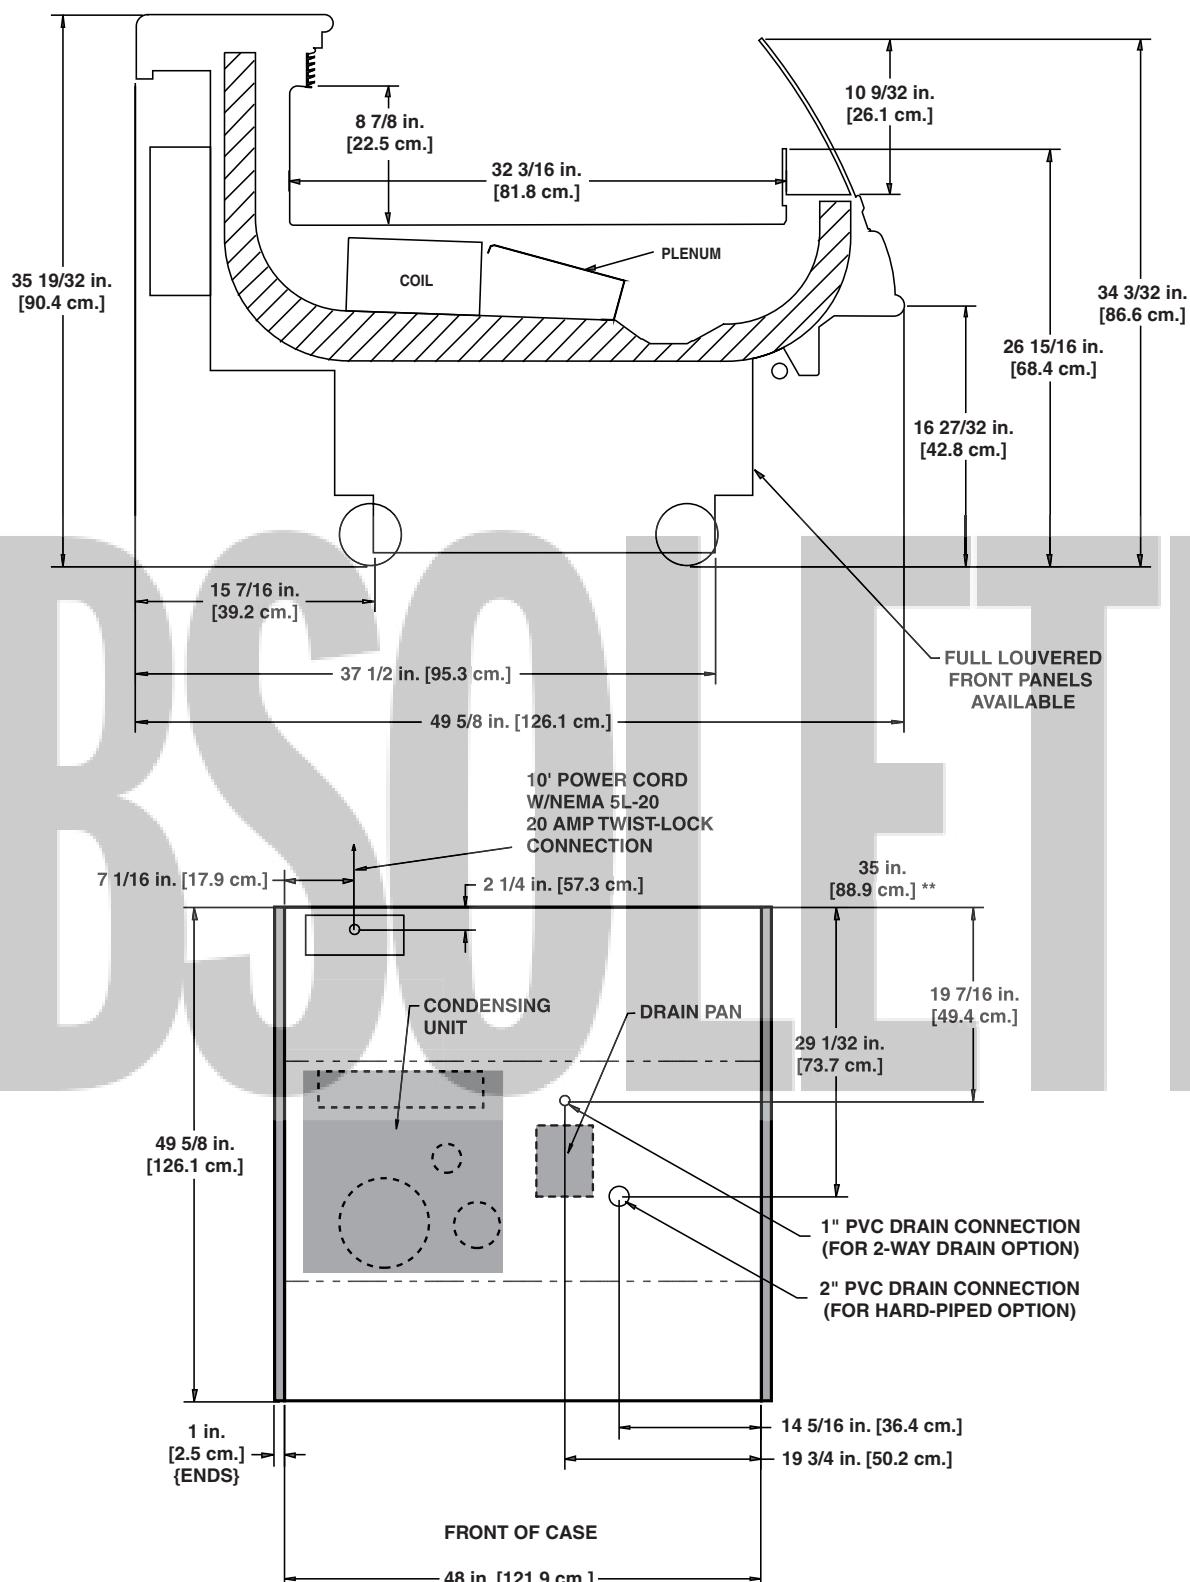

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

A DOVER DIVERSIFIED COMPANY

SELF-CONTAINED

Deli/Meat/Seafood

International Style Self-Contained Mobile Deli/Meat/Seafood Prep

Merchandiser

OSIOPA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIOPA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OSIOPA-4' deli	13.6	20	6-8	34	38	36	200
OSIOPA-4' meat	18.0	16	6-8	32	34	36	200

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIOPA-4'	120	1	60	1/3	7.2	29.0	134A	2.25	45	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIOPA-4'	2	40	47	---	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm



All measurements are taken per CRMA specifications.

A DOVER DIVERSIFIED COMPANY

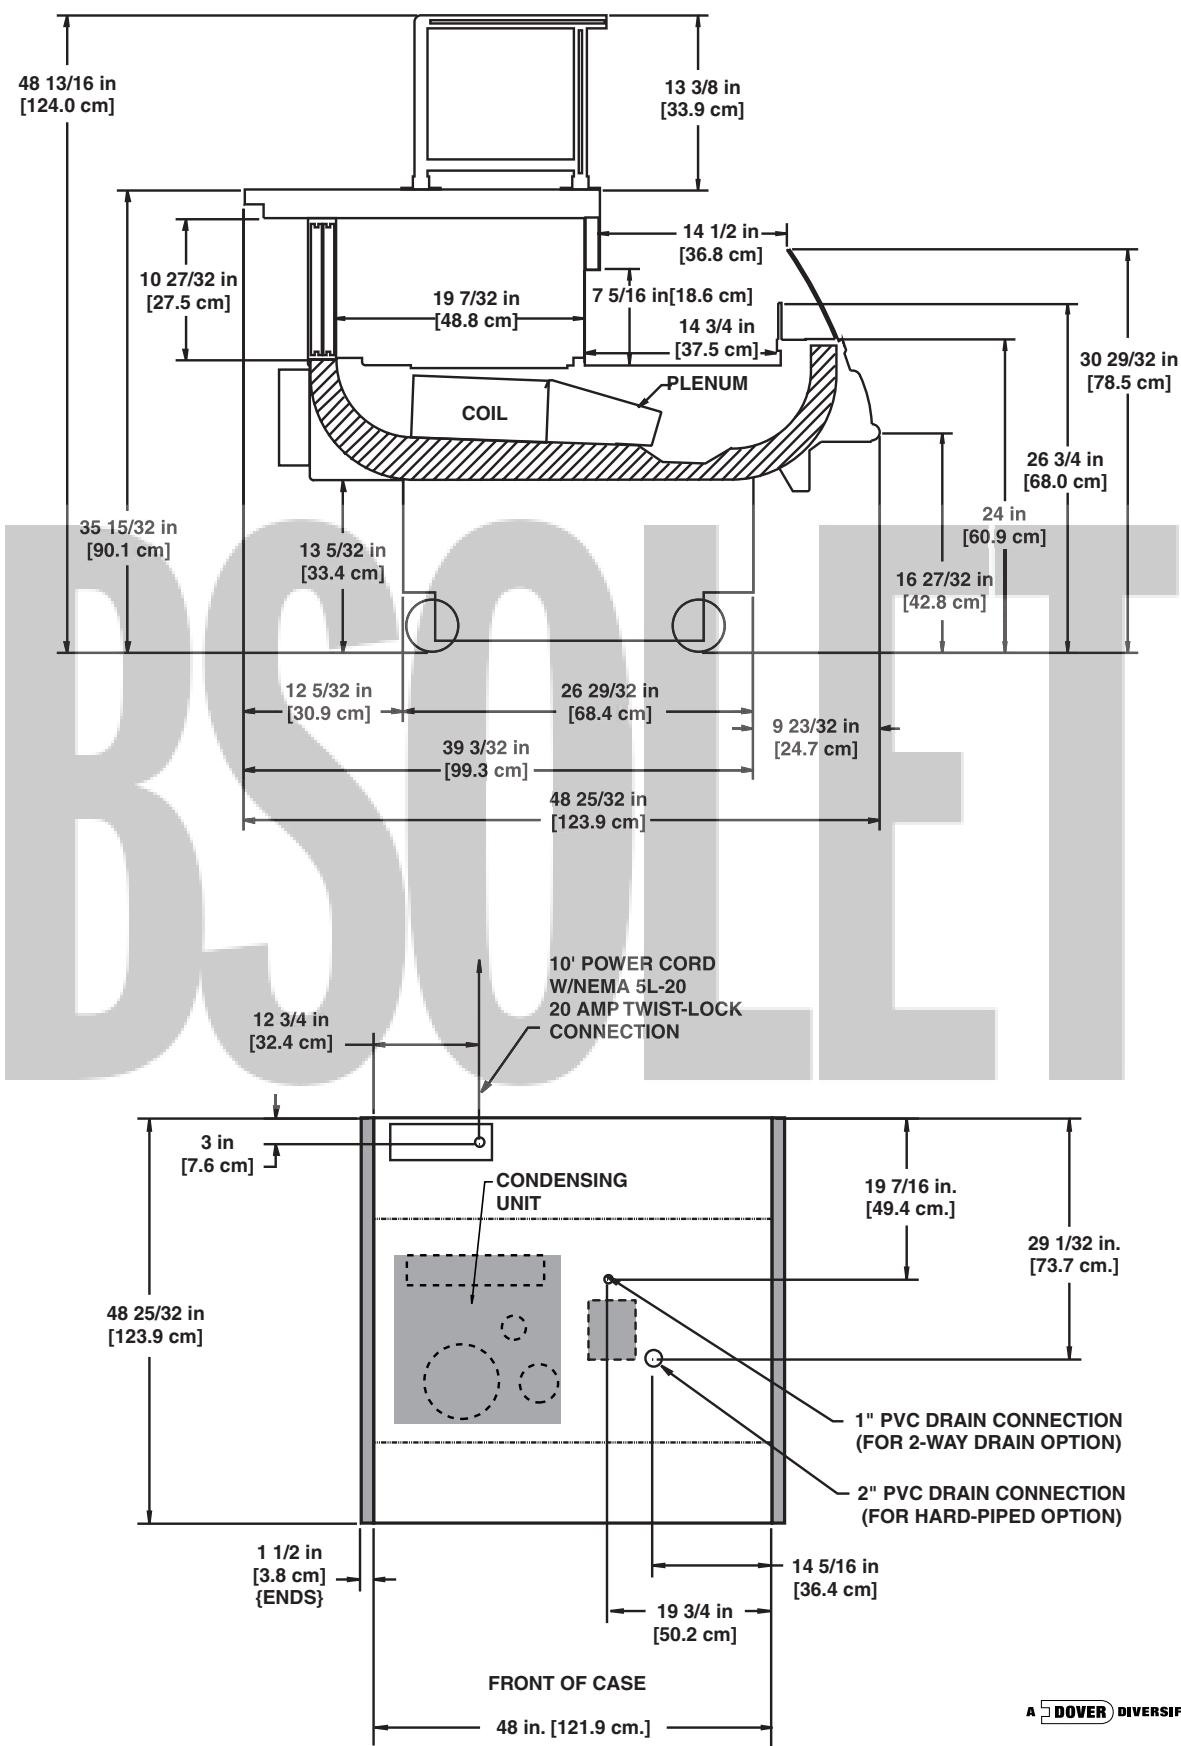

International Style Self-Contained Mobile Dual Temp. Merchandiser

OSIOZA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIOZA-4'	120	1	60	NEMA 5L30	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OSIOZA-4'	25.0	12-14	3-4	-24	-6	-10	220

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIOZA-4'	115	1	60	3/4	10.9	85.5	R404A	3.75	0	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIOZA-4'	2	47	45	---	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.

Low Temperature Defrost Schedule


No. Per Day	Hours
1	10 pm
2	6 am - 10 pm**

** Or immediately after store closing hour



All measurements are taken per CRMA specifications.

A DOVER DIVERSIFIED COMPANY

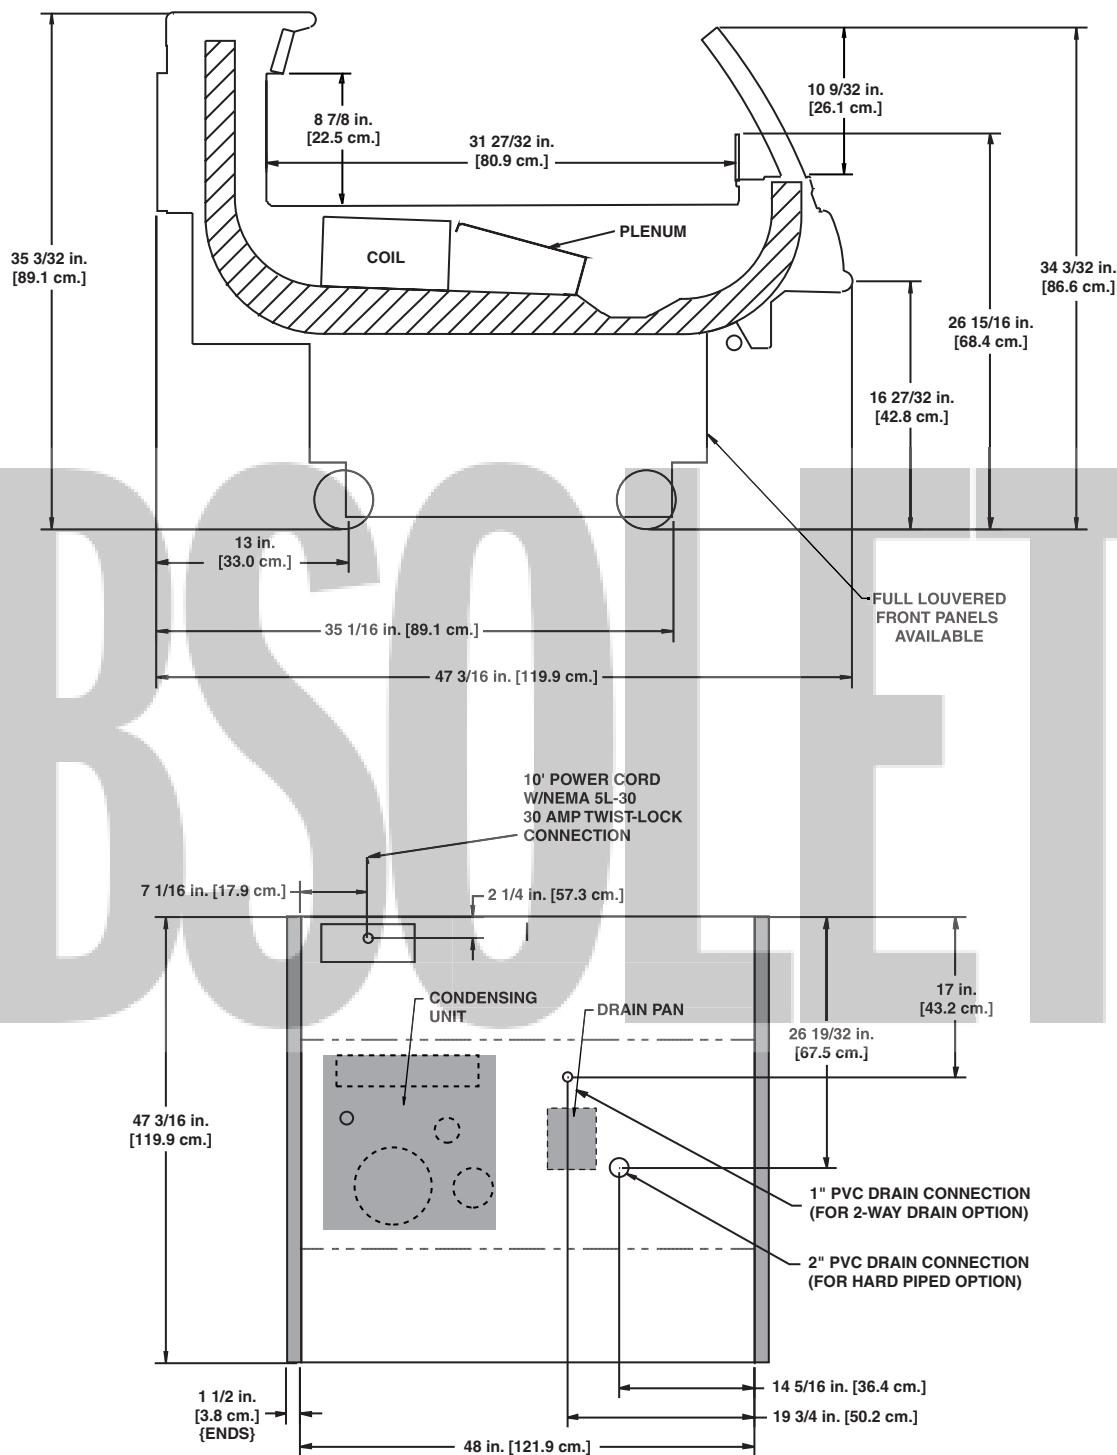

FRONT OF CASE

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

Single Deck Self-Contained Mobile Boxed Produce Merchandiser

UPA-8'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
UPA-8'	120	1	60	NEMA L5-30	6'

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
UPA-8'	38"	37	20	6-8	32	38	42	275

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
UPA-8'	115	1	60	1/2	12.9	66.3	R134A	4.0	25	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
UPA-8'	3	---	---	45	45	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE™

A  DOVER DIVERSIFIED COMPANY

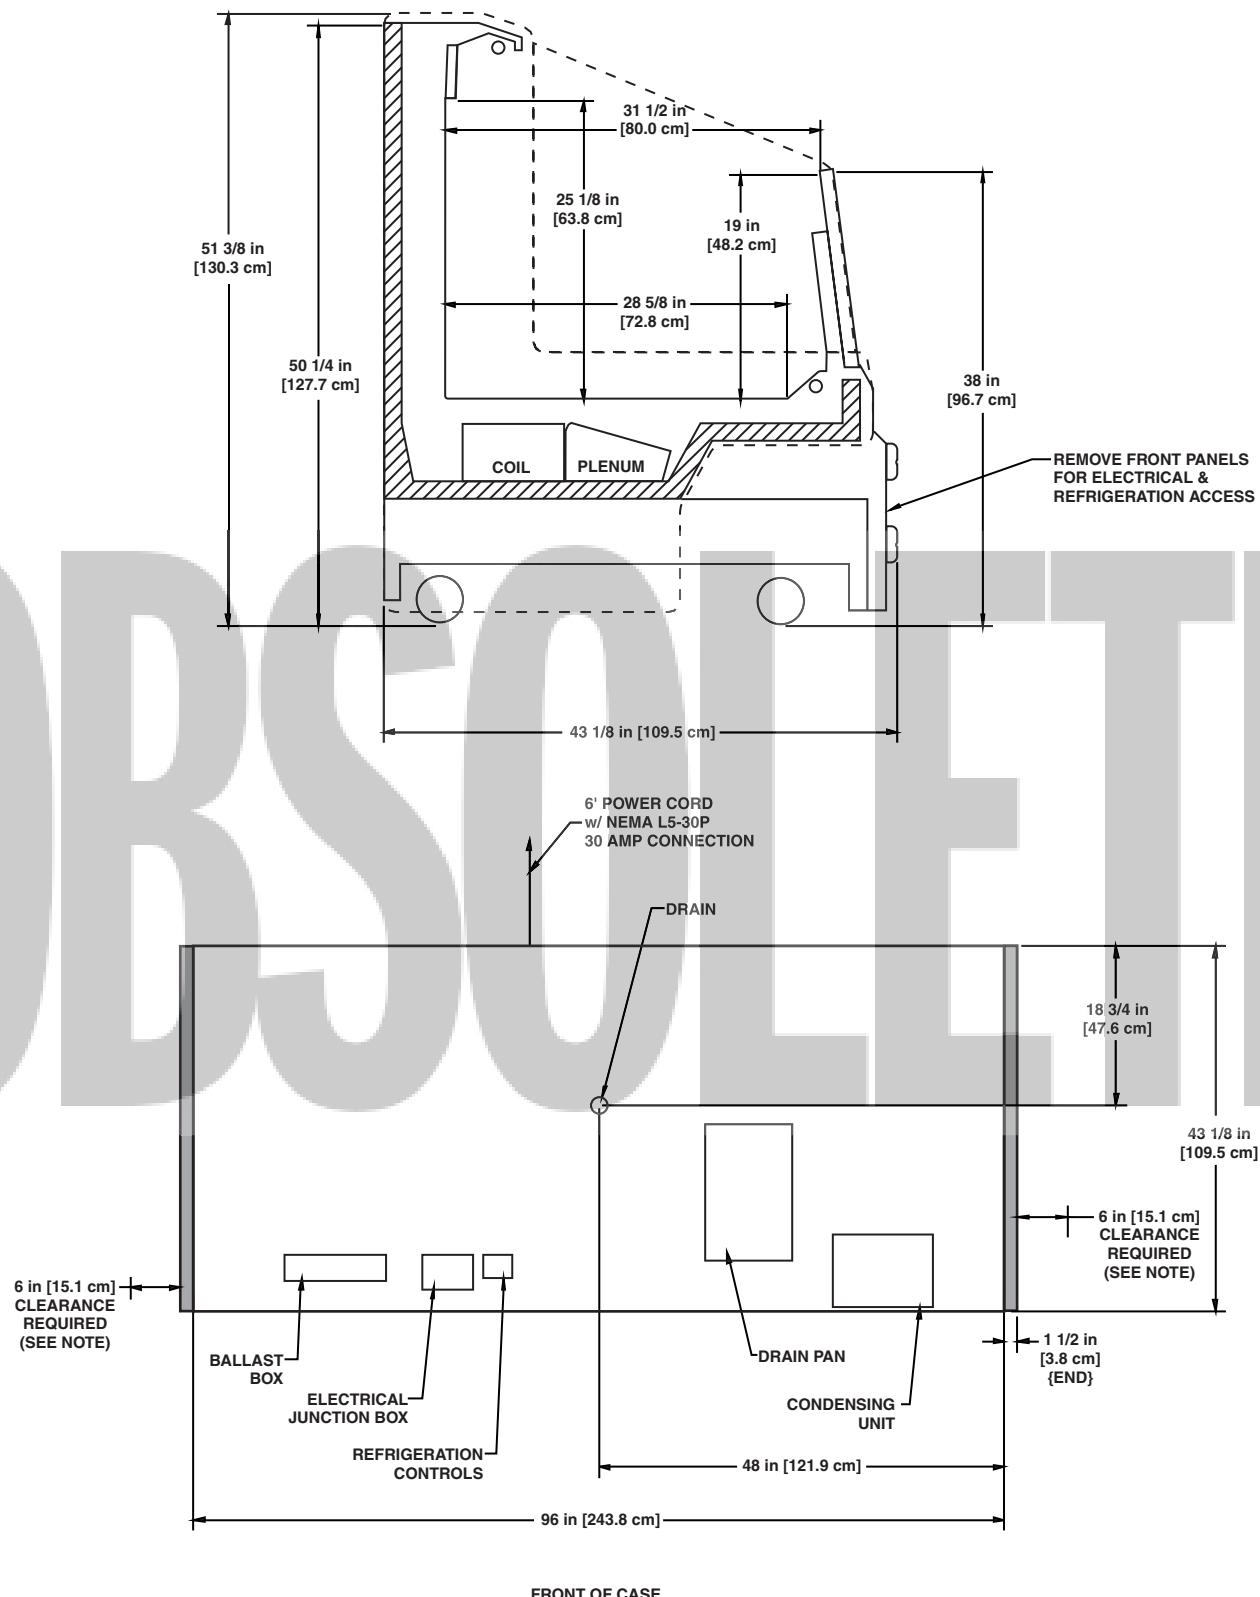

SELF-CONTAINED

Boxed Product

NOTES:

CASE CLEARANCE: MINIMUM 6" BOTH ENDS

Multi-Deck Self-Contained Mobile Produce/Dairy/Deli/Meat Merchandiser

O2.5UMA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
O2.5UMA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
O2.5UMA-4' Produce	27"	32.3	12-14	6-8	29-30	37	40-42	228
	31"	30.2	12-14	6-8	25-27	35	39-41	230
	33"	30.3	12-14	6-8	25-26	34	36-38	226

¹ Note: when ordering the 27" front a 4" piece of straight plexiglass must be placed in front of the return air baffle.

² Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O2.5UMA-4'	115	1	60	1/2	12.9	66.3	R134A	3.6	25	440	162

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O2.5UMA-4'	3	40	47	---	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.



A DOVER DIVERSIFIED COMPANY

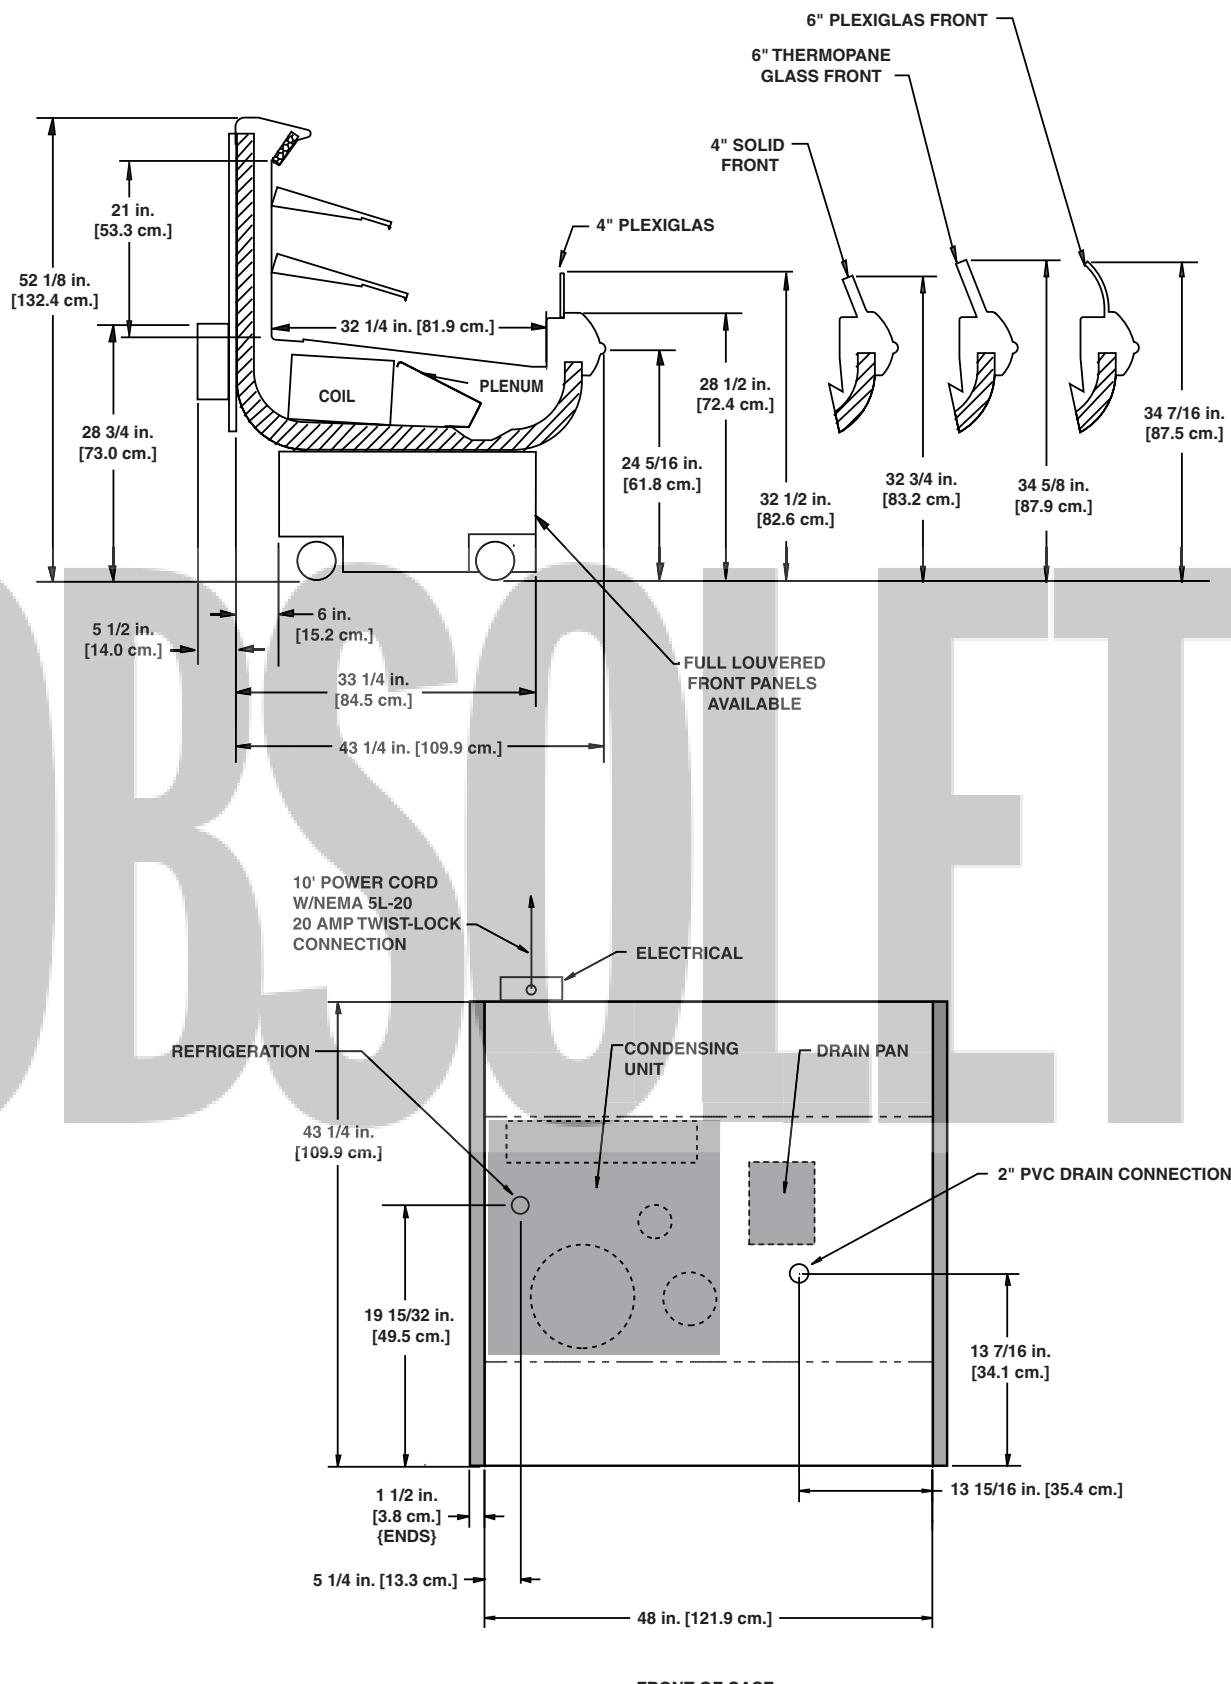

FRONT OF CASE

NOTES:

- ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT
- AVAILABLE SHELF SIZES: 10", 12", 14", & 16"

Multi-Deck Self-Contained Mobile Produce/Dairy/Deli/Meat Merchandiser

O3UMA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
O3UMA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
O3UMA-4'	31"	32.1	12-14	6-8	26	32	35	230

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3UMA-4'	115	1	60	1/2	12.9	66.3	134A	3.6	25	440	162

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost			Hot Gas Defrost			Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3UMA-4'	3	40	47	-- ⁵	---	---	---	---	---	---	---


⁵ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm



All measurements are taken per CRMA specifications.

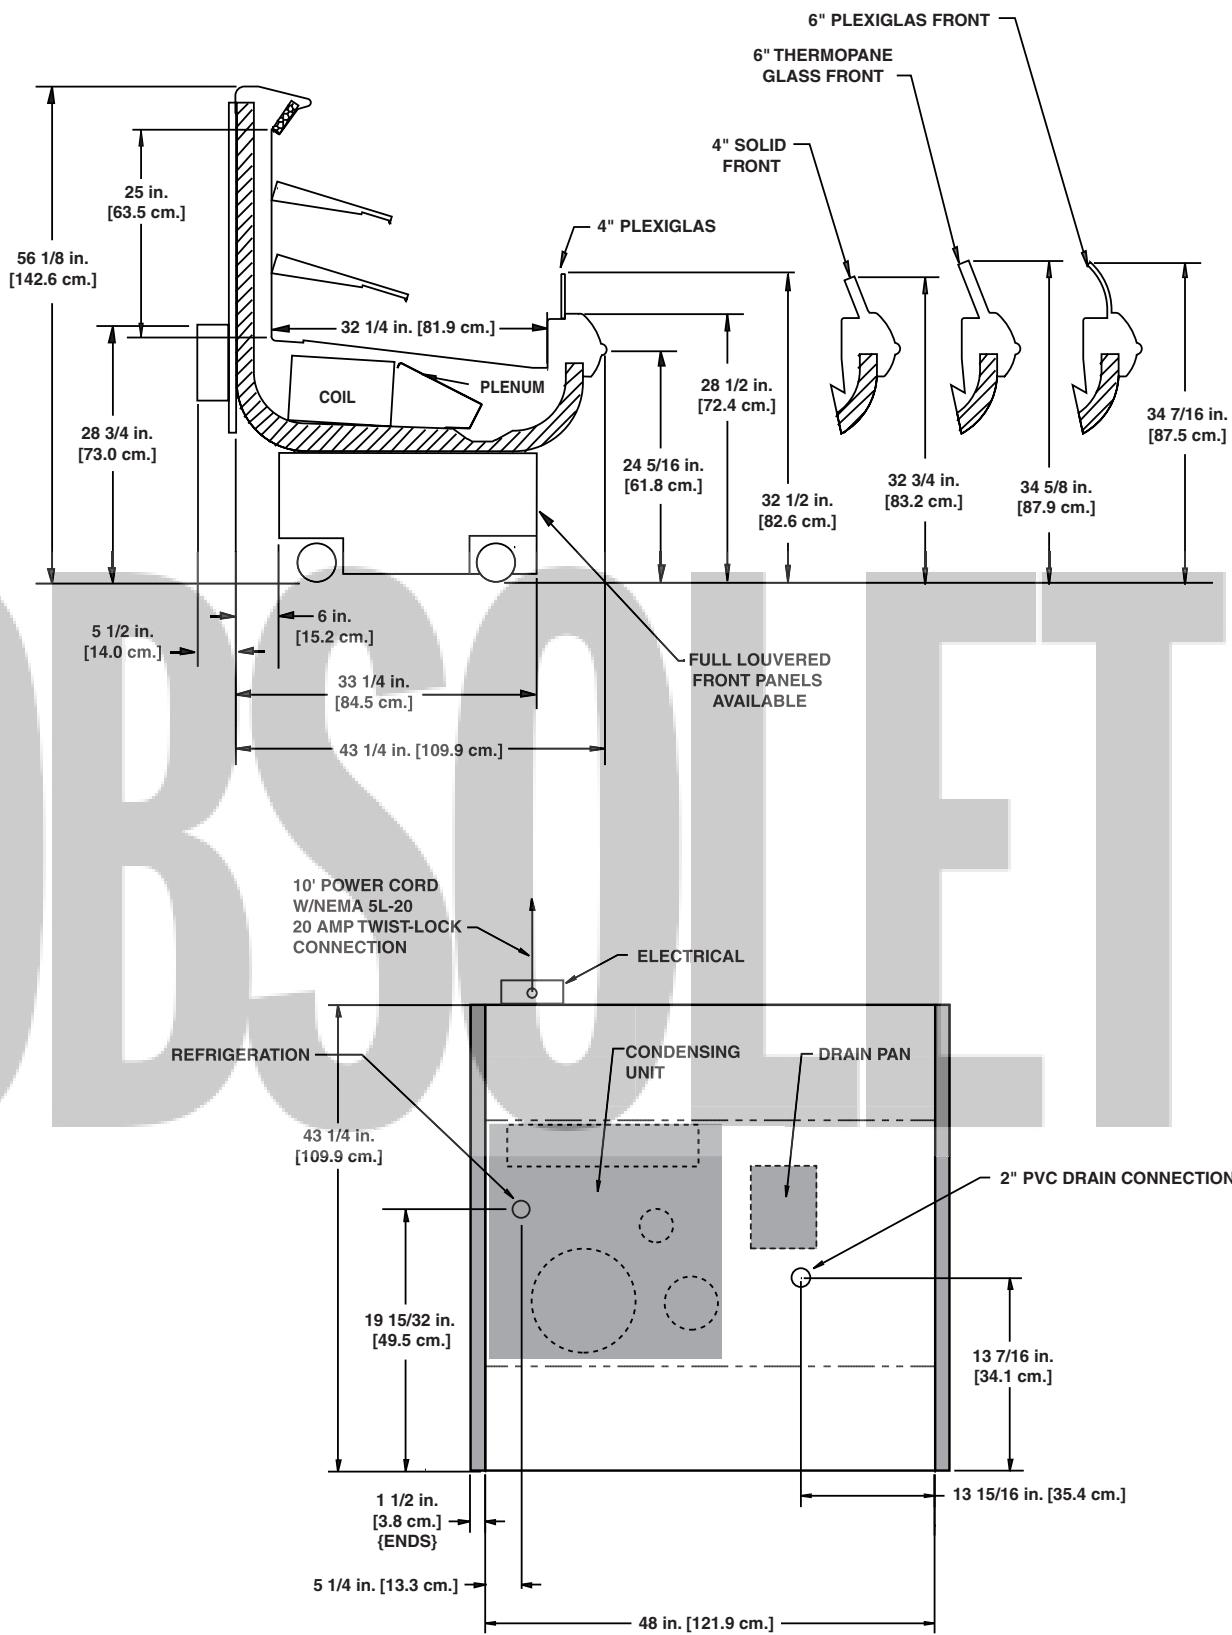

Multi-Deck Self-Contained Produce/Dairy/Deli Merchandiser

O5DMA - 4', 6', & 8'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O5DMA	4'	208/230	1	60	3 wire + ground	24.8
	6'	208/230	1	60	3 wire + ground	28.5
	8'	208/230	1	60	3 wire + ground	30.9

Electrical Data

Model	Fans per Case	Condenser Fan				Drain Pump		Evap. Pan Heater		Maximum Lights		
		Standard Fans		120 Volts		208 Volts		120 Volts		240 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
O5DMA	4'	2	1.00	60	0.85	130	1.10	132	7.21	1500	2.63	316
	6'	2	1.00	60	1.10	111	1.10	132	7.21	1500	4.47	536
	8'	3	1.50	90	1.10	111	1.10	132	7.21	1500	4.47	536

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
O5DMA-4'		52	6-8	30	35	44	250
O5DMA-6'		52	6-8	30	35	44	250
O5DMA-8'		52	6-8	30	35	44	250

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O5DMA-4'	208	1	60	1	9.6	51	404A	4.5	45	500	174
O5DMA-6'	208	1	60	1 3/4	10.9	56	404A		45	500	174
O5DMA-8'	208	1	60	2	12.4	61	404A		45	500	174

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O5DMA	3	---	4	42	47	---	---	---	---

⁴ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm


All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE

A DOVER DIVERSIFIED COMPANY

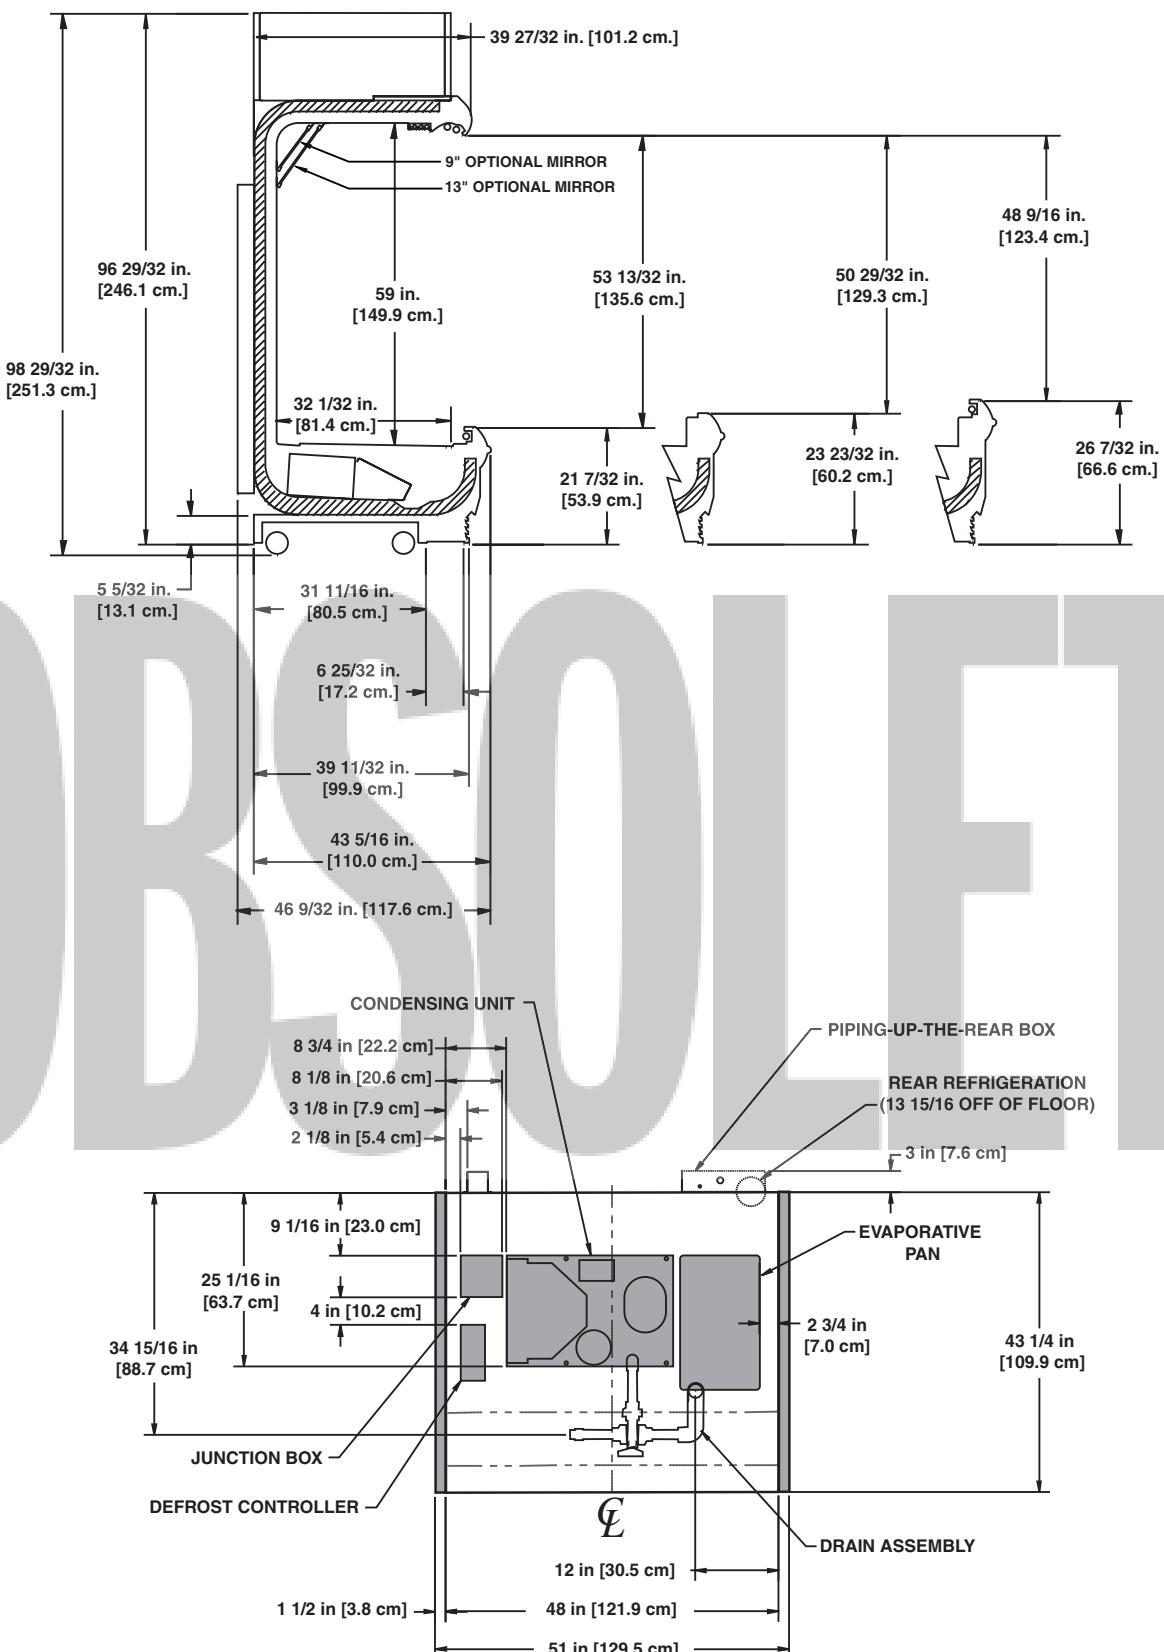
**SELF-CONTAINED**

Produce/Dairy/Deli

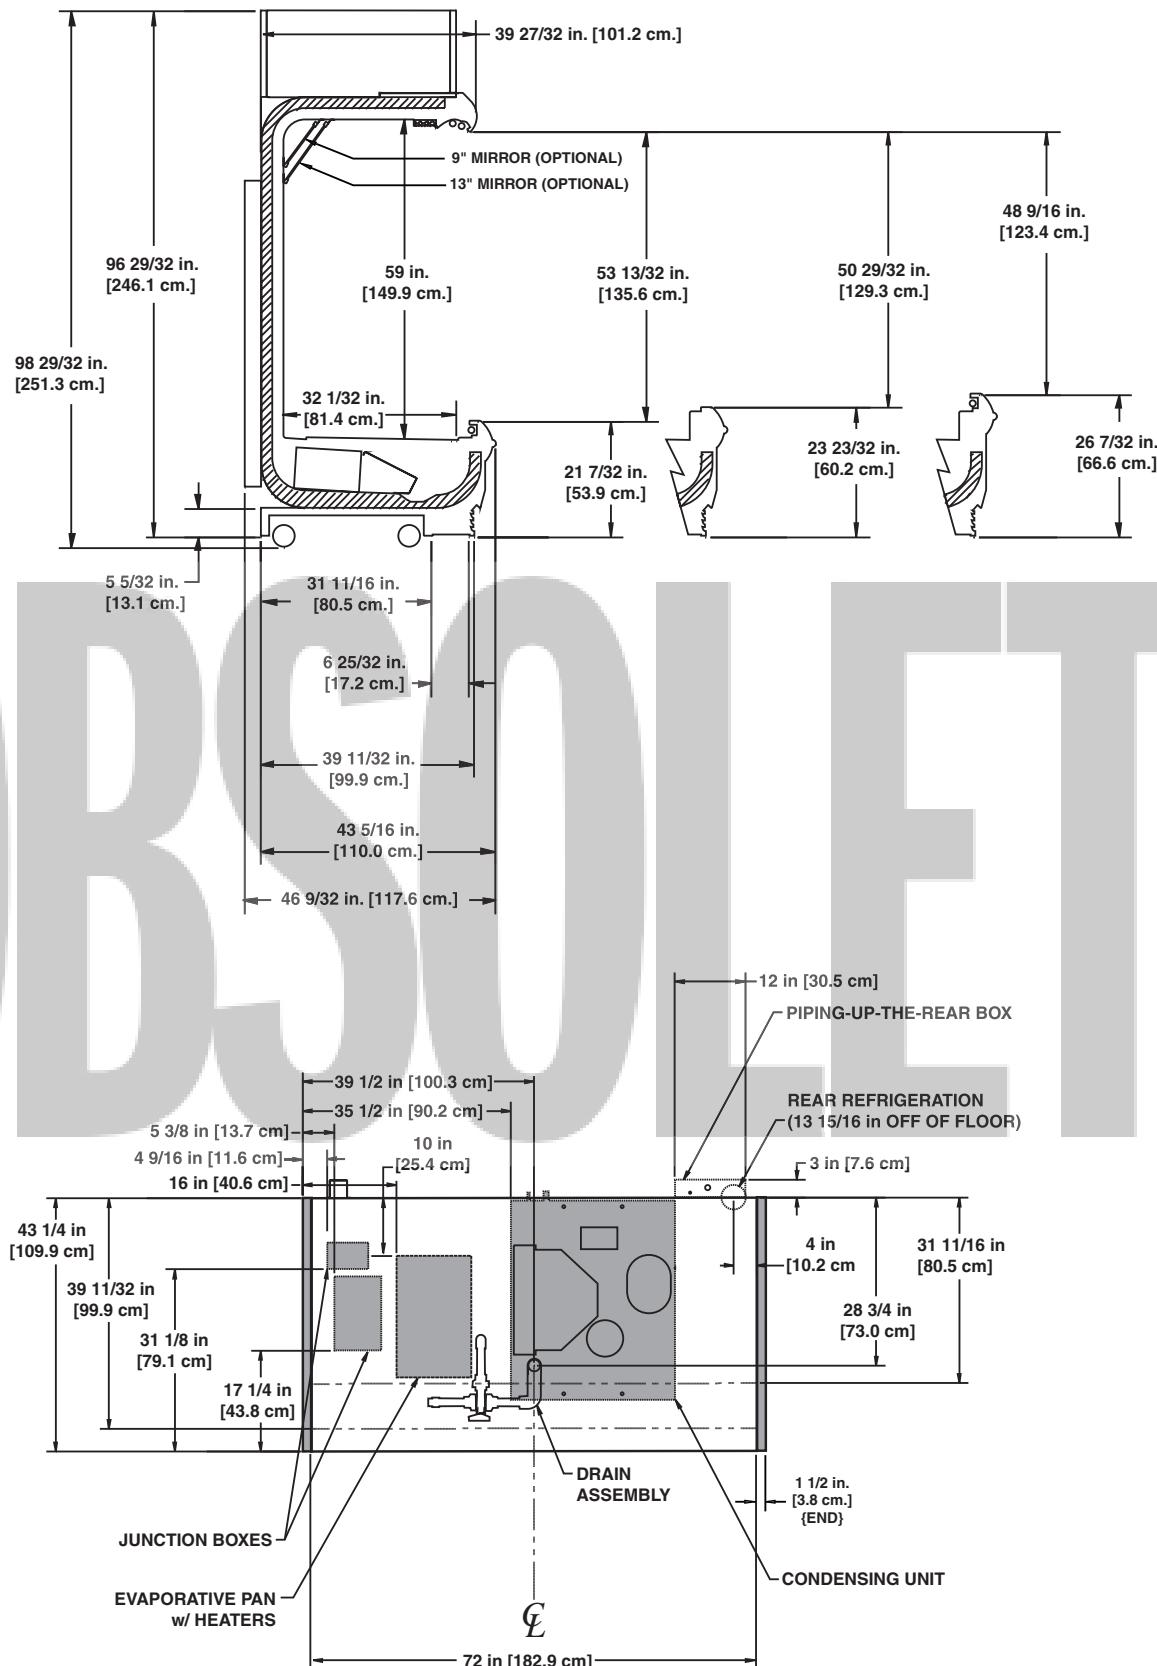

NOTES:

- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- AVAILABLE SHELF SIZES: 10", 12", 14", 16", 18", 20", 22", & 24"

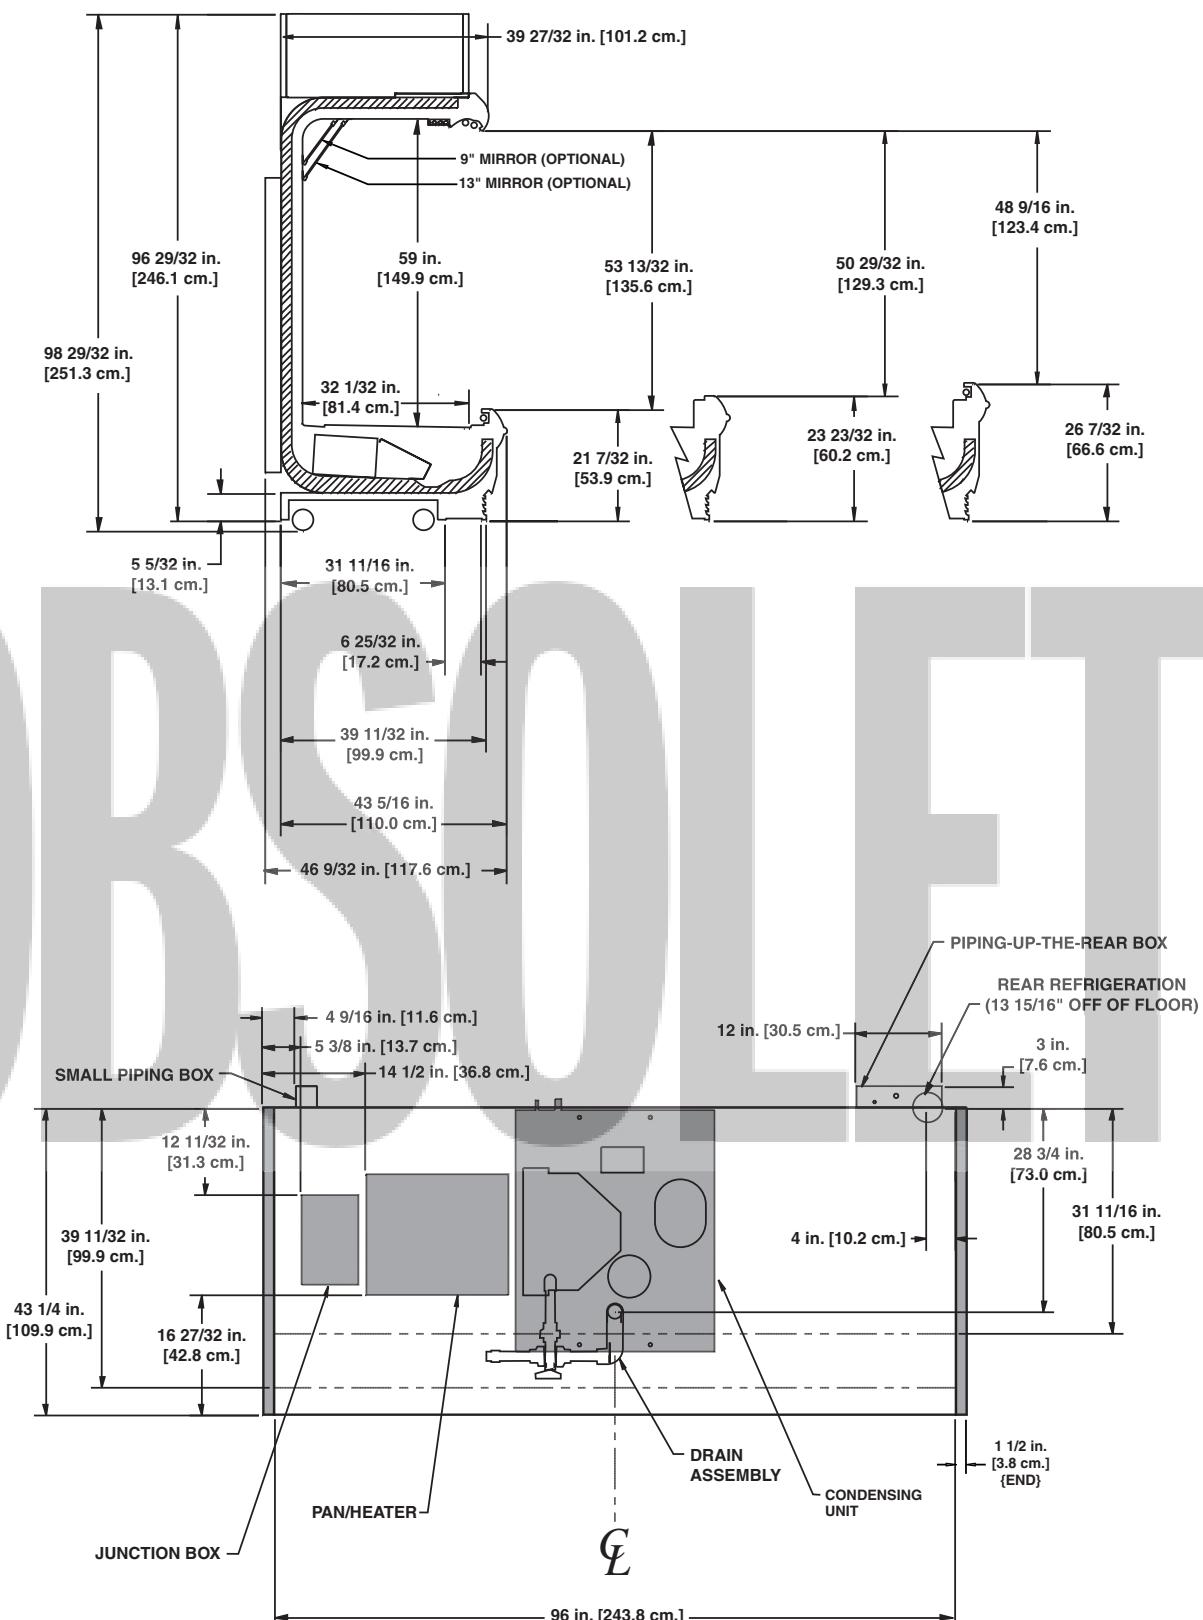

SELF-CONTAINED

Produce/Dairy/Deli

Narrow Multi-Deck Self-Contained Dairy Merchandiser

ONNA-47"

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONNA	47"	208/230	1	60	3 wire + ground	18.5

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Drain Pump		Evap. Pan Heater		Maximum Lights		
		120 Volts		208 Volts		120 Volts		240 Volts		120 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
ONNA	47"	3	1.35	51	0.85	130	0.9	47	6.28	1500	0.57	68

Guidelines & Control Settings

Model	Front Sill Height	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
ONNA-47"	16"	37.2	15.5	6-8	35	38	43	275

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONNA-47"	208-230	1	60	3/4	6.8	33.5	R134A	3.5	25	440	165

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONNA	4	---	---	40	47	---	---	---	---


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
REFRIGERATION

A DOVER DIVERSIFIED COMPANY

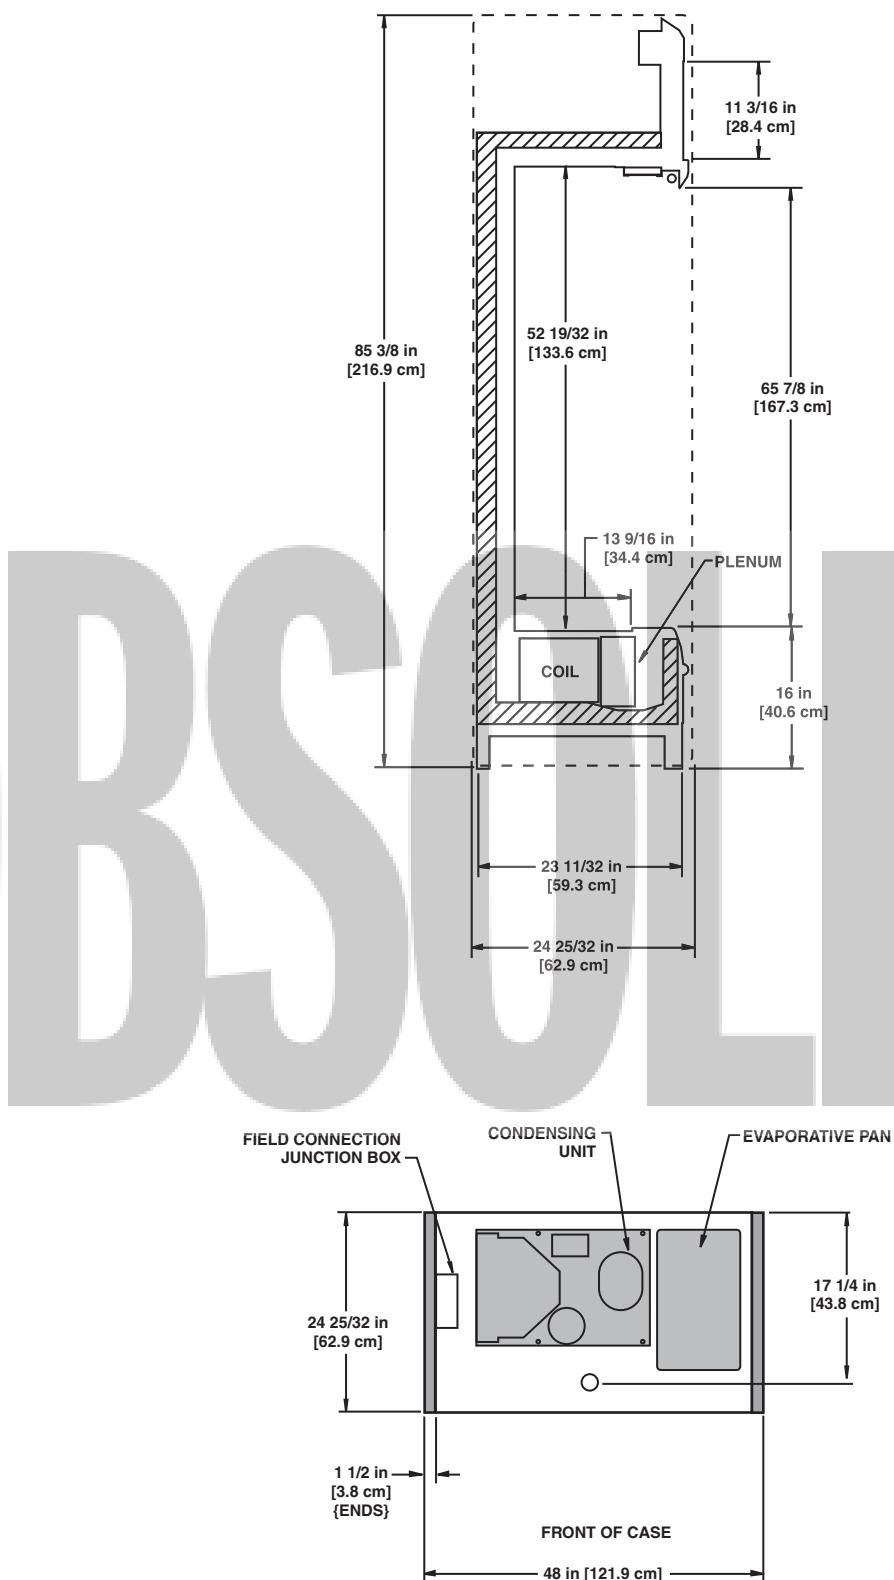

NOTES:

- A 2" MINIMUM AIR GAP IS REQUIRED BETWEEN THE REAR OF THE CASE AND A WALL
- AVAILABLE SHELF SIZE: 12"

Narrow Multi-Deck Self-Contained Dairy/Deli/Meat Merchandiser

ONUA - 4'47" & 6'71"

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONUA	4'47"	208/230	1	60	3 wire + ground	19.8
	6'71"	208/230	1	60	3 wire + ground	27.1

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Drain Pump		Evap. Pan Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONUA	4'47"	2	1.00	60	0.85	130	0.90	108	6.28	1500	2.06
	6'71"	3	1.50	90	1.50	111	0.90	108	6.28	1500	3.90

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
ONUA-4'47"	43.9	33	6-8	27.5	34	39	310
ONUA-6'71"	59.3	33	6-8	27.5	34	39	310

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONUA-4'47"	208-230	1	60	1	7.0	34.2	R-22	5.9	45	500	174
ONUA-6'71"	208-230	1	60	1 1/2	10.4	48.2	R-22	6.75	45	500	174

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
ONUA	4	---	---	40	45	---	---	---

⁴ Average discharge air velocity at peak of defrost.


Medium Temperature Defrost Schedule


No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE™

A DOVER DIVERSIFIED COMPANY

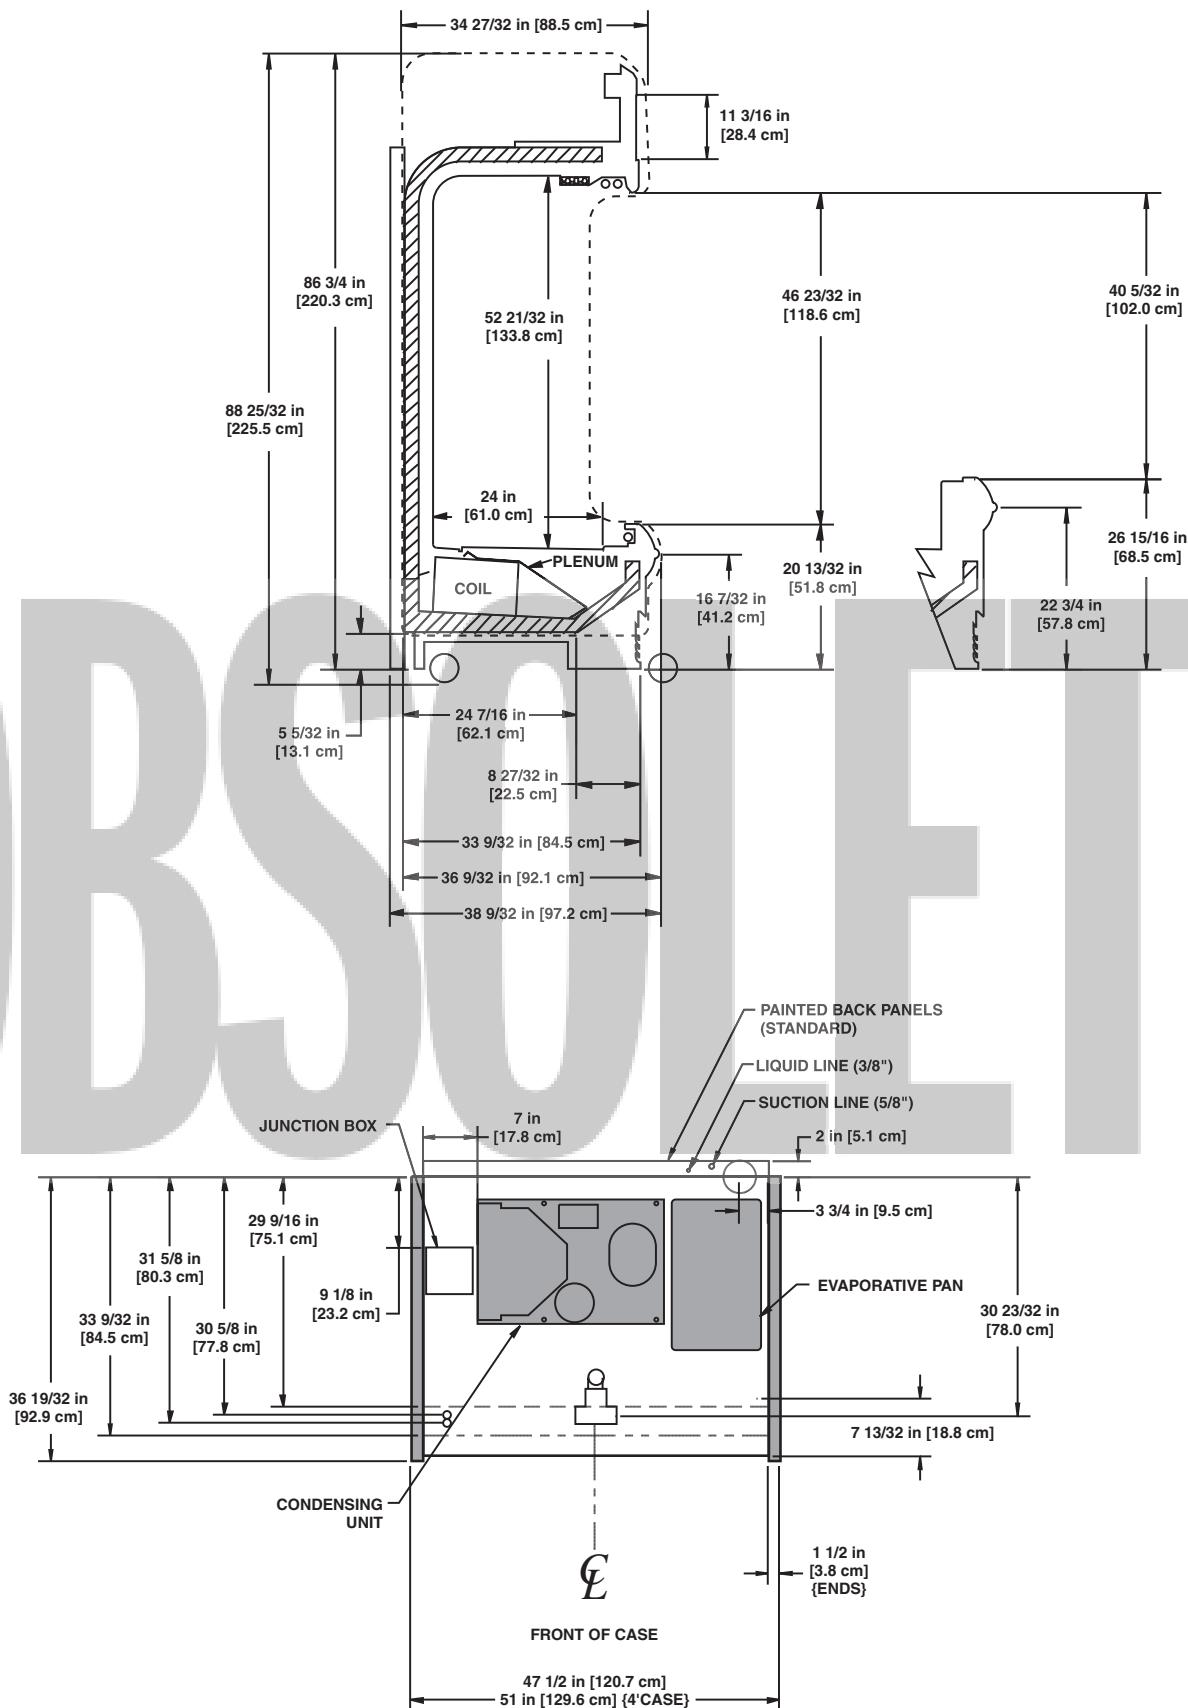

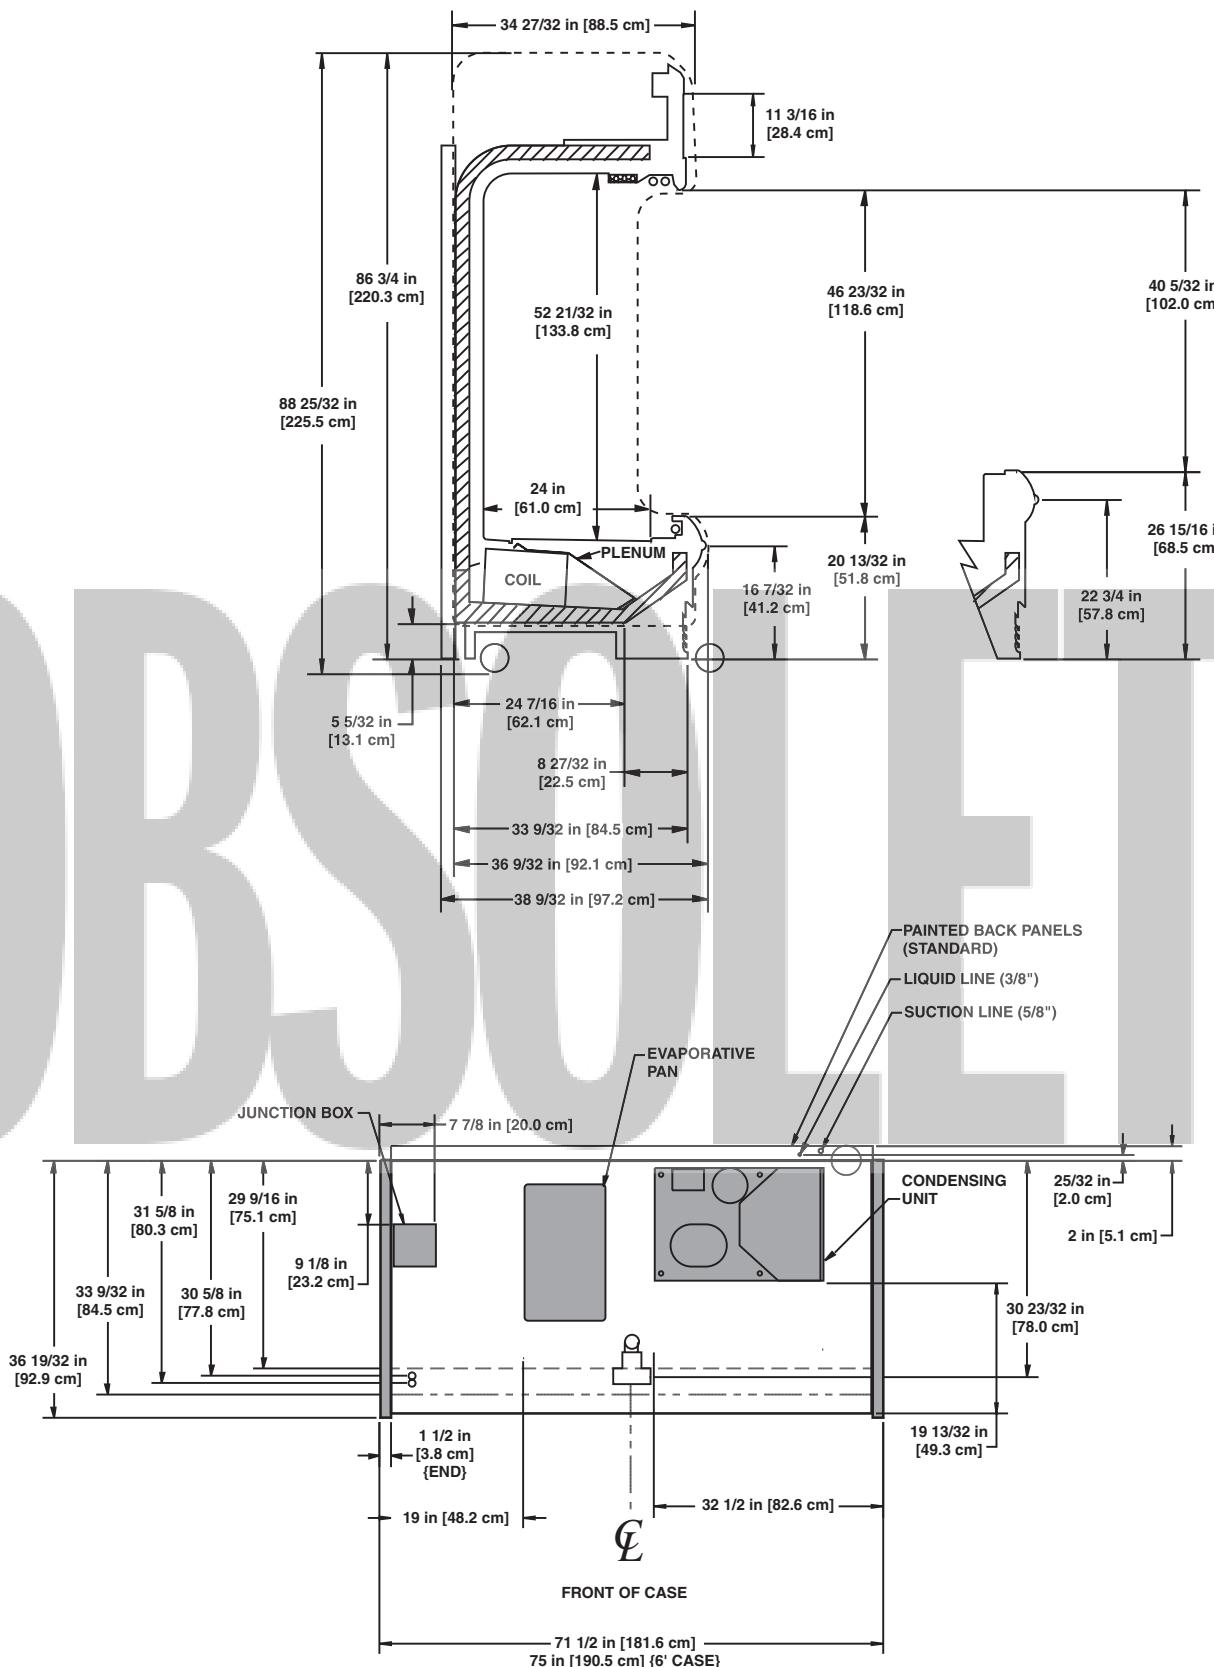

SELF-CONTAINED

Dairy/Deli/Meat

OBSCULTE

Narrow Island Self-Contained Deli/Meat Merchandiser

ONIMA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONIMA	8'	208/230	1	60	3 wire + ground	23.3
	12'	208/230	1	60	3 wire + ground	29.1
						35

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIMA	8'	2.70	102	0.85	130	0.82	98	4.34	902	5.00	1200	5.55	1331	1.26	151
	12'	3.60	136	1.70	260	1.08	130	7.22	1502	8.33	2000	5.55	1331	1.46	175

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
ONIMA-8'		35	6-8	25	33	34	180
ONIMA-12'		35	6-8	25	33	34	180

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONIMA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
ONIMA-12' ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
ONIMA	3	35	47	--- ⁵	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
COLD

A DOVER DIVERSIFIED COMPANY

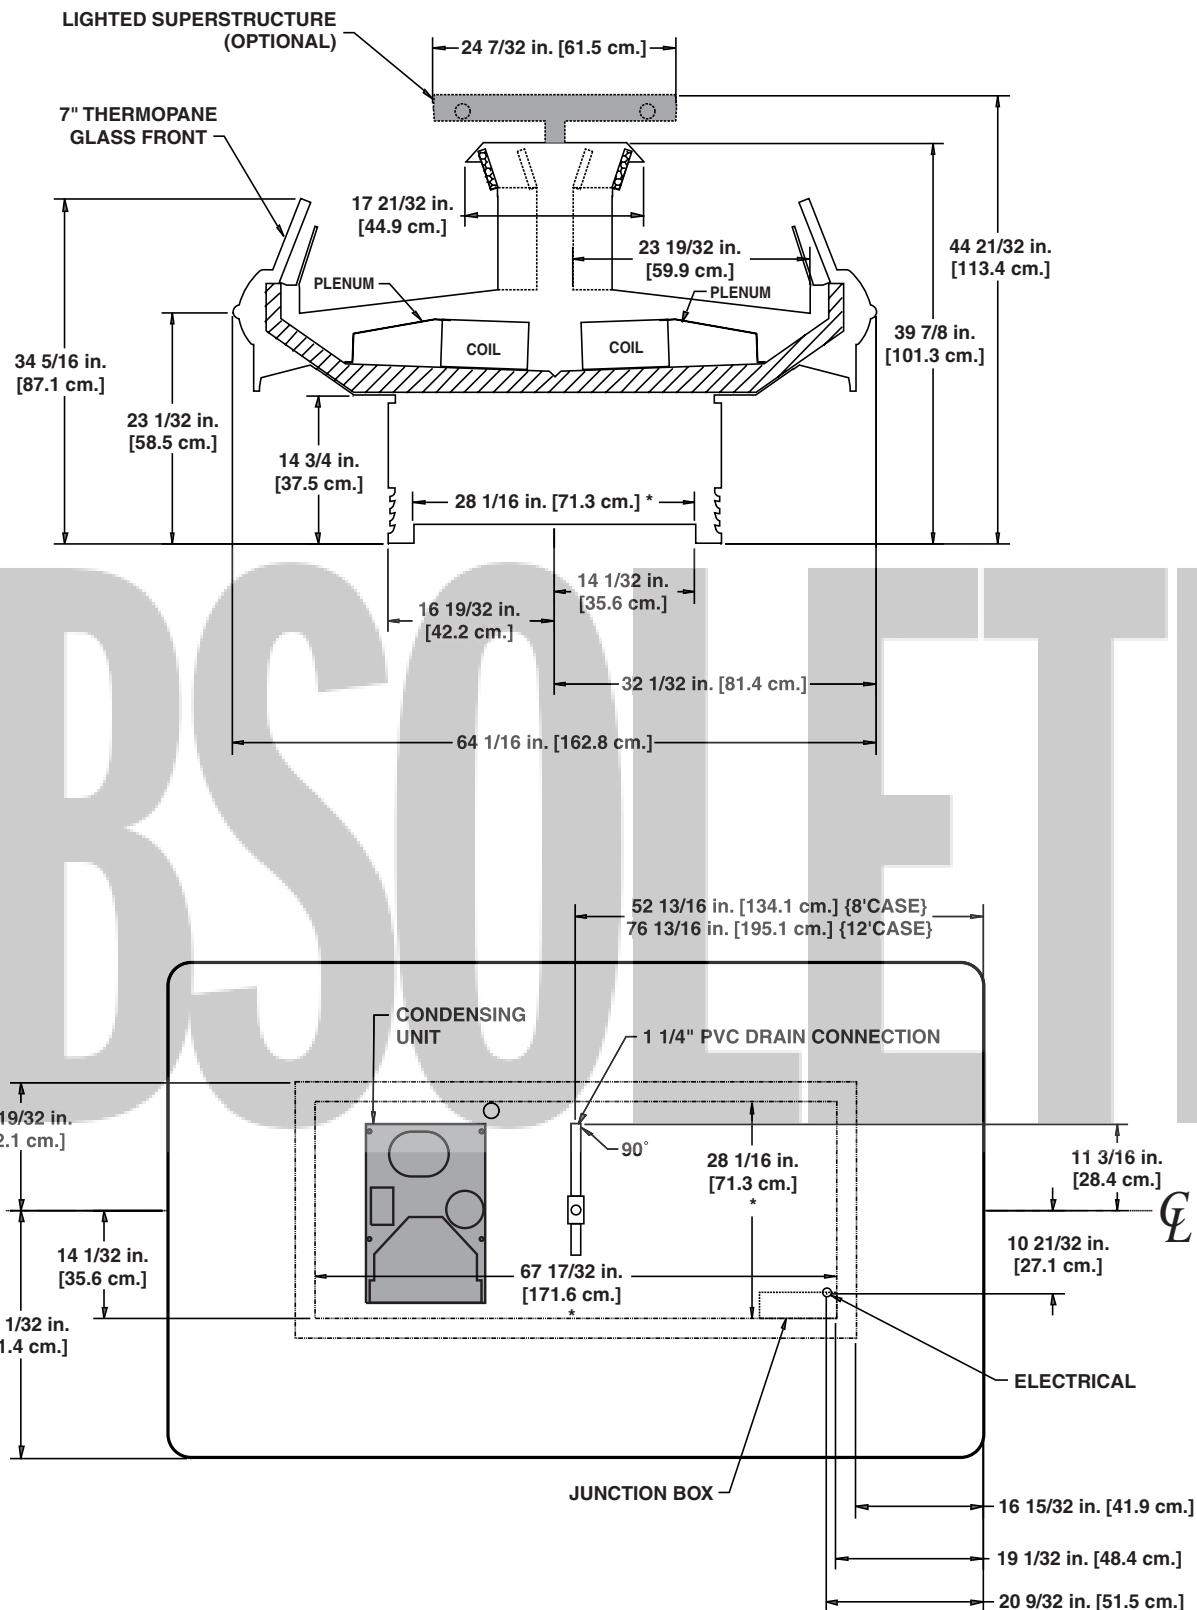

NOTES:

- * STUB-UP AREA
- 12' CASES HAVE TWO CONDENSING UNITS

Narrow Island Self-Contained Deli/Meat Merchandiser

ONIMBA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
ONIMBA	8'	208/230	1	60	3 wire + ground	23.3
	12'	208/230	1	60	3 wire + ground	29.1
						35

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
ONIMBA	8'	2.70	102	0.85	130	0.75	90	4.34	902	5.00	1200	5.55	1331	1.26	151
	12'	3.60	136	1.70	260	1.17	140	7.22	1502	8.33	2000	5.55	1331	1.46	175

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
ONIMBA-8'		35	6-8	28	33	37	180
ONIMBA-12'		35	6-8	28	33	37	180

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
ONIMBA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
ONIMBA-12' ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost			Hot Gas Defrost			Reverse Air Defrost		
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	
ONIMBA	3	35	47	--- ⁵	---	---	---	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN COOLING

A DOVER DIVERSIFIED COMPANY

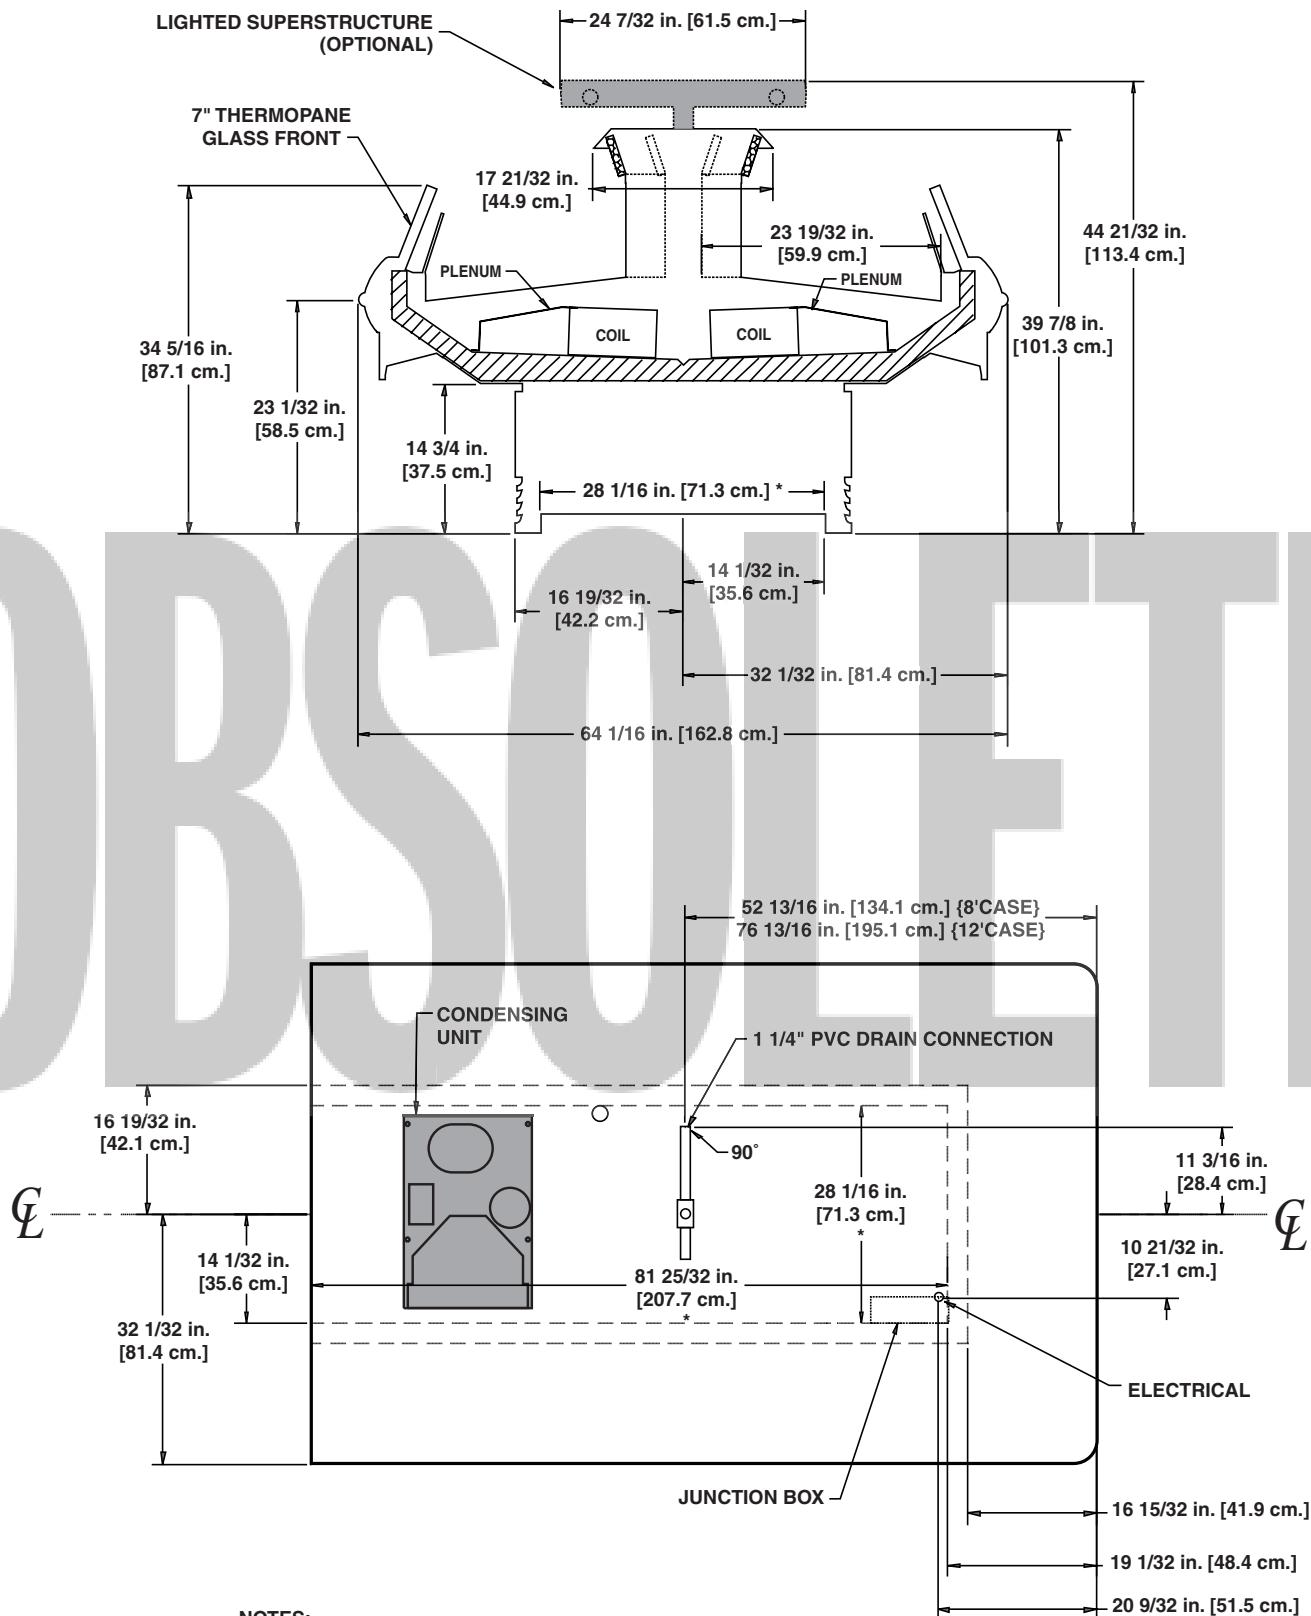

SELF-CONTAINED

Deli/Meat

Wide Island Self-Contained Deli/Meat Merchandiser

OIMA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIMA	8'	208/230	1	60	3 wire + ground	27.9
	12'	208/230	1	60	3 wire + ground	34.2
						40

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fans		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIMA	8'	2.70	102	0.85	130	0.82	98	4.34	9.02	5.00	1200	5.55	1331	5.04	606
	12'	3.60	136	1.70	260	1.08	130	7.22	1502	8.33	2000	5.55	1331	6.50	780

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OIMA-8'		35	6-8	26	34	31	140
OIMA-12'		35	6-8	26	34	31	140

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIMA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
OIMA-12' ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost			Hot Gas Defrost			Reverse Air Defrost		
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	
OIMA	3	40	47	---	⁵	---	---	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE™

A DOVER DIVERSIFIED COMPANY

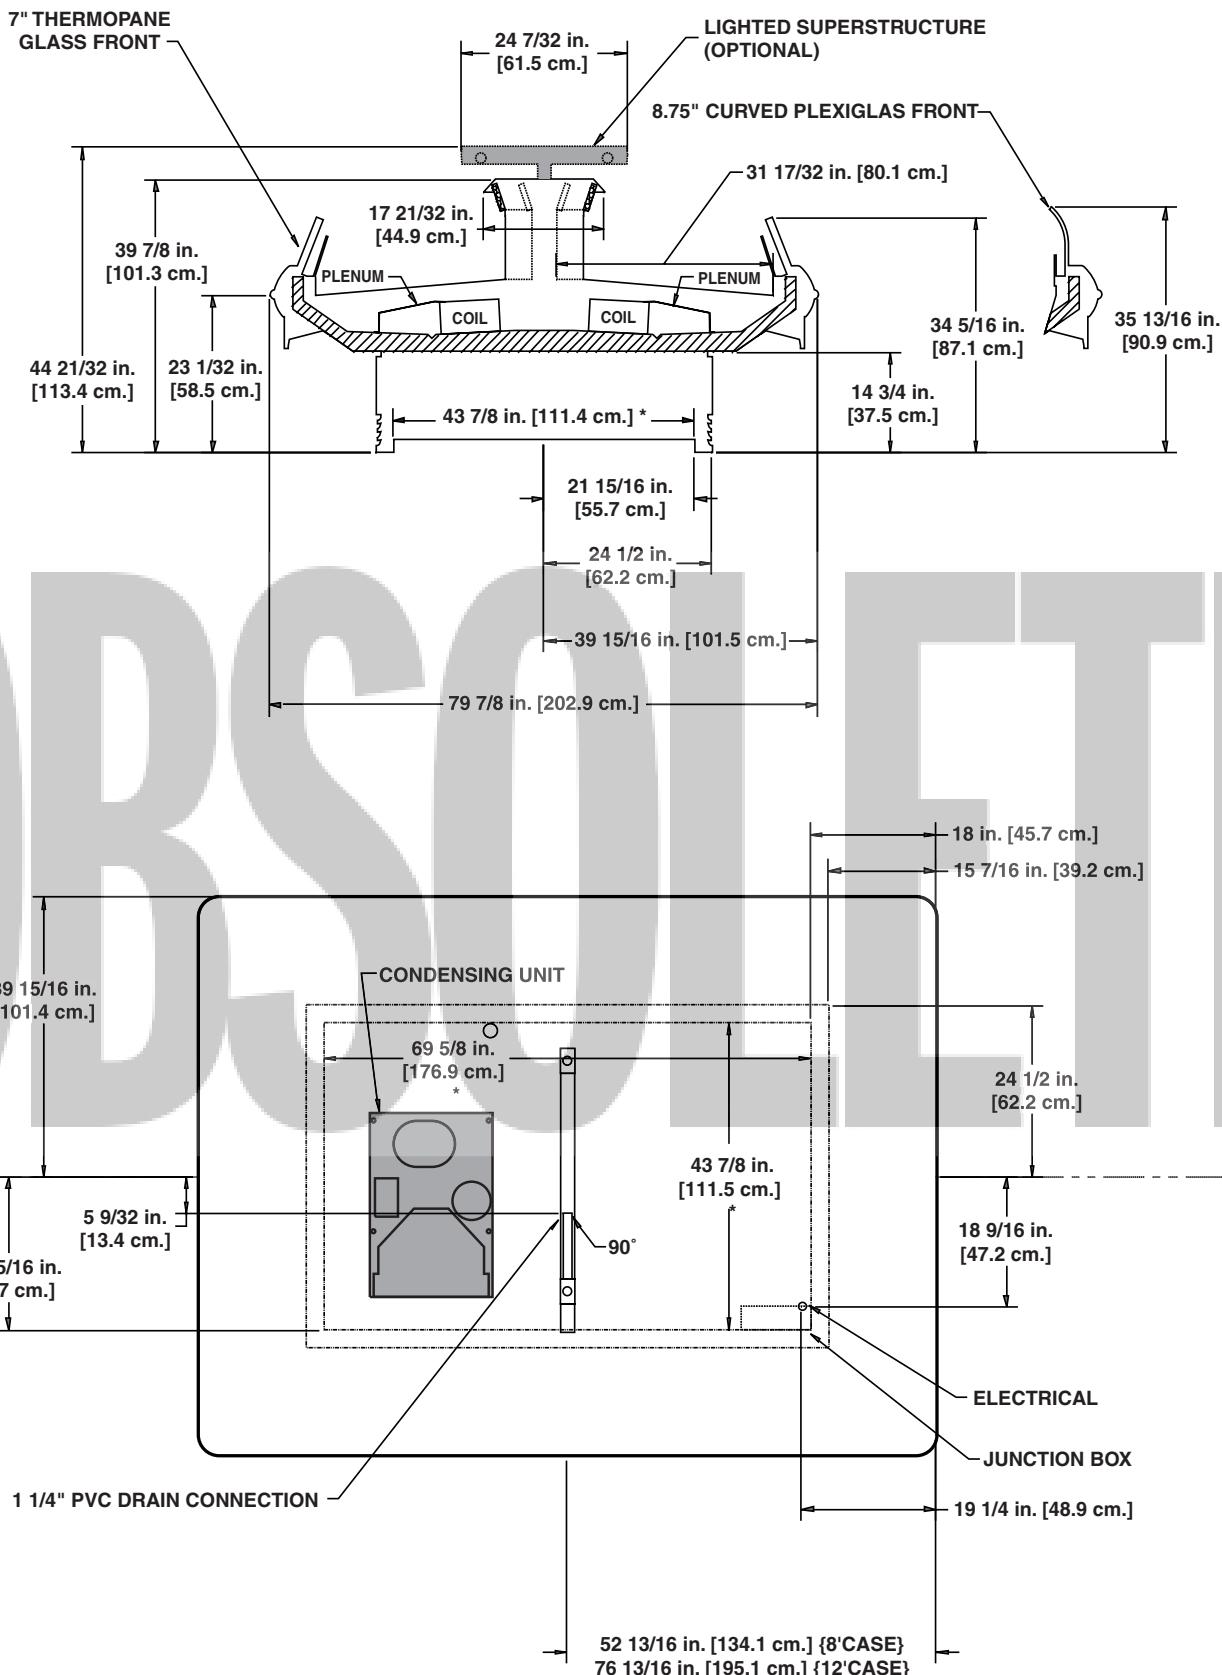

SELF-CONTAINED

Deli/Meat

Wide Island Self-Contained Deli/Meat Merchandiser

OIMBA - 6' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIMBA	6'	208/230	1	60	3 wire + ground	20.7
	12'	208/230	1	60	3 wire + ground	33.6
					40	

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights		
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts		
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	
OIMBA	6'	4	1.80	76	0.85	130	0.57	68	3.25	676	3.75	900	5.55	1331	3.15	378
	12'	8	3.60	136	1.70	260	1.17	140	7.22	1502	8.33	2000	5.55	1331	5.87	704

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OIMBA-6'		35	6-8	26	34	31	140
OIMBA-12'		35	6-8	26	34	31	140

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIMBA-6'	208-230	1	60	1	7.0	34.2	R22	8.2	45	360	215
OIMBA-12' ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OIMBA	3	40	47	--- ⁵	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE™

A DOVER DIVERSIFIED COMPANY

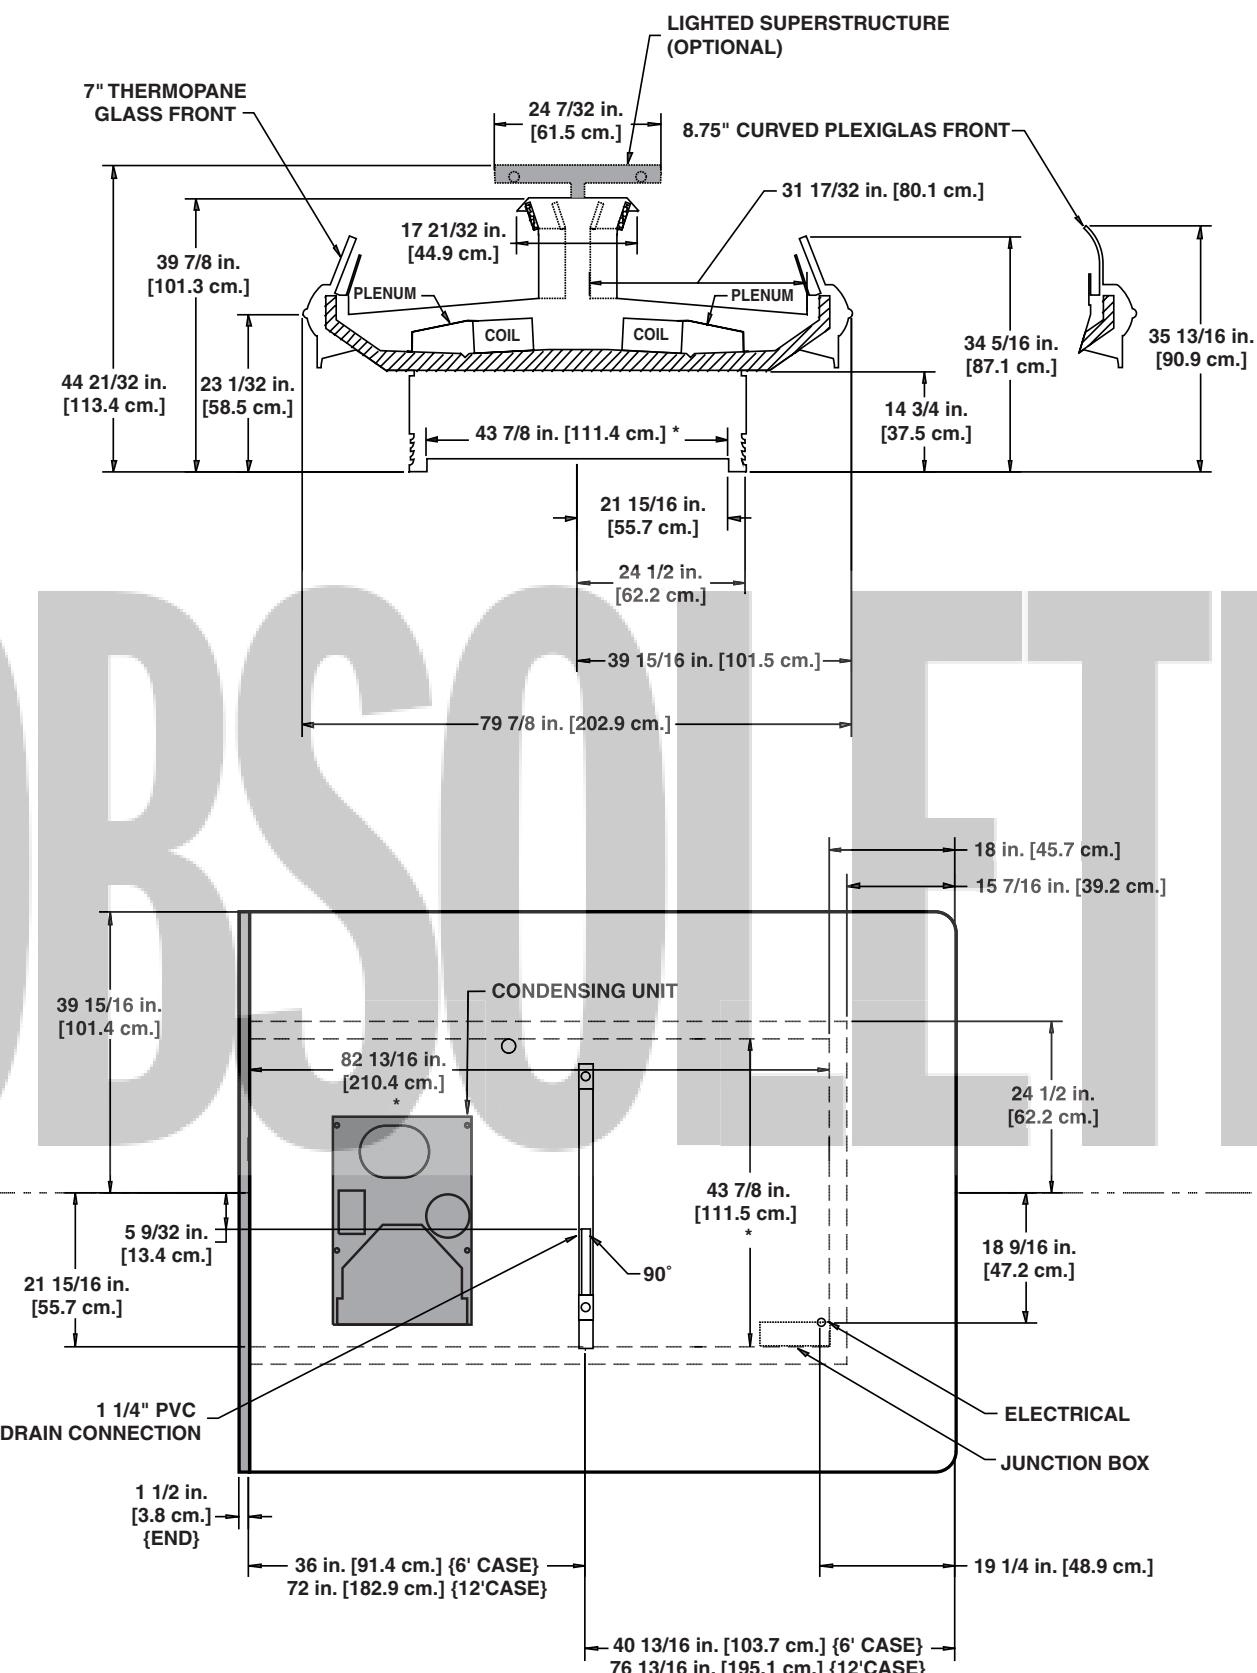

SELF-CONTAINED

Deli/Meat

Wide Island Self-Contained Bulk Produce Merchandiser

OIPA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
OIPA	8'	208/230	1	60	3 wire + ground	21.5
	12'	208/230	1	60	3 wire + ground	37.6
						50

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OIPA	8'	2.70	102	0.85	130	0.23	28	- - -	1	- - -	- - -	5.55	1331	3.78	454
	12'	3.60	136	1.70	260	0.55	66	- - -	- - -	- - -	- - -	5.55	1331	5.04	605

1 NOTE: - - - not an option on this case model.

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ² (FPM)
OIPA-8'		45	6-8	34	40	48	140
OIPA-12'		45	6-8	34	40	48	140

² Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ⁴ (amps)	LRA ⁵ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OIPA-8'	208-230	1	60	1	6.7	33.5	R22	7.8	45	360	215
OIPA-12' ³	208-230	1	60	3/4	9.4	48.2	R22	11.9	45	360	215

³ This case uses two of the condensing units listed above.

⁴ RLA - Running Load Amps.

⁵ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost		Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)
OIPA	3	- - -	- - -	44	38	- - -	- - -	- - -

Medium Temperature Defrost Schedule


No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
E X C E L L E N C E™

A DOVER DIVERSIFIED COMPANY

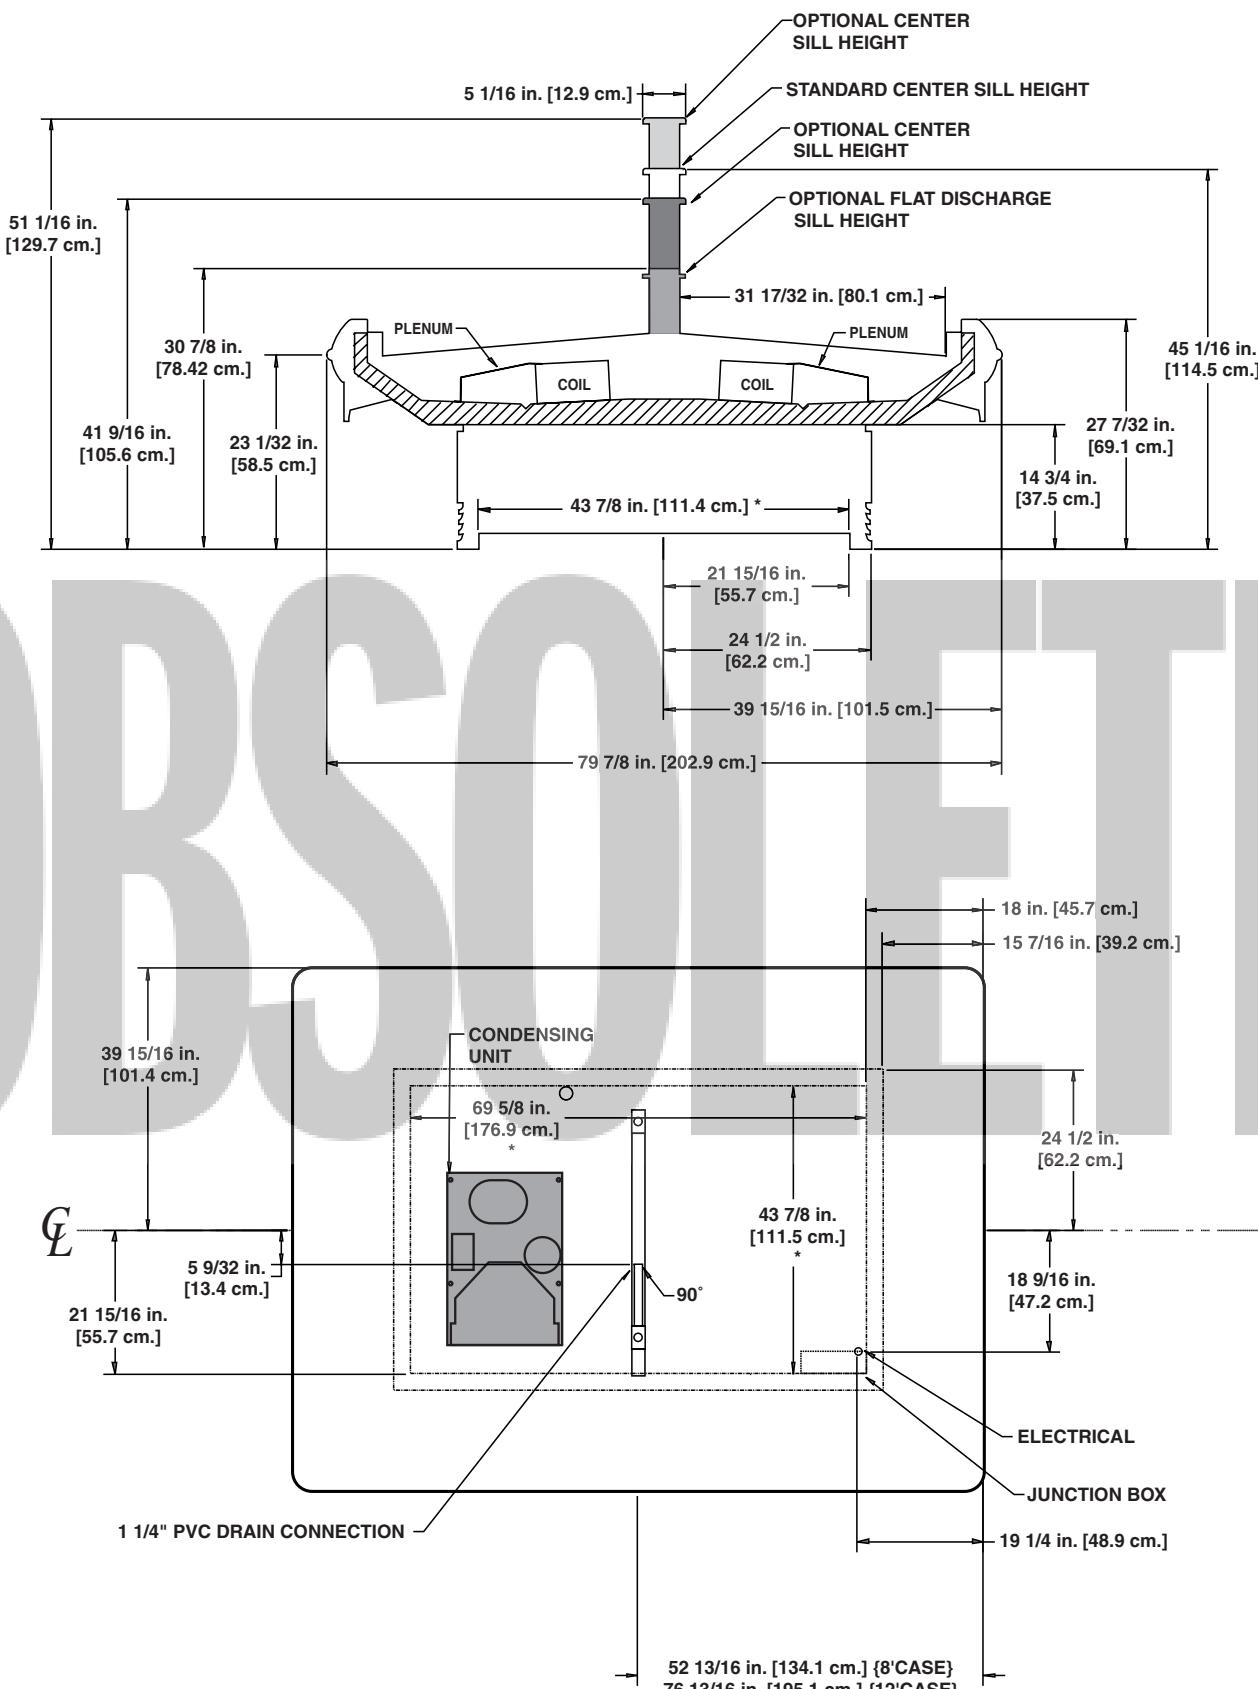

Wide Island Multi-Deck Self-Contained Cheese Merchandiser

O3ICA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O3ICA	8'	208/230	1	60	3 wire + ground	28.6
	12'	208/230	1	60	3 wire + ground	35.1

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Anti-Condensate Heaters		Defrost Heaters		Drain Heater		Maximum Lights			
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts			
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts		
O3ICA	8'	2.70	102	0.85	130	0.82	98	4.34	902	5.00	1200	5.55	1331	5.71	546
	12'	3.60	136	1.70	260	1.08	130	7.22	1502	8.33	2000	5.55	1331	7.46	779

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
O3ICA-8'		37	6-8	29	37	48	160
O3ICA-12'		37	6-8	29	37	48	160

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3ICA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
O3ICA-12 ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3ICA	6	30	47	---	5	---	---	---	---

⁵ NOTE: --- not an option on this case model.

Medium Temperature Defrost Schedule


No. Per Day Hours

- 1 12 midnight
- 2 12 am - 12 pm
- 3 6 am - 2 pm - 10 pm
- 4 12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE™

A DOVER DIVERSIFIED COMPANY

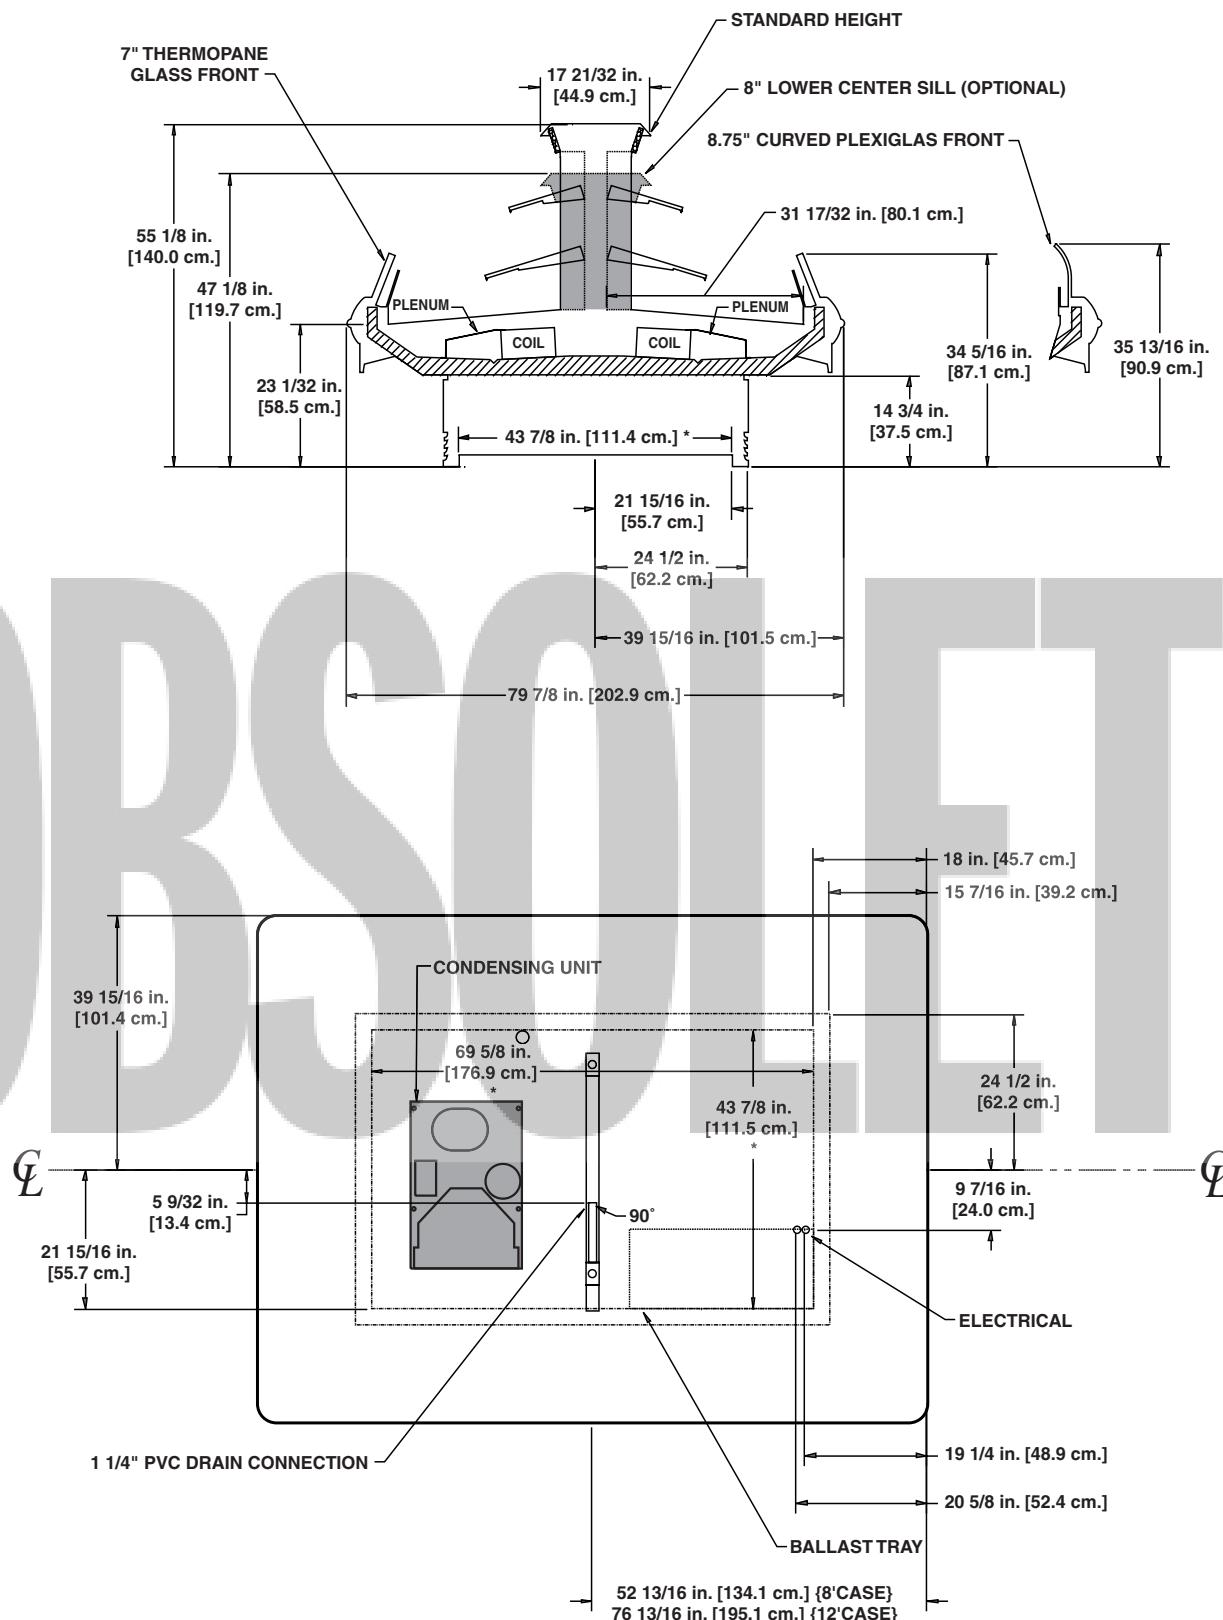

Wide Island Multi-Deck Self-Contained Cheese Merchandiser

O3ICBA - 8' & 12'

System Requirements

Model	Volts	Phase	Hz	Wire	Minimum Circuit Ampacity	Maximum Fuse Size
O3ICBA	8'	208/230	1	60	3 wire + ground	27.6
	12'	208/230	1	60	3 wire + ground	33.8
						40

Electrical Data

Model	Fans per Case	Standard Fans		Condenser Fan		Anti-Condensate Heaters		Defrost Heaters				Drain Heater		Maximum Lights	
		120 Volts		208 Volts		120 Volts		208 Volts		240 Volts		240 Volts		120 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O3ICBA	8'	2.70	102	0.85	130	0.75	90	4.34	902	5.00	1200	5.55	1331	4.76	514
	12'	3.60	136	1.70	260	1.17	140	7.22	1502	8.33	2000	5.55	1331	6.02	665

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
O3ICBA-8'		37	6-8	29	37	48	160
O3ICBA-12'		37	6-8	29	37	48	160

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ³ (amps)	LRA ⁴ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O3ICBA-8'	208-230	1	60	1	10.36	48.2	R22	8.2	45	360	215
O3ICBA-12' ²	208-230	1	60	1	7.0	34.2	R22	12.6	45	360	215

² This case uses two of the condensing units listed above.

³ RLA - Running Load Amps.

⁴ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O3ICBA	6	30	47	--- ⁵	---	---	---	---	---

⁵ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELLLENCE IN
ENGINEERING

A DOVER DIVERSIFIED COMPANY

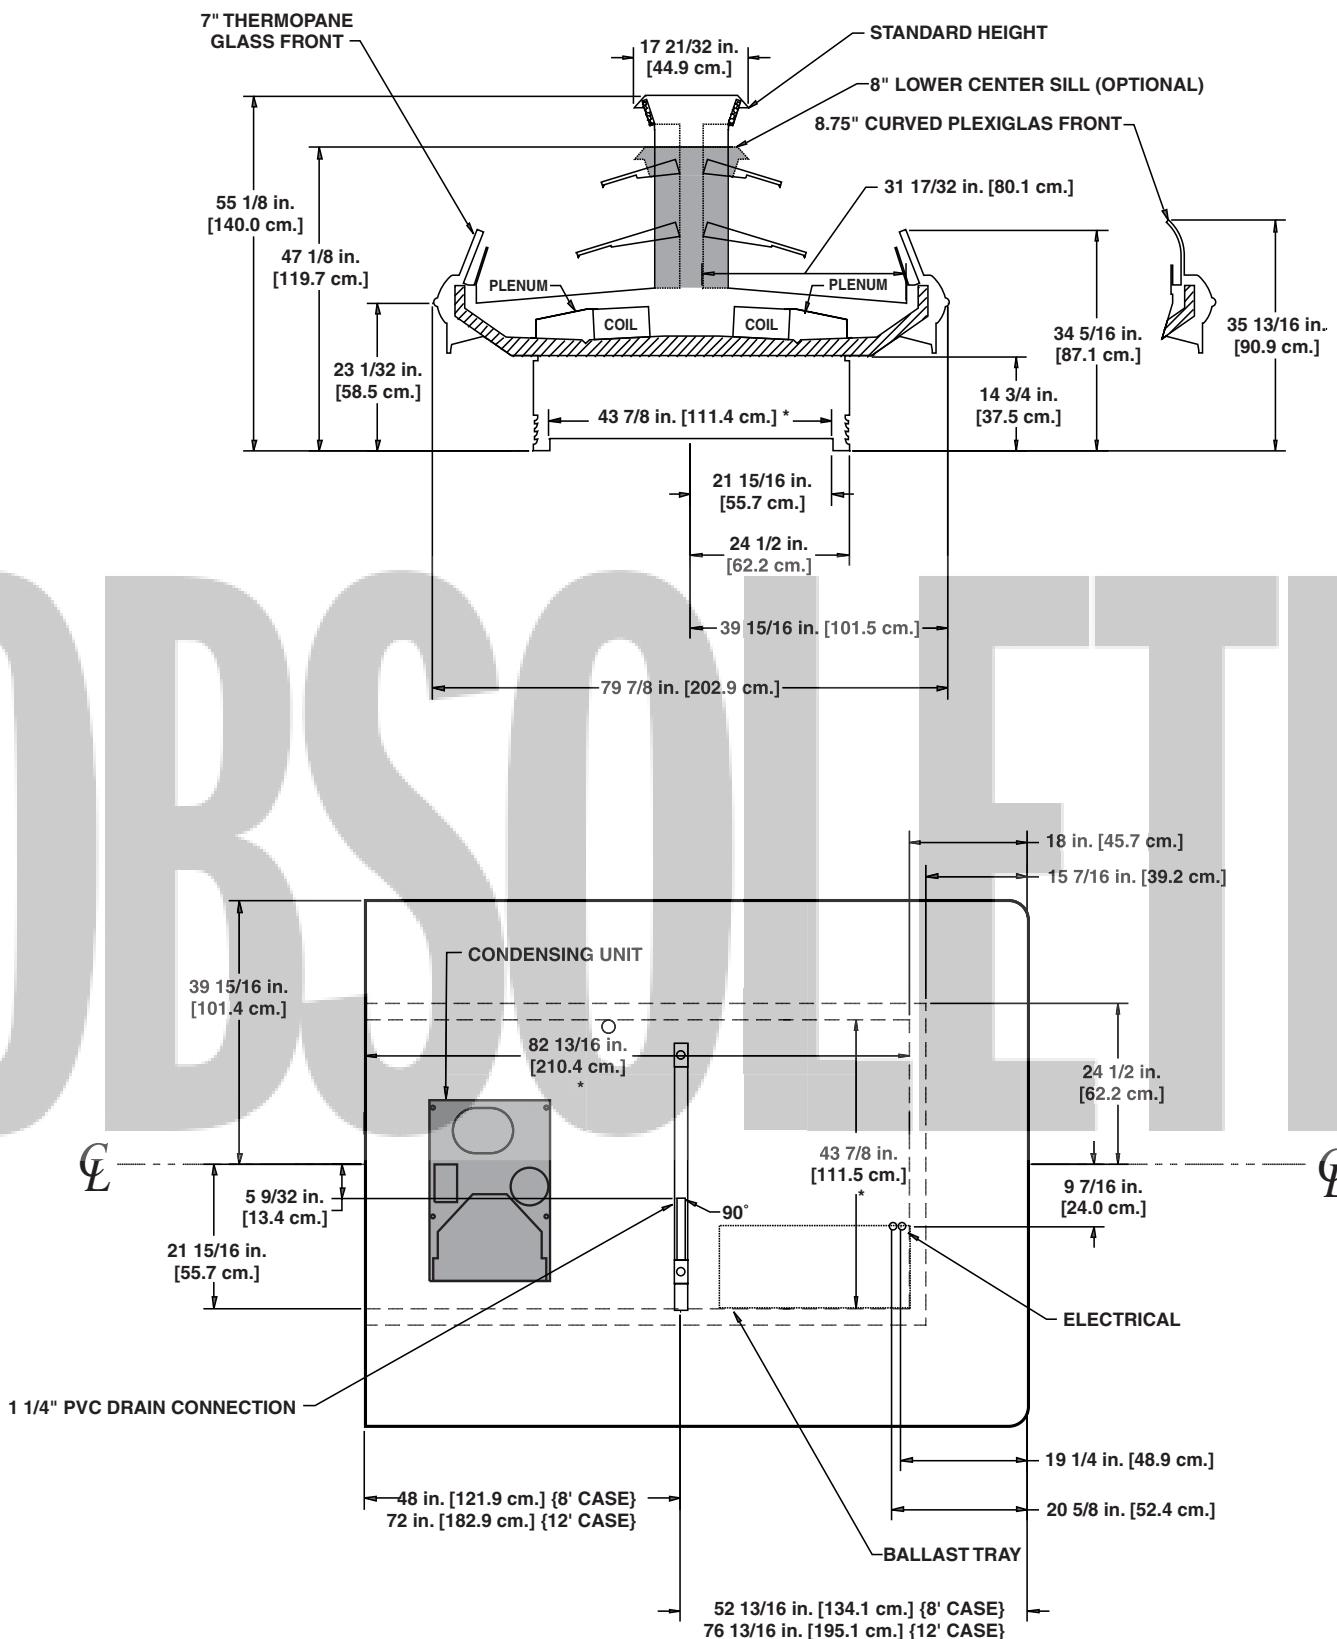

SELF-CONTAINED

Cheese

International Style Self-Contained Mobile Service Deli/Meat/Seafood

Merchandiser

OSIA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
OSIA-4'	120	1	60	NEMA 5L20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
OSIA-4'		12-14	6-8	26	33	34	175

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
OSIA-4'	115	1	60	1/3	7.2	29.0	R134A	2.25	45	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
OSIA-4'	2	45	47	---	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE

A  DOVER DIVERSIFIED COMPANY

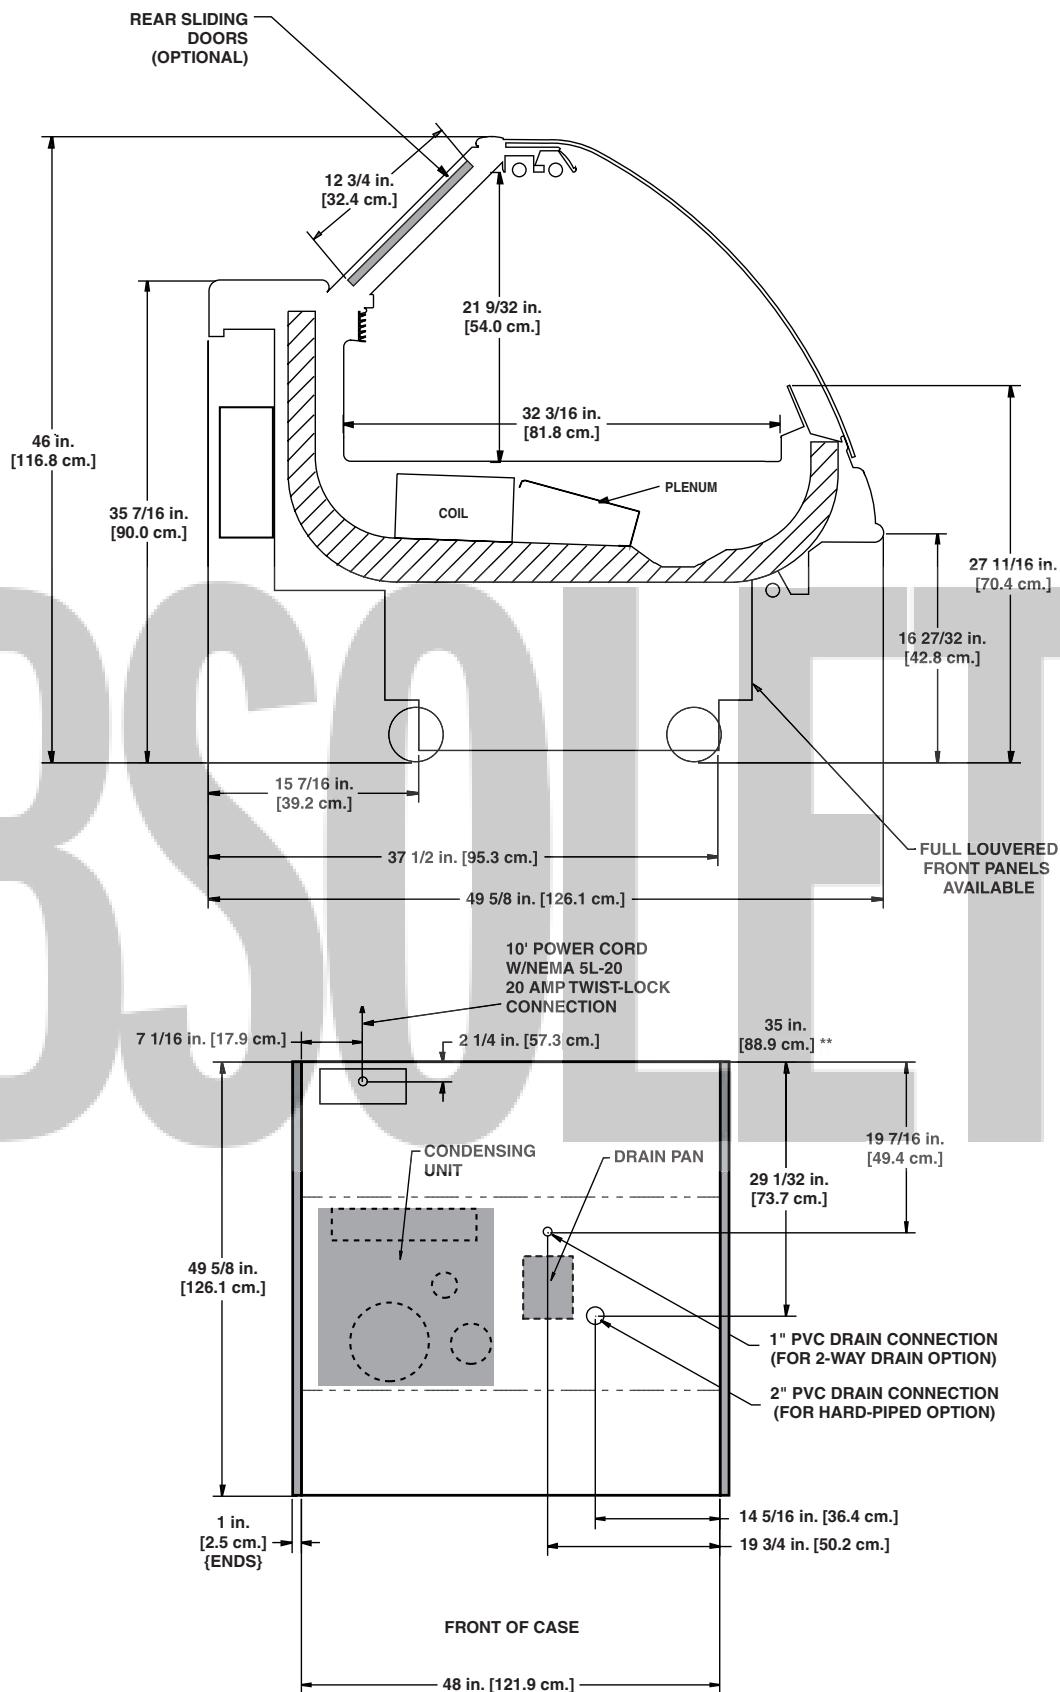

SELF-CONTAINED

Deli/Meat/Seafood

NOTE:

ENDS ADD APPROXIMATELY 1 INCH TO CASE HEIGHT

A DOVER DIVERSIFIED COMPANY

International Style Self-Contained Mobile Service Deli/Meat/Seafood

Merchandiser

O2SIA-4'

System Data

Model	Volts	Phase	Hz	Plug Style	Cord Length
O2SIA-4'	120	1	60	NEMA L5-20	10 ft

Guidelines & Control Settings

Model	24 hr Energy Usage (kWh)	Suction Pressure @ Case Outlet (psig)	Superheat Set Point @ Bulb (°F)	Discharge Air (°F)	Average Product (°F)	Return Air (°F)	Discharge Air Velocity ¹ (FPM)
O2SIA-4'	14.02	16	6-8	24	32	35	540

¹ Average discharge air velocity at peak of defrost.

Condensing Unit Data

Model	Volts	Phase	Frequency (Hz)	HP	RLA ² (amps)	LRA ³ (amps)	Refrig.	Ibs of Refrig.	Max. Evap. Temp. (°F)	High Side Press. (psig)	Low Side Press. (psig)
O2SIA-4'	115	1	60	1/3	7.2	29.0	R134A	2.25	45	440	162

² RLA - Running Load Amps.

³ LRA - Locked Rotor Amps.

Defrost Controls

Model	Electric Defrost			Timed Off Defrost		Hot Gas Defrost		Reverse Air Defrost	
	Defrosts Per Day	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)	Fail-safe (min)	Termination Temp. (°F)
O2SIA-4'	3	45	50	---	---	---	---	---	---

⁴ NOTE: --- not an option on this case model.


Medium Temperature Defrost Schedule

No. Per Day	Hours
1	12 midnight
2	12 am - 12 pm
3	6 am - 2 pm - 10 pm
4	12 - 6 am - 12 - 6 pm

All measurements are taken per CRMA specifications.

HILL PHOENIX
EXCELENCE

A DOVER DIVERSIFIED COMPANY

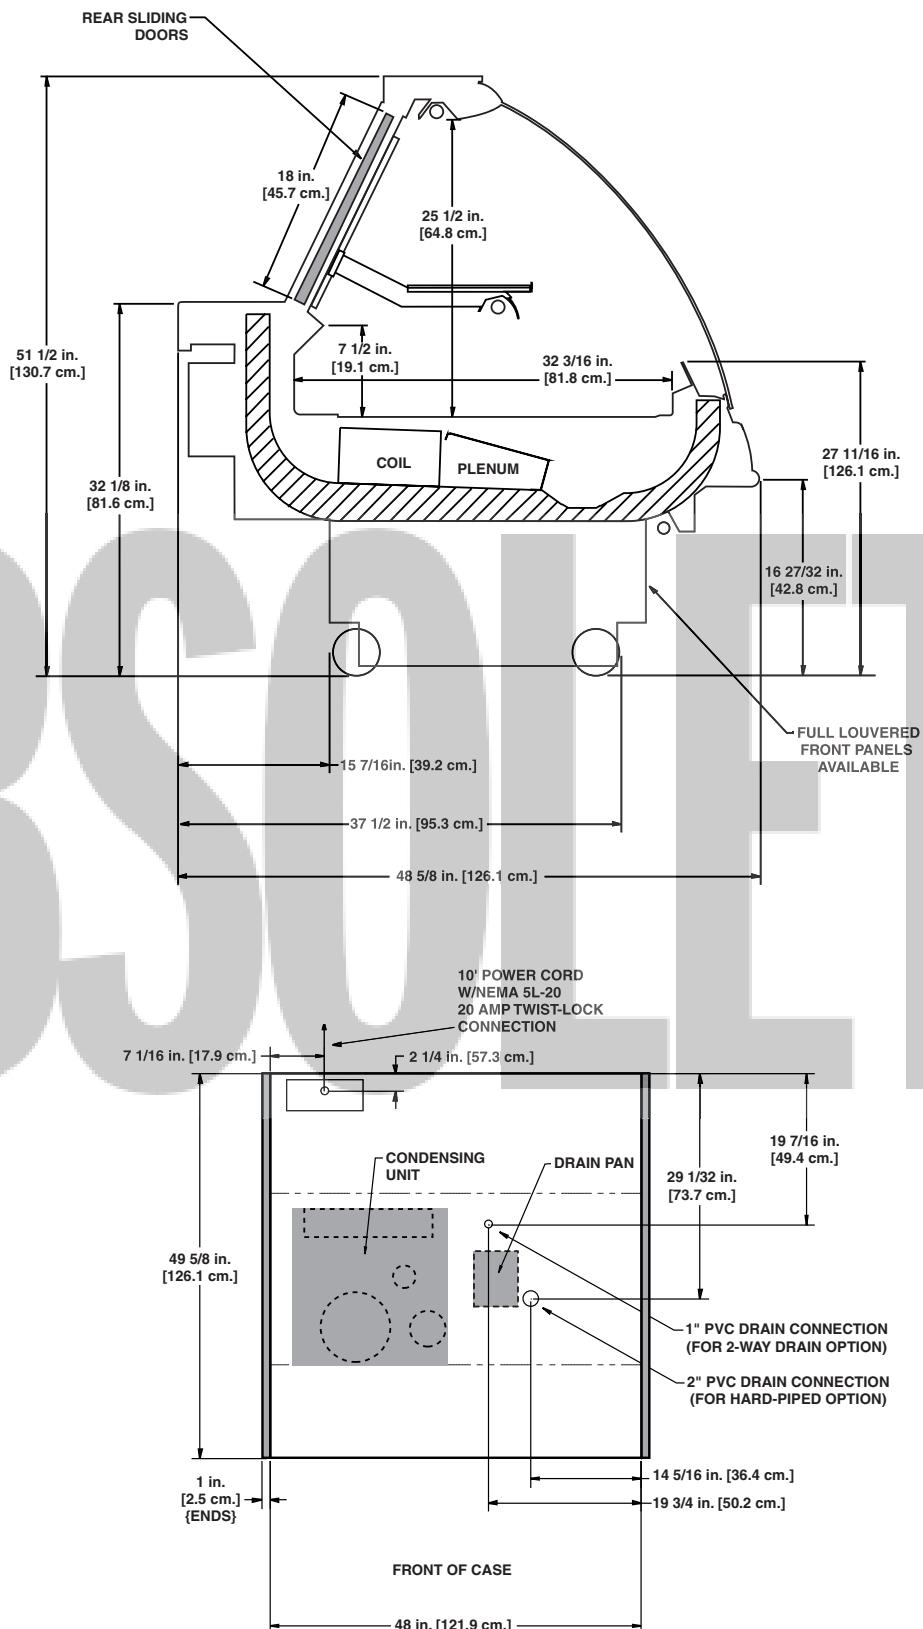
 SELF-CONTAINED
 Deli

OBSOLETE

OBSOLETE

**Curved Case
Merchandisers**

Curved Case Merchandisers

30°, 45°, 60°, & 90° Inside and Outside

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OC	30° I/S	7.5	550	17	1	0.50	30	0.30	20	0.15	18	---	---
	45° I/S	11.3	820	17	1	0.50	30	0.30	20	0.21	25	---	---
	60° I/S	15.1	1090	17	1	0.50	30	0.30	20	0.26	31	---	---
	90° I/S	22.6	1630	17	2	1.00	60	0.60	40	0.39	47	---	---
	30° O/S	6.5	480	17	1	0.50	30	0.30	20	0.04	5	---	---
	45° O/S	9.8	710	17	1	0.50	30	0.30	20	0.05	6	---	---
	60° O/S	13.1	950	17	1	0.50	30	0.30	20	0.08	10	---	---
	90° O/S	19.6	1420	17	2	1.00	60	0.60	40	0.10	12	---	---

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OM	30° I/S	6.6	570	17	1	0.50	30	0.30	20	0.15	18	0.75	90
	45° I/S	9.9	850	17	1	0.50	30	0.30	20	0.21	25	0.75	90
	60° I/S	13.3	1140	17	1	0.50	30	0.30	20	0.26	31	1.50	180
	90° I/S	19.9	1700	17	2	1.00	60	0.60	40	0.39	47	1.50	180
	30° O/S	6.1	530	17	1	0.50	30	0.30	20	0.04	5	0.75	90
	45° O/S	9.2	790	17	1	0.50	30	0.30	20	0.05	6	0.75	90
	60° O/S	12.2	1050	17	1	0.50	30	0.30	20	0.08	10	1.50	180
	90° O/S	18.3	1570	17	2	1.00	60	0.60	40	0.10	12	1.50	180

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OP 39" Rear Sill	30° I/S	6.1	410	27	1	0.50	30	0.30	20	---	---	---	---
	45° I/S	6.2	620	27	1	0.50	30	0.30	20	---	---	---	---
	60° I/S	12.2	820	27	1	0.50	30	0.30	20	---	---	---	---
	90° I/S	18.4	1230	27	2	1.00	60	0.60	40	---	---	---	---
	30° O/S	5.4	360	27	1	0.50	30	0.30	20	---	---	---	---
	45° O/S	8.1	540	27	1	0.50	30	0.30	20	---	---	---	---
	60° O/S	10.8	720	27	1	0.50	30	0.30	20	---	---	---	---
	90° O/S	16.1	1080	27	2	1.00	60	0.60	40	---	---	---	---

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
OP 43" Rear Sill	30° I/S	7.0	580	27	1	0.50	30	0.30	20	---	---	---	---
	45° I/S	10.5	860	27	1	0.50	30	0.30	20	---	---	---	---
	60° I/S	14.0	1150	27	1	0.50	30	0.30	20	---	---	---	---
	90° I/S	21.0	1720	27	2	1.00	60	0.60	40	---	---	---	---
	30° O/S	5.8	480	27	1	0.50	30	0.30	20	---	---	---	---
	45° O/S	8.7	720	27	1	0.50	30	0.30	20	---	---	---	---
	60° O/S	11.6	950	27	1	0.50	30	0.30	20	---	---	---	---
	90° O/S	17.4	1430	27	2	1.00	60	0.60	40	---	---	---	---

Curved Case Merchandisers

30°, 45°, 60°, & 90° Inside and Outside

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
O2UM	30° I/S	7.8	1350	17	1	0.50	30	0.30	20	0.15 ²	18	1.55	186
	45° I/S	11.7	2030	17	1	0.50	30	0.30	20	0.21 ²	25	1.55	186
	60° I/S	15.6	2700	17	1	0.50	30	0.30	20	0.26 ²	31	1.90	288
	90° I/S	23.4	4050	17	2	1.00	60	0.60	40	0.39 ²	47	2.85	342
	30° O/S	6.5	1130	17	1	0.50	30	0.30	20	0.04 ²	5	1.55	186
	45° O/S	9.8	1690	17	1	0.50	30	0.30	20	0.05 ²	6	1.55	186
	60° O/S	13.0	2260	17	1	0.50	30	0.30	20	0.08 ²	10	1.90	288
	90° O/S	19.5	3380	17	2	1.00	60	0.60	40	0.10 ²	12	2.85	342

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
O2.5UM	30° I/S	8.4	1450	17	1	0.50	30	0.30	20	0.15 ²	18	2.35	282
	45° I/S	12.7	2170	17	1	0.50	30	0.30	20	0.21 ²	25	2.35	282
	60° I/S	16.9	2890	17	1	0.50	30	0.30	20	0.26 ²	31	2.55	306
	90° I/S	25.3	4340	17	2	1.00	60	0.60	40	0.39 ²	47	4.45	534
	30° O/S	6.9	1190	17	1	0.50	30	0.30	20	0.04 ²	5	2.35	282
	45° O/S	10.4	1780	17	1	0.50	30	0.30	20	0.05 ²	6	2.35	282
	60° O/S	13.8	2370	17	1	0.50	30	0.30	20	0.08 ²	10	2.55	306
	90° O/S	20.7	3550	17	2	1.00	60	0.60	40	0.10 ²	12	4.45	534

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
O3UM	30° I/S	9.3	1510	17	1	0.50	30	0.30	20	0.15 ²	18	2.35	282
	45° I/S	14.0	2260	17	1	0.50	30	0.30	20	0.21 ²	25	2.35	282
	60° I/S	18.7	3020	17	1	0.50	30	0.30	20	0.26 ²	31	2.55	306
	90° I/S	28.0	4520	17	2	1.00	60	0.60	40	0.39 ²	47	4.45	534
	30° O/S	7.5	1220	17	1	0.50	30	0.30	20	0.04 ²	5	2.35	282
	45° O/S	11.3	1830	17	1	0.50	30	0.30	20	0.05 ²	6	2.35	282
	60° O/S	15.1	2440	17	1	0.50	30	0.30	20	0.08 ²	10	2.55	306
	90° O/S	22.6	3650	17	2	1.00	60	0.60	40	0.10 ²	12	4.45	534

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
O3.5UM	30° I/S	10.4	1880	17	1	0.50	30	0.30	20	0.15 ²	18	3.15	378
	45° I/S	15.7	2820	17	1	0.50	30	0.30	20	0.21 ²	25	3.15	378
	60° I/S	20.9	3760	17	1	0.50	30	0.30	20	0.26 ²	31	3.20	384
	90° I/S	31.3	5640	17	2	1.00	60	0.60	40	0.39 ²	47	6.05	726
	30° O/S	8.2	1480	17	1	0.50	30	0.30	20	0.04 ²	5	3.15	378
	45° O/S	12.3	2210	17	1	0.50	30	0.30	20	0.05 ²	6	3.15	378
	60° O/S	16.4	2950	17	1	0.50	30	0.30	20	0.08 ²	10	3.20	384
	90° O/S	24.6	4420	17	2	1.00	60	0.60	40	0.10 ²	12	6.05	726

CURVED CASE

Curved Case Merchandisers

30°, 45°, 60°, & 90° Inside and Outside

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O4UM	30° I/S	12.1	2040	17	1	0.50	30	0.30	20	0.15 ²	18	3.15	378
	45° I/S	18.2	3060	17	1	0.50	30	0.30	20	0.21 ²	25	3.15	378
	60° I/S	24.3	4080	17	1	0.50	30	0.30	20	0.26 ²	31	3.20	384
	90° I/S	36.4	6120	17	2	1.00	60	0.60	40	0.39 ²	47	6.05	726
	30° O/S	9.4	1580	17	1	0.50	30	0.30	20	0.04 ²	5	3.15	378
	45° O/S	14.0	2360	17	1	0.50	30	0.30	20	0.05 ²	6	3.15	378
	60° O/S	18.7	3150	17	1	0.50	30	0.30	20	0.08 ²	10	3.20	384
	90° O/S	28.1	4720	17	2	1.00	60	0.60	40	0.10 ²	12	6.05	726

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5UM	30° I/S	13.2	2090	17	1	0.50	30	0.30	20	0.15 ²	18	3.95	474
	45° I/S	19.8	3130	17	1	0.50	30	0.30	20	0.21 ²	25	3.95	474
	60° I/S	26.3	4170	17	1	0.50	30	0.30	20	0.26 ²	31	3.85	462
	90° I/S	39.5	6260	17	2	1.00	60	0.60	40	0.39 ²	47	7.65	918
	30° O/S	10.1	1600	17	1	0.50	30	0.30	20	0.04 ²	5	3.95	474
	45° O/S	15.1	2390	17	1	0.50	30	0.30	20	0.05 ²	6	3.95	474
	60° O/S	20.1	3190	17	1	0.50	30	0.30	20	0.08 ²	10	3.85	462
	90° O/S	30.2	4780	17	2	1.00	60	0.60	40	0.10 ²	12	7.65	918

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5DM Deli	30° I/S	21.3	2020	17	1	0.50	30	0.30	20	---	---	5.00	600
	45° I/S	32.0	3030	17	1	0.50	30	0.30	20	---	---	5.00	600
	60° I/S	42.6	4030	17	1	0.50	30	0.30	20	---	---	5.25	630
	90° I/S	64.0	6050	17	2	1.00	60	0.60	40	---	---	10.00	1200
	30° O/S	20.5	1940	17	1	0.50	30	0.30	20	---	---	5.00	600
	45° O/S	30.8	2910	17	1	0.50	30	0.30	20	---	---	5.00	600
	60° O/S	41.0	3880	17	1	0.50	30	0.30	20	---	---	5.25	630
	90° O/S	61.5	5820	17	2	1.00	60	0.60	40	---	---	10.00	1200

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts		120 Volts		120 Volts		120 Volts	
						Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
O5DM Dairy	30° I/S	21.3	1890	22	1	0.50	30	0.30	20	---	---	5.00	600
	45° I/S	32.0	2840	22	1	0.50	30	0.30	20	---	---	5.00	600
	60° I/S	42.6	3780	22	1	0.50	30	0.30	20	---	---	5.25	630
	90° I/S	64.0	5670	22	2	1.00	60	0.60	40	---	---	10.00	1200
	30° O/S	20.5	1820	22	1	0.50	30	0.30	20	---	---	5.00	600
	45° O/S	30.8	2730	22	1	0.50	30	0.30	20	---	---	5.00	600
	60° O/S	41.0	3640	22	1	0.50	30	0.30	20	---	---	5.25	630
	90° O/S	61.5	5460	22	2	1.00	60	0.60	40	---	---	10.00	1200

Curved Case Merchandisers

30°, 45°, 60°, & 90° Inside and Outside

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
OHM	30° I/S	17.3	1780	17	1	0.50	30	0.30	20	0.04	5	3.95	474
	45° I/S	26.0	2660	17	1	0.50	30	0.30	20	0.10	12	3.95	474
	60° I/S	34.6	3550	17	1	0.50	30	0.30	20	0.34	41	4.10	492
	90° I/S	52.0	5320	17	2	1.00	60	0.60	40	0.32	38	7.90	948
	30° O/S	16.2	1660	17	1	0.50	30	0.30	20	0.10	12	3.95	474
	45° O/S	24.2	2480	17	1	0.50	30	0.30	20	0.14	17	3.95	474
	60° O/S	32.3	3310	17	1	0.50	30	0.30	20	0.18	22	4.10	492
	90° O/S	48.5	4960	17	2	1.00	60	0.60	40	0.28	34	7.90	948


Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
OHMH	30° I/S	18.3	1980	12	1	0.50	30	0.30	20	0.08	10	4.75	570
	45° I/S	27.4	2970	12	1	0.50	30	0.30	20	0.20	24	4.75	570
	60° I/S	36.6	3960	12	1	0.50	30	0.30	20	0.68	82	4.75	570
	90° I/S	54.9	5940	12	2	1.00	60	0.60	40	0.64	77	9.50	1140
	30° O/S	15.9	1730	12	1	0.50	30	0.30	20	0.20	24	4.75	570
	45° O/S	23.9	2590	12	1	0.50	30	0.30	20	0.28	34	4.75	570
	60° O/S	31.8	3450	12	1	0.50	30	0.30	20	0.36	44	4.75	570
	90° O/S	47.8	5170	12	2	1.00	60	0.60	40	0.56	68	9.50	1140

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
OHP	30° I/S	17.2	1650	22	1	0.50	30	0.30	20	---	---	3.95	474
	45° I/S	25.8	2470	22	1	0.50	30	0.30	20	---	---	3.95	474
	60° I/S	34.4	3300	22	1	0.50	30	0.30	20	---	---	4.10	492
	90° I/S	51.6	4940	22	2	1.00	60	0.60	40	---	---	7.90	948
	30° O/S	16.1	1550	22	1	0.50	30	0.30	20	---	---	3.95	474
	45° O/S	24.2	2320	22	1	0.50	30	0.30	20	---	---	3.95	474
	60° O/S	32.3	3090	22	1	0.50	30	0.30	20	---	---	4.10	492
	90° O/S	48.4	4640	22	2	1.00	60	0.60	40	---	---	7.90	948

Case Model	Wedge Model	Volume (ft³)	BTUH ¹	Suction Temp. (°F)	Fans per Case	Standard Fans		High Efficiency Fans		Anti-Condensate Heaters		Maximum Lighting	
						120 Volts	120 Volts	Amps	Watts	Amps	Watts	Amps	Watts
OPHP	30° I/S	18.3	17	1860	1	0.50	30	0.30	20	0.04	5	4.75	570
	45° I/S	27.5	17	2790	1	0.50	30	0.30	20	0.10	12	4.75	570
	60° I/S	36.7	17	3720	1	0.50	30	0.30	20	0.34	41	4.75	570
	90° I/S	55.0	17	5580	2	1.00	60	0.60	40	0.32	38	9.50	1140
	30° O/S	15.8	17	1610	1	0.50	30	0.30	20	0.10	12	4.75	570
	45° O/S	23.7	17	2410	1	0.50	30	0.30	20	0.14	17	4.75	570
	60° O/S	31.6	17	3210	1	0.50	30	0.30	20	0.18	22	4.75	570
	90° O/S	47.4	17	4810	2	1.00	60	0.60	40	0.28	34	9.50	1140


30° Curved Case

HILL PHOENIXTM
E X C E L L E N C E

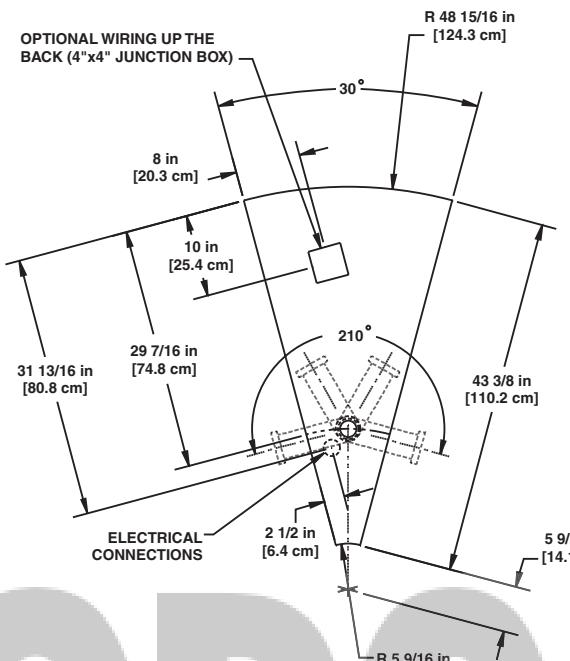


FRONT OF CASE

30° INSIDE (11" BASEFRAME)

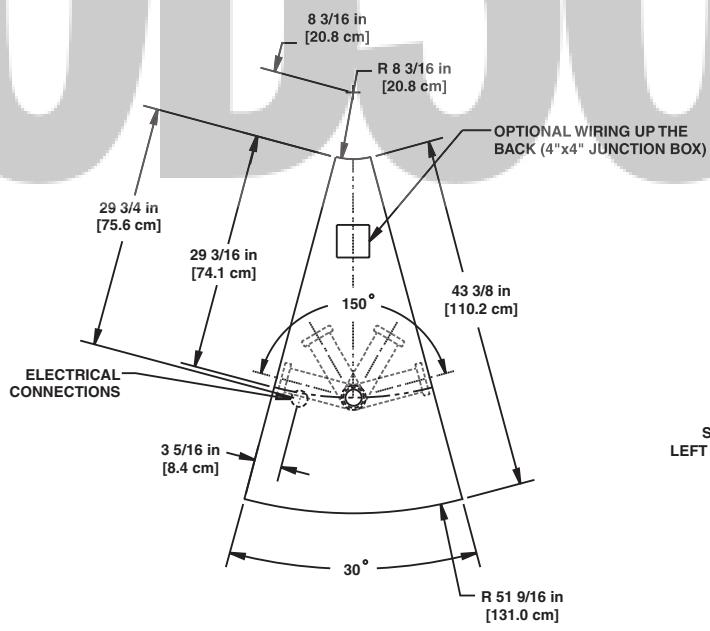


FRONT OF CASE

30° OUTSIDE (11" BASEFRAME)

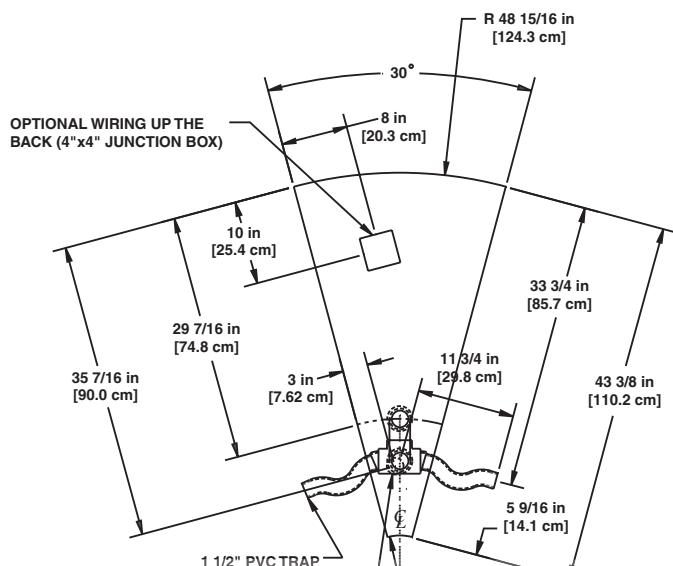

FRONT OF CASE

30° INSIDE (5 5/32" BASEFRAME)

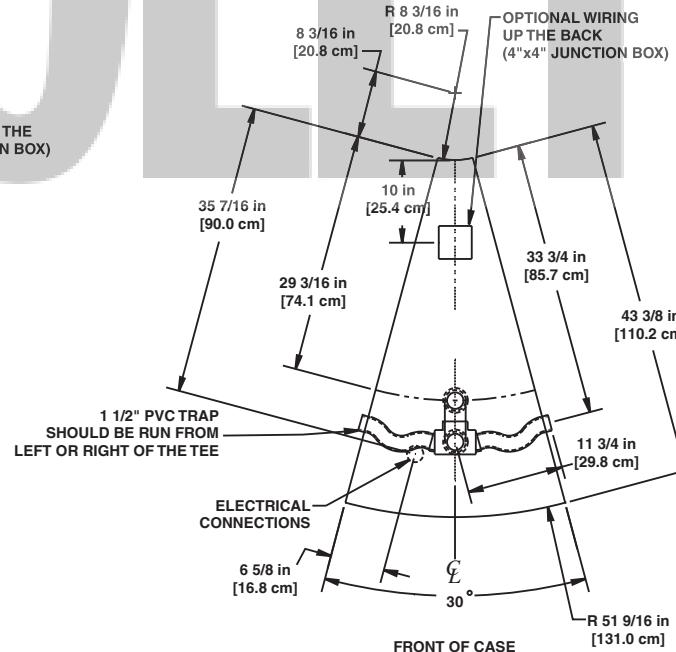

FRONT OF CASE


30° OUTSIDE (5 5/32" BASEFRAME)

NOTE: Curved case cross sections are the same as the standard model


A DOVER DIVERSIFIED COMPANY

45° Curved Case


HILL PHOENIX
EXCELLENCE™

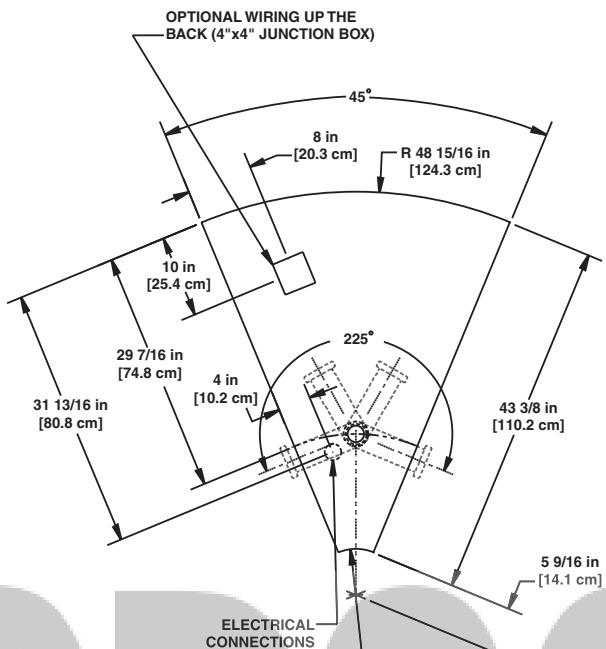


**45° INSIDE
(11" BASEFRAME)**

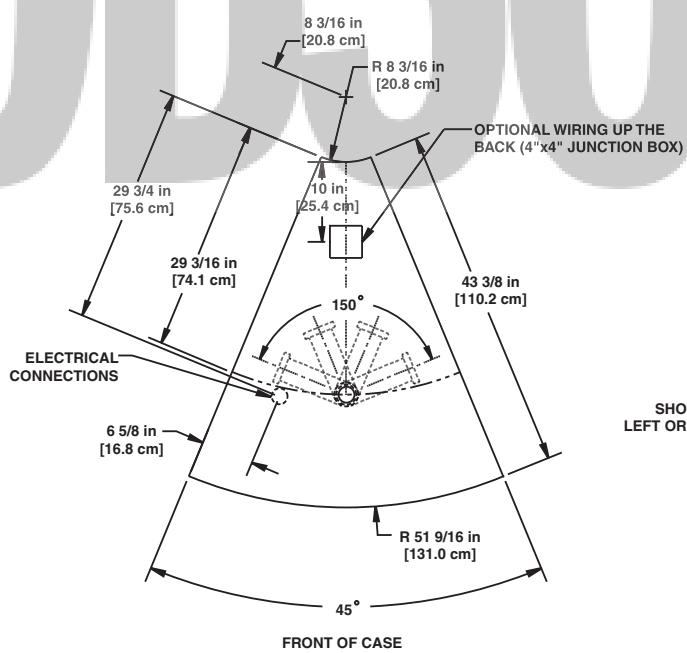

**45° OUTSIDE
(11" BASEFRAME)**

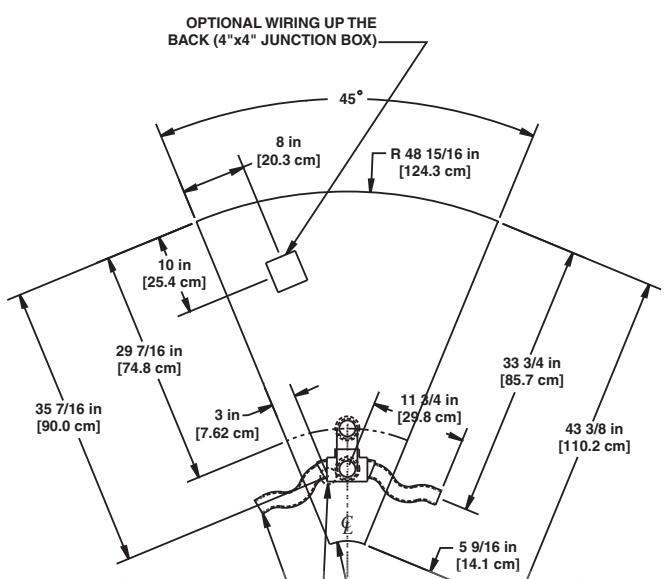


**45° INSIDE
(5 5/32" BASEFRAME)**

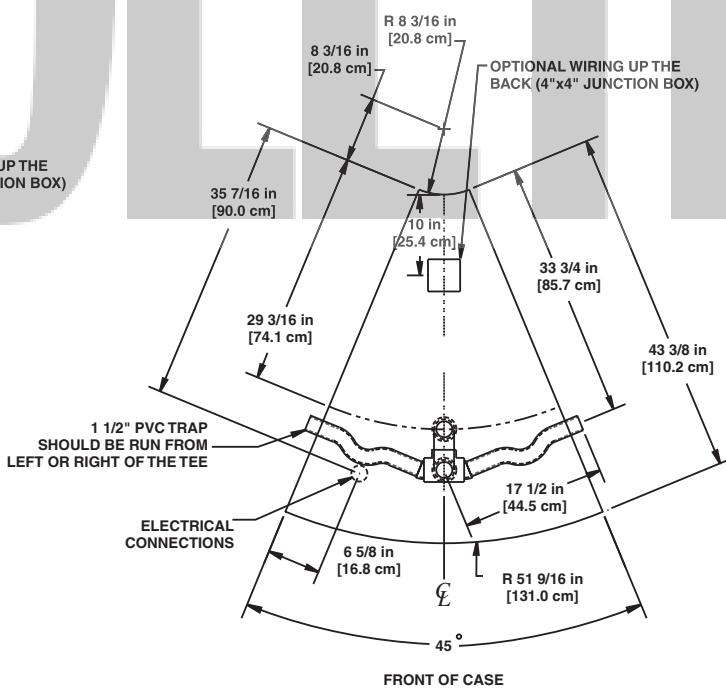


**45° OUTSIDE
(5 5/32" BASEFRAME)**

NOTE: Curved case cross sections are the same as the standard model


A DOVER DIVERSIFIED COMPANY

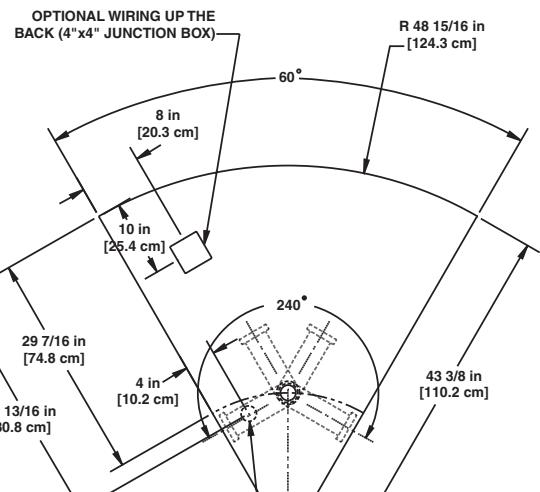


**60° INSIDE
(11" BASEFRAME)**

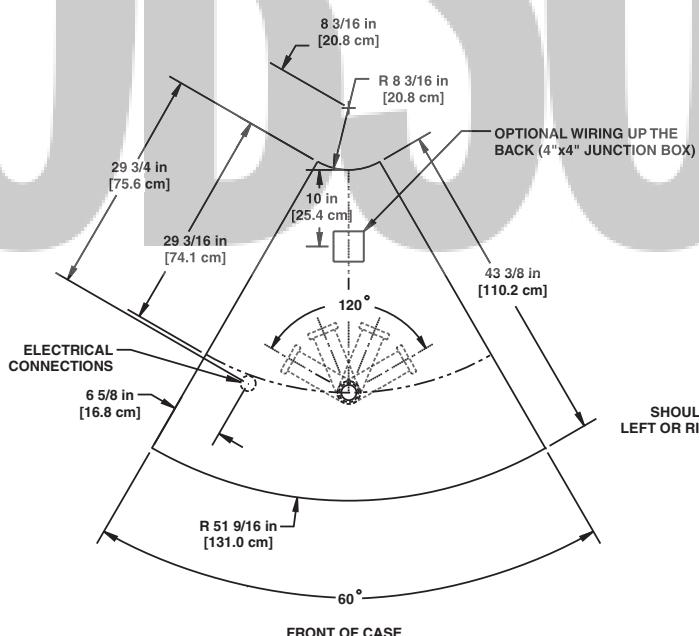

**.60° OUTSIDE
(11" BASEFRAME)**

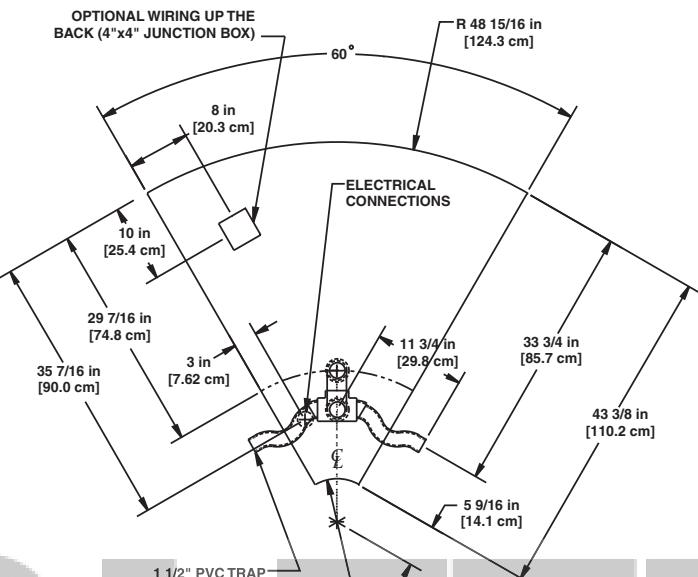


**60° INSIDE
(5 5/32" BASEFRAME)**

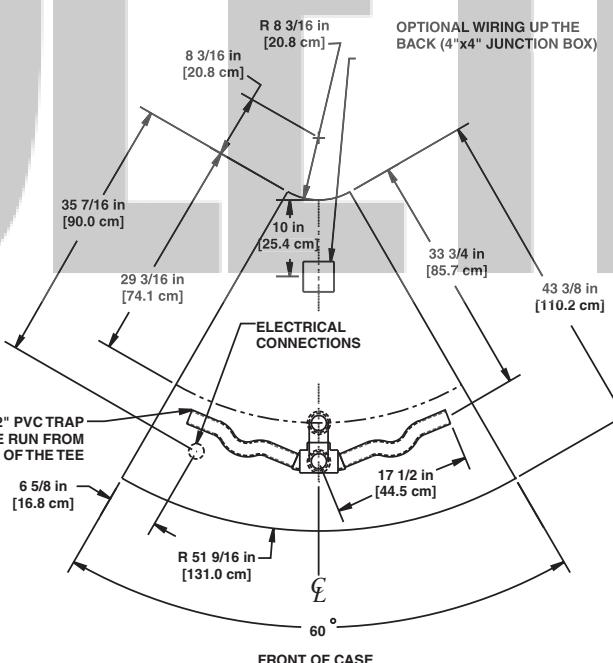


**60° OUTSIDE
(5 5/32" BASEFRAME)**

NOTE: Curved case cross sections are the same as the standard model


A DOVER DIVERSIFIED COMPANY

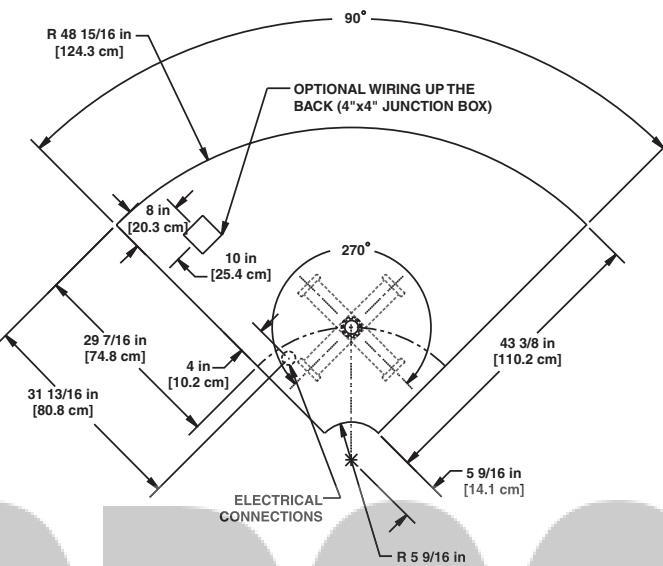


**90° INSIDE
(11" BASEFRAME)**

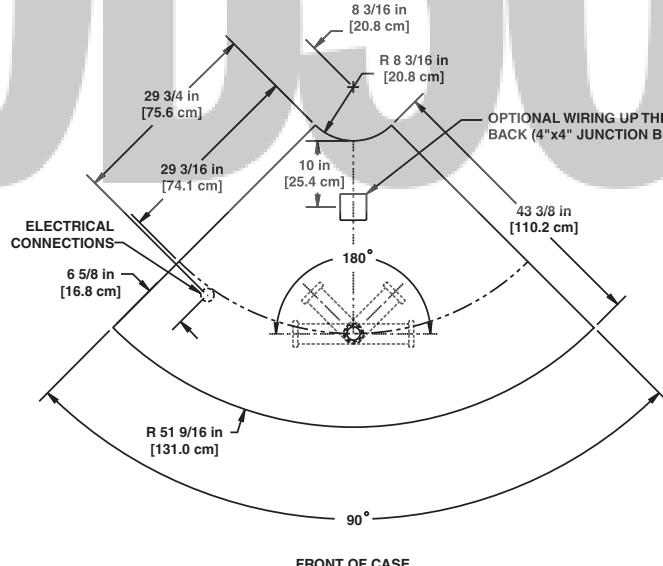

**90° OUTSIDE
(11" BASEFRAME)**

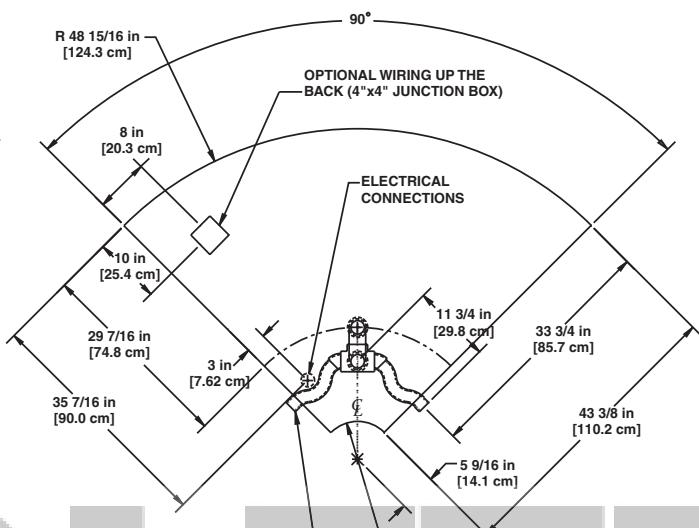

**90° INSIDE
(5 5/32" BASEFRAME)**

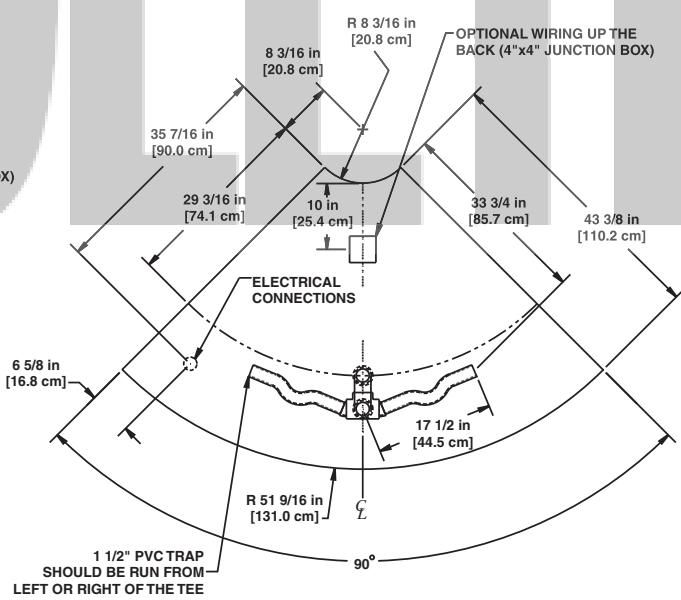

**90° OUTSIDE
(5 5/32" BASEFRAME)**

CURVED CASE

NOTE: Curved case cross sections are the same as the standard model

A DOVER DIVERSIFIED COMPANY

Index

BB	108	ON2UM	26
CURVED CASES	261-269	ON2.5UM	34
MDCA-4'	214	ON3UM	44
MMCA-4'	216	ON3.5UM	52
O2SIA-4'	258	ON5DM	72
O2UM	30	ONHM	90
O2.5UM	38	ONHP	96
O2.5UMA-4'	224	ONIM	132
O3IC	156	ONIMA	242
O3ICA	252	ONIMB	132
O3ICB	156	ONIMBA	244
O3ICBA	254	ONIZ	144
O3IM	162	ONIZG	144
O3IMB	162	ONNA-47"	236
O3IP	168	ONRB	112
O3IPB	168	ONRBH	114
O3UM	48	ONRZ	120
O3UMA-4'	226	ONRZH	122
O3.5UD	60	ONU	102
O3.5UM	56	ONUA	238
O4UM	62	ONZ	12
O5DM	74	OP	14
O5DMA	228	OPA	218
O5DMH	80	ORB	116
O5DR	84	ORBH	118
O5UM	66	ORDR	104
O5Z	88	OREZ	128
O6UM	70	ORZ	124
OC	2	ORZH	126
OGM	180	OSA	172
OHM	92	OSAG	180
OHMH	94	OSAH	206
OHP	98	OSI	188
OHPH	100	OSIA-4'	256
OIM	136	OSIF	194
OIMA	246	OSIH	210
OIMB	136	OSIO	18
OIMBA	248	OSIOA-4'	220
OIMBB	136	OSIOPA-4'	222
OIP	140	OSIOZA-4'	224
OIPA	250	OSM	176
OIPB	140	OWEZ	152
OIPBB	140	OWEZG	152
OIZ	148	OWIZ	150
OLF	198	OWIZG	150
OLFG	202	OWSI	192
OM	4	OWSIO	22
OMZ	8	UPA-8'	226
OMZD	10		

OBSOLETE

OBSOLETE

804-526-4455

HILL PHOENIX
E X C E L L E N C E™

A  DOVER DIVERSIFIED COMPANY

1925 Ruffin Mill Road, Colonial Heights, VA 23834 • 709 Sigman Road, Conyers, GA 30013 • 1258 Quarry Lane, Suite G, Pleasanton, CA 94566 • 3601 Walnut Avenue, Chino, CA 91710
Due to our commitment to continuous improvement all specifications are subject to change without notice.

Hill Phoenix is a Sustaining Member of the American Society of Quality.
Visit our web site at www.hillphoenix.com

ASH0010

