


GENERAL NOTES

- "-" Indicates that the feature is not an option on this case model and/or available at this time.



SHIPPING WEIGHT	
Case	Weight
OWEZV	---

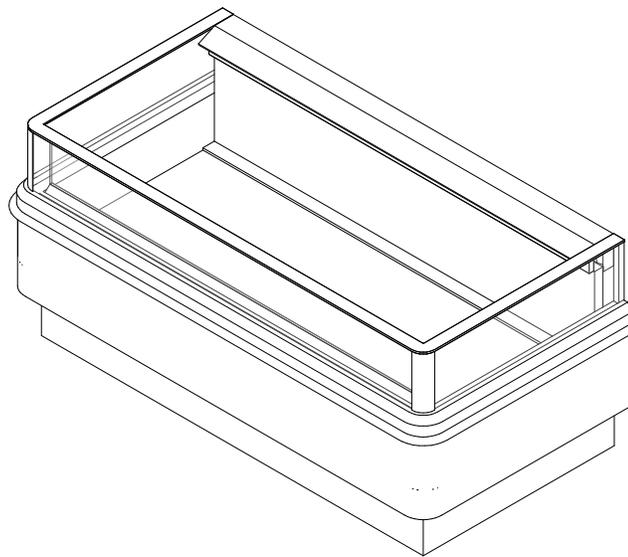

ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWEZV

Rev. Date	Rev. #	Rev. Title
11-21-19	4	DATA UPDATE
7-23-18	3	SECTION UPDATE

ELECTRICAL DATA																
Fans Per Case	High Efficiency Fans		Anti Condensate Heaters								Drain Heater		Defrost Heaters			
	120 Volt		Solid Front		7" Glass Front		12" Glass Front		17" Glass Front		120 Volts		208 Volts		240 Volts	
	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
	2	0.15	8	0.81	88	1.09	131	1.12	134	2.15	258	0.13	15	8.65	1800	9.98

GUIDELINES AND CONTROL SETTINGS						
Application	BTUH/case		Superheat Set Point @ Bulb (°F)	Evaporator (°F)	Discharge Air (°F)	Discharge Air Velocity (FPM)
	Solid/Glass Front					
	Conventional	Parallel				
Frozen Food	2090	2055	3 - 5	-12	-6	200
Ice Cream	2235	2185	3 - 5	-22	-16	200
Medium Temp	1674	1665	6 - 8	17	27	200

DEFROST CONTROLS									
Application	Defrosts Per Day	Run-Off Time (Min)		Electrical Defrost		Timed-Off Defrost		Hot Gas Defrost	
		Electric	Hot Gas	Fail Safe (Min)	Termination Temp (°F)	Fail-Safe (Min)	Termination Temp (°F)	Fail Safe (Min)	Termination Temp (°F)
		Frozen Food/ Ice Cream	1	5	13 - 15	60	49	---	---
Medium Temp	1	0	0	35	49	32	42	10	60

NOTES

- Listed discharge air velocity represents the average velocity at the peak of defrost.
- Temperature and defrost settings listed below are recommended start-up settings. Final operational settings may need to be adjusted for the store conditions in which the case operates.
- The recommended evaporator temperatures may need to be adjusted based on system setup, store conditions, etc. The minimum recommended evaporator temperature is 4°F below the listed evaporator temperature.
- "- - -" Indicates that the feature is not an option on this case model and/or available at this time.



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWEZV

Rev. Date	Rev. #	Rev. Title
11-21-19	4	DATA UPDATE
7-23-18	3	SECTION UPDATE



A DOVER COMPANY


SOLID/GLASS FRONT OPTIONS					
<u>SOLID</u>	<u>CLASSIC 2</u>	<u>FUSION</u>			
<u>17" STREAMLYNE</u>	<u>17" FLAT</u>	<u>12" STREAMLYNE</u>	<u>12" FLAT</u>	<u>7" STREAMLYNE</u>	<u>7" FLAT</u>
CASE CONFIGURATIONS					
<u>STAND ALONE ENDCAP CASE WITH FLAT END</u>	<u>SINGLE UNITIZED ENDCAP CASE WITH CASE JOINT</u>	<u>BACK TO BACK END CAP CASES</u>			



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWEZV

Rev. Date	Rev. #	Rev. Title
11-21-19	4	DATA UPDATE
7-23-18	3	SECTION UPDATE

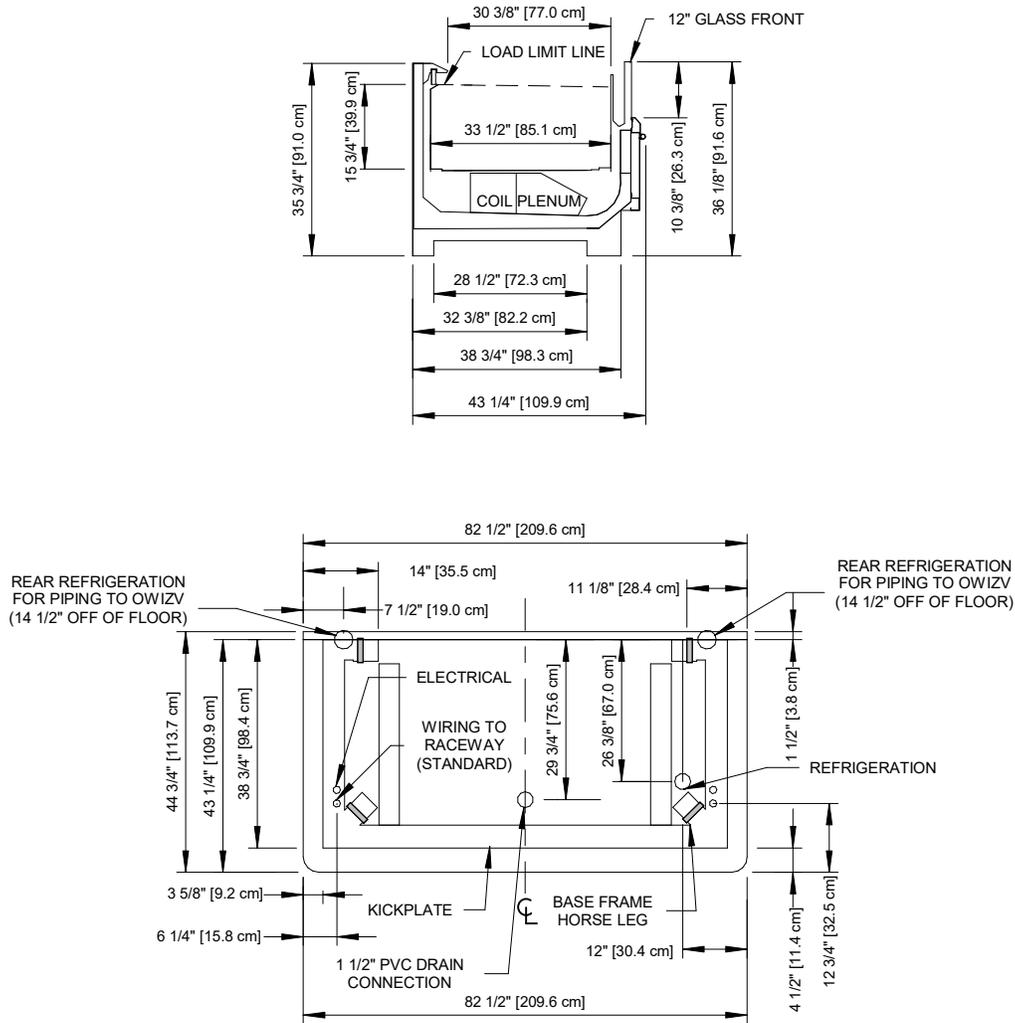

NOTES

- * : STUB-UP AREA
- ** : RECOMMENDED SETUP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

- Suction line - 7/8", Liquid line - 1/2"
- Flat end-panel required when case is standalone



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72-2005 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWEZV

Rev. Date	Rev. #	Rev. Title
11-21-19	4	DATA UPDATE
7-23-18	3	SECTION UPDATE