


**GENERAL NOTES**

- "---" indicates the feature is not an option for this model and/or the data is not yet available.



SHIPPING WEIGHT	
Case	Weight
OWZGG	---

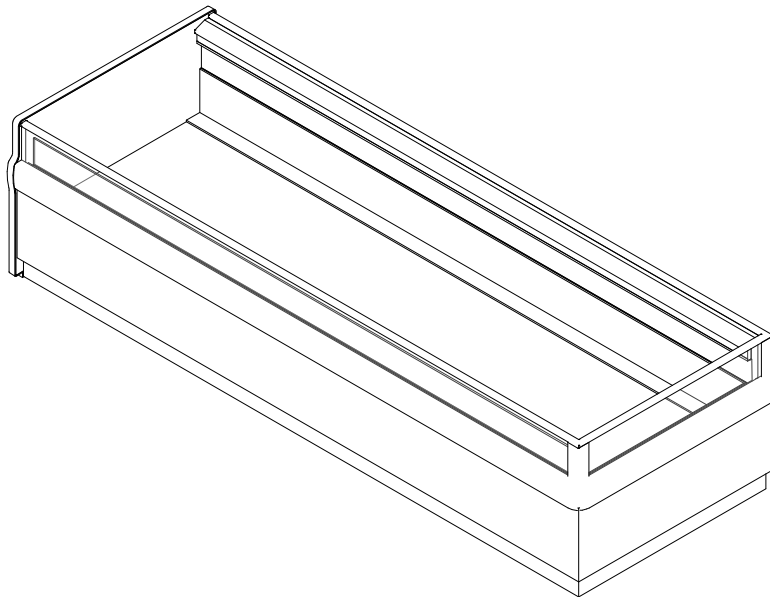

ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

**OWZGG**

Rev. Date	Rev. #	Rev. Title
10-21-22	6	DATA UPDATE
4-25-22	5	NOTES UPDATE

ELECTRICAL DATA									
Case Length	Fans Per Case	High Efficiency Fans		Anti Condensate Heaters		Defrost Heaters			
		120 Volt		120 Volts		208 Volts		240 Volts	
		Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
6'	2	0.12	9.0	1.78	213	5.77	1200	6.66	1598
8'	2	0.12	9.0	2.05	246	7.69	1600	8.87	2130
10'	3	0.18	14.0	2.44	293	9.62	2000	11.10	2663
12'	3	0.18	14.0	2.61	313	11.54	2400	13.31	3195

GUIDELINES AND CONTROL SETTINGS					
BTUH/ft		Superheat Set Point @ Bulb (°F)	Evaporator (°F)	Discharge Air (°F)	Discharge Air Velocity (FPM)
Conventional	Parallel				
543	496	3 - 5	-22	-15	345

DEFROST CONTROLS					
Defrosts Per Day	Run Off Time (Min)	Electric Defrost		Hot Gas Defrost	
		Fail Safe (Min)	Termination Temp (°F)	Fail Safe (Min)	Termination Temp (°F)
3	5	50	45	20	60

**NOTES:**

- "---" indicates the feature is not an option for this model and/or the data is not yet available.
- Listed discharge air velocity represents the average velocity at the peak of defrost.
- Temperature and defrost settings listed above are recommended start-up settings. Final operational settings may need to be adjusted for the store conditions in which the case operates.
- The recommended evaporator temperatures may need to be adjusted based on system setup, store conditions, etc. The minimum recommended evaporator temperature is 4°F below the listed evaporator temperature.
- Discharge air temperature values represent readings taken within the upper air channel immediately behind/upstream of the honeycomb.



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

**OWZGG**

Rev. Date	Rev. #	Rev. Title
10-21-22	6	DATA UPDATE
4-25-22	5	NOTES UPDATE

**Hillphoenix**  
A DOVER COMPANY

GLASS FRONT OPTIONS	END OPTIONS	
<p style="text-align: center;"><u>10" GLASS STREAMLINE FRONT</u></p>	<p style="text-align: center;"><u>SINGLE WRAP END</u></p>	<p style="text-align: center;"><u>DOUBLE WRAP END</u></p>
<p style="text-align: center;"><u>10" GLASS FLAT FRONT</u></p>	<p style="text-align: center;"><u>SINGLE FLAT END</u></p>	<p style="text-align: center;"><u>DOUBLE FLAT END</u></p>
<p style="text-align: center;"><u>SINGLE WRAP, SINGLE FLAT END</u></p>	<p style="text-align: center;"><u>SINGLE JOINT (BUTT)</u></p>	<p style="text-align: center;"><u>DOUBLE JOINT (BUTT)</u></p>




ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWZGG

Rev. Date	Rev. #	Rev. Title
10-21-22	6	DATA UPDATE
4-25-22	5	NOTES UPDATE

**Hillphoenix**  
A DOVER COMPANY

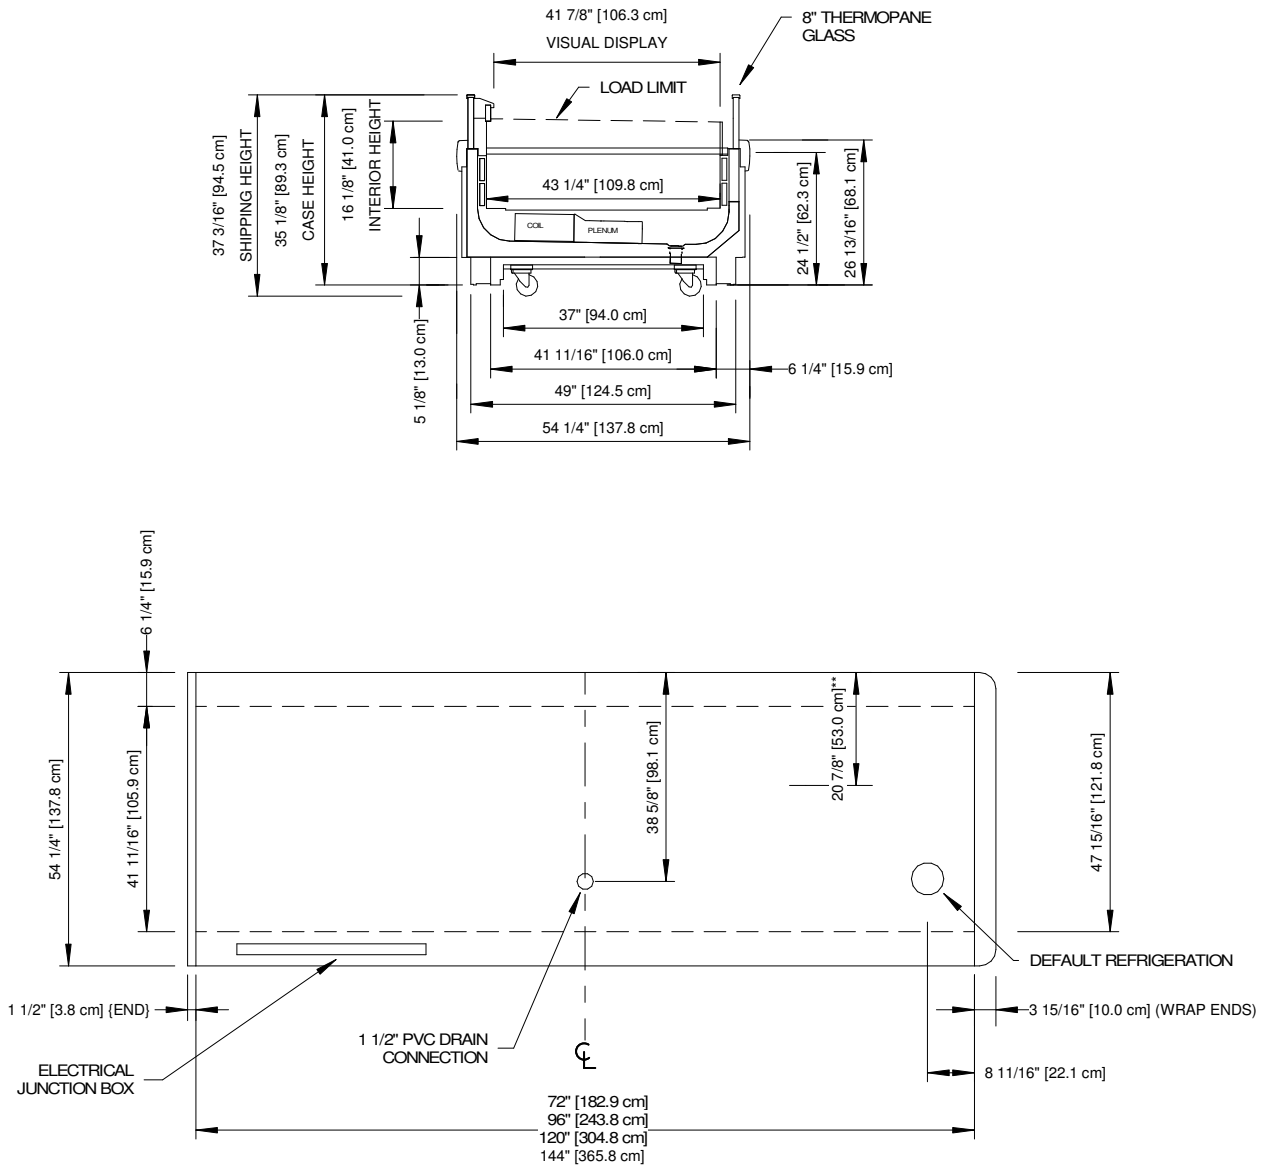

### NOTES

- \* :STUB-UP AREA
- \*\* :RECOMMENDED STUB-UP CENTERLINE FOR ELECTRICAL AND HUB DRAINS

• Ends add approximately 1" to case height.



ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS.

OWZGG

Rev. Date	Rev. #	Rev. Title
10-21-22	6	DATA UPDATE
4-25-22	5	NOTES UPDATE

**Hillphoenix**  
A DOVER COMPANY