
## **GENERAL NOTES:**

- "---" Indicates that the feature is not an option on this case model and/or the data is not yet available at this time.
- 7 13/16" toekick height (optional)



SHIPPING WEIGHT			
Case Weight			
PF-54-R			



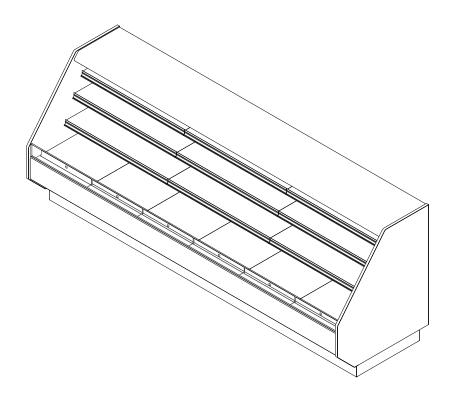



Intertek Intertek

ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

PF-54-R

Rev. Date	Rev.#	Rev. Title
03-10-22	3	DATA UPDATE
10-07-20	2	ENDVIEW UPDATE



ELECTRICAL DATA									
	Fans	_	fficiency ans	_	ndensate ans		ain aters		l Defrost iters
Case	Per	120	Volts	120	Volts	120	Volts	208	Volts
Length	Case	Amps	Watts	Amps	Watts	Amps	Watts	Amps	Watts
4'	2	0.60	72.0						
6'	3	0.90	108.0						
8'	3	0.90	108.0						
10'	4	1.20	144.0						
12'	4	1.20	144.0						

LIGHTING	G DATA					
			Clearvoyant 4 LED Lighting (Per Light Row)			
	Lights		Standard (Cornice			Power nice)
Case	Per	Light	120	Volts	120	Volts
Length	Row	Length	Amps	Watts	Amps	Watts
4'	1	4'	0.05	5.9	0.12	14.9
6'	2	3'	0.08	9.4	0.20	23.8
8'	2	4'	0.10	11.8	0.24	29.8
10'	2	5'	0.12	15.0	0.30	37.0
12'	3	4'	0.15	17.7	0.36	44.7

GUIDELINES AND CONTROL SETTINGS (DX) {DIRECT EXPANSION HFC/CO2}						
BTUH	/ft	Superheat			Discharge Air	
		Set Point @ Bulb	Evaporator	Discharge Air	Velocity	
Conventional	Parallel	(°F)	(°F)	(°F)	(FPM)	
1004	924	6 - 8	24	29	200	

DEFROST CONTROLS {DIRECT EXPANSION HFC/CO2}							
		Electric Defrost		Timed-	Off Defrost	Hot Ga	as Defrost
	Run-Off		Termination		Termination		Termination
Defrosts	Time	Fail-Safe	Temp	Fail-Safe	Temp	Fail-Safe	Temp
Per Day	(Min)	(Min)	(°F)	(Min)	(°F)	(Min)	(°F)
4				65/*36	42		

## NOTES:

- "---" Indicates that the feature is not an option on this case model and/or the data is not yet available at this time.
- · Listed BTUH indicates unlighted shelves. Add the following for lighted shelves:

4' Shelf LED: 36 BTUH 4' Canopy LED: 72 BTUH 3' Shelf LED: 27 BTUH 3' Hi-Output LED: 54 BTUH

- Listed discharge air velocity represents the average velocity at the peak of defrost.
- · Discharge air temperature values represent readings taken within the upper air channel immediately behind/upstream of the honeycomb.
- \* Time-off duration for defrost with no termination control.









ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

PF-54-R

Rev. Date	Rev.#	Rev. Title
03-10-22	3	DATA UPDATE
10-07-20	2	ENDVIEW UPDATE



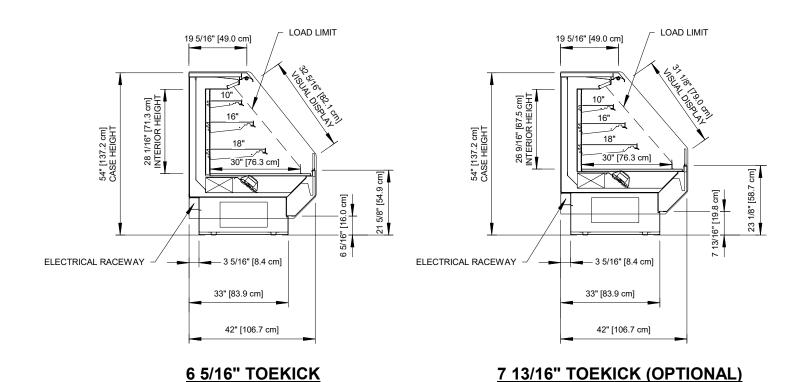

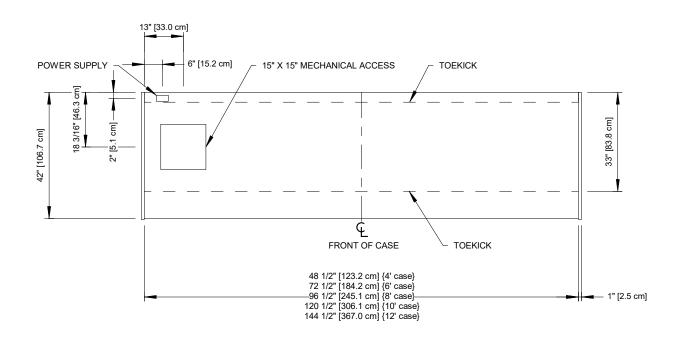








ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

PF-54-R

Rev. Date	Rev.#	Rev. Title
03-10-22	3	DATA UPDATE
10-07-20	2	ENDVIEW UPDATE




Clearvayant

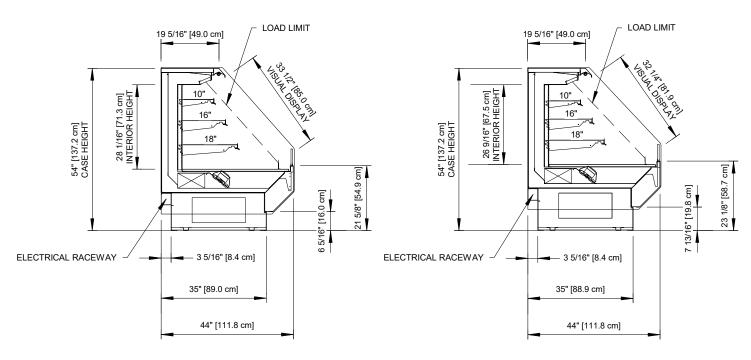

## **6 5/16" TOEKICK**

7 13/16" TOEKICK (OPTIONAL)

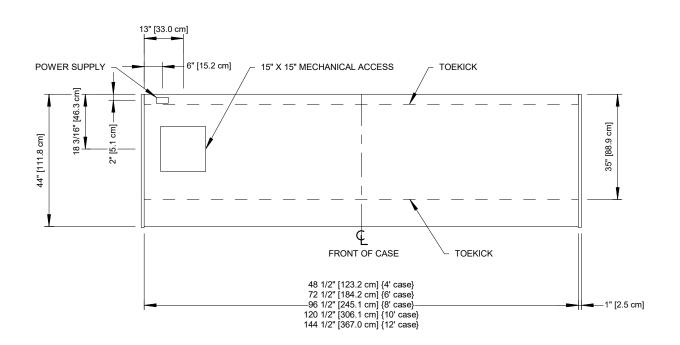







Intertek

ENGINEERED FOR STORES WITH AMBIENT CONDITIONS NOT TO EXCEED 75° AND 55% RELATIVE HUMIDITY. DUE TO ENGINEERING IMPROVEMENTS SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. ALL MEASUREMENTS ARE TAKEN PER ASHRAE-72 SPECIFICATIONS. HILLPHOENIX REFRIGERATED DISPLAY CASES FOR SALE IN THE UNITED STATES MEET OR EXCEED DEPARTMENT OF ENERGY 2017 REQUIREMENTS. NUMBERS ARE BASED ON STANDARD CASE SIZES. CONSULT ENGINEERING.

PF-54-R

Rev. Date	Rev.#	Rev. Title
03-10-22	3	DATA UPDATE
10-07-20	2	ENDVIEW UPDATE

